

**ASME B31.1-2012**  
(Revision of ASME B31.1-2010)

# Power Piping

---

**ASME Code for Pressure Piping, B31**

ASMENORMDOC.COM : Click to view the full PDF of ASME B31.1 2012

**AN AMERICAN NATIONAL STANDARD**



**The American Society of  
Mechanical Engineers**

Three Park Avenue • New York, NY • 10016 USA

Date of Issuance: June 29, 2012

The next edition of this Code is scheduled for publication in 2014. This Code will become effective 6 months after the Date of Issuance.

ASME issues written replies to inquiries concerning interpretations of technical aspects of this Code. Interpretations, Code Cases, and errata are published on the ASME Web site under the Committee Pages at <http://cstools.asme.org/> as they are issued. Interpretations and Code Cases are also included with each edition.

Errata to codes and standards may be posted on the ASME Web site under the Committee Pages to provide corrections to incorrectly published items, or to correct typographical or grammatical errors in codes and standards. Such errata shall be used on the date posted.

The Committee Pages can be found at <http://cstools.asme.org/>. There is an option available to automatically receive an e-mail notification when errata are posted to a particular code or standard. This option can be found on the appropriate Committee Page after selecting "Errata" in the "Publication Information" section.

ASME is the registered trademark of The American Society of Mechanical Engineers.

This code or standard was developed under procedures accredited as meeting the criteria for American National Standards. The Standards Committee that approved the code or standard was balanced to assure that individuals from competent and concerned interests have had an opportunity to participate. The proposed code or standard was made available for public review and comment that provides an opportunity for additional public input from industry, academia, regulatory agencies, and the public-at-large.

ASME does not "approve," "rate," or "endorse" any item, construction, proprietary device, or activity.

ASME does not take any position with respect to the validity of any patent rights asserted in connection with any items mentioned in this document, and does not undertake to insure anyone utilizing a standard against liability for infringement of any applicable letters patent, nor assume any such liability. Users of a code or standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.

Participation by federal agency representative(s) or person(s) affiliated with industry is not to be interpreted as government or industry endorsement of this code or standard.

ASME accepts responsibility for only those interpretations of this document issued in accordance with the established ASME procedures and policies, which precludes the issuance of interpretations by individuals.

No part of this document may be reproduced in any form,  
in an electronic retrieval system or otherwise,  
without the prior written permission of the publisher.

The American Society of Mechanical Engineers  
Three Park Avenue, New York, NY 10016-5990

Copyright © 2012 by  
THE AMERICAN SOCIETY OF MECHANICAL ENGINEERS  
All rights reserved  
Printed in U.S.A.

# CONTENTS

|                          |                                                                                               |
|--------------------------|-----------------------------------------------------------------------------------------------|
| Foreword .....           | vii                                                                                           |
| Committee Roster .....   | viii                                                                                          |
| Introduction .....       | xii                                                                                           |
| Summary of Changes ..... | xiv                                                                                           |
| <b>Chapter I</b>         | <b>Scope and Definitions</b> .....                                                            |
| 100                      | General .....                                                                                 |
| <b>Chapter II</b>        | <b>Design</b> .....                                                                           |
| <b>Part 1</b>            | <b>Conditions and Criteria</b> .....                                                          |
| 101                      | Design Conditions .....                                                                       |
| 102                      | Design Criteria .....                                                                         |
| <b>Part 2</b>            | <b>Pressure Design of Piping Components</b> .....                                             |
| 103                      | Criteria for Pressure Design of Piping Components .....                                       |
| 104                      | Pressure Design of Components .....                                                           |
| <b>Part 3</b>            | <b>Selection and Limitations of Piping Components</b> .....                                   |
| 105                      | Pipe .....                                                                                    |
| 106                      | Fittings, Bends, and Intersections .....                                                      |
| 107                      | Valves .....                                                                                  |
| 108                      | Pipe Flanges, Blanks, Flange Facings, Gaskets, and Bolting .....                              |
| <b>Part 4</b>            | <b>Selection and Limitations of Piping Joints</b> .....                                       |
| 110                      | Piping Joints .....                                                                           |
| 111                      | Welded Joints .....                                                                           |
| 112                      | Flanged Joints .....                                                                          |
| 113                      | Expanded or Rolled Joints .....                                                               |
| 114                      | Threaded Joints .....                                                                         |
| 115                      | Flared, Flareless, and Compression Joints, and Unions .....                                   |
| 116                      | Bell End Joints .....                                                                         |
| 117                      | Brazed and Soldered Joints .....                                                              |
| 118                      | Sleeve Coupled and Other Proprietary Joints .....                                             |
| <b>Part 5</b>            | <b>Expansion, Flexibility, and Pipe Supporting Element</b> .....                              |
| 119                      | Expansion and Flexibility .....                                                               |
| 120                      | Loads on Pipe Supporting Elements .....                                                       |
| 121                      | Design of Pipe Supporting Elements .....                                                      |
| <b>Part 6</b>            | <b>Systems</b> .....                                                                          |
| 122                      | Design Requirements Pertaining to Specific Piping Systems .....                               |
| <b>Chapter III</b>       | <b>Materials</b> .....                                                                        |
| 123                      | General Requirements .....                                                                    |
| 124                      | Limitations on Materials .....                                                                |
| 125                      | Materials Applied to Miscellaneous Parts .....                                                |
| <b>Chapter IV</b>        | <b>Dimensional Requirements</b> .....                                                         |
| 126                      | Material Specifications and Standards for Standard and Nonstandard<br>Piping Components ..... |
| <b>Chapter V</b>         | <b>Fabrication, Assembly, and Erection</b> .....                                              |
| 127                      | Welding .....                                                                                 |
| 128                      | Brazing and Soldering .....                                                                   |
| 129                      | Bending and Forming .....                                                                     |
| 130                      | Requirements for Fabricating and Attaching Pipe Supports .....                                |
| 131                      | Welding Preheat .....                                                                         |

|                    |                                                                                                                                                        |            |
|--------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------|------------|
| 132                | Postweld Heat Treatment .....                                                                                                                          | 94         |
| 133                | Stamping .....                                                                                                                                         | 101        |
| 135                | Assembly .....                                                                                                                                         | 101        |
| <b>Chapter VI</b>  | <b>Inspection, Examination, and Testing .....</b>                                                                                                      | <b>103</b> |
| 136                | Inspection and Examination .....                                                                                                                       | 103        |
| 137                | Pressure Tests .....                                                                                                                                   | 107        |
| <b>Chapter VII</b> | <b>Operation and Maintenance .....</b>                                                                                                                 | <b>110</b> |
| 138                | General .....                                                                                                                                          | 110        |
| 139                | Operation and Maintenance Procedures .....                                                                                                             | 110        |
| 140                | Condition Assessment of CPS .....                                                                                                                      | 110        |
| 141                | CPS Records .....                                                                                                                                      | 111        |
| 144                | CPS Walkdowns .....                                                                                                                                    | 111        |
| 145                | Material Degradation Mechanisms .....                                                                                                                  | 111        |
| <b>Figures</b>     |                                                                                                                                                        |            |
| 100.1.2(A.1)       | Code Jurisdictional Limits for Piping — An Example of Forced Flow<br>Steam Generators With No Fixed Steam and Water Line .....                         | 2          |
| 100.1.2(A.2)       | Code Jurisdictional Limits for Piping — An Example of Steam Separator<br>Type Forced Flow Steam Generators With No Fixed Steam and Water<br>Line ..... | 3          |
| 100.1.2(B)         | Code Jurisdictional Limits for Piping — Drum-Type Boilers .....                                                                                        | 4          |
| 100.1.2(C)         | Code Jurisdictional Limits for Piping — Spray-Type Desuperheater .....                                                                                 | 5          |
| 102.4.5            | Nomenclature for Pipe Bends .....                                                                                                                      | 17         |
| 104.3.1(D)         | Reinforcement of Branch Connections .....                                                                                                              | 24         |
| 104.3.1(G)         | Reinforced Extruded Outlets .....                                                                                                                      | 28         |
| 104.5.3            | Types of Permanent Blanks .....                                                                                                                        | 31         |
| 104.8.4            | Cross Section Resultant Moment Loading .....                                                                                                           | 33         |
| 122.1.7(C)         | Typical Globe Valves .....                                                                                                                             | 55         |
| 122.4              | Desuperheater Schematic Arrangement .....                                                                                                              | 59         |
| 127.3              | Butt Welding of Piping Components With Internal Misalignment .....                                                                                     | 79         |
| 127.4.2            | Welding End Transition — Maximum Envelope .....                                                                                                        | 80         |
| 127.4.4(A)         | Fillet Weld Size .....                                                                                                                                 | 83         |
| 127.4.4(B)         | Welding Details for Slip-On and Socket-Welding Flanges; Some<br>Acceptable Types of Flange Attachment Welds .....                                      | 84         |
| 127.4.4(C)         | Minimum Welding Dimensions Required for Socket Welding<br>Components Other Than Flanges .....                                                          | 84         |
| 127.4.8(A)         | Typical Welded Branch Connection Without Additional<br>Reinforcement .....                                                                             | 84         |
| 127.4.8(B)         | Typical Welded Branch Connection With Additional Reinforcement .....                                                                                   | 84         |
| 127.4.8(C)         | Typical Welded Angular Branch Connection Without Additional<br>Reinforcement .....                                                                     | 84         |
| 127.4.8(D)         | Some Acceptable Types of Welded Branch Attachment Details<br>Showing Minimum Acceptable Welds .....                                                    | 85         |
| 127.4.8(E)         | Some Acceptable Details for Integrally Reinforced Outlet Fittings .....                                                                                | 86         |
| 127.4.8(F)         | Typical Full Penetration Weld Branch Connections for NPS 3 and<br>Smaller Half Couplings or Adapters .....                                             | 87         |
| 127.4.8(G)         | Typical Partial Penetration Weld Branch Connection for NPS 2 and<br>Smaller Fittings .....                                                             | 88         |
| 135.5.3            | Typical Threaded Joints Using Straight Threads .....                                                                                                   | 102        |
| <b>Tables</b>      |                                                                                                                                                        |            |
| 102.4.3            | Longitudinal Weld Joint Efficiency Factors .....                                                                                                       | 16         |
| 102.4.5            | Bend Thinning Allowance .....                                                                                                                          | 17         |
| 102.4.6(B.1.1)     | Maximum Severity Level for Casting Thickness $4\frac{1}{2}$ in. (114 mm) or<br>Less .....                                                              | 18         |
| 102.4.6(B.2.2)     | Maximum Severity Level for Casting Thickness Greater Than $4\frac{1}{2}$ in.<br>(114 mm) .....                                                         | 18         |

|                                |                                                                                                                                                                                            |     |
|--------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----|
| 102.4.7                        | Weld Strength Reduction Factors to Be Applied When Calculating the Minimum Wall Thickness or Allowable Design Pressure of Components Fabricated With a Longitudinal Seam Fusion Weld ..... | 20  |
| 104.1.2(A)                     | Values of $y$ .....                                                                                                                                                                        | 22  |
| 112                            | Piping Flange Bolting, Facing, and Gasket Requirements .....                                                                                                                               | 39  |
| 114.2.1                        | Threaded Joints Limitations .....                                                                                                                                                          | 43  |
| 121.5                          | Suggested Pipe Support Spacing .....                                                                                                                                                       | 48  |
| 121.7.2(A)                     | Carrying Capacity of Threaded ASTM A36, A575, and A576 Hot-Rolled Carbon Steel .....                                                                                                       | 50  |
| 122.2                          | Design Pressure for Blowoff/Blowdown Piping Downstream of BEP Valves .....                                                                                                                 | 56  |
| 122.8.2(B)                     | Minimum Wall Thickness Requirements for Toxic Fluid Piping .....                                                                                                                           | 63  |
| 126.1                          | Specifications and Standards .....                                                                                                                                                         | 71  |
| 127.4.2                        | Reinforcement of Girth and Longitudinal Butt Welds .....                                                                                                                                   | 82  |
| 129.3.1                        | Approximate Lower Critical Temperatures .....                                                                                                                                              | 91  |
| 129.3.4.1                      | Post Cold-Forming Strain Limits and Heat-Treatment Requirements .....                                                                                                                      | 92  |
| 132                            | Postweld Heat Treatment .....                                                                                                                                                              | 95  |
| 132.1                          | Alternate Postweld Heat Treatment Requirements for Carbon and Low Alloy Steels .....                                                                                                       | 100 |
| 136.4                          | Mandatory Minimum Nondestructive Examinations for Pressure Welds or Welds to Pressure-Retaining Components .....                                                                           | 105 |
| 136.4.1                        | Weld Imperfections Indicated by Various Types of Examination .....                                                                                                                         | 106 |
| <b>Mandatory Appendices</b>    |                                                                                                                                                                                            |     |
| A                              | Allowable Stress Tables .....                                                                                                                                                              | 113 |
|                                | Table A-1, Carbon Steel .....                                                                                                                                                              | 114 |
|                                | Table A-2, Low and Intermediate Alloy Steel .....                                                                                                                                          | 126 |
|                                | Table A-3, Stainless Steels .....                                                                                                                                                          | 136 |
|                                | Table A-4, Nickel and High Nickel Alloys .....                                                                                                                                             | 166 |
|                                | Table A-5, Cast Iron .....                                                                                                                                                                 | 180 |
|                                | Table A-6, Copper and Copper Alloys .....                                                                                                                                                  | 182 |
|                                | Table A-7, Aluminum and Aluminum Alloys .....                                                                                                                                              | 186 |
|                                | Table A-8, Temperatures 1,200°F and Above .....                                                                                                                                            | 194 |
|                                | Table A-9, Titanium and Titanium Alloys .....                                                                                                                                              | 200 |
|                                | Table A-10, Bolts, Nuts, and Studs .....                                                                                                                                                   | 204 |
| B                              | Thermal Expansion Data .....                                                                                                                                                               | 209 |
|                                | Table B-1, Thermal Expansion Data .....                                                                                                                                                    | 210 |
|                                | Table B-1 (SI), Thermal Expansion Data .....                                                                                                                                               | 214 |
| C                              | Moduli of Elasticity .....                                                                                                                                                                 | 218 |
|                                | Table C-1, Moduli of Elasticity for Ferrous Material .....                                                                                                                                 | 218 |
|                                | Table C-1 (SI), Moduli of Elasticity for Ferrous Material .....                                                                                                                            | 219 |
|                                | Table C-2, Moduli of Elasticity for Nonferrous Material .....                                                                                                                              | 220 |
|                                | Table C-2 (SI), Moduli of Elasticity for Nonferrous Material .....                                                                                                                         | 222 |
| D                              | Flexibility and Stress Intensification Factors .....                                                                                                                                       | 224 |
|                                | Table D-1, Flexibility and Stress Intensification Factors .....                                                                                                                            | 224 |
|                                | Chart D-1, Flexibility Factor, $k$ , and Stress Intensification Factor, $i$ .....                                                                                                          | 228 |
|                                | Chart D-2, Correction Factor, $c$ .....                                                                                                                                                    | 229 |
|                                | Fig. D-1, Branch Connection Dimensions .....                                                                                                                                               | 230 |
| F                              | Referenced Standards .....                                                                                                                                                                 | 231 |
| G                              | Nomenclature .....                                                                                                                                                                         | 235 |
| H                              | Preparation of Technical Inquiries .....                                                                                                                                                   | 242 |
| J                              | Quality Control Requirements for Boiler External Piping (BEP) .....                                                                                                                        | 243 |
| <b>Nonmandatory Appendices</b> |                                                                                                                                                                                            |     |
| II                             | Rules for the Design of Safety Valve Installations .....                                                                                                                                   | 245 |
| III                            | Rules for Nonmetallic Piping and Piping Lined With Nonmetals .....                                                                                                                         | 265 |
| IV                             | Corrosion Control for ASME B31.1 Power Piping Systems .....                                                                                                                                | 286 |

|                    |                                                                                                    |     |
|--------------------|----------------------------------------------------------------------------------------------------|-----|
| V                  | Recommended Practice for Operation, Maintenance, and<br>Modification of Power Piping Systems ..... | 290 |
| VI                 | Approval of New Materials .....                                                                    | 303 |
| VII                | Procedures for the Design of Restrained Underground Piping .....                                   | 304 |
| <b>Index</b> ..... |                                                                                                    | 315 |

ASMENORMDOC.COM : Click to view the full PDF of ASME B31.1 2012

# FOREWORD

The general philosophy underlying this Power Piping Code is to parallel those provisions of Section I, Power Boilers, of the ASME Boiler and Pressure Vessel Code, as they can be applied to power piping systems. The Allowable Stress Values for power piping are generally consistent with those assigned for power boilers. This Code is more conservative than some other piping codes, reflecting the need for long service life and maximum reliability in power plant installations.

The Power Piping Code as currently written does not differentiate among the design, fabrication, and erection requirements for critical and noncritical piping systems, except for certain stress calculations and mandatory nondestructive tests of welds for heavy wall, high temperature applications. The problem involved is to try to reach agreement on how to evaluate criticality, and to avoid the inference that noncritical systems do not require competence in design, fabrication, and erection. Someday such levels of quality may be definable, so that the need for the many different piping codes will be overcome.

There are many instances where the Code serves to warn a designer, fabricator, or erector against possible pitfalls; but the Code is not a handbook, and cannot substitute for education, experience, and sound engineering judgment.

Nonmandatory Appendices are included in the Code. Each contains information on a specific subject, and is maintained current with the Code. Although written in mandatory language, these Appendices are offered for application at the user's discretion.

The Code never intentionally puts a ceiling limit on conservatism. A designer is free to specify more rigid requirements as he feels they may be justified. Conversely, a designer who is capable of a more rigorous analysis than is specified in the Code may justify a less conservative design, and still satisfy the basic intent of the Code.

The Power Piping Committee strives to keep abreast of the current technological improvements in new materials, fabrication practices, and testing techniques; and endeavors to keep the Code updated to permit the use of acceptable new developments.

# ASME B31 COMMITTEE

## Code for Pressure Piping

(The following is the roster of the Committee at the time of approval of this Code.)

### STANDARDS COMMITTEE OFFICERS

**M. L. Nayyar**, *Chair*  
**J. E. Meyer**, *Vice Chair*  
**N. Lobo**, *Secretary*

### STANDARDS COMMITTEE PERSONNEL

**R. J. T. Appleby**, ExxonMobil Development Co.  
**C. Becht IV**, Becht Engineering Co.  
**A. E. Beyer**, Fluor Enterprises  
**K. C. Bodenhamer**, Enterprise Products Co.  
**C. J. Campbell**, Air Liquide  
**J. S. Chin**, TransCanada Pipeline U.S.  
**D. D. Christian**, Victaulic  
**D. L. Coym**, Intertek Moody  
**C. J. Melo**, *Alternate*, S & B Engineers and Constructors, Ltd.  
**R. P. Deubler**, Fronex Power Systems, LLC  
**P. D. Flenner**, Flenner Engineering Services  
**J. W. Frey**, Stress Engineering Services, Inc.  
**D. R. Frikken**, Becht Engineering Co.  
**R. A. Grichuk**, Fluor Enterprises, Inc.  
**R. W. Haupt**, Pressure Piping Engineering Associates, Inc.  
**B. P. Holbrook**, Babcock Power, Inc.  
**G. A. Jolly**, Vogt Valves/Flowserve Corp.  
**N. Lobo**, The American Society of Mechanical Engineers  
**W. J. Mauro**, American Electric Power  
**J. E. Meyer**, Louis Perry & Associates, Inc.  
**M. L. Nayyar**  
**R. G. Payne**, Alstom Power, Inc.  
**G. R. Petru**, Engineering Products Co., Inc.  
**E. H. Rinaca**, Dominion Resources, Inc.  
**M. J. Rosenfeld**, Kiefner & Associates, Inc.  
**R. J. Silvia**, Process Engineers and Constructors, Inc.  
**W. J. Sperko**, Sperko Engineering Services, Inc.  
**F. W. Tatar**, FM Global  
**K. A. Vilminot**, Black & Veatch  
**A. Soni**, *Delegate*, Engineers India Ltd.  
**L. E. Hayden, Jr.**, *Ex-Officio*, Consultant  
**W. J. Koves**, *Ex-Officio*, Pi Engineering Software, Inc.  
**A. P. Rangus**, *Ex-Officio*, Bechtel  
**J. T. Schmitz**, *Ex-Officio*, Southwest Gas Corp.  
**R. A. Appleton**, *Contributing Member*, Refrigeration Systems Co.

### B31.1 POWER PIPING SECTION COMMITTEE

**J. W. Frey**, *Chair*, Stress Engineering Services, Inc.  
**W. J. Mauro**, *Vice Chair*, American Electric Power  
**C. E. O'Brien**, *Secretary*, The American Society of Mechanical Engineers  
**D. D. Christian**, Victaulic  
**M. J. Cohn**, Intertek-Aptech  
**D. H. Creates**, Ontario Power Generation, Inc.  
**S. D. Cross**, Zachry Engineering  
**G. J. Delude**, Penpower  
**R. P. Deubler**, Fronex Power Systems, LLC  
**A. S. Drake**, Constellation Energy Group  
**S. J. Findlan**, Shaw Power Group  
**P. D. Flenner**, Flenner Engineering Services  
**E. C. Goodling, Jr.**, WorleyParsons  
**J. W. Goodwin**, Southern Co.  
**T. E. Hansen**, American Electric Power  
**R. W. Haupt**, Pressure Piping Engineering Associates, Inc.  
**C. L. Henley**, Black & Veatch  
**B. P. Holbrook**, Babcock Power, Inc.  
**M. W. Johnson**, GenOn Energy, Inc.  
**R. J. Kennedy**, Detroit Edison Co.  
**D. J. Leininger**, WorleyParsons  
**S. P. Licud**, Consultant  
**W. M. Lundy**, U.S. Coast Guard  
**M. L. Nayyar**  
**R. G. Payne**, Alstom Power, Inc.  
**D. W. Raho**, CCM 2000  
**K. I. Rapkin**, FPL  
**R. K. Reamey**, Turner Industries Group, LLC  
**E. H. Rinaca**, Dominion Resources, Inc.  
**R. D. Schueler, Jr.**, The National Board of Boiler and Pressure Vessel Inspectors  
**J. P. Scott**, Dominion  
**J. J. Sekely**, Welding Services, Inc.  
**H. R. Simpson**, Stantec  
**S. K. Sinha**, Lucius Pitkin, Inc.  
**K. A. Vilminot**, Black & Veatch  
**A. L. Watkins**, First Energy Corp.  
**H. A. Ainsworth**, *Contributing Member*, Consultant

### B31.1 SUBGROUP ON DESIGN

**K. A. Vilminot**, *Chair*, Black & Veatch  
**A. L. Watkins**, *Secretary*, First Energy Corp.  
**D. H. Creates**, Ontario Power Generation, Inc.  
**S. D. Cross**, Zachry Engineering  
**M. K. Engelkemier**, Stanley Consultants, Inc.  
**J. W. Goodwin**, Southern Co.  
**R. W. Haupt**, Pressure Piping Engineering Associates, Inc.  
**B. P. Holbrook**, Babcock Power, Inc.  
**M. W. Johnson**, GenOn Energy, Inc.

**R. J. Kennedy**, Detroit Edison Co.  
**W. M. Lundy**, U.S. Coast Guard  
**R. G. Payne**, Alstom Power, Inc.  
**D. D. Pierce**, Puget Sound Naval Shipyard  
**K. I. Rapkin**, FPL  
**P. E. Sandage**, Sega, Inc.  
**T. Sato**, Japan Power Engineering and Inspection Corp.  
**D. B. Selman**, Ambitech Engineering Corp.  
**R. B. Wilson**, TWD Technologies Ltd.  
**A. D. Nance**, *Contributing Member*, Consultant

### B31.1 SUBGROUP ON FABRICATION AND EXAMINATION

**R. K. Reamey**, *Chair*, Turner Industries Group, LLC  
**R. B. Corbit**, Exelon Nuclear  
**R. D. Couch**, Electric Power Research Institute  
**P. M. Davis**, Foster Wheeler North America Corp.  
**C. Emslander**  
**S. J. Findlan**, Shaw Power Group  
**P. D. Flenner**, Flenner Engineering Services  
**J. W. Frey**, Stress Engineering Services, Inc.  
**S. E. Gingrich**, URS Corp.

**J. Hainsworth**, WR Metallurgical  
**T. E. Hansen**, American Electric Power  
**K. G. Kofford**, Idaho National Laboratory  
**S. L. Leach**, Babcock & Wilcox Construction Co., Inc.  
**D. J. Leininger**, WorleyParsons  
**S. P. Licud**, Consultant  
**T. Monday**, Team Industries, Inc.  
**J. J. Sekely**, Welding Services, Inc.  
**E. F. Gerwin**, *Honorary Member*

### B31.1 SUBGROUP ON GENERAL REQUIREMENTS

**W. J. Mauro**, *Chair*, American Electric Power  
**H. A. Ainsworth**, Consultant  
**R. D. Austin**, Arizona Division of Safety and Health  
**D. D. Christian**, Victaulic  
**G. J. Delude**, Penpower

**J. W. Power**, Alstom Power, Inc.  
**R. D. Schueler, Jr.**, The National Board of Boiler and Pressure Vessel Inspectors  
**M. A. Treat**, Associated Electric Cooperative, Inc.

### B31.1 SUBGROUP ON MATERIALS

**D. W. Rahoi**, *Chair*, CCM 2000  
**M. G. Barkan**, Lisega, Inc.  
**R. P. Deubler**, Fronex Power Systems, LLC  
**A. S. Drake**, Constellation Energy Group  
**C. L. Henley**, Black & Veatch

**S. L. McCracken**, Electric Power Research Institute  
**L. C. McDonald**, Structural Integrity Associates, Inc.  
**M. L. Nayyar**  
**W. M. Sherman**, Swagelok Co.  
**N. S. Tambat**, Bechtel

### B31.1 SUBGROUP ON OPERATION AND MAINTENANCE

**R. J. Kennedy**, *Chair*, Detroit Edison Co.  
**M. K. Engelkemier**, *Secretary*, Stanley Consultants, Inc.  
**M. J. Cohn**, Intertek-Aptech  
**D. H. Creates**, Ontario Power Generation, Inc.  
**S. D. Cross**, Zachry Engineering  
**P. M. Davis**, Foster Wheeler North America Corp.  
**P. D. Flenner**, Flenner Engineering Services  
**J. W. Frey**, Stress Engineering Services, Inc.  
**E. C. Goodling, Jr.**, WorleyParsons  
**J. W. Goodwin**, Southern Co.  
**T. E. Hansen**, American Electric Power

**R. W. Haupt**, Pressure Piping Engineering Associates, Inc.  
**B. P. Holbrook**, Babcock Power, Inc.  
**M. W. Johnson**, GenOn Energy, Inc.  
**W. J. Mauro**, American Electric Power  
**L. C. McDonald**, Structural Integrity Associates, Inc.  
**M. L. Nayyar**  
**R. G. Payne**, Alstom Power, Inc.  
**K. I. Rapkin**, FPL  
**R. K. Reamey**, Turner Industries Group, LLC  
**E. H. Rinaca**, Dominion Resources, Inc.  
**J. P. Scott**, Dominion  
**A. L. Watkins**, First Energy Corp.

### B31.1 SUBGROUP ON SPECIAL ASSIGNMENTS

**S. K. Sinha**, *Chair*, Lucius Pitkin, Inc.  
**J. P. Scott**, *Secretary*, Dominion  
**M. J. Cohn**, Intertek-Aptech  
**E. C. Goodling, Jr.**, WorleyParsons

**E. H. Rinaca**, Dominion Resources, Inc.  
**H. R. Simpson**, Stantec  
**L. G. Vetter**, Sargent & Lundy Engineers  
**D. A. Yoder**, WorleyParsons

### B31 EXECUTIVE COMMITTEE

**J. E. Meyer**, *Chair*, Louis Perry & Associates, Inc.  
**N. Lobo**, *Secretary*, The American Society of Mechanical Engineers  
**R. J. T. Appleby**, ExxonMobil Development Co.  
**D. D. Christian**, Victaulic  
**J. W. Frey**, Stress Engineering Services, Inc.  
**D. R. Frikken**, Becht Engineering Co.  
**R. A. Grichuk**, Fluor Enterprises, Inc.  
**L. E. Hayden, Jr.**, Consultant

**G. A. Jolly**, Vogt Valves/Flowserve Corp.  
**W. J. Koves**, Pi Engineering Software, Inc.  
**M. L. Nayyar**  
**G. R. Petru**, Engineering Products Co., Inc.  
**A. P. Rangus**, Bechtel  
**J. T. Schmitz**, Southwest Gas Co.  
**R. A. Appleton**, *Contributing Member*, Refrigeration Systems Co.

### B31 CONFERENCE GROUP

**A. Bell**, Bonneville Power Administration  
**R. A. Coomes**, Commonwealth of Kentucky, Department of Housing/Boiler Section  
**D. H. Hanrath**  
**C. J. Harvey**, Alabama Public Service Commission  
**D. T. Jagger**, Ohio Department of Commerce  
**M. Kotb**, Regie du Batiment du Quebec  
**K. T. Lau**, Alberta Boilers Safety Association  
**G. Marini**, New Hampshire Public Utilities Commission  
**I. W. Mault**, Manitoba Department of Labour  
**A. W. Meiring**, Fire and Building Safety Division/Indiana

**R. F. Mullaney**, Boiler and Pressure Vessel Safety Branch/Vancouver  
**P. Sher**, State of Connecticut  
**M. E. Skarda**, Arkansas Department of Labor  
**D. A. Starr**, Nebraska Department of Labor  
**D. J. Stursma**, Iowa Utilities Board  
**R. P. Sullivan**, The National Board of Boiler and Pressure Vessel Inspectors  
**J. E. Troppman**, Division of Labor/State of Colorado Boiler Inspections  
**W. A. M. West**, Lighthouse Assistance, Inc.  
**T. F. Wickham**, Rhode Island Department of Labor

### B31 FABRICATION AND EXAMINATION COMMITTEE

**A. P. Rangus**, *Chair*, Bechtel  
**N. Lobo**, *Secretary*, The American Society of Mechanical Engineers  
**J. P. Ellenberger**  
**R. J. Ferguson**, Metallurgist  
**D. J. Fetzner**, BP Exploration Alaska, Inc.  
**P. D. Flenner**, Flenner Engineering Services  
**W. W. Frey**, Stress Engineering Services, Inc.  
**W. W. Lewis**, E. I. DuPont

**S. P. Licud**, Consultant  
**T. Monday**, Team Industries, Inc.  
**A. D. Nalbandian**, Thielsch Engineering, Inc.  
**R. I. Seals**, Consultant  
**R. J. Silvia**, Process Engineers & Constructors, Inc.  
**W. J. Sperko**, Sperko Engineering Services, Inc.  
**E. F. Summers, Jr.**, Babcock & Wilcox Construction Co.  
**J. P. Swezy, Jr.**, UT-Battelle  
**P. L. Vaughan**, ONEOK Partners

### B31 MATERIALS TECHNICAL COMMITTEE

**R. A. Grichuk**, *Chair*, Fluor Enterprises, Inc.  
**N. Lobo**, *Secretary*, The American Society of Mechanical Engineers  
**R. P. Deubler**, Fronex Power Systems, LLC  
**W. H. Eskridge, Jr.**, Jacobs Engineering  
**G. A. Jolly**, Vogt Valves/Flowserve Corp.  
**C. J. Melo**, S & B Engineers and Constructors, Ltd.  
**M. L. Nayyar**

**M. B. Pickell**, Willbros Engineers, Inc.  
**D. W. Raho**, CCM 2000  
**R. A. Schmidt**, Canadoil  
**H. R. Simpson**, Stantec  
**J. L. Smith**, Jacobs Engineering Group  
**Z. Djilali**, *Contributing Member*, BERE

### B31.1 INTERNATIONAL WORKING GROUP — INDIA

**A. Kumar**, *Chair*, Bechtel India Pvt. Ltd.  
**G. Ravichandran**, *Vice Chair*, Bharat Heavy Electricals Ltd.  
**P. P. Buddhadeo**, Bechtel India Pvt. Ltd.  
**D. D. Christian**, Victaulic  
**R. Goel**, Bechtel India Pvt. Ltd.  
**R. Muruganatham**, Larsen & Toubro Ltd.

**V. Pahujani**, Bechtel India Pvt. Ltd.  
**P. Sanyal**, Bechtel India Pvt. Ltd.  
**R. P. Singh**, CB&I Lummus Private Ltd.  
**K. Srinivasan**, Bharat Heavy Electricals Ltd.  
**R. Tiwari**, CoDesign Engineering Pvt. Ltd.

## B31 MECHANICAL DESIGN TECHNICAL COMMITTEE

**W. J. Koves**, *Chair*, Pi Engineering Software, Inc.  
**G. A. Antaki**, *Vice Chair*, Becht Engineering Co., Inc.  
**C. E. O'Brien**, *Secretary*, The American Society of Mechanical Engineers  
**D. Arnett**, Fluor Enterprises, Inc.  
**C. Becht IV**, Becht Engineering Co.  
**R. Bethea**, Newport News Shipbuilding  
**J. P. Breen**, Becht Engineering Co.  
**P. Cakir-Kavcar**, Bechtel Corp.  
**N. F. Consumo, Sr.**  
**J. P. Ellenberger**  
**D. J. Fetzner**, BP Exploration Alaska, Inc.  
**J. A. Graziano**, Consultant  
**R. W. Haupt**, Pressure Piping Engineering Associates, Inc.

**B. P. Holbrook**, Babcock Power, Inc.  
**R. A. Leishear**, Savannah River National Laboratory  
**G. D. Mayers**, Alion Science & Technology  
**J. F. McCabe**, General Dynamics Electric Boat  
**T. Q. McCawley**, TQM Engineering  
**R. J. Medvick**, Consultant  
**J. C. Minichiello**, Bechtel National, Inc.  
**A. W. Paulin**, Paulin Research Group  
**R. A. Robleto**, KBR  
**M. J. Rosenfeld**, Kiefner & Associates, Inc.  
**T. Sato**, Japan Power Engineering and Inspection Corp.  
**G. Stevick**, Berkeley Engineering and Research, Inc.  
**H. Kosasayama**, *Delegate*, JGC Corp.  
**E. C. Rodabaugh**, *Honorary Member*, Consultant

ASME NORMDOC.COM : Click to view the full PDF of ASME B31.1-2012

# INTRODUCTION

The ASME B31 Code for Pressure Piping consists of a number of individually published Sections, each an American National Standard, under the direction of ASME Committee B31, Code for Pressure Piping.

Rules for each Section have been developed considering the need for application of specific requirements for various types of pressure piping. Applications considered for each Code Section include

- B31.1 Power Piping: piping typically found in electric power generating stations, in industrial and institutional plants, geothermal heating systems, and central and district heating and cooling systems
- B31.3 Process Piping: piping typically found in petroleum refineries; chemical, pharmaceutical, textile, paper, semiconductor, and cryogenic plants; and related processing plants and terminals
- B31.4 Pipeline Transportation Systems for Liquid Hydrocarbons and Other Liquids: piping transporting products that are predominately liquid between plants and terminals and within terminals, pumping, regulating, and metering stations
- B31.5 Refrigeration Piping: piping for refrigerants and secondary coolants
- B31.8 Gas Transportation and Distribution Piping Systems: piping transporting products that are predominately gas between sources and terminals, including compressor, regulating, and metering stations, and gas gathering pipelines
- B31.9 Building Services Piping: piping typically found in industrial, institutional, commercial, and public buildings, and in multi-unit residences, which does not require the range of sizes, pressures, and temperatures covered in B31.1
- B31.11 Slurry Transportation Piping Systems: piping transporting aqueous slurries between plants and terminals and within terminals, pumping, and regulating stations
- B31.12 Hydrogen Piping and Pipelines: piping in gaseous and liquid hydrogen service, and pipelines in gaseous hydrogen service

This is the B31.1 Power Piping Code Section. Hereafter, in this Introduction and in the text of this Code Section B31.1, where the word *Code* is used without specific identification, it means this Code Section.

It is the owner's responsibility to select the Code Section that most nearly applies to a proposed piping installation. Factors to be considered by the owner include limitations of the Code Section, jurisdictional requirements, and the applicability of other codes and standards. All applicable requirements of the selected Code Section shall be met. For some installations, more than one Code Section may apply to different parts of the installation. The owner is also responsible for imposing requirements supplementary to those of the selected Code Section, if necessary, to assure safe piping for the proposed installation.

Certain piping within a facility may be subject to other codes and standards, including but not limited to

- ASME Boiler and Pressure Vessel Code, Section III: nuclear power piping
- ANSI Z223.1 National Fuel Gas Code: piping for fuel gas from the point of delivery to the connection of each fuel utilization device
- NFPA Fire Protection Standards: fire protection systems using water, carbon dioxide, halon, foam, dry chemical, and wet chemicals
- NFPA 99 Health Care Facilities: medical and laboratory gas systems
- NFPA 8503 Standard for Pulverized Fuel Systems: piping for pulverized coal from the coal mills to the burners
- building and plumbing codes, as applicable, for potable hot and cold water, and for sewer and drain systems

The Code sets forth engineering requirements deemed necessary for safe design and construction of pressure piping. While safety is the basic consideration, this factor alone will not necessarily govern the final specifications for any piping system. The designer is cautioned that the Code is not a design handbook; it does not eliminate the need for the designer or for competent engineering judgment.

To the greatest possible extent, Code requirements for design are stated in terms of basic design principles and formulas. These are supplemented as necessary with specific requirements to ensure uniform application of principles and to guide selection and application of piping elements. The Code prohibits designs and practices known to be unsafe and contains warnings where caution, but not prohibition, is warranted.

The specific design requirements of the Code usually revolve around a simplified engineering approach to a subject. It is intended that a designer capable of applying more complete and rigorous analysis to special or

unusual problems shall have latitude in the development of such designs and the evaluation of complex or combined stresses. In such cases the designer is responsible for demonstrating the validity of his approach.

This Code Section includes the following:

(a) references to acceptable material specifications and component standards, including dimensional requirements and pressure-temperature ratings

(b) requirements for design of components and assemblies, including pipe supports

(c) requirements and data for evaluation and limitation of stresses, reactions, and movements associated with pressure, temperature changes, and other forces

(d) guidance and limitations on the selection and application of materials, components, and joining methods

(e) requirements for the fabrication, assembly, and erection of piping

(f) requirements for examination, inspection, and testing of piping

(g) requirements for operation and maintenance of piping systems

It is intended that this edition of Code Section B31.1 not be retroactive. Unless agreement is specifically made between contracting parties to use another issue, or the regulatory body having jurisdiction imposes the use of another issue, the latest edition issued at least 6 months prior to the original contract date for the first phase of activity covering a piping system or systems shall be the governing document for all design, materials, fabrication, erection, examination, and testing for the piping until the completion of the work and initial operation.

Users of this Code are cautioned against making use of revisions without assurance that they are acceptable to the proper authorities in the jurisdiction where the piping is to be installed.

Code users will note that clauses in the Code are not necessarily numbered consecutively. Such discontinuities result from following a common outline, insofar as practicable, for all Code Sections. In this way, corresponding material is correspondingly numbered in most Code Sections, thus facilitating reference by those who have occasion to use more than one Section.

The Code is under the direction of ASME Committee B31, Code for Pressure Piping, which is organized and operates under procedures of The American Society of Mechanical Engineers which have been accredited by the American National Standards Institute. The Committee is a continuing one, and keeps all Code Sections current with new developments in materials, construction, and industrial practice. New editions are published at intervals of two to five years.

When no Section of the ASME Code for Pressure Piping, specifically covers a piping system, at the user's discretion, he/she may select any Section determined to be generally applicable. However, it is cautioned that supplementary requirements to the Section chosen may be necessary to provide for a safe piping system for the intended application. Technical limitations of the various Sections, legal requirements, and possible applicability of other codes or standards are some of the factors to be considered by the user in determining the applicability of any Section of this Code.

The Committee has established an orderly procedure to consider requests for interpretation and revision of Code requirements. To receive consideration, inquiries must be in writing and must give full particulars (see Mandatory Appendix H covering preparation of technical inquiries). The Committee will not respond to inquiries requesting assignment of a Code Section to a piping installation.

The approved reply to an inquiry will be sent directly to the inquirer. In addition, the question and reply will be published as part of an Interpretation Supplement issued to the applicable Code Section.

A Case is the prescribed form of reply to an inquiry when study indicates that the Code wording needs clarification or when the reply modifies existing requirements of the Code or grants permission to use new materials or alternative constructions. The Case will be published as part of a Case Supplement issued to the applicable Code Section.

The ASME B31 Standards Committee took action to eliminate Code Case expiration dates effective September 21, 2007. This means that all Code Cases in effect as of this date will remain available for use until annulled by the ASME B31 Standards Committee.

Materials are listed in the Stress Tables only when sufficient usage in piping within the scope of the Code has been shown. Materials may be covered by a Case. Requests for listing shall include evidence of satisfactory usage and specific data to permit establishment of allowable stresses, maximum and minimum temperature limits, and other restrictions. Additional criteria can be found in the guidelines for addition of new materials in the ASME Boiler and Pressure Vessel Code, Section II and Section VIII, Division 1, Appendix B. (To develop usage and gain experience, unlisted materials may be used in accordance with para. 123.1.)

Requests for interpretation and suggestions for revision should be addressed to the Secretary, ASME B31 Committee, Three Park Avenue, New York, NY 10016-5990.

# ASME B31.1-2012

## SUMMARY OF CHANGES

Following approval by the B31 Committee and ASME, and after public review, ASME B31.1-2012 was approved by the American National Standards Institute on May 9, 2012.

Changes given below are identified on the pages by a margin note, **(12)**, placed next to the affected area.

| <i>Page</i> | <i>Location</i> | <i>Change</i>                                                               |
|-------------|-----------------|-----------------------------------------------------------------------------|
| 1           | 100.1.1         | Second paragraph revised                                                    |
| 6–10        | 100.1.3         | Subparagraph (F) added                                                      |
|             | 100.1.4         | Added                                                                       |
|             | 100.2           | (1) Definition of <i>packaged equipment</i> added<br>(2) Footnote 1 revised |
|             |                 |                                                                             |
| 13          | 101.7.2         | Revised                                                                     |
| 14, 15      | 102.3.2         | Subparagraph (B) revised                                                    |
| 22–29       | 104.3.1         | Subparagraphs (D.2), (G.4), (G.6.1), (G.6.2), and (G.6.3) revised           |
|             | Fig. 104.3.1(G) | Callouts revised                                                            |
| 32          | 104.7.2         | Subparagraphs (B) and (D) revised                                           |
|             | 104.8           | Revised                                                                     |
| 34          | 106.1           | Subparagraph (C) revised                                                    |
| 36          | 107.8           | Revised in its entirety                                                     |
| 45          | 119.7.1         | Subparagraph (A.3) revised                                                  |
| 51          | 122.1.1         | Subparagraph (I) added                                                      |
| 53, 55      | 122.1.5         | Subparagraph (A) revised                                                    |
|             | 122.1.7         | Subparagraph (D) revised                                                    |
|             |                 |                                                                             |
| 60          | 122.5           | Revised in its entirety                                                     |
|             | 122.6           | Revised in its entirety                                                     |
| 62, 63      | 122.8.1         | Subparagraphs (A), (D), and (D.3) revised                                   |
| 64          | 122.10          | First paragraph revised                                                     |
| 65          | 122.12          | Revised                                                                     |
|             | 122.13          | Subparagraph (A) revised                                                    |
|             | 122.14          | Revised in its entirety                                                     |
|             |                 |                                                                             |
| 67          | 124.2           | Subparagraphs (B) and (D) revised                                           |
|             | 124.4           | Celsius temperature in first paragraph revised                              |

| <i>Page</i> | <i>Location</i> | <i>Change</i>                                                                                                                                                                                                                                        |
|-------------|-----------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 68          | 124.5           | Celsius temperature in first paragraph revised                                                                                                                                                                                                       |
|             | 124.6           | Celsius temperature in subparagraph (A.3) revised                                                                                                                                                                                                    |
| 71–75       | Table 126.1     | Revised                                                                                                                                                                                                                                              |
| 78          | 127.2.1         | Subparagraphs (C) and (G) revised                                                                                                                                                                                                                    |
| 91–93       | Table 129.3.1   | Last row added                                                                                                                                                                                                                                       |
|             | 129.3.4         | Revised in its entirety                                                                                                                                                                                                                              |
|             | Table 129.3.4.1 | Added                                                                                                                                                                                                                                                |
| 94          | 131.6.2         | Revised                                                                                                                                                                                                                                              |
|             | 132.2           | In subparagraph (A), cross-reference corrected by errata to read Table 129.3.1                                                                                                                                                                       |
|             | 132.3.1         | In subparagraph (C), cross-reference corrected by errata to read Table 129.3.1                                                                                                                                                                       |
|             | 132.3.3         | First paragraph and subparagraph (C) revised                                                                                                                                                                                                         |
| 103         | 136.1.1         | Revised                                                                                                                                                                                                                                              |
|             | 136.1.2         | Revised in its entirety                                                                                                                                                                                                                              |
| 104         | 136.4.2         | Subparagraph (A.2) revised                                                                                                                                                                                                                           |
| 110         | 138             | Last paragraph revised                                                                                                                                                                                                                               |
| 111         | 144             | Added                                                                                                                                                                                                                                                |
|             | 145             | Added                                                                                                                                                                                                                                                |
| 114, 115    | Table A-1       | (1) Under Seamless Pipe and Tube, for A106 Grade A, stress value for 800°F revised<br>(2) For A333 Grade 6, Notes revised<br>(3) Under Electric Resistance Welded Pipe and Tube, for A333 Grade 6, Notes revised                                     |
| 116, 117    | Table A-1       | Under Electric Fusion Welded Pipe — Filler Metal Added, A211 deleted                                                                                                                                                                                 |
| 124         | Table A-1       | Notes (21) through (23) redesignated as (11) through (13), respectively, and corresponding cross-references revised                                                                                                                                  |
| 126, 127    | Table A-2       | Under Seamless Pipe and Tube, A199 deleted                                                                                                                                                                                                           |
| 134         | Table A-2       | (1) Note (17) redesignated as (5)<br>(2) Notes (11) and (12) redesignated as (8) and (9), respectively<br>(3) Notes (19) and (20) redesignated as (10) and (11), respectively<br>(4) Corresponding cross-references for the above five Notes revised |

| <i>Page</i> | <i>Location</i> | <i>Change</i>                                                                                                                                                                                                        |
|-------------|-----------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 136, 137    | Table A-3       | Under Seamless Pipe and Tube, Austenitic, for both A213 TP316L lines, Note (29) added and stress values revised                                                                                                      |
| 138, 139    | Table A-3       | For both A312 TP316L lines, Note (29) and stress values for 900°F through 1,200°F added                                                                                                                              |
| 140, 141    | Table A-3       | (1) A430 deleted<br>(2) Under Seamless Pipe and Tube, Ferritic/Martensitic, A731 deleted                                                                                                                             |
| 142, 143    | Table A-3       | Under Welded Pipe and Tube — Without Filler Metal, Austenitic, for both A249 TP316L lines, Note (29) and stress values for 900°F through 1,200°F added                                                               |
| 144, 145    | Table A-3       | For both A312 TP316L lines, Note (29) and stress values for 900°F through 1,200°F added                                                                                                                              |
| 146, 147    | Table A-3       | (1) For A789 and A790, <i>E</i> or <i>F</i> revised<br>(2) Under Welded Pipe and Tube — Without Filler Metal, Ferritic/Martensitic, A731 deleted                                                                     |
| 148, 149    | Table A-3       | Under Welded Pipe — Filler Metal Added, Austenitic, for all four A358 316L lines, Note (29) and stress values for 900°F through 1,200°F added                                                                        |
| 150, 151    | Table A-3       | For fifth A409 TP316 line, stress values for 1,100°F through 1,200°F italicized                                                                                                                                      |
| 152, 153    | Table A-3       | (1) For all six A409 TP316L lines, Note (29) and stress values for 900°F through 1,200°F added<br>(2) Under Plate, Sheet, and Strip, Austenitic, for both A240 316L lines, Note (29) added and stress values revised |
| 156, 157    | Table A-3       | Under Forgings, Austenitic, for both A182 F316L lines, Note (29) added and stress values revised                                                                                                                     |
| 158, 159    | Table A-3       | Under Fittings (Seamless and Welded), Austenitic, for both A403 WP316L lines, Note (29) added and stress values revised                                                                                              |
| 162, 163    | Table A-3       | (1) Under Bar, Austenitic, for both A479 316L lines, Note (29) added and stress values revised<br>(2) Under Bar, Ferritic/Austenitic, A479 S32750 added                                                              |
| 164, 165    | Table A-3       | (1) Notes (25) through (27) redesignated as (16) through (18), respectively                                                                                                                                          |

| <i>Page</i> | <i>Location</i> | <i>Change</i>                                                                                                                                                                                                                                                                                                                                                                                                    |
|-------------|-----------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|             |                 | <ul style="list-style-type: none"> <li>(2) Notes (29) through (38) redesignated as (19) through (28), respectively</li> <li>(3) Corresponding cross-references for the above Notes revised</li> <li>(4) Note (29) added</li> </ul>                                                                                                                                                                               |
| 174, 175    | Table A-4       | <ul style="list-style-type: none"> <li>(1) Under Seamless Fittings, for both B366 N08020 lines, <i>E</i> or <i>F</i> added by errata</li> <li>(2) For both B366 N08925 lines, stress values for 650°F through 750°F corrected and values for 800°F added by errata</li> <li>(3) Under Welded Fittings, for both B366 N06625 lines, stress values corrected by errata</li> </ul>                                  |
| 176, 177    | Table A-4       | For first and third B366 R30556 lines, Note (12) references deleted by errata                                                                                                                                                                                                                                                                                                                                    |
| 178         | Table A-4       | Note (13) revised                                                                                                                                                                                                                                                                                                                                                                                                |
| 184, 185    | Table A-6       | <ul style="list-style-type: none"> <li>(1) Under Rod, three B16 C36000 and three B453 C35300 lines added</li> <li>(2) Under Bar, two B16 C36000 lines added</li> <li>(3) Notes (7) and (8) added</li> </ul>                                                                                                                                                                                                      |
| 186, 187    | Table A-7       | Under Seamless Pipe and Seamless Extruded Tube, for B241 A96063 T6, italics for value at 300°F deleted by errata                                                                                                                                                                                                                                                                                                 |
| 194, 195    | Table A-8       | Under Seamless Pipe and Tube, A430 deleted                                                                                                                                                                                                                                                                                                                                                                       |
| 210, 211    | Table B-1       | <ul style="list-style-type: none"> <li>(1) Values for <i>A</i> and <i>B</i> revised</li> <li>(2) Nickel alloys N06022, N06625, and N10276 added</li> </ul>                                                                                                                                                                                                                                                       |
| 214–217     | Table B-1 (SI)  | <ul style="list-style-type: none"> <li>(1) Values for <i>A</i> and <i>B</i> revised</li> <li>(2) Nickel alloys N06022, N06625, and N10276 added</li> </ul>                                                                                                                                                                                                                                                       |
| 218         | Table C-1       | Values revised                                                                                                                                                                                                                                                                                                                                                                                                   |
| 219         | Table C-1 (SI)  | <ul style="list-style-type: none"> <li>(1) Third column head revised</li> <li>(2) Fourth column deleted</li> <li>(3) Values revised</li> </ul>                                                                                                                                                                                                                                                                   |
| 220, 221    | Table C-2       | <ul style="list-style-type: none"> <li>(1) Values revised</li> <li>(2) Under High Nickel Alloys, N06022, N08020, and N08825 added</li> <li>(3) Lines for high nickel alloys arranged in alphanumeric order</li> <li>(4) Under Copper and Copper Alloys, values for C11000 revised and line relocated</li> <li>(5) For C70600, value at 500°F revised</li> <li>(6) For C71500, value at –100°F revised</li> </ul> |

| <i>Page</i> | <i>Location</i>                  | <i>Change</i>                                                                                                                                                                                                                                                                                             |
|-------------|----------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 222, 223    | Table C-2 (SI)                   | (1) Third column head revised<br>(2) Fourth column deleted<br>(3) Values revised<br>(4) Under High Nickel Alloys, N06022, N08020, and N08825 added<br>(5) Lines for high nickel alloys arranged in alphanumeric order<br>(6) Under Copper and Copper Alloys, values for C11000 revised and line relocated |
| 226         | Table D-1                        | (1) In first row, Description revised<br>(2) Note (1) revised                                                                                                                                                                                                                                             |
| 231–233     | Mandatory Appendix F             | (1) Editions updated<br>(2) ASTM B574 and B575 added<br>(3) MSS SP-69 and SP-89 deleted                                                                                                                                                                                                                   |
| 235–241     | Mandatory Appendix G             | Revised                                                                                                                                                                                                                                                                                                   |
| 243         | Mandatory Appendix J<br>Foreword | Revised                                                                                                                                                                                                                                                                                                   |
| 244         | J-1.2.14                         | Title and para. J-1.2.14.1 revised                                                                                                                                                                                                                                                                        |
| 277         | Table III-4.2.1                  | (1) PE2406 and PE3408 deleted<br>(2) PE2708, PE3608, PE3708, PE3710, PE4708, and PE4710 added<br>(3) Note (6) revised                                                                                                                                                                                     |
| 280         | Table III-4.3.1                  | (1) PE, Type 2406 and PE, Type 3408 deleted<br>(2) PE2708, PE3608, PE3708, PE3710, PE4708, and PE4710 added                                                                                                                                                                                               |
| 281         | Table III-4.3.2                  | (1) PE, Type 2406 and PE, Type 3408 deleted<br>(2) PE2708, PE3608, PE3708, PE3710, PE4708, and PE4710 added                                                                                                                                                                                               |
| 294–298     | V-7                              | Revised in its entirety                                                                                                                                                                                                                                                                                   |
| 300–302     | V-12                             | Revised in its entirety                                                                                                                                                                                                                                                                                   |
| 315–321     | Index                            | Revised                                                                                                                                                                                                                                                                                                   |

#### **SPECIAL NOTE:**

The Interpretations to ASME B31.1 issued between January 1, 2010 and December 31, 2011 follow the last page of this Edition as a separate supplement, Interpretations Volume 46. After the Interpretations, a separate supplement, Cases No. 36, follows.

# POWER PIPING

## Chapter I Scope and Definitions

### 100 GENERAL

This Power Piping Code is one of several Sections of the American Society of Mechanical Engineers Code for Pressure Piping, B31. This Section is published as a separate document for convenience.

Standards and specifications specifically incorporated by reference into this Code are shown in Table 126.1. It is not considered practical to refer to a dated edition of each of the standards and specifications in this Code. Instead, the dated edition references are included in an Addenda and will be revised yearly.

#### 100.1 Scope

Rules for this Code Section have been developed considering the needs for applications that include piping typically found in electric power generating stations, in industrial and institutional plants, geothermal heating systems, and central and district heating and cooling systems.

- (12) **100.1.1** This Code prescribes requirements for the design, materials, fabrication, erection, test, inspection, operation, and maintenance of piping systems.

Piping as used in this Code includes pipe, flanges, bolting, gaskets, valves, pressure-relieving valves/devices, fittings, and the pressure containing portions of other piping components, whether manufactured in accordance with Standards listed in Table 126.1 or specially designed. It also includes hangers and supports and other equipment items necessary to prevent overstressing the pressure containing components.

Rules governing piping for miscellaneous appurtenances, such as water columns, remote water level indicators, pressure gages, gage glasses, etc., are included within the scope of this Code, but the requirements for boiler appurtenances shall be in accordance with Section I of the ASME Boiler and Pressure Vessel Code, PG-60.

The users of this Code are advised that in some areas legislation may establish governmental jurisdiction over the subject matter covered by this Code. However, any such legal requirement shall not relieve the owner of his inspection responsibilities specified in para. 136.1.

**100.1.2** Power piping systems as covered by this Code apply to all piping and their component parts except as excluded in para. 100.1.3. They include but are not limited to steam, water, oil, gas, and air services.

(A) This Code covers boiler external piping as defined below for power boilers and high temperature, high pressure water boilers in which steam or vapor is generated at a pressure of more than 15 psig [100 kPa (gage)]; and high temperature water is generated at pressures exceeding 160 psig [1 103 kPa (gage)] and/or temperatures exceeding 250°F (120°C).


Boiler external piping shall be considered as piping that begins where the boiler proper terminates at

- (1) the first circumferential joint for welding end connections; or
- (2) the face of the first flange in bolted flanged connections; or
- (3) the first threaded joint in that type of connection; and that extends up to and including the valve or valves required by para. 122.1.

The terminal points themselves are considered part of the boiler external piping. The terminal points and piping external to power boilers are illustrated by Figs. 100.1.2(A.1), 100.1.2(A.2), 100.1.2(B), and 100.1.2(C).

Piping between the terminal points and the valve or valves required by para. 122.1 shall be provided with Data Reports, inspection, and stamping as required by Section I of the ASME Boiler and Pressure Vessel Code. All welding and brazing of this piping shall be performed by manufacturers or contractors authorized to use the appropriate symbol shown in Figs. PG-105.1 through PG-105.3 of Section I of the ASME Boiler and Pressure Vessel Code. The installation of boiler external piping by mechanical means may be performed by an organization not holding a Code symbol stamp. However, the holder of a valid S, A, or PP Certificate of Authorization shall be responsible for the documentation and hydrostatic test, regardless of the method of assembly. The quality control system requirements of Section I of the ASME Boiler and Pressure Vessel Code shall apply. These requirements are shown in Mandatory Appendix J of this Code.


**Fig. 100.1.2(A.1) Code Jurisdictional Limits for Piping — An Example of Forced Flow Steam Generators With No Fixed Steam and Water Line**

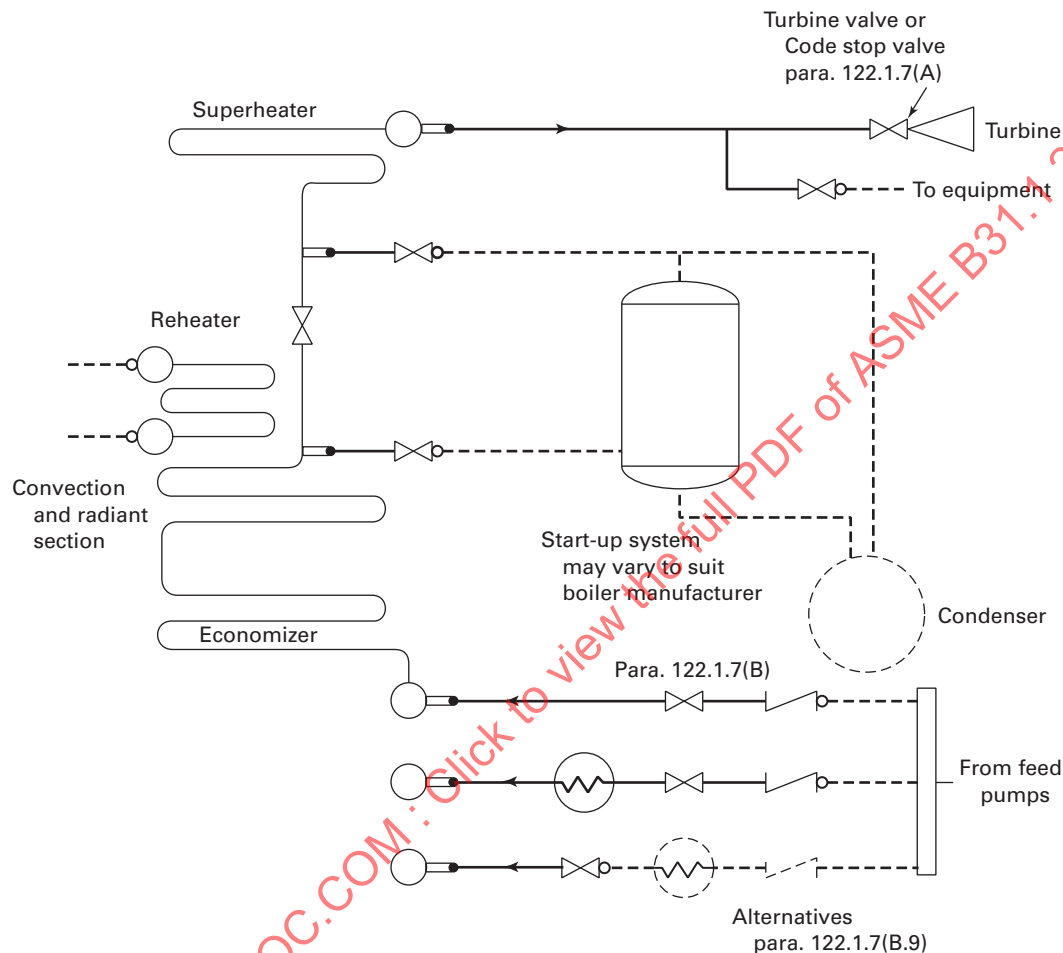

#### Administrative Jurisdiction and Technical Responsibility


- Boiler Proper — The ASME Boiler and Pressure Vessel Code (ASME BPVC) has total administrative jurisdiction and technical responsibility. Refer to ASME BPVC Section I Preamble.
- Boiler External Piping and Joint (BEP) — The ASME BPVC has total administrative jurisdiction (mandatory certification by Code Symbol stamping, ASME Data Forms, and Authorized Inspection) of BEP. The ASME Section Committee B31.1 has been assigned technical responsibility. Refer to ASME BPVC Section I Preamble, fifth, sixth, and seventh paragraphs and ASME B31.1 Scope, para. 100.1.2(A). Applicable ASME B31.1 Editions and Addenda are referenced in ASME BPVC Section I, PG-58.3.
- Nonboiler External Piping and Joint (NBEP) — The ASME Code Committee for Pressure Piping, B31, has total administrative and technical responsibility.

**Fig. 100.1.2(A.2) Code Jurisdictional Limits for Piping — An Example of Steam Separator Type Forced Flow Steam Generators With No Fixed Steam and Water Line**

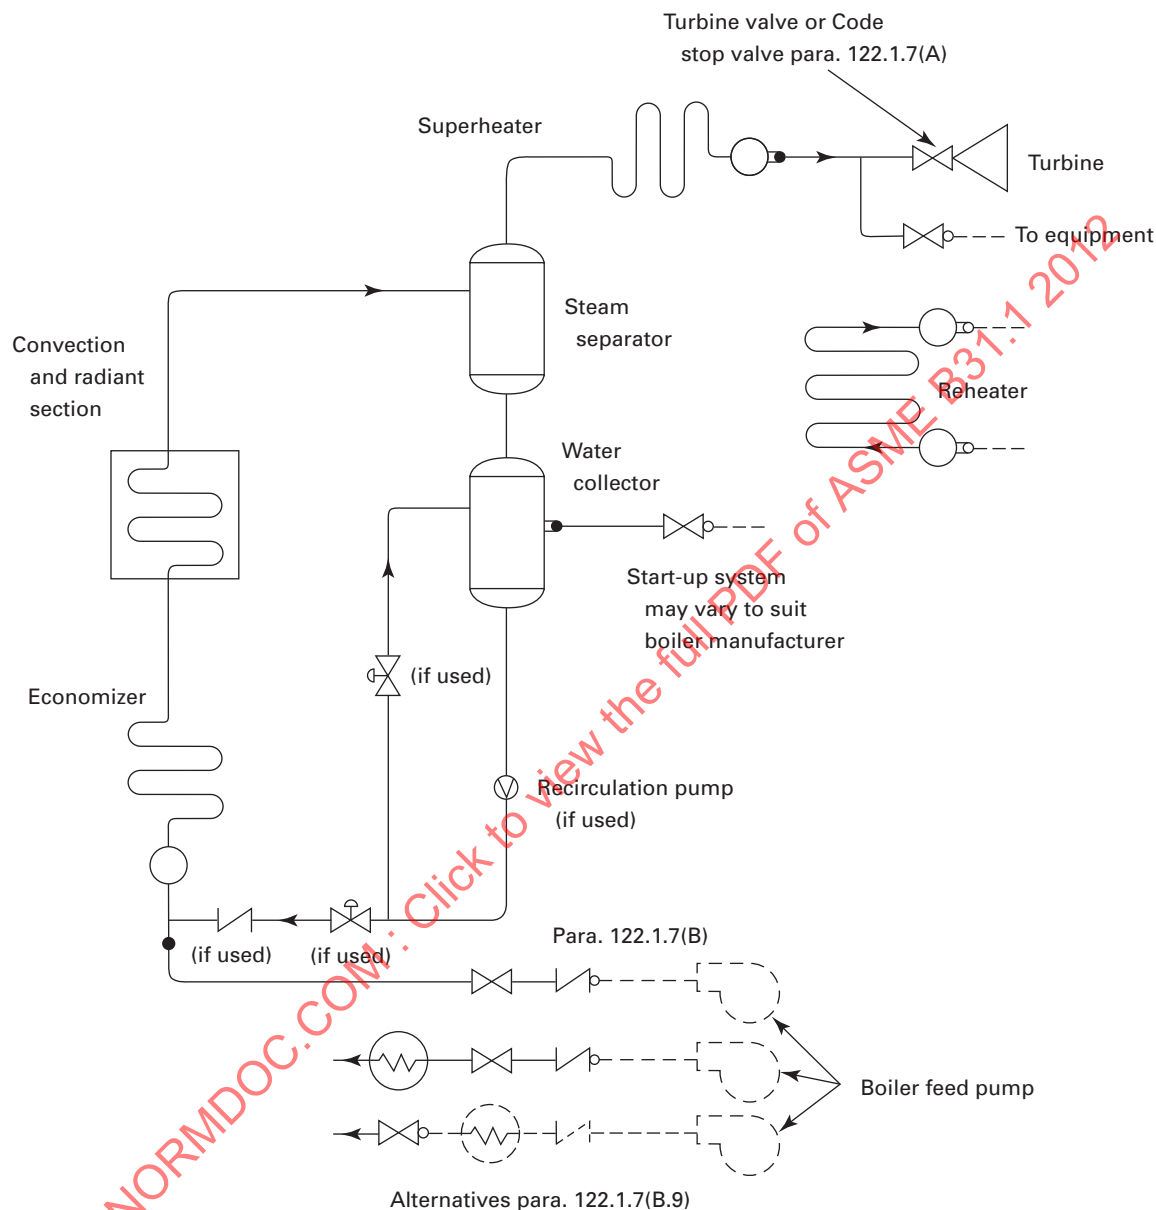


#### Administrative Jurisdiction and Technical Responsibility

- Boiler Proper – The ASME Boiler and Pressure Vessel Code (ASME BPVC) has total administrative jurisdiction and technical responsibility. Refer to ASME BPVC Section I Preamble.
- Boiler External Piping and Joint (BEP) – The ASME BPVC has total administrative jurisdiction (mandatory certification by Code Symbol stamping, ASME Data Forms, and Authorized Inspection) of BEP. The ASME Section Committee B31.1 has been assigned technical responsibility. Refer to ASME BPVC Section I Preamble, fifth, sixth, and seventh paragraphs and ASME B31.1 Scope, para. 100.1.2(A). Applicable ASME B31.1 Editions and Addenda are referenced in ASME BPVC Section I, PG-58.3.
- Nonboiler External Piping and Joint (NBEP) – The ASME Code Committee for Pressure Piping, B31, has total administrative and technical responsibility.

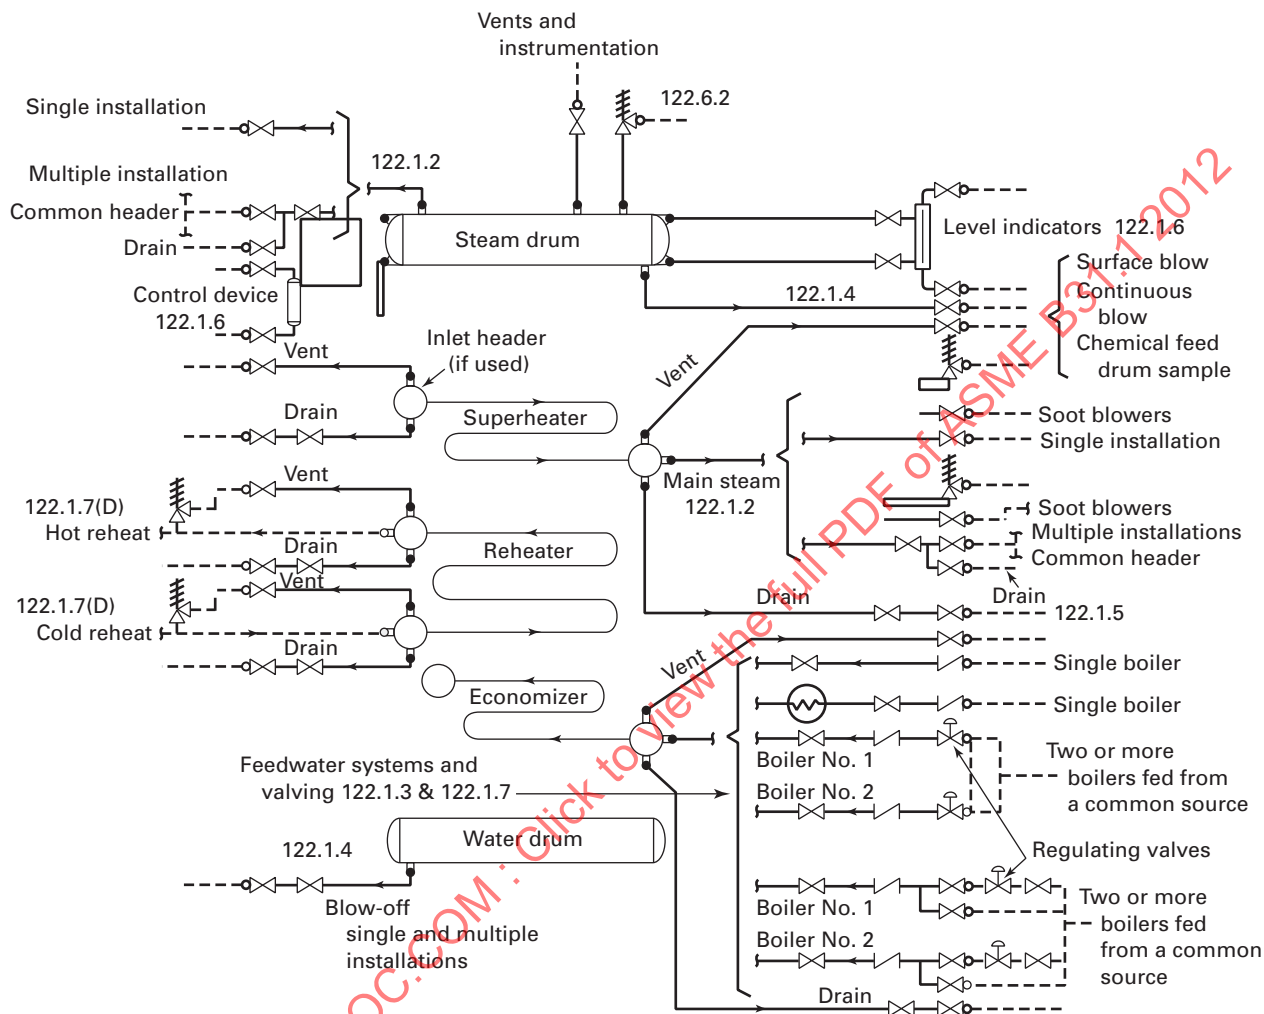**Fig. 100.1.2(B) Code Jurisdictional Limits for Piping — Drum-Type Boilers****Administrative Jurisdiction and Technical Responsibility**

- Boiler Proper — The ASME Boiler and Pressure Vessel Code (ASME BPVC) has total administrative jurisdiction and technical responsibility. Refer to ASME BPVC Section I Preamble.
- Boiler External Piping and Joint (BEP) — The ASME BPVC has total administrative jurisdiction (mandatory certification by Code Symbol stamping, ASME Data Forms, and Authorized Inspection) of BEP. The ASME Section Committee B31.1 has been assigned technical responsibility. Refer to ASME BPVC Section I Preamble and ASME B31.1 Scope, para. 100.1.2(A). Applicable ASME B31.1 Editions and Addenda are referenced in ASME BPVC Section I, PG-58.3.
- Nonboiler External Piping and Joint (NBEP) — The ASME Code Committee for Pressure Piping, B31, has total administrative jurisdiction and technical responsibility.

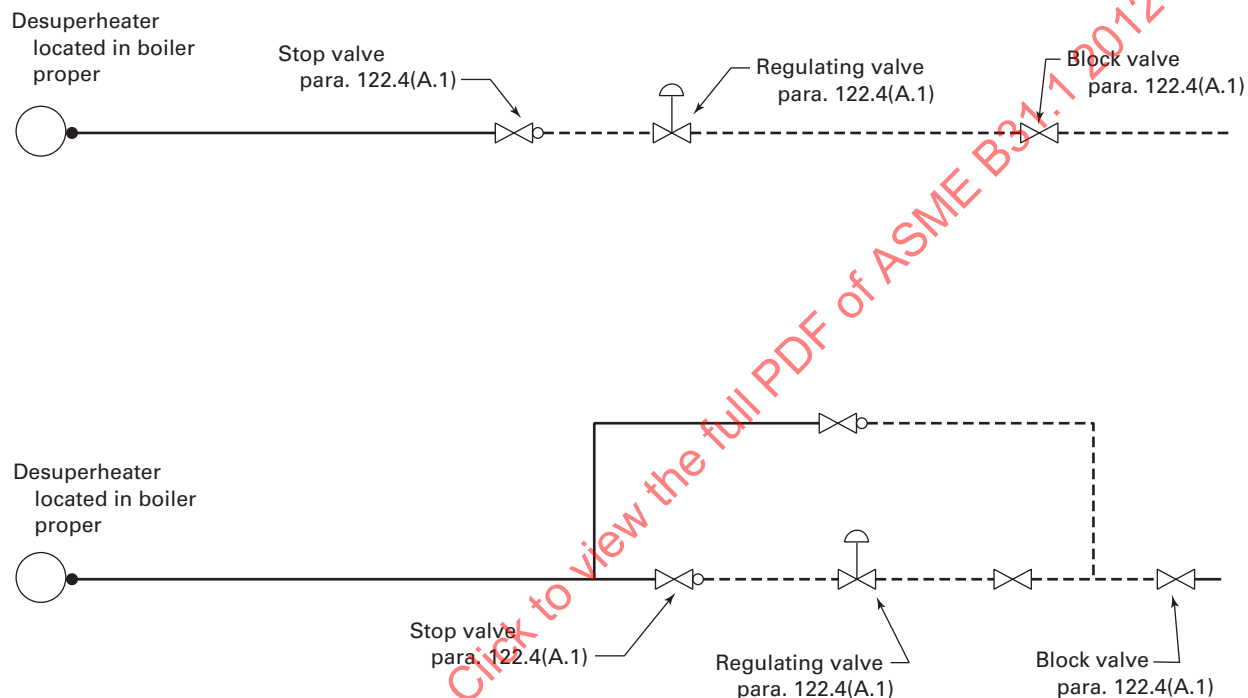**Fig. 100.1.2(C) Code Jurisdictional Limits for Piping — Spray-Type Desuperheater****Administrative Jurisdiction and Technical Responsibility**

- Boiler Proper — The ASME Boiler and Pressure Vessel Code (ASME BPVC) has total administrative jurisdiction and technical responsibility. Refer to ASME BPVC Section 1 Preamble.
- Boiler External Piping and Joint (BEP) — The ASME BPVC has total administrative jurisdiction (mandatory certification by Code Symbol stamping, ASME Data Forms, and Authorized Inspection) of BEP. The ASME Section Committee B31.1 has been assigned technical responsibility. Refer to ASME BPVC Section I Preamble and ASME B31.1 Scope, para. 100.1.2(A). Applicable ASME B31.1 Editions and Addenda are referenced in ASME BPVC Section I, PG-58.3.
- Nonboiler External Piping and Joint (NBEP) — The ASME Code Committee for Pressure Piping, B31, has total administrative and technical responsibility.

The valve or valves required by para. 122.1 are part of the boiler external piping, but do not require ASME Boiler and Pressure Vessel Code, Section I inspection and stamping except for safety, safety relief, and relief valves; see para. 107.8.2. Refer to PG-11.

Pipe connections meeting all other requirements of this Code but not exceeding NPS  $\frac{1}{2}$  may be welded to pipe or boiler headers without inspection and stamping required by Section I of the ASME Boiler and Pressure Vessel Code.

(B) Nonboiler external piping includes all the piping covered by this Code except for that portion defined above as boiler external piping.

**(12) 100.1.3** This Code does not apply to the following:

(A) economizers, heaters, pressure vessels, and components covered by Sections of the ASME Boiler and Pressure Vessel Code.

(B) building heating and distribution steam and condensate piping designed for 15 psig [100 kPa (gage)] or less, or hot water heating systems designed for 30 psig [200 kPa (gage)] or less.

(C) piping for hydraulic or pneumatic tools and their components downstream of the first block or stop valve off the system distribution header.

(D) piping for marine or other installations under Federal control.

(E) towers, building frames, tanks, mechanical equipment, instruments, and foundations.

(F) piping included as part of a shop-assembled packaged equipment assembly within a B31.1 Code piping installation when such equipment piping is constructed to another B31 Code Section (e.g., B31.3 or B31.9) with the owner's approval. See para. 100.2 for a definition of packaged equipment.

**(12) 100.1.4** This Code does not prescribe procedures for flushing, cleaning, start-up, operating, or maintenance.

**(12) 100.2 Definitions**

Some commonly used terms relating to piping are defined below. Terms related to welding generally agree with AWS A3.0. Some welding terms are defined with specified reference to piping. For welding terms used in this Code, but not shown here, definitions of AWS A3.0 apply.

*anchor*: a rigid restraint providing substantially full fixation, permitting neither translatory nor rotational displacement of the pipe.

*annealing*: see *heat treatments*.

*arc welding*: a group of welding processes wherein coalescence is produced by heating with an electric arc or arcs, with or without the application of pressure and with or without the use of filler metal.

*assembly*: the joining together of two or more piping components by bolting, welding, caulking, brazing, soldering, cementing, or threading into their installed location as specified by the engineering design.

*automatic welding*: welding with equipment that performs the entire welding operation without constant observation and adjustment of the controls by an operator. The equipment may or may not perform the loading and unloading of the work.

*backing ring*: backing in the form of a ring that can be used in the welding of piping.

*ball joint*: a component that permits universal rotational movement in a piping system.

*base metal*: the metal to be welded, brazed, soldered, or cut.

*branch connection*: the attachment of a branch pipe to the run of a main pipe with or without the use of fittings.

*brazing*: a method of welding whereby a groove, fillet, plug, or slot weld is made using a nonferrous filler metal having a melting point below that of the base metals, but above 840°F (450°C). The filler metal is not distributed in the joint by capillary action. (Bronze welding, formerly used, is a misnomer for this term.)

*brazing*: a metal joining process wherein coalescence is produced by use of a nonferrous filler metal having a melting point above 840°F (450°C) but lower than that of the base metals joined. The filler metal is distributed between the closely fitted surfaces of the joint by capillary action.

*butt joint*: a joint between two members lying approximately in the same plane.

*capacitor discharge welding (CDW)*: stud arc welding process in which DC arc power is produced by a rapid discharge of stored electrical energy with pressure applied during or immediately following the electrical discharge. The process uses an electrostatic storage system as a power source in which the weld energy is stored in capacitors.

*component*: component as used in this Code is defined as consisting of but not limited to items such as pipe, piping subassemblies, parts, valves, strainers, relief devices, fittings, etc.

*specialty designed component*: a component designed in accordance with para. 104.7.2.

*standard component*: a component manufactured in accordance with one or more of the standards listed in Table 126.1.

*covered piping systems (CPS)*: piping systems on which condition assessments are to be conducted. As a minimum for electric power generating stations, the CPS systems are to include NPS 4 and larger of the main steam, hot reheat steam, cold reheat steam, and boiler feedwater piping systems. In addition to the above, CPS

also includes NPS 4 and larger piping in other systems that operate above 750°F (400°C) or above 1,025 psi (7 100 kPa). The Operating Company may, in its judgment, include other piping systems determined to be hazardous by an engineering evaluation of probability and consequences of failure.

*creep strength enhanced ferritic steel*: steel in which the microstructure, consisting of lower transformation products such as martensite and bainite, is stabilized by controlled precipitation of temper-resistant carbides, carbonitrides, and/or nitrides.

*defect*: a flaw (imperfection or unintentional discontinuity) of such size, shape, orientation, location, or properties as to be rejectable.

*discontinuity*: a lack of continuity or cohesion; an interruption in the normal physical structure of material or a product.

*employer*: the owner, manufacturer, fabricator, contractor, assembler, or installer responsible for the welding, brazing, and NDE performed by his organization including procedure and performance qualifications.

*engineering design*: the detailed design developed from process requirements and conforming to Code requirements, including all necessary drawings and specifications, governing a piping installation.

*equipment connection*: an integral part of such equipment as pressure vessels, heat exchangers, pumps, etc., designed for attachment of pipe or piping components.

*erection*: the complete installation of a piping system, including any field assembly, fabrication, testing, and inspection of the system.

*examination*: denotes the procedures for all nondestructive examination. Refer to para. 136.3 and the definition for visual examination.

*expansion joint*: a flexible piping component that absorbs thermal and/or terminal movement.

*fabrication*: primarily the joining of piping components into integral pieces ready for assembly. It includes bending, forming, threading, welding, or other operations upon these components, if not part of assembly. It may be done in a shop or in the field.

*face of weld*: the exposed surface of a weld on the side from which the welding was done.

*filler metal*: metal to be added in welding, soldering, brazing, or braze welding.

*fillet weld*: a weld of approximately triangular cross section joining two surfaces approximately at right angles to each other in a lap joint, tee joint, corner joint, or socket weld.

*fire hazard*: situation in which a material of more than average combustibility or explosibility exists in the presence of a potential ignition source.

*flaw*: an imperfection or unintentional discontinuity that is detectable by a nondestructive examination.

*full fillet weld*: a fillet weld whose size is equal to the thickness of the thinner member joined.

*fusion*: the melting together of filler metal and base metal, or of base metal only, that results in coalescence.

*gas welding*: a group of welding processes wherein coalescence is produced by heating with a gas flame or flames, with or without the application of pressure, and with or without the use of filler metal.

*groove weld*: a weld made in the groove between two members to be joined.

*heat affected zone*: portion of the base metal that has not been melted, but whose mechanical properties or microstructure have been altered by the heat of welding or cutting.

*heat treatments*

*annealing, full*: heating a metal or alloy to a temperature above the critical temperature range and holding above the range for a proper period of time, followed by cooling to below that range. (A softening treatment is often carried out just below the critical range, which is referred to as a subcritical anneal.)

*normalizing*: a process in which a ferrous metal is heated to a suitable temperature above the transformation range and is subsequently cooled in still air at room temperature.

*postweld heat treatment*: any heat treatment subsequent to welding.

*preheating*: the application of heat to a base metal immediately prior to a welding or cutting operation.

*stress-relieving*: uniform heating of a structure or portion thereof to a sufficient temperature to relieve the major portion of the residual stresses, followed by uniform cooling.

*imperfection*: a condition of being imperfect; a departure of a quality characteristic from its intended condition.

*indication*: the response or evidence from the application of a nondestructive examination.

*inert gas metal arc welding*: an arc welding process wherein coalescence is produced by heating with an electric arc between a metal electrode and the work. Shielding is obtained from an inert gas, such as helium or argon. Pressure may or may not be used and filler metal may or may not be used.

*inspection*: denotes the activities performed by an Authorized Inspector, or an owner's Inspector, to verify that all required examinations and testing have been completed, and to ensure that all the documentation for material, fabrication, and examination conforms to the applicable requirements of this Code and the engineering design.

*integrally reinforced branch outlet fitting*: a branch outlet fitting that is welded directly to a run pipe, where the branch fitting and the deposited weld metal used to attach the fitting to the run pipe are designed by the fitting manufacturer to provide all the reinforcement required by this Code without the addition of separate saddles or pads. The attachment of the branch pipe to the fitting is by butt welding, socket welding, threading, or by a flanged connection. Integrally reinforced branch outlet fittings include those fittings conforming to MSS SP-97.

*joint design*: the joint geometry together with the required dimensions of the welded joint.

*joint penetration*: the minimum depth of a groove weld extends from its face into a joint, exclusive of reinforcement.

*low energy capacitor discharge welding*: a resistance welding process wherein coalescence is produced by the rapid discharge of stored electric energy from a low voltage electrostatic storage system.

*manual welding*: welding wherein the entire welding operation is performed and controlled by hand.

*maximum allowable stress*: the maximum stress value that may be used in the design formulas for a given material and design temperature.

*maximum allowable working pressure (MAWP)*: the pressure at the coincident temperature to which a boiler or pressure vessel can be subjected without exceeding the maximum allowable stress of the material or pressure-temperature rating of the equipment. For this Code, the term "MAWP" is as defined in the ASME Boiler and Pressure Vessel Code, Sections I and VIII.

*may*: used to denote permission; neither a requirement nor a recommendation.

*mechanical joint*: a joint for the purpose of mechanical strength or leak resistance, or both, where the mechanical strength is developed by threaded, grooved, rolled, flared, or flanged pipe ends, or by bolts, pins, and compounds, gaskets, rolled ends, caulking, or machined and mated surfaces. These joints have particular application where ease of disassembly is desired.

*miter*: two or more straight sections of pipe matched and joined on a line bisecting the angle of junction so as to produce a change in direction.

*nominal thickness*: the thickness given in the product material specification or standard to which manufacturing tolerances are applied.

*normalizing*: see *heat treatments*.

*Operating Company*: the owner, user, or agent acting on behalf of the owner, who has the responsibility for performing the operations and maintenance functions on the piping systems within the scope of the Code.

*owner*: the party or organization ultimately responsible for operation of a facility. The owner is usually the one who would be granted an operating license by the regulatory authority having jurisdiction or who has the administrative and operational responsibility for the facility. The owner may be either the operating organization (may not be the actual owner of the physical property of the facility) or the organization that owns and operates the plant.

*oxygen cutting*: a group of cutting processes wherein the severing of metals is effected by means of the chemical reaction of oxygen with the base metal at elevated temperatures. In the case of oxidation-resistant metals, the reaction is facilitated by use of a flux.

*oxygen gouging*: an application of oxygen cutting wherein a chamfer or groove is formed.

*packaged equipment*: an assembly of individual components or stages of equipment, complete with its interconnecting piping and connections for piping external to the equipment assembly. The assembly may be mounted on a skid or other structure prior to delivery.

*peening*: the mechanical working of metals by means of hammer blows.

*pipe and tube*: the fundamental difference between pipe and tube is the dimensional standard to which each is manufactured.

A pipe is a tube with a round cross section conforming to the dimensional requirements for nominal pipe size as tabulated in ASME B36.10M, Table 1, and ASME B36.19M, Table 1. For special pipe having a diameter not listed in these Tables, and also for round tube, the nominal diameter corresponds with the outside diameter.

A tube is a hollow product of round or any other cross section having a continuous periphery. Round tube size may be specified with respect to any two, but not all three, of the following: outside diameter, inside diameter, wall thickness; types K, L, and M copper tube may also be specified by nominal size and type only. Dimensions and permissible variations (tolerances) are specified in the appropriate ASTM or ASME standard specifications.

Types of pipe, according to the method of manufacture, are defined as follows:

(A) *electric resistance welded pipe*: pipe produced in individual lengths or in continuous lengths from coiled skelp and subsequently cut into individual lengths, having a longitudinal butt joint wherein coalescence is produced by the heat obtained from resistance of the pipe to the flow of electric current in a circuit of which the pipe is a part, and by the application of pressure.

(B) *furnace butt welded pipe*

(B.1) *furnace butt welded pipe, bell welded*: pipe produced in individual lengths from cut length skelp, having its longitudinal butt joint forge welded by the

mechanical pressure developed in drawing the furnace heated skelp through a cone shaped die (commonly known as a "welding bell") that serves as a combined forming and welding die.

(B.2) *furnace butt welded pipe, continuous welded*: pipe produced in continuous lengths from coiled skelp and subsequently cut into individual lengths, having its longitudinal butt joint forge welded by the mechanical pressure developed in rolling the hot formed skelp through a set of round pass welding rolls.

(C) *electric fusion welded pipe*: pipe having a longitudinal butt joint wherein coalescence is produced in the preformed tube by manual or automatic electric arc welding. The weld may be single (welded from one side), or double (welded from inside and outside) and may be made with or without the use of filler metal. Spiral welded pipe is also made by the electric fusion welded process with either a butt joint, a lap joint, or a lock seam joint.

(D) *electric flash welded pipe*: pipe having a longitudinal butt joint wherein coalescence is produced, simultaneously over the entire area of abutting surfaces, by the heat obtained from resistance to the flow of electric current between the two surfaces, and by the application of pressure after heating is substantially completed. Flashing and upsetting are accompanied by expulsion of metal from the joint.

(E) *double submerged arc welded pipe*: pipe having a longitudinal butt joint produced by the submerged arc process, with at least two passes, one of which is on the inside of the pipe.

(F) *seamless pipe*: pipe produced by one or more of the following processes:

(F.1) *rolled pipe*: pipe produced from a forged billet that is pierced by a conical mandrel between two diametrically opposed rolls. The pierced shell is subsequently rolled and expanded over mandrels of increasingly larger diameter. Where closer dimensional tolerances are desired, the rolled pipe is cold or hot drawn through dies, and machined.

One variation of this process produces the hollow shell by extrusion of the forged billet over a mandrel in a vertical, hydraulic piercing press.

(F.2) *forged and bored pipe*: pipe produced by boring or trepanning of a forged billet.

(F.3) *extruded pipe*: pipe produced from hollow or solid round forgings, usually in a hydraulic extrusion press. In this process the forging is contained in a cylindrical die. Initially a punch at the end of the extrusion plunger pierces the forging. The extrusion plunger then forces the contained billet between the cylindrical die and the punch to form the pipe, the latter acting as a mandrel.

(F.4) *centrifugally cast pipe*: pipe formed from the solidification of molten metal in a rotating mold. Both metal and sand molds are used. After casting, the pipe

is machined, to sound metal, on the internal and external diameters to the surface roughness and dimensional requirements of the applicable material specification.

One variation of this process utilizes autofrettage (hydraulic expansion) and heat treatment, above the recrystallization temperature of the material, to produce a wrought structure.

(F.5) *statically cast pipe*: pipe formed by the solidification of molten metal in a sand mold.

*pipe supporting elements*: pipe supporting elements consist of hangers, supports, and structural attachments.

*hangers and supports*: hangers and supports include elements that transfer the load from the pipe or structural attachment to the supporting structure or equipment. They include hanging type fixtures, such as hanger rods, spring hangers, sway braces, counterweights, turnbuckles, struts, chains, guides, and anchors, and bearing type fixtures, such as saddles, bases, rollers, brackets, and sliding supports.

*structural attachments*: structural attachments include elements that are welded, bolted, or clamped to the pipe, such as clips, lugs, rings, clamps, clevises, straps, and skirts.

*porosity*: cavity-type discontinuities formed by gas entrapment during metal solidification.

*postweld heat treatment*: see *heat treatments*.

*preheating*: see *heat treatments*.

*pressure*: an application of force per unit area; fluid pressure (an application of internal or external fluid force per unit area on the pressure boundary of piping components).

*Procedure Qualification Record (PQR)*: a record of the welding data used to weld a test coupon. The PQR is a record of variables recorded during the welding of the test coupons. It also contains the test results of the tested specimens. Recorded variables normally fall within a small range of the actual variables that will be used in production welding.

*readily accessible*: for visual examination, readily accessible inside surfaces are defined as those inside surfaces that can be examined without the aid of optical devices. (This definition does not prohibit the use of optical devices for a visual examination; however, the selection of the device should be a matter of mutual agreement between the owner and the fabricator or erector.)

*Reid vapor pressure*: the vapor pressure of a flammable or combustible liquid as determined by ASTM Standard Test Method D323 Vapor Pressure of Petroleum Products (Reid Method).

*reinforcement of weld*: weld metal on the face of a groove weld in excess of the metal necessary for the specified weld size.

*restraint*: any device that prevents, resists, or limits movement of a piping system.

*root opening*: the separation between the members to be joined, at the root of the joint.

*root penetration*: the depth a groove weld extends into the root opening of a joint measured on the centerline of the root cross section.

*seal weld*: a weld used on a pipe joint primarily to obtain fluid tightness as opposed to mechanical strength.

*semiautomatic arc welding*: arc welding with equipment that controls only the filler metal feed. The advance of the welding is manually controlled.

*shall*: “shall” or “shall not” is used to indicate that a provision or prohibition is mandatory.

*shielded metal arc welding*: an arc welding process wherein coalescence is produced by heating with an electric arc between a covered metal electrode and the work. Shielding is obtained from decomposition of the electrode covering. Pressure is not used and filler metal is obtained from the electrode.

*should*: “should” or “it is recommended” is used to indicate that a provision is not mandatory but recommended as good practice.

*size of weld*

*fillet weld*: for equal leg fillet welds, the leg lengths of the largest isosceles right triangle that can be inscribed within the fillet weld cross section. For unequal leg fillet welds, the leg lengths of the largest right triangle that can be inscribed within the fillet weld cross section.

*groove weld*: the joint penetration (depth of chamfering plus the root penetration when specified).

*slag inclusion*: nonmetallic solid material entrapped in weld metal or between weld metal and base metal.

*soldering*: a metal joining process wherein coalescence is produced by heating to suitable temperature and by using a nonferrous alloy fusible at temperatures below 840°F (450°C) and having a melting point below that of the base metals being joined. The filler metal is distributed between closely fitted surfaces of the joint by capillary action. In general, solders are lead-tin alloys and may contain antimony, bismuth, silver, and other elements.

*steel*: an alloy of iron and carbon with no more than 2% carbon by weight. Other alloying elements may include manganese, sulfur, phosphorus, silicon, aluminum, chromium, copper, nickel, molybdenum, vanadium, and others depending upon the type of steel. For acceptable material specifications for steel, refer to Chapter III, Materials.

*stresses*

*displacement stress*: a stress developed by the self-constraint of the structure. It must satisfy an imposed strain pattern rather than being in equilibrium with an external load. The basic characteristic of a displacement stress is that it is self-limiting. Local yielding and minor

distortions can satisfy the displacement or expansion conditions that cause the stress to occur. Failure from one application of the stress is not to be expected. Further, the displacement stresses calculated in this Code are “effective” stresses and are generally lower than those predicted by theory or measured in strain-gage tests.<sup>1</sup>

*peak stress*: the highest stress in the region under consideration. The basic characteristic of a peak stress is that it causes no significant distortion and is objectionable only as a possible source of a fatigue crack initiation or a brittle fracture. This Code does not utilize peak stress as a design basis, but rather uses effective stress values for sustained stress and for displacement stress; the peak stress effect is combined with the displacement stress effect in the displacement stress range calculation.

*sustained stress*: a stress developed by an imposed loading that is necessary to satisfy the laws of equilibrium between external and internal forces and moments. The basic characteristic of a sustained stress is that it is not self-limiting. If a sustained stress exceeds the yield strength of the material through the entire thickness, the prevention of failure is entirely dependent on the strain-hardening properties of the material. A thermal stress is not classified as a sustained stress. Further, the sustained stresses calculated in this Code are “effective” stresses and are generally lower than those predicted by theory or measured in strain-gage tests.

*stress-relieving*: see *heat treatments*.

*submerged arc welding*: an arc welding process wherein coalescence is produced by heating with an electric arc or arcs between a bare metal electrode or electrodes and the work. The welding is shielded by a blanket of granular, fusible material on the work. Pressure is not used, and filler metal is obtained from the electrode and sometimes from a supplementary welding rod.

*supplementary steel*: steel members that are installed between existing members for the purpose of installing supports for piping or piping equipment.

*swivel joint*: a component that permits single-plane rotational movement in a piping system.

*tack weld*: a weld made to hold parts of a weldment in proper alignment until the final welds are made.

*throat of a fillet weld*

*actual*: the shortest distance from the root of a fillet weld to its face.

<sup>1</sup> Normally, the most significant displacement stress is encountered in the thermal expansion stress range from ambient to the normal operating condition. This stress range is also the stress range usually considered in a flexibility analysis. However, if other significant stress ranges occur, whether they are displacement stress ranges (such as from other thermal expansion or contraction events, or differential support point movements) or sustained stress ranges (such as from cyclic pressure, steam hammer, or earthquake inertia forces), paras. 102.3.2(B) and 104.8.3 may be used to evaluate their effect on fatigue life.

*theoretical*: the distance from the beginning of the root of the joint perpendicular to the hypotenuse of the largest right triangle that can be inscribed within the fillet weld cross section.

*toe of weld*: the junction between the face of the weld and the base metal.

*tube*: refer to pipe and tube.

*tungsten electrode*: a nonfiller metal electrode used in arc welding, consisting of a tungsten wire.

*undercut*: a groove melted into the base metal adjacent to the toe of a weld and not filled with weld metal.

*visual examination*: the observation of whatever portions of components, joints, and other piping elements that are exposed to such observation either before, during, or after manufacture, fabrication, assembly, erection, inspection, or testing. This examination may include verification of the applicable requirements for materials, components, dimensions, joint preparation, alignment, welding or joining, supports, assembly, and erection.

*weld*: a localized coalescence of metal that is produced by heating to suitable temperatures, with or without the

application of pressure, and with or without the use of filler metal. The filler metal shall have a melting point approximately the same as the base metal.

*welder*: one who is capable of performing a manual or semiautomatic welding operation.

*Welder/Welding Operator Performance Qualification (WPQ)*: demonstration of a welder's ability to produce welds in a manner described in a Welding Procedure Specification that meets prescribed standards.

*welding operator*: one who operates machine or automatic welding equipment.

*Welding Procedure Specification (WPS)*: a written qualified welding procedure prepared to provide direction for making production welds to Code requirements. The WPS or other documents may be used to provide direction to the welder or welding operator to ensure compliance with the Code requirements.

*weldment*: an assembly whose component parts are joined by welding.

ASME B31.1-2012  
 Click to view the full PDF of ASME B31.1-2012

## Chapter II Design

### PART 1 CONDITIONS AND CRITERIA

#### 101 DESIGN CONDITIONS

##### 101.1 General

These design conditions define the pressures, temperatures, and various forces applicable to the design of power piping systems. Power piping systems shall be designed for the most severe condition of coincident pressure, temperature, and loading, except as herein stated. The most severe condition shall be that which results in the greatest required pipe wall thickness and the highest flange rating.

##### 101.2 Pressure

All pressures referred to in this Code are expressed in pounds per square inch and kilopascals above atmospheric pressure, i.e., psig [kPa (gage)], unless otherwise stated.

**101.2.2 Internal Design Pressure.** The internal design pressure shall be not less than the maximum sustained operating pressure (MSOP) within the piping system including the effects of static head.

**101.2.4 External Design Pressure.** Piping subject to external pressure shall be designed for the maximum differential pressure anticipated during operating, shut-down, or test conditions.

**101.2.5 Pressure Cycling.** This Code does not address the contribution to fatigue in fittings and components caused by pressure cycling. Special consideration may be necessary where systems are subjected to a very high number of large pressure cycles.

##### 101.3 Temperature

**101.3.1** All temperatures referred to in this Code, unless otherwise stated, are the average metal temperatures of the respective materials expressed in degrees Fahrenheit, i.e., °F (Celsius, i.e., °C).

##### 101.3.2 Design Temperature

(A) The piping shall be designed for a metal temperature representing the maximum sustained condition expected. The design temperature shall be assumed to be the same as the fluid temperature unless calculations or tests support the use of other data, in which case the design temperature shall not be less than the average of the fluid temperature and the outside wall temperature.

(B) Where a fluid passes through heat exchangers in series, the design temperature of the piping in each section of the system shall conform to the most severe temperature condition expected to be produced by the heat exchangers in that section of the system.

(C) For steam, feedwater, and hot water piping leading from fired equipment (such as boiler, reheater, superheater, economizer, etc.), the design temperature shall be based on the expected continuous operating condition plus the equipment manufacturers guaranteed maximum temperature tolerance. For operation at temperatures in excess of this condition, the limitations described in para. 102.2.4 shall apply.

(D) Accelerated creep damage, leading to excessive creep strains and potential pipe rupture, caused by extended operation above the design temperature shall be considered in selecting the design temperature for piping to be operated above 800°F (425°C).

##### 101.4 Ambient Influences

**101.4.1 Cooling Effects on Pressure.** Where the cooling of a fluid may reduce the pressure in the piping to below atmospheric, the piping shall be designed to withstand the external pressure or provision shall be made to break the vacuum.

**101.4.2 Fluid Expansion Effects.** Where the expansion of a fluid may increase the pressure, the piping system shall be designed to withstand the increased pressure or provision shall be made to relieve the excess pressure.

##### 101.5 Dynamic Effects

**101.5.1 Impact.** Impact forces caused by all external and internal conditions shall be considered in the piping design. One form of internal impact force is due to the propagation of pressure waves produced by sudden changes in fluid momentum. This phenomena is often called water or steam "hammer." It may be caused by the rapid opening or closing of a valve in the system. The designer should be aware that this is only one example of this phenomena and that other causes of impact loading exist.

**101.5.2 Wind.** Exposed piping shall be designed to withstand wind loadings. The analysis considerations and loads may be as described in ASCE/SEI 7, Minimum Design Loads for Buildings and Other Structures. Authoritative local meteorological data may also be

used to define or refine the design wind forces. Where local jurisdictional rules covering the design of building structures are in effect and specify wind loadings for piping, these values shall be considered the minimum design values. Wind need not be considered as acting concurrently with earthquakes.

**101.5.3 Earthquake.** The effect of earthquakes shall be considered in the design of piping, piping supports, and restraints. The analysis considerations and loads may be as described in ASCE/SEI 7. Authoritative local seismological data may also be used to define or refine the design earthquake forces. Where local jurisdictional rules covering the design of building structures are in effect and specify seismic loadings for piping, these values shall be considered the minimum design values. Earthquakes need not be considered as acting concurrently with wind.

**101.5.4 Vibration.** Piping shall be arranged and supported with consideration of vibration [see paras. 120.1(c) and 121.7.5].

## 101.6 Weight Effects

The following weight effects combined with loads and forces from other causes shall be taken into account in the design of piping. Piping shall be carried on adjustable hangers or properly leveled rigid hangers or supports, and suitable springs, sway bracing, vibration dampeners, etc., shall be provided where necessary.

**101.6.1 Live Load.** The live load consists of the weight of the fluid transported. Snow and ice loads shall be considered in localities where such conditions exist.

**101.6.2 Dead Load.** The dead load consists of the weight of the piping components, insulation, protective lining and coating, and other superimposed permanent loads.

**101.6.3 Test or Cleaning Fluid Load.** The test or cleaning fluid load consists of the weight of the test or cleaning fluid.

## 101.7 Thermal Expansion and Contraction Loads

**101.7.1 General.** The design of piping systems shall take account of the forces and moments resulting from thermal expansion and contraction, and from the effects of expansion joints.

Thermal expansion and contraction shall be provided for preferably by pipe bends, elbows, offsets, or changes in direction of the pipeline.

Hangers and supports shall permit expansion and contraction of the piping between anchors.

- (12) **101.7.2 Expansion, Swivel, or Ball Joints, and Flexible Metal Hose Assemblies.** Joints of the corrugated bellows, slip, sleeve, ball, or swivel types and flexible metal hose assemblies may be used if their materials conform

to this Code, their structural and working parts are of ample proportions, and their design prevents the complete disengagement of working parts while in service.

## 102 DESIGN CRITERIA

### 102.1 General

These criteria cover pressure–temperature ratings for standard and specially designed components, allowable stresses, stress limits, and various allowances to be used in the design of piping and piping components.

### 102.2 Pressure–Temperature Ratings for Piping Components

#### 102.2.1 Components Having Specific Ratings.

Pressure–temperature ratings for certain piping components have been established and are contained in some of the standards listed in Table 126.1.

Where piping components have established pressure–temperature ratings that do not extend to the upper material temperature limits permitted by this Code, the pressure–temperature ratings between those established and the upper material temperature limit may be determined in accordance with the rules of this Code, but such extensions are subject to restrictions, if any, imposed by the standards.

Standard components may not be used at conditions of pressure and temperature that exceed the limits imposed by this Code.

#### 102.2.2 Components Not Having Specific Ratings.

Some of the Standards listed in Table 126.1, such as those for butt welding fittings, specify that components shall be furnished in nominal thicknesses. Unless limited elsewhere in this Code, such components shall be rated for the same allowable pressures as seamless pipe of the same nominal thickness, as determined in paras. 103 and 104 for material having the same allowable stress.

Piping components, such as pipe, for which allowable stresses have been developed in accordance with para. 102.3, but that do not have established pressure ratings, shall be rated by rules for pressure design in para. 104, modified as applicable by other provisions of this Code.

Should it be desired to use methods of manufacture or design of components not covered by this Code or not listed in referenced standards, it is intended that the manufacturer shall comply with the requirements of paras. 103 and 104 and other applicable requirements of this Code for design conditions involved. Where components other than those discussed above, such as pipe or fittings not assigned pressure–temperature ratings in an American National Standard, are used, the manufacturer's recommended pressure–temperature rating shall not be exceeded.

**102.2.3 Ratings: Normal Operating Condition.** A piping system shall be considered safe for operation if

the maximum sustained operating pressure and temperature that may act on any part or component of the system does not exceed the maximum pressure and temperature allowed by this Code for that particular part or component. The design pressure and temperature shall not exceed the pressure-temperature rating for the particular component and material as defined in the applicable specification or standard listed in Table 126.1.

**102.2.4 Ratings: Allowance for Variation From Normal Operation.** The maximum internal pressure and temperature allowed shall include considerations for occasional loads and transients of pressure and temperature.

It is recognized that variations in pressure and temperature inevitably occur, and therefore the piping system, except as limited by component standards referred to in para. 102.2.1 or by manufacturers of components referred to in para. 102.2.2, shall be considered safe for occasional short operating periods at higher than design pressure or temperature. For such variations, either pressure or temperature, or both, may exceed the design values if the computed circumferential pressure stress does not exceed the maximum allowable stress from Mandatory Appendix A for the coincident temperature by

(A) 15% if the event duration occurs for no more than 8 hr at any one time and not more than 800 hr/year, or

(B) 20% if the event duration occurs for not more than 1 hr at any one time and not more than 80 hr/year

**102.2.5 Ratings at Transitions.** Where piping systems operating at different design conditions are connected, a division valve shall be provided having a pressure-temperature rating equal to or exceeding the more severe conditions. See para. 122 for design requirements pertaining to specific piping systems.

### 102.3 Allowable Stress Values and Other Stress Limits for Piping Components

#### 102.3.1 Allowable Stress Values

(A) Allowable stress values to be used for the design of power piping systems are given in the Tables in Mandatory Appendix A, also referred to in this Code Section as the Allowable Stress Tables. These tables list allowable stress values for commonly used materials at temperatures appropriate to power piping installations. In every case the temperature is understood to be the metal temperature. Where applicable, weld joint efficiency factors and casting quality factors are included in the tabulated values. Thus, the tabulated values are values of  $S$ ,  $SE$ , or  $SF$ , as applicable.

(B) Allowable stress values in shear shall not exceed 80% of the values determined in accordance with the rules of para. 102.3.1(A). Allowable stress values in bearing shall not exceed 160% of the determined values.

(C) The basis for establishing the allowable stress values in this Code Section are the same as those in the

ASME Boiler and Pressure Vessel Code, Section II, Part D, Mandatory Appendix 1; except that allowable stresses for cast iron and ductile iron are in accordance with Section VIII, Division 1, Nonmandatory Appendix P for Tables UCI-23 and UCD-23, respectively.

#### 102.3.2 Limits for Sustained and Displacement Stresses (12)

##### (A) Sustained Stresses

(A.1) *Internal Pressure Stress.* The calculated stress due to internal pressure shall not exceed the allowable stress values given in the Allowable Stress Tables in Mandatory Appendix A. This criterion is satisfied when the wall thickness of the piping component, including any reinforcement, meets the requirements of paras. 104.1 through 104.7, excluding para. 104.1.3 but including the consideration of allowances permitted by paras. 102.2.4, 102.3.3(B), and 102.4.

(A.2) *External Pressure Stress.* Piping subject to external pressure shall be considered safe when the wall thickness and means of stiffening meet the requirements of para. 104.1.3.

(A.3) *Longitudinal Stress.* The sum of the longitudinal stresses,  $S_L$ , due to pressure, weight, and other sustained loads shall not exceed the basic material allowable stress in the hot condition,  $S_h$ .

The longitudinal pressure stress,  $S_{lp}$ , may be determined by either of the following equations:

$$S_{lp} = \frac{PD_o}{4t_n}$$

or

$$S_{lp} = \frac{Pd_n^2}{D_o^2 - d_n^2}$$

(B) *Displacement Stress Range.* The calculated reference displacement stress range,  $S_E$  (see paras. 104.8.3 and 119.6.4), shall not exceed the allowable stress range,  $S_A$ , calculated by eq. (1A)

$$S_A = f(1.25S_c + 0.25S_h) \quad (1A)$$

When  $S_h$  is greater than  $S_L$ , the difference between them may be added to the term  $0.25S_h$  in eq. (1A). In that case, the allowable stress range,  $S_A$ , is calculated by eq. (1B)

$$S_A = f(1.25S_c + 1.25S_h - S_L) \quad (1B)$$

where

$f$  = cyclic stress range factor<sup>1</sup> for the total number of equivalent reference displacement stress range cycles,  $N$ , determined from eq. (1C)

$$f = 6/N^{0.2} \leq 1.0 \quad (1C)$$

$N$  = total number of equivalent reference displacement stress range cycles expected during the service life of the piping. A minimum value for  $f$  is 0.15, which results in an allowable displacement stress range for a total number of equivalent reference displacement stress range cycles greater than  $10^8$  cycles.

$S_c$  = basic material allowable stress from Mandatory Appendix A at the minimum metal temperature expected during the reference stress range cycle, psi (kPa)<sup>2</sup>

$S_h$  = basic material allowable stress from Mandatory Appendix A at the maximum metal temperature expected during the reference stress range cycle, psi (kPa)<sup>2</sup>

In determining the basic material allowable stresses,  $S_c$  and  $S_h$ , for welded pipe, the joint efficiency factor,  $E$ , need not be applied (see para. 102.4.3). The values of the allowable stresses from Mandatory Appendix A may be divided by the joint efficiency factor given for that material. In determining the basic material allowable stresses for castings, the casting quality factor,  $F$ , shall be applied (see para. 102.4.6).

When considering more than a single displacement stress range, whether from thermal expansion or other cyclic conditions, each significant stress range shall be computed. The reference displacement stress range,  $S_E$ , is defined as the greatest computed displacement stress range. The total number of equivalent reference displacement stress range cycles,  $N$ , may then be calculated by eq. (2)

$$N = N_E + \sum (q_i^2 N_i) \text{ for } i = 1, 2, \dots, n \quad (2)$$

where

$N_E$  = number of cycles of the reference displacement stress range,  $S_E$

$N_i$  = number of cycles associated with displacement stress range,  $S_i$

$q_i = S_i/S_E$

$S_i$  = any computed stress range other than the reference displacement stress range, psi (kPa)

<sup>1</sup> Applies to essentially noncorroded piping. Corrosion can sharply decrease cyclic life; therefore, corrosion resistant materials should be considered where a large number of significant stress range cycles is anticipated. The designer is also cautioned that the fatigue life of materials operated at elevated temperatures may be reduced.

<sup>2</sup> For materials with a minimum tensile strength of over 70 ksi (480 MPa), eqs. (1A) and (1B) shall be calculated using  $S_c$  or  $S_h$  values no greater than 20 ksi (140 MPa), unless otherwise justified.

### 102.3.3 Limits of Calculated Stresses Due to Occasional Loads

(A) *During Operation.* The sum of the longitudinal stresses produced by internal pressure, live and dead loads and those produced by occasional loads, such as the temporary supporting of extra weight, may exceed the allowable stress values given in the Allowable Stress Tables by the amounts and durations of time given in para. 104.8.2.

(B) *During Test.* During pressure tests performed in accordance with para. 137, the circumferential (hoop) stress shall not exceed 90% of the yield strength (0.2% offset) at test temperature. In addition, the sum of longitudinal stresses due to test pressure and live and dead loads at the time of test, excluding occasional loads, shall not exceed 90% of the yield strength at test temperature.

### 102.4 Allowances

**102.4.1 Corrosion or Erosion.** When corrosion or erosion is expected, an increase in wall thickness of the piping shall be provided over that required by other design requirements. This allowance in the judgment of the designer shall be consistent with the expected life of the piping.

**102.4.2 Threading and Grooving.** The calculated minimum thickness of piping (or tubing) that is to be threaded shall be increased by an allowance equal to thread depth; dimension  $h$  of ASME B1.20.1 or equivalent shall apply. For machined surfaces or grooves, where the tolerance is not specified, the tolerance shall be assumed to be  $\frac{1}{64}$  in. (0.40 mm) in addition to the specified depth of cut. The requirements of para. 104.1.2(C) shall also apply.

**102.4.3 Weld Joint Efficiency Factors.** The use of joint efficiency factors for welded pipe is required by this Code. The factors in Table 102.4.3 are based on full penetration welds. These factors are included in the allowable stress values given in Mandatory Appendix A. The factors in Table 102.4.3 apply to both straight seam and spiral seam welded pipe.

**102.4.4 Mechanical Strength.** Where necessary for mechanical strength to prevent damage, collapse, excessive sag, or buckling of pipe due to superimposed loads from supports or other causes, the wall thickness of the pipe should be increased; or, if this is impractical or would cause excessive local stresses, the superimposed loads or other causes shall be reduced or eliminated by other design methods. The requirements of para. 104.1.2(C) shall also apply.

**102.4.5 Bending.** The minimum wall thickness at any point on the bend shall conform to (A) or (B) below.

(A) The minimum wall thickness at any point in a completed bend shall not be less than required by eq. (7) or (8) of para. 104.1.2(A).

**Table 102.4.3 Longitudinal Weld Joint Efficiency Factors**

| No. | Type of Joint                                                                                                                                                                | Type of Seam                             | Examination                                                       | Factor <i>E</i>            |
|-----|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------|-------------------------------------------------------------------|----------------------------|
| 1   | Furnace butt weld, continuous weld<br>                                                      | Straight                                 | As required by listed specification                               | 0.60<br>[Note (1)]         |
| 2   | Electric resistance weld<br>                                                                | Straight or spiral                       | As required by listed specification                               | 0.85<br>[Note (1)]         |
| 3   | Electric fusion weld                                                                                                                                                         |                                          |                                                                   |                            |
|     | (a) Single butt weld (without filler metal)<br>                                             | Straight or spiral                       | As required by listed specification<br>Additionally 100% RT or UT | 0.85<br>1.00<br>[Note (2)] |
|     | (b) Single butt weld (with filler metal)<br>                                                | Straight or spiral                       | As required by listed specification<br>Additionally 100% RT or UT | 0.80<br>1.00<br>[Note (2)] |
|     | (c) Double butt weld (without filler metal)<br>                                           | Straight or spiral                       | As required by listed specification<br>Additionally 100% RT or UT | 0.90<br>1.00<br>[Note (2)] |
|     | (d) Double butt weld (with filler metal)<br>                                              | Straight or spiral                       | As required by listed specification<br>Additionally 100% RT or UT | 0.90<br>1.00<br>[Note (2)] |
| 4   | API 5L<br>Submerged arc weld (SAW)<br>Gas metal arc weld (GMAW)<br>Combined GMAW, SAW<br> | Straight with one or two seams<br>Spiral | As required by specification<br>Additionally 100% RT or UT        | 0.90<br>1.00<br>[Note (2)] |

**NOTES:**

- (1) It is not permitted to increase the longitudinal weld joint efficiency factor by additional examination for joint 1 or 2.
- (2) RT (radiographic examination) shall be in accordance with the requirements of para. 136.4.5 or the material specification, as applicable. UT (ultrasonic examination) shall be in accordance with the requirements of para. 136.4.6 or the material specification, as applicable.

**Table 102.4.5 Bend Thinning Allowance**

| Radius of Bends             | Minimum Thickness Recommended Prior to Bending |
|-----------------------------|------------------------------------------------|
| 6 pipe diameters or greater | $1.06t_m$                                      |
| 5 pipe diameters            | $1.08t_m$                                      |
| 4 pipe diameters            | $1.14t_m$                                      |
| 3 pipe diameters            | $1.25t_m$                                      |

**GENERAL NOTES:**

- (a) Interpolation is permissible for bending to intermediate radii.  
 (b)  $t_m$  is determined by eq. (7) or (8) of para. 104.1.2(A).  
 (c) Pipe diameter is the nominal diameter as tabulated in ASME B36.10M, Tables 1, and ASME B36.19M, Table 1. For piping with a diameter not listed in these Tables, and also for tubing, the nominal diameter corresponds with the outside diameter.

(A.1) Table 102.4.5 is a guide to the designer who must specify wall thickness for ordering pipe. In general, it has been the experience that when good shop practices are employed, the minimum thicknesses of straight pipe shown in Table 102.4.5 should be sufficient for bending and still meet the minimum thickness requirements of para. 104.1.2(A).

(A.2) The bend thinning allowance in Table 102.4.5 may be provided in all parts of the cross section of the pipe circumference without any detrimental effects being produced.

(B) The minimum required thickness,  $t_m$ , of a bend, after bending, in its finished form, shall be determined in accordance with eq. (3) or (4)

$$t_m = \frac{PD_o}{2(SE/I + Py)} + A \quad (3)$$

or

$$t_m = \frac{Pd + 2SEA/I + 2yPA}{2(SE/I + Py - P)} \quad (4)$$

where at the intrados (inside of bend)


$$I = \frac{4(R/D_o) - 1}{4(R/D_o) - 2} \quad (5)$$

and at the extrados (outside of bend)

$$I = \frac{4(R/D_o) + 1}{4(R/D_o) + 2} \quad (6)$$

and at the sidewall on the bend centerline,  $I = 1.0$  where  
 $R$  = bend radius of pipe bend

Thickness variations from the intrados to the extrados and at the ends of the bend shall be gradual. The thickness requirements apply at the center of the bend arc, at the intrados, extrados, and bend centerline (see Fig. 102.4.5). The minimum thickness at the ends of the bends shall not be less than the requirements of

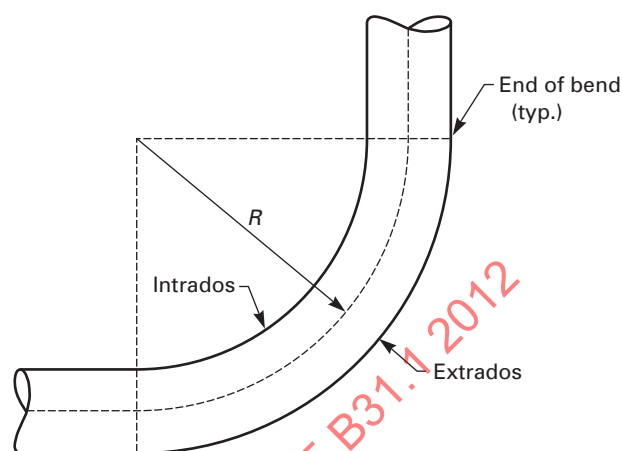**Fig. 102.4.5 Nomenclature for Pipe Bends**

para. 104.1.2 for straight pipe. For bends to conform to this paragraph, all thickness requirements must be met.

**102.4.6 Casting Quality Factors**

(A) *General.* The use of a casting quality factor is required for all cast components that use the allowable stress values of Mandatory Appendix A as the design basis. A factor of 0.80 is included in the allowable stress values for all castings given in Mandatory Appendix A.

This required factor does not apply to component standards listed in Table 126.1, if such standards define allowable pressure-temperature ratings or provide the allowable stresses to be used as the design basis for the component.

(B) For steel materials, a casting quality factor not exceeding 1.0 may be applied when the following requirements are met:

(B.1) All steel castings having a nominal body thickness of  $4\frac{1}{2}$  in. (114 mm) or less (other than pipe flanges, flanged valves and fittings, and butt welding end valves, all complying with ASME B16.5 or B16.34) shall be inspected visually (MSS SP-55 may be used for guidance) as follows:

(B.1.1) All critical areas, including the junctions of all gates, risers, and abrupt changes in section or direction and area of weld end preparation shall be radiographed in accordance with Article 2 of Section V of the ASME Boiler and Pressure Vessel Code. The radiographs shall conform to the requirements of ASTM E446, Reference Radiographs for Steel Castings up to 2 in. (50 mm) in Thickness or ASTM E186 Reference Radiographs for Heavy Walled (2 to  $4\frac{1}{2}$  in. [50 to 114 mm]) Steel Castings, depending upon the section thickness. MSS SP-54 may be used for guidance. The maximum acceptable severity level for a 1.0 quality factor shall be as listed in Table 102.4.6(B.1.1). Where appropriate, radiographic examination (RT) of castings may be supplemented or replaced with ultrasonic examination

**Table 102.4.6(B.1.1) Maximum Severity Level for Casting Thickness  $4\frac{1}{2}$  in. (114 mm) or Less**

| Discontinuity<br>Category Designation                | Severity Level          |                         | Discontinuity<br>Category Designation                                 | Severity Level     |
|------------------------------------------------------|-------------------------|-------------------------|-----------------------------------------------------------------------|--------------------|
|                                                      | ≤1 in. (25 mm)<br>Thick | >1 in. (25 mm)<br>Thick |                                                                       |                    |
| For E446 [Castings up to 2 in.<br>(50 mm) Thickness] |                         |                         | For E186 [Castings 2 in. to<br>4½ in. (50 mm to 114 mm)<br>Thickness] |                    |
| A                                                    | 1                       | 2                       | A, B, and Types 1 and 2 of C                                          | 2                  |
| B                                                    | 2                       | 3                       | Type 3 of C                                                           | 3                  |
| C Types 1, 2,<br>3, and 4                            | 1                       | 3                       | D, E, and F                                                           | None<br>acceptable |
| D, E, F, and G                                       | None<br>acceptable      | None<br>acceptable      |                                                                       |                    |

(UT), provided it is performed in accordance with MSS SP-94.

(B.1.2) All surfaces of each casting, including machined gasket seating surfaces, shall be examined by the magnetic particle or dye penetrant method after heat treatment. The examination techniques shall be in accordance with Article 6 or 7, as applicable, and Article 9 of Section V of the ASME Boiler and Pressure Vessel Code. MSS SP-53 and SP-93 may be used for guidance. Magnetic particle or dye penetrant indications exceeding degree 1 of Type I, degree 2 of Type II, and degree 3 of Type III, and exceeding degree 1 of Types IV and V of ASTM E125, Standard Reference Photographs for Magnetic Particle Indications on Ferrous Castings, are not acceptable and shall be removed.

(B.1.3) Where more than one casting of a particular design is produced, each of the first five castings shall be inspected as above. Where more than five castings are being produced, the examination shall be performed on the first five plus one additional casting to represent each five additional castings. If this additional casting proves to be unacceptable, each of the remaining castings in the group shall be inspected.

(B.1.4) Any discontinuities in excess of the maximum permitted in (B.1.1) and (B.1.2) above shall be removed, and the casting may be repaired by welding after the base metal has been inspected to ensure complete removal of discontinuities. [Refer to para. 127.4.11(A).] The complete 4d repair shall be subject to reinspection by the same method as was used in the original inspection and shall be reinspected after any required postweld heat treatment.

(B.2) All steel castings having a nominal body thickness greater than  $4\frac{1}{2}$  in. (114 mm) (other than pipe flanges, flanged valves and fittings, and butt welding end valves, all complying with ASME B16.5 or B16.34) shall be inspected visually (MSS SP-55 may be used for guidance) as follows:

**Table 102.4.6(B.2.2) Maximum Severity Level for Casting Thickness Greater Than  $4\frac{1}{2}$  in. (114 mm)**

| Discontinuity<br>Category Designation | Severity Level     |
|---------------------------------------|--------------------|
| A, B, and Types 1, 2, and 3 of C      | 2                  |
| D, E, and F                           | None<br>acceptable |

(B.2.1) All surfaces of each casting including machined gasket seating surfaces, shall be examined by the magnetic particle or dye penetrant method after heat treatment. The examination techniques shall be in accordance with Article 6 or 7, as applicable, and with Article 9 of Section V of the ASME Boiler and Pressure Vessel Code. Magnetic particle or dye penetrant indications exceeding degree 1 of Type I, degree 2 of Type II, degree 3 of Type III, and degree 1 of Types IV and V of ASTM E125, Standard Reference Photographs for Magnetic Particle Indications on Ferrous Castings, shall be removed.

(B.2.2) All parts of castings shall be subjected to complete radiographic inspection in accordance with Article 2 of Section V of the ASME Boiler and Pressure Vessel Code. The radiographs shall conform to the requirements of ASTM E280.

The maximum acceptable severity level for a 1.0 quality factor shall be as listed in Table 102.4.6(B.2.2). MSS SP-54 may be used for guidance. Where appropriate, radiographic examination (RT) of castings may be supplemented or replaced with ultrasonic examination (UT), provided it is performed in accordance with MSS SP-94.

(B.2.3) Any discontinuities in excess of the maximum permitted in (B.2.1) and (B.2.2) above shall be removed and may be repaired by welding after the base

metal has been magnetic particle or dye penetrant inspected to ensure complete removal of discontinuities. [Refer to para. 127.4.11(A).]

(B.2.4) All weld repairs of depth exceeding 1 in. (25 mm) or 20% of the section thickness, whichever is the lesser, shall be inspected by radiography in accordance with (B.2.2) above and by magnetic particle or dye penetrant inspection of the finished weld surface. All weld repairs of depth less than 20% of the section thickness, or 1 in. (25 mm), whichever is the lesser, and all weld repairs of section that cannot be effectively radiographed shall be examined by magnetic particle or dye penetrant inspection of the first layer, of each  $\frac{1}{4}$  in. (6 mm) thickness of deposited weld metal, and of the finished weld surface. Magnetic particle or dye penetrant testing of the finished weld surface shall be done after postweld heat treatment.

(C) For cast iron and nonferrous materials, no increase of the casting quality factor is allowed except when special methods of examination, prescribed by the material specification, are followed. If such increase is specifically permitted by the material specification, a factor not exceeding 1.0 may be applied.

**102.4.7 Weld Strength Reduction Factors.** At elevated temperatures, seam welds on longitudinal-welded or spiral-welded pipe can have lower creep strength than the base material. This reduction is a factor in determining the minimum wall thickness for longitudinal-welded or spiral-welded pipe (i.e., not seamless), whether fabricated in accordance with a material specification or fabricated in accordance with the rules of this Code. The weld strength reduction factor,  $W$ , is given in Table 102.4.7. The designer is responsible to assess application of weld strength reduction factor requirements for welds other than longitudinal and spiral, as applicable (e.g., circumferential welds).

## PART 2

### PRESSURE DESIGN OF PIPING COMPONENTS

#### 103 CRITERIA FOR PRESSURE DESIGN OF PIPING COMPONENTS

The design of piping components shall consider the effects of pressure and temperature, in accordance with paras. 104.1 through 104.7, including the consideration of allowances permitted by paras. 102.2.4 and 102.4. In addition, the mechanical strength of the piping system shall be determined adequate in accordance with para. 104.8 under other applicable loadings, including but not limited to those loadings defined in para. 101.

#### 104 PRESSURE DESIGN OF COMPONENTS

##### 104.1 Straight Pipe

###### 104.1.1 Straight Pipe Under Internal Pressure.

Straight pipe under internal pressure shall have a minimum wall thickness calculated per para. 104.1.2 if the

pipe is of seamless construction or is designed for sustained operation below the creep range. Straight pipe under internal pressure shall have a minimum wall thickness calculated per para. 104.1.4 if the pipe is of longitudinal-welded or spiral-welded construction designed for sustained operation within the creep range. (See para. 123.4 for definition of the creep range.)

###### 104.1.2 Straight Pipe Under Internal Pressure — Seamless, Longitudinal Welded, or Spiral Welded and Operating Below the Creep Range

(A) *Minimum Wall Thickness.* The minimum thickness of pipe wall required for design pressures and for temperatures not exceeding those for the various materials listed in the Allowable Stress Tables, including allowances for mechanical strength, shall not be less than that determined by eq. (7) or (8), as follows:

$$t_m = \frac{PD_o}{2(SE + Py)} + A \quad (7)^3$$

$$t_m = \frac{Pd + 2SEA + 2yPA}{2(SE + Py - P)} \quad (8)^3$$

Design pressure shall not exceed

$$P = \frac{2SE(t_m - A)}{D_o - 2y(t_m - A)} \quad (9)^3$$

$$P = \frac{2SE(t_m - A)}{d - 2y(t_m - A) + 2t_m} \quad (10)^3$$

where the nomenclature used above is:

(A.1)  $t_m$  = minimum required wall thickness, in. (mm)

(A.1.1) If pipe is ordered by its nominal wall thickness, the manufacturing tolerance on wall thickness must be taken into account. After the minimum pipe wall thickness  $t_m$  is determined by eq. (7) or (8), this minimum thickness shall be increased by an amount sufficient to provide the manufacturing tolerance allowed in the applicable pipe specification or required by the process. The next heavier commercial wall thickness shall then be selected from thickness schedules such as contained in ASME B36.10M or from manufacturers' schedules for other than standard thickness.

(A.1.2) To compensate for thinning in bends, refer to para. 102.4.5.

(A.1.3) For cast piping components, refer to para. 102.4.6.

<sup>3</sup>  $SF$  shall be used in place of  $SE$  where casting quality factors are intended. See definition of  $SE$ . Units of  $P$  and  $SE$  must be identical. Mandatory Appendix A values must be converted to kPa when the design pressure is in kPa.

**Table 102.4.7 Weld Strength Reduction Factors to Be Applied When Calculating the Minimum Wall Thickness or Allowable Design Pressure of Components Fabricated With a Longitudinal Seam Fusion Weld**

| Steel Group                                                  | Weld Strength Reduction Factor for Temperature, °F (°C) [Notes (1)–(6)] |              |              |              |              |              |                |                |                |                |                |
|--------------------------------------------------------------|-------------------------------------------------------------------------|--------------|--------------|--------------|--------------|--------------|----------------|----------------|----------------|----------------|----------------|
|                                                              | 700<br>(371)                                                            | 750<br>(399) | 800<br>(427) | 850<br>(454) | 900<br>(482) | 950<br>(510) | 1,000<br>(538) | 1,050<br>(566) | 1,100<br>(593) | 1,150<br>(621) | 1,200<br>(649) |
| Carbon (Norm.) [Notes (7), (8)]                              | 1.00                                                                    | 0.95         | 0.91         | NP           | NP           | NP           | NP             | NP             | NP             | NP             | NP             |
| Carbon (Sub Crit) [Notes (8), (9)]                           | 1.00                                                                    | 0.95         | 0.91         | NP           | NP           | NP           | NP             | NP             | NP             | NP             | NP             |
| CrMo [Notes (8), (10), (11)]                                 | ...                                                                     | ...          | 1.00         | 0.95         | 0.91         | 0.86         | 0.82           | 0.77           | 0.73           | 0.68           | 0.64           |
| CSEF (N+T) [Notes (8), (12), (13)]                           | ...                                                                     | ...          | ...          | ...          | ...          | 1.00         | 0.95           | 0.91           | 0.86           | 0.82           | 0.77           |
| CSEF (Sub Crit) [Notes (8), (9)]                             | ...                                                                     | ...          | ...          | ...          | 1.00         | 0.73         | 0.68           | 0.64           | 0.59           | 0.55           | 0.50           |
| Austenitic stainless (incl. 800H & 800HT) [Notes (14), (15)] | ...                                                                     | ...          | ...          | ...          | ...          | 1.00         | 0.95           | 0.91           | 0.86           | 0.82           | 0.77           |
| Autogenously welded austenitic stainless [Note (16)]         | ...                                                                     | ...          | ...          | ...          | ...          | 1.00         | 1.00           | 1.00           | 1.00           | 1.00           | 1.00           |

## NOTES:

- (1) NP = not permitted.
- (2) Longitudinal welds in pipe for materials not covered in this Table operating in the creep regime are not permitted. For the purposes of this Table, the start of the creep range is the highest temperature where the nonitalicized stress values end in Mandatory Appendix A for the base material involved.
- (3) All weld filler metal shall be a minimum of 0.05% C for CrMo and CSEF materials, and 0.04% C for austenitic stainless in this Table.
- (4) Materials designed for temperatures below the creep range [see Note (2)] may be used without consideration of the WSRF or the rules of this Table. All other Code rules apply.
- (5) Longitudinal seam welds in CrMo and CSEF materials shall be subjected to, and pass, a 100% volumetric examination (RT or UT). For materials other than CrMo and CSEF, see para. 123.4(B).
- (6) At temperatures below those where WSRFs are tabulated, a value of 1.0 shall be used for the factor *W* where required by the rules of this Section. However, the additional rules of this Table and Notes do not apply.
- (7) Norm. = normalizing postweld heat treatment (PWHT) is required.
- (8) Basicity index of SAW flux  $\geq 1.0$ .
- (9) Sub Crit = subcritical PWHT is required. No exemptions from PWHT are permitted. The PWHT time and temperature shall meet the requirements of Table 132; the alternate PWHT requirements of Table 132.1 are not permitted.
- (10) The CrMo steels include  $\frac{1}{2}\text{Cr}-\frac{1}{2}\text{Mo}$ ,  $1\text{Cr}-\frac{1}{2}\text{Mo}$ ,  $1\frac{1}{4}\text{Cr}-\frac{1}{2}\text{Mo}-\text{Si}$ ,  $2\frac{1}{4}\text{Cr}-1\text{Mo}$ ,  $3\text{Cr}-1\text{Mo}$ , and  $5\text{Cr}-\frac{1}{2}\text{Mo}$ . Longitudinal welds shall either be normalized, normalized and tempered, or subjected to proper subcritical PWHT for the alloy.
- (11) Longitudinal seam fusion welded construction is not permitted for  $\text{C}-\frac{1}{2}\text{Mo}$  steel for operation in the creep range [see Notes (2) and (4)].
- (12) The CSEF (creep strength enhanced ferritic) steels include Grades 91, 92, 911, 122, and 23.
- (13) N+T = normalizing + tempering PWHT.
- (14) WSRFs have been assigned for austenitic stainless (including 800H and 800HT) longitudinally welded pipe up to 1,500°F as follows:

| Temperature, °F | Temperature, °C | Weld Strength Reduction Factor |
|-----------------|-----------------|--------------------------------|
| 1,250           | 677             | 0.73                           |
| 1,300           | 704             | 0.68                           |
| 1,350           | 732             | 0.64                           |
| 1,400           | 760             | 0.59                           |
| 1,450           | 788             | 0.55                           |
| 1,500           | 816             | 0.5                            |

- (15) Certain heats of the austenitic stainless steels, particularly for those grades whose creep strength is enhanced by the precipitation of temper-resistant carbides and carbo-nitrides, can suffer from an embrittlement condition in the weld heat affected zone that can lead to premature failure of welded components operating at elevated temperatures. A solution annealing heat treatment of the weld area mitigates this susceptibility.
- (16) Autogenous SS welded pipe (without weld filler metal) has been assigned a WSRF up to 1,500°F of 1.00, provided that the product is solution annealed after welding and receives nondestructive electric examination, in accordance with the material specification.

(A.1.4) Where ends are subject to forming or machining for jointing, the wall thickness of the pipe, tube, or component after such forming or machining shall not be less than  $t_m$  minus the amount provided for removal by para. 104.1.2 (A.6.1).

(A.2)  $P$  = internal design pressure, psig [kPa (gage)]

NOTE: When computing the design pressure for a pipe of a definite minimum wall thickness by eq. (9) or (10), the value of  $P$  obtained by these formulas may be rounded out to the next higher unit of 10. For cast iron pipe, see para. 104.1.2(B).

(A.3)  $D_o$  = outside diameter of pipe, in. (mm). For design calculations, the outside diameter of pipe as given in tables of standards and specifications shall be used in obtaining the value of  $t_m$ . When calculating the allowable working pressure of pipe on hand or in stock, the actual measured outside diameter and actual measured minimum wall thickness at the thinner end of the pipe may be used to calculate this pressure.

(A.4)  $d$  = inside diameter of pipe, in. (mm). For design calculations, the inside diameter of pipe is the maximum possible value allowable under the purchase specification. When calculating the allowable working pressure of pipe on hand or in stock, the actual measured inside diameter and actual measured minimum wall thickness at the thinner end of the pipe may be used to calculate this pressure.

(A.5)  $SE$   
or  $SF$  = maximum allowable stress in material due to internal pressure and joint efficiency (or casting quality factor) at the design temperature, psi (MPa). The value of  $SE$  or  $SF$  shall not exceed that given in Mandatory Appendix A, for the respective material and design temperature. These values include the weld joint efficiency,  $E$ , or the casting factor,  $F$ .

(A.6)  $A$  = additional thickness, in. (mm)

(A.6.1) To compensate for material removed in threading, grooving, etc., required to make a mechanical joint, refer to para. 102.4.2.

(A.6.2) To provide for mechanical strength of the pipe, refer to para. 102.4.4 (not intended to provide for extreme conditions of misapplied external loads or for mechanical abuse).

(A.6.3) To provide for corrosion and/or erosion, refer to para. 102.4.1.

(A.7)  $y$  = coefficient having values as given in Table 104.1.2(A)

(B) Thickness of gray and ductile iron fittings conveying liquids may be determined from ANSI/AWWA C110/A21.10 or ANSI/AWWA C153/A21.53. The thickness of ductile iron pipe may be determined by ANSI/AWWA C115/A21.15 or ANSI/AWWA C150/A21.50. These thicknesses include allowances for foundry tolerances and water hammer.

(C) While the thickness determined from eq. (7) or (8) is theoretically ample for both bursting pressure and material removed in threading, the following minimum requirements are mandatory to furnish added mechanical strength:

(C.1) Where steel pipe is threaded and used for steam service at pressure above 250 psi (1 750 kPa) or for water service above 100 psi (700 kPa) with water temperature above 220°F (105°C), the pipe shall be seamless having the minimum ultimate tensile strength of 48,000 psi (330 MPa) and a weight at least equal to Schedule 80 of ASME B36.10M.

(C.2) Where threaded brass or copper pipe is used for the services described in (C.1) above, it shall comply with pressure and temperature classifications permitted for these materials by other paragraphs of this Code and shall have a wall thickness at least equal to that specified above for steel pipe of corresponding size.

(C.3) Plain end nonferrous pipe or tube shall have minimum wall thicknesses as follows:

(C.3.1) For nominal sizes smaller than NPS  $\frac{3}{4}$ , the thickness shall not be less than that specified for Type K of ASTM B88.

(C.3.2) For nominal sizes NPS  $\frac{3}{4}$  and larger, the wall thickness shall not be less than 0.049 in. (1.25 mm). The wall thickness shall be further increased, as required, in accordance with para. 102.4.

**104.1.3 Straight Pipe Under External Pressure.** For determining wall thickness and stiffening requirements for straight pipe under external pressure, the procedures outlined in UG-28, UG-29, and UG-30 of Section VIII, Division 1 of the ASME Boiler and Pressure Vessel Code shall be followed.

**104.1.4 Longitudinal-Welded or Spiral-Welded Pipe Operating in the Creep Range.** The minimum thickness of pipe wall required for design pressures and for temperature not exceeding that for the various materials listed in the Allowable Stress Tables shall not be less than that determined by eq. (11) or (12) as follows:

$$t_m = \frac{PD_o}{2(SEW + Py)} + A \quad (11)$$

$$t_m = \frac{Pd + 2SEWA + 2yPA}{2(SEW + Py - P)} \quad (12)$$

**Table 104.1.2(A) Values of  $y$** 

| Material                                                 | Temperature, °F (°C)         |              |                |                |                |                |                                |
|----------------------------------------------------------|------------------------------|--------------|----------------|----------------|----------------|----------------|--------------------------------|
|                                                          | 900<br>(482)<br>and<br>Below | 950<br>(510) | 1,000<br>(538) | 1,050<br>(566) | 1,100<br>(593) | 1,150<br>(621) | 1,200<br>(649)<br>and<br>Above |
| Ferritic steels                                          | 0.4                          | 0.5          | 0.7            | 0.7            | 0.7            | 0.7            | 0.7                            |
| Austenitic steels                                        | 0.4                          | 0.4          | 0.4            | 0.4            | 0.5            | 0.7            | 0.7                            |
| Nickel alloys UNS Nos. N06617,<br>N08800, N08810, N08825 | 0.4                          | 0.4          | 0.4            | 0.4            | 0.4            | 0.4            | 0.5                            |

## GENERAL NOTES:

- (a) The value of  $y$  may be interpolated between the 50°F (27.8°C) values shown in the Table. For cast iron and nonferrous materials,  $y$  equals 0.
- (b) For pipe with a  $D_o/t_m$  ratio less than 6, the value of  $y$  for ferritic and austenitic steels designed for temperatures of 900°F (480°C) and below shall be taken as:

$$y = \frac{d}{d + D_o}$$

Design pressure shall not exceed

$$P = \frac{2SEW(t_m - A)}{D_o - 2y(t_m - A)}$$

$$P = \frac{2SEW(t_m - A)}{d - 2y(t_m - A) + 2t_m}$$

where the nomenclature used above is given in para. 104.1.2 and

$E$  = weld joint efficiency factor (as given in Table 102.4.3 and referenced in Mandatory Appendix A tables)

$SE$  = maximum allowable stress in material due to internal pressure and joint efficiency at the design temperature, psi (MPa). The value of  $SE$  shall not exceed that given in Mandatory Appendix A, for the respective material and design temperature. These values include the weld joint efficiency factor,  $E$ .

$W$  = weld strength reduction factor (see para. 102.4.7)

Also see requirements in para. 123.4 and Table 102.4.3.

## 104.2 Curved Segments of Pipe

**104.2.1 Pipe Bends.** Pipe bends shall be subject to the following limitations:

(A) The minimum wall thickness shall meet the requirements of para. 102.4.5 and the fabrication requirements of para. 129.

(B) Limits on flattening and buckling at bends may be specified by design, depending upon the service, the material, and the stress level involved. Where limits on flattening and buckling are not specified by design, the requirements of para. 129.1 shall be met.

**104.2.2 Elbows.** Elbows manufactured in accordance with the standards listed in Table 126.1 are suitable for use at the pressure-temperature ratings specified by such standards, subject to the requirements of para. 106.

## 104.3 Intersections

### 104.3.1 Branch Connections

(12)

(A) This paragraph gives rules governing the design of branch connections to sustain internal and external pressure in cases where the axes of the branch and the run intersect, and the angle between the axes of the branch and of the run is between 45 deg and 90 deg, inclusive.

Branch connections in which the smaller angle between the axes of the branch and the run is less than 45 deg or branch connections where the axes of the branch and the run do not intersect impose special design and fabrication problems. The rules given herein may be used as a guide, but sufficient additional strength must be provided to ensure safe service. Such branch connections shall be designed to meet the requirement of para. 104.7.

(B) Branch connections in piping may be made from materials listed in Mandatory Appendix A by the use of the following:

(B.1) fittings, such as tees, laterals, and crosses made in accordance with the applicable standards listed in Table 126.1 where the attachment of the branch pipe to the fitting is by butt welding, socket welding, brazing, soldering, threading, or by a flanged connection.

(B.2) weld outlet fittings, such as cast or forged nozzles, couplings and adaptors, or similar items where the attachment of the branch pipe to the fitting is by butt welding, socket welding, threading, or by a flanged

connection. Such weld outlet fittings are attached to the run by welding similar to that shown in Fig. 127.4.8(E) or Fig. 127.4.8(F), as applicable. MSS SP-97 may be used for design and manufacturing standards for integrally reinforced forged branch outlet fittings. Couplings are restricted to a maximum of NPS 3.

(B.3) extruded outlets at right angles to the run pipe, in accordance with (G) below, where the attachment of the branch pipe is by butt welding.

(B.4) piping directly attached to the run pipe by welding in accordance with para. 127.4.8 or by socket welding or threading as stipulated below:

(B.4.1) socket welded right angle branch connections may be made by attaching the branch pipe directly to the run pipe provided.

(B.4.1.1) the nominal size of the branch does not exceed NPS 2 or one-fourth of the nominal size of the run, whichever is smaller.

(B.4.1.2) the depth of the socket measured at its minimum depth in the run pipe is at least equal to that shown in ASME B16.11. If the run pipe wall does not have sufficient thickness to provide the proper depth of socket, an alternate type of construction shall be used.

(B.4.1.3) the clearance between the bottom of the socket and the end of the inserted branch pipe is in accordance with Fig. 127.4.4(C).

(B.4.1.4) the size of the fillet weld is not less than 1.09 times the nominal wall thickness of the branch pipe.

(B.4.2) threaded right angle branch connections may be made by attaching the branch pipe directly to the run provided

(B.4.2.1) the nominal size of the branch does not exceed NPS 2 or one-fourth of the nominal size of the run, whichever is smaller.

(B.4.2.2) the minimum thread engagement is 6 full threads for NPS  $\frac{1}{2}$  and NPS  $\frac{3}{4}$  branches; 7 for NPS 1, NPS  $1\frac{1}{4}$ , and NPS  $1\frac{1}{2}$  branches; and 8 for NPS 2 branches. If the run pipe wall does not have sufficient thickness to provide the proper depth for thread engagement, an alternative type of construction shall be used.

(C) *Branch Connections Not Requiring Reinforcement.* A pipe having a branch connection is weakened by the opening that must be made in it. Unless the wall thickness of the branch and/or run pipe is sufficiently in excess of that required to sustain the pressure, it is necessary to provide additional material to meet the reinforcement requirements of (D) and (E) below. However, there are certain branch connections for which supporting calculations are not required. These are as follows:

(C.1) branch connections made by the use of a fitting (tee, lateral, cross, or branch weld-on fitting), manufactured in accordance with a standard listed in Table 126.1, and used within the limits of pressure-temperature ratings specified in that standard.

(C.2) branch connections made by welding a coupling or half coupling directly to the run pipe in accordance with Fig. 127.4.8(E), provided the nominal diameter of the branch does not exceed NPS 2 or one-fourth the nominal diameter of the run, whichever is less. The minimum wall thickness of the coupling anywhere in the reinforcement zone (if threads are in the zone, wall thickness is measured from the root of the thread to the minimum O.D.) shall not be less than that of the unthreaded branch pipe. In no case shall the thickness of the coupling be less than extra heavy or Class 3000 rating.

Small branch connections NPS 2 or smaller as shown in Fig. 127.4.8(F) may be used, provided  $t_w$  is not less than the thickness of schedule 160 pipe of the branch size.

(C.3) integrally reinforced fittings welded directly to the run pipe when the reinforcements provided by the fitting and the deposited weld metal meets the requirements of (D) below.

(C.4) integrally reinforced extruded outlets in the run pipe. The reinforcement requirements shall be in accordance with (G) below.

(D) *Branch Connections Subject to Internal Pressure Requiring Reinforcement*

(D.1) Reinforcement is required when it is not provided inherently in the components of the branch connection. This paragraph gives rules covering the design of branch connections to sustain internal pressure in cases where the angle between the axes of the branch and of the run is between 45 deg and 90 deg. Subparagraph (E) below gives rules governing the design of connections to sustain external pressure.

(D.2) Figure 104.3.1(D) illustrates the notations used in the pressure-temperature design conditions of branch connections. These notations are as follows:

$b$  = subscript referring to branch

$D_{ob}$  = outside diameter of branch, in. (mm)

$D_{oh}$  = outside diameter of header, in. (mm)

$d_1$  = inside centerline longitudinal dimension of the finished branch opening in the run of the pipe, in. (mm)

$= [D_{ob} - 2(T_b - A)]/\sin \alpha$

$d_2$  = "half width" of reinforcing zone, in. (mm)

$=$  the greater of  $d_1$  or  $(T_b - A) + (T_h - A) + d_1/2$  but in no case more than  $D_{oh}$ , in. (mm)


$h$  = subscript referring to run or header

$L_4$  = altitude of reinforcement zone outside of run, in. (mm)

$= 2.5(T_b - A) + t_r$  or  $2.5(T_h - A)$ , whichever is smaller

$t_r$  = thickness of attached reinforcing pad, in. (mm); or height of the largest 60 deg right triangle supported by the run and branch outside diameter projected surfaces and lying completely within

Fig. 104.3.1(D) Reinforcement of Branch Connections

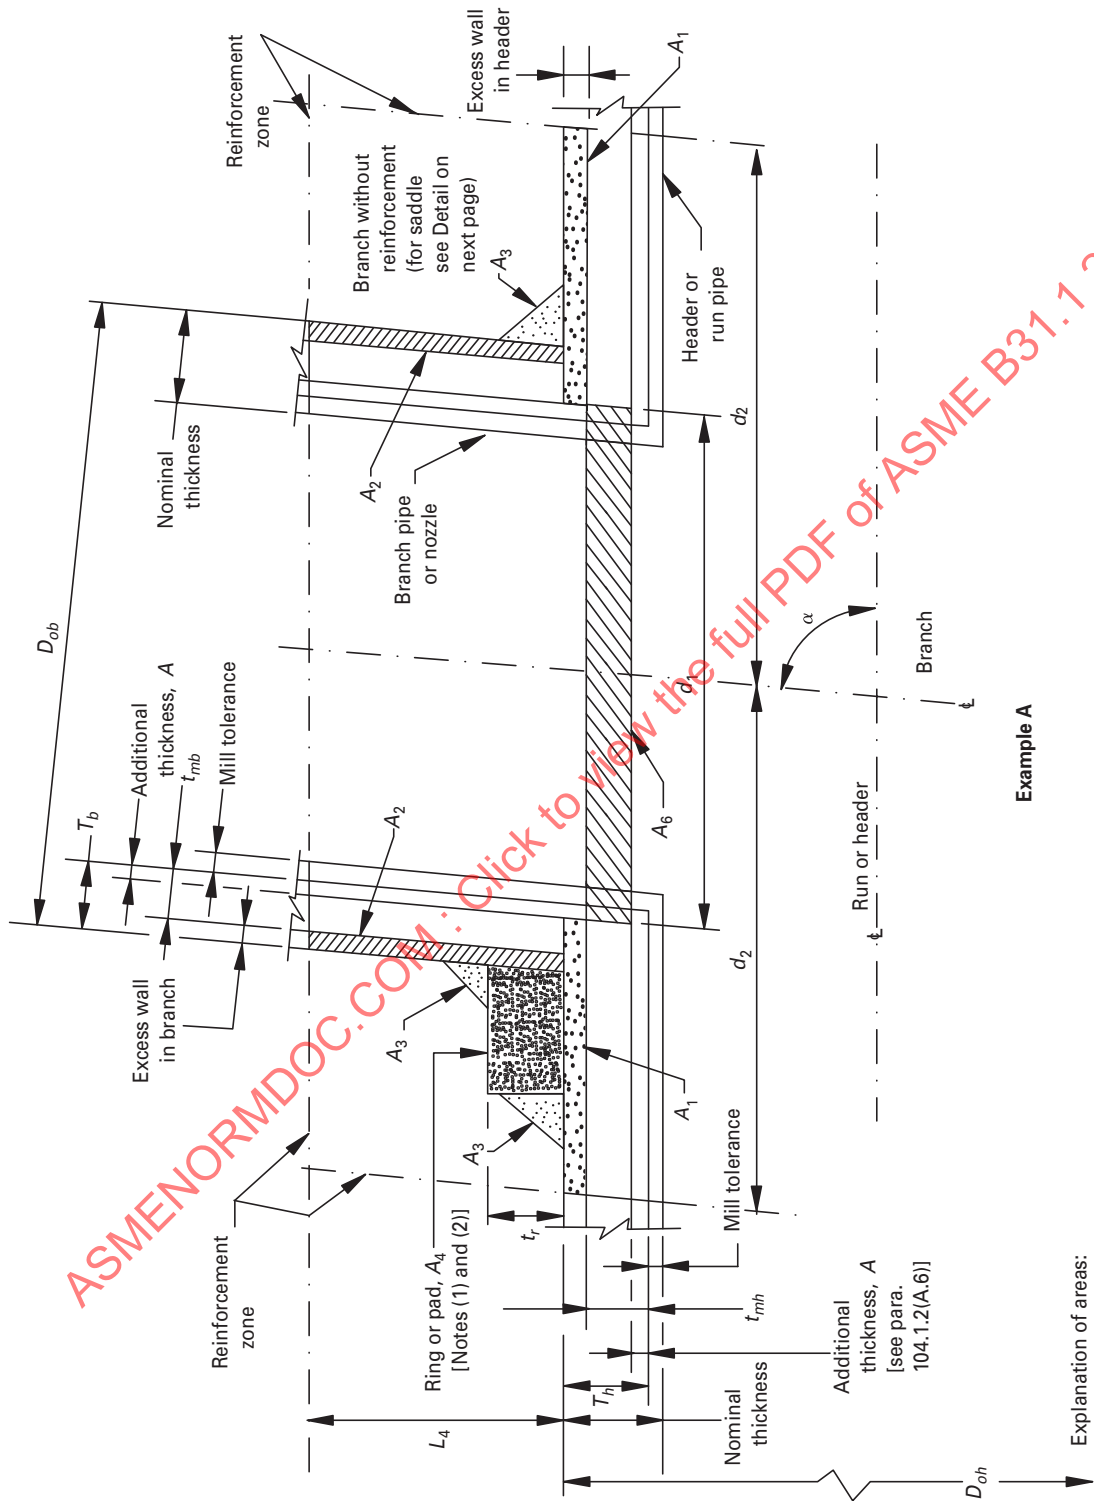


Example A

Explanation of areas:

- |  |                                                                   |  |                                                                         |
|--|-------------------------------------------------------------------|--|-------------------------------------------------------------------------|
|  | Area $A_1$ — available reinforcement area (excess wall) in header |  | Area $A_4$ — metal in ring, pad, or integral reinforcement              |
|  | Area $A_2$ — available reinforcement area (excess wall) in branch |  | Area $A_5$ — metal in saddle parallel to run (see Detail)               |
|  | Area $A_3$ — available reinforcement area fillet weld metal       |  | Area $A_6$ — pressure design area (expected at the end of service life) |

Fig. 104.3.1(D) Reinforcement of Branch Connections (Cont'd)

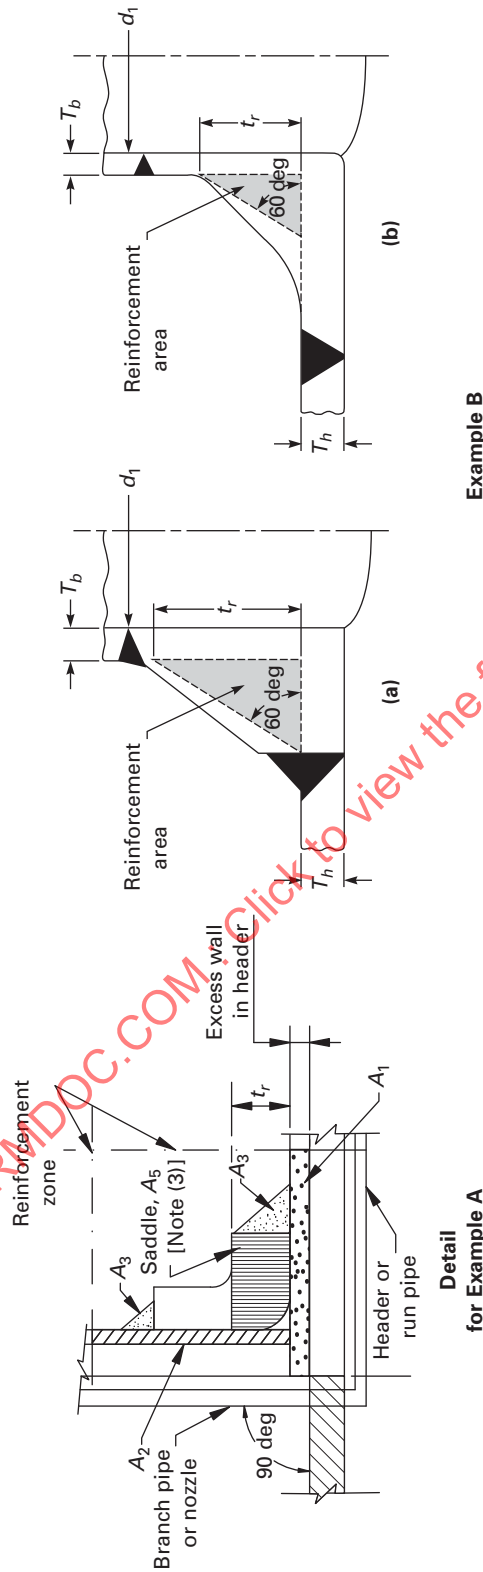

## GENERAL NOTES:

- This Figure illustrates the nomenclature of para. 104.3.1(D).
- Required reinforcement area  $= A_7 = A_6 (2 - \sin \alpha) = (t_{mh} - A)d_1 (2 - \sin \alpha)$ .
- Available reinforcement areas  $= A_1 + A_2 + A_3 + A_4 + A_5$  (as applicable).
- Available reinforcement areas  $\geq$  required reinforcement area.

## NOTES:

- When a ring or pad is added as reinforcement (Example A), the value of reinforcement area may be taken in the same manner in which excess header metal is considered, provided the weld completely fuses the branch pipe, header pipe, and ring or pad. Typical acceptable methods of welding which meet the above requirement are shown in Fig. 127.4.8(D), sketches (c) and (d).
- Width to height of rings and pads shall be reasonably proportioned, preferably on a ratio as close to 4:1 as the available horizontal space within the limits of the reinforcing zone along the run and the outside diameter of the branch will permit, but in no case may the ratio be less than 1:1.
- Reinforcement saddles are limited to use on 90 deg branches (Example A Detail).

the area of integral reinforcement, in Example B, in. (mm)

$T_b, T_h$  = actual wall thickness (by measurement) or the minimum wall thickness permissible under the purchase specification of the branch or header pipe, in. (mm)

$t_{mb}, t_{mh}$  = required minimum wall thickness, in. (mm), of the branch or header pipe as determined by use of eq. (7) or (8) in para. 104.1.2(A)

$\alpha$  = angle between axes of branch and run, deg

(D.2.1) If the run pipe contains a longitudinal seam that is not intersected by the branch, the stress value of seamless pipe of comparable grade may be used to determine the value of  $t_{mh}$  for the purpose of reinforcement calculations only. If the branch intersects a longitudinal weld in the run, or if the branch contains a weld, the weld joint efficiency for either or both shall enter the calculations. If the branch and run both contain longitudinal welds, care shall be taken to ensure that the two welds do not intersect each other.

(D.2.2) The required reinforcement area in square inches (square millimeters) for branch connections shall be the quantity

$$A_7 = A_6(2 - \sin \alpha) = (t_{mh} - A)d_1(2 - \sin \alpha)$$

For right angle connections, the required reinforcement becomes

$$A_7 = A_6 = (t_{mh} - A)d_1$$

The required reinforcement must be within the limits of the reinforcement zone as defined in (D.2.4) below.

(D.2.3) The reinforcement required by (D.2) shall be that provided by any combination of areas  $A_1, A_2, A_3, A_4$ , and  $A_5$ , as defined below and illustrated in Fig. 104.3.1(D) where

$A_1$  = area provided by excess pipe wall in the run  
 $= (2d_2 - d_1)(T_h - t_{mh})$

$A_2$  = area, in.<sup>2</sup> (mm<sup>2</sup>), provided by excess pipe wall in the branch for a distance  $L_4$  above the run  
 $= 2L_4(T_b - t_{mb})/\sin \alpha$

$A_3$  = area provided by deposited weld metal beyond the outside diameter of the run and branch, and for fillet weld attachments of rings, pads, and saddles

$A_4$  = area provided by a reinforcing ring, pad, or integral reinforcement. The value of  $A_4$  may be taken in the same manner in which excess header metal is considered, provided the weld completely fuses the branch pipe, run pipe, and ring or pad, or integral reinforcement. For welding branch connections refer to para. 127.4.8.

$A_5$  = area provided by a saddle on right angle connections

$$= (\text{O.D. of saddle} - D_{ob})t_r$$

$A_6$  = pressure design area expected at the end of service life

$$= (t_{mh} - A)d_1$$

Portions of the reinforcement area may be composed of materials other than those of the run pipe, but if the allowable stress of these materials is less than that for the run pipe, the corresponding calculated reinforcement area provided by this material shall be reduced in the ratio of the allowable stress being applied to the reinforcement area. No additional credit shall be taken for materials having higher allowable stress values than the run pipe.

(D.2.4) *Reinforcement Zone.* The reinforcement zone is a parallelogram whose width shall extend a distance  $d_2$  on each side of the centerline of the branch pipe, and whose altitude shall start at the inside surface of the run pipe and extend to a distance  $L_4$  from the outside surface of the run pipe.

(D.2.5) *Reinforcement of Multiple Openings.* It is preferred that multiple branch openings be spaced so that their reinforcement zones do not overlap. If closer spacing is necessary, the following requirement shall be met. The two or more openings shall be reinforced in accordance with (D.2), with a combined reinforcement that has a strength equal to the combined strength of the reinforcement that would be required for the separate openings. No portion of the cross section shall be considered as applying to more than one opening, or be evaluated more than once in a combined area.

When more than two adjacent openings are to be provided with a combined reinforcement, the minimum distance between centers of any two of these openings should preferably be at least  $1\frac{1}{2}$  times their average diameter, and the area of reinforcement between them shall be at least equal to 50% of the total required for these two openings.

(D.2.6) *Rings, Pads, and Saddles.* Reinforcement provided in the form of rings, pads, or saddles shall not be appreciably narrower at the side than at the crotch.

A vent hole shall be provided at the ring, pad, or saddle to provide venting during welding and heat treatment. Refer to para. 127.4.8(E).

Rings, pads, or saddles may be made in more than one piece, provided the joints between pieces have full thickness welds, and each piece is provided with a vent hole.

(D.2.7) *Other Designs.* The adequacy of designs to which the reinforcement requirements of para. 104.3 cannot be applied shall be proven by burst or proof tests on scale models or on full size structures, or by calculations previously substantiated by successful service of similar design.

(E) *Branch Connections Subject to External Pressure Requiring Reinforcement.* The reinforcement area in square inches (square millimeters) required for branch connections subject to external pressure shall be

$$0.5t_{mh}d_1(2 - \sin \alpha)$$

where  $t_{mh}$  is the required header wall thickness determined for straight pipe under external pressure, using procedures outlined in UG-28, UG-29, UG-30, and UG-31 of Section VIII, Division 1, of the ASME Boiler and Pressure Vessel Code.

Procedures established heretofore for connections subject to internal pressure shall apply for connections subject to external pressure provided that  $D_{oh}$ ,  $D_{ob}$ , and  $t_r$  are reduced to compensate for external corrosion, if required by design conditions.

(F) *Branch Connections Subject to External Forces and Moments.* The requirements of the preceding paragraphs are intended to ensure safe performance of a branch connection subjected only to pressure. However, when external forces and moments are applied to a branch connection by thermal expansion and contraction, by dead weight of piping, valves, and fittings, covering and contents, or by earth settlement, the branch connection shall be analyzed considering the stress intensification factors as specified in Mandatory Appendix D. Use of ribs, gussets, and clamps designed in accordance with para. 104.3.4 is permissible to stiffen the branch connection, but their areas cannot be counted as contributing to the required reinforcement area of the branch connection.

(G) *Extruded Outlets Integrally Reinforced*

(G.1) The following definitions, modifications, notations, and requirements are specifically applicable to extruded outlets. The designer shall make proper wall thickness allowances in order that the required minimum reinforcement is ensured over the design life of the system.

(G.2) *Definition.* An extruded outlet header is defined as a header in which the extruded lip at the outlet has an altitude above the surface of the run that is equal to or greater than the radius of curvature of the external contoured portion of the outlet; i.e.,  $h_o \geq r_o$ . See nomenclature and Fig. 104.3.1(G).

(G.3) These rules apply only to cases where the axis of the outlet intersects and is perpendicular to the axis of the run. These rules do not apply to any nozzle in which additional nonintegral material is applied in the form of rings, pads, or saddles.

(G.4) The notation used herein is illustrated in Fig. 104.3.1(G). All dimensions are in inches (millimeters).

$D_{ob}$  = outside diameter of branch pipe

$D_{oh}$  = outside diameter of run

$d_b$  = corroded internal diameter of branch pipe

$d_c$  = corroded internal diameter of extruded outlet measured at the level of the outside surface of the run

$d_r$  = corroded internal diameter of run

$h_o$  = height of the extruded lip. This must be equal to or greater than  $r_o$ , except as shown in (G.4.2) below.

$L_8$  = altitude of reinforcement zone

$$= 0.7\sqrt{D_{ob}T_o}$$

$T_b - A$  = actual wall thickness (by measurement) or the minimum wall thickness permissible under the purchase specification of the branch pipe minus the corrosion allowance, in. (mm)

$T_h - A$  = actual wall thickness (by measurement) or the minimum wall thickness permissible under the purchase specification of the header pipe minus the corrosion allowance, in. (mm)

$T_o$  = corroded finished thickness of extruded outlet measured at a height equal to  $r_o$  above the outside surface of the run

$t_{mb} - A$  = required thickness of branch pipe according to wall thickness eq. (7) or (8) in para. 104.1.2(A), but not including any thickness for corrosion

$t_{mh} - A$  = required thickness of the run according to eq. (7) or (8) in para. 104.1.2(A), but not including any allowance for corrosion

$r_1$  = half width of reinforcement zone (equal to  $d_c$ )


$r_o$  = radius of curvature of external contoured portion of outlet measured in the plane containing the axes of the run and branch. This is subject to the following limitations:

(G.4.1) *Minimum Radius.* This dimension shall not be less than  $0.05D_{ob}$  except that on branch diameters larger than NPS 30, it need not exceed 1.50 in. (38 mm).

(G.4.2) *Maximum Radius.* For outlet pipe sizes 6 in. (150 mm) nominal and larger, this dimension shall not exceed  $0.10D_{ob} + 0.50$  in. ( $0.10D_{ob} + 12.7$  mm). For outlet pipe sizes less than NPS 6, this dimension shall be not greater than 1.25 in. (32 mm).

(G.4.3) When the external contour contains more than one radius, the radius of any arc sector of approximately 45 deg shall meet the requirements of (G.4.1) and (G.4.2) above. When the external contour has a continuously varying radius, the radius of curvature at every point on the contour shall meet the requirements of (G.4.1) and (G.4.2) above.

(12)

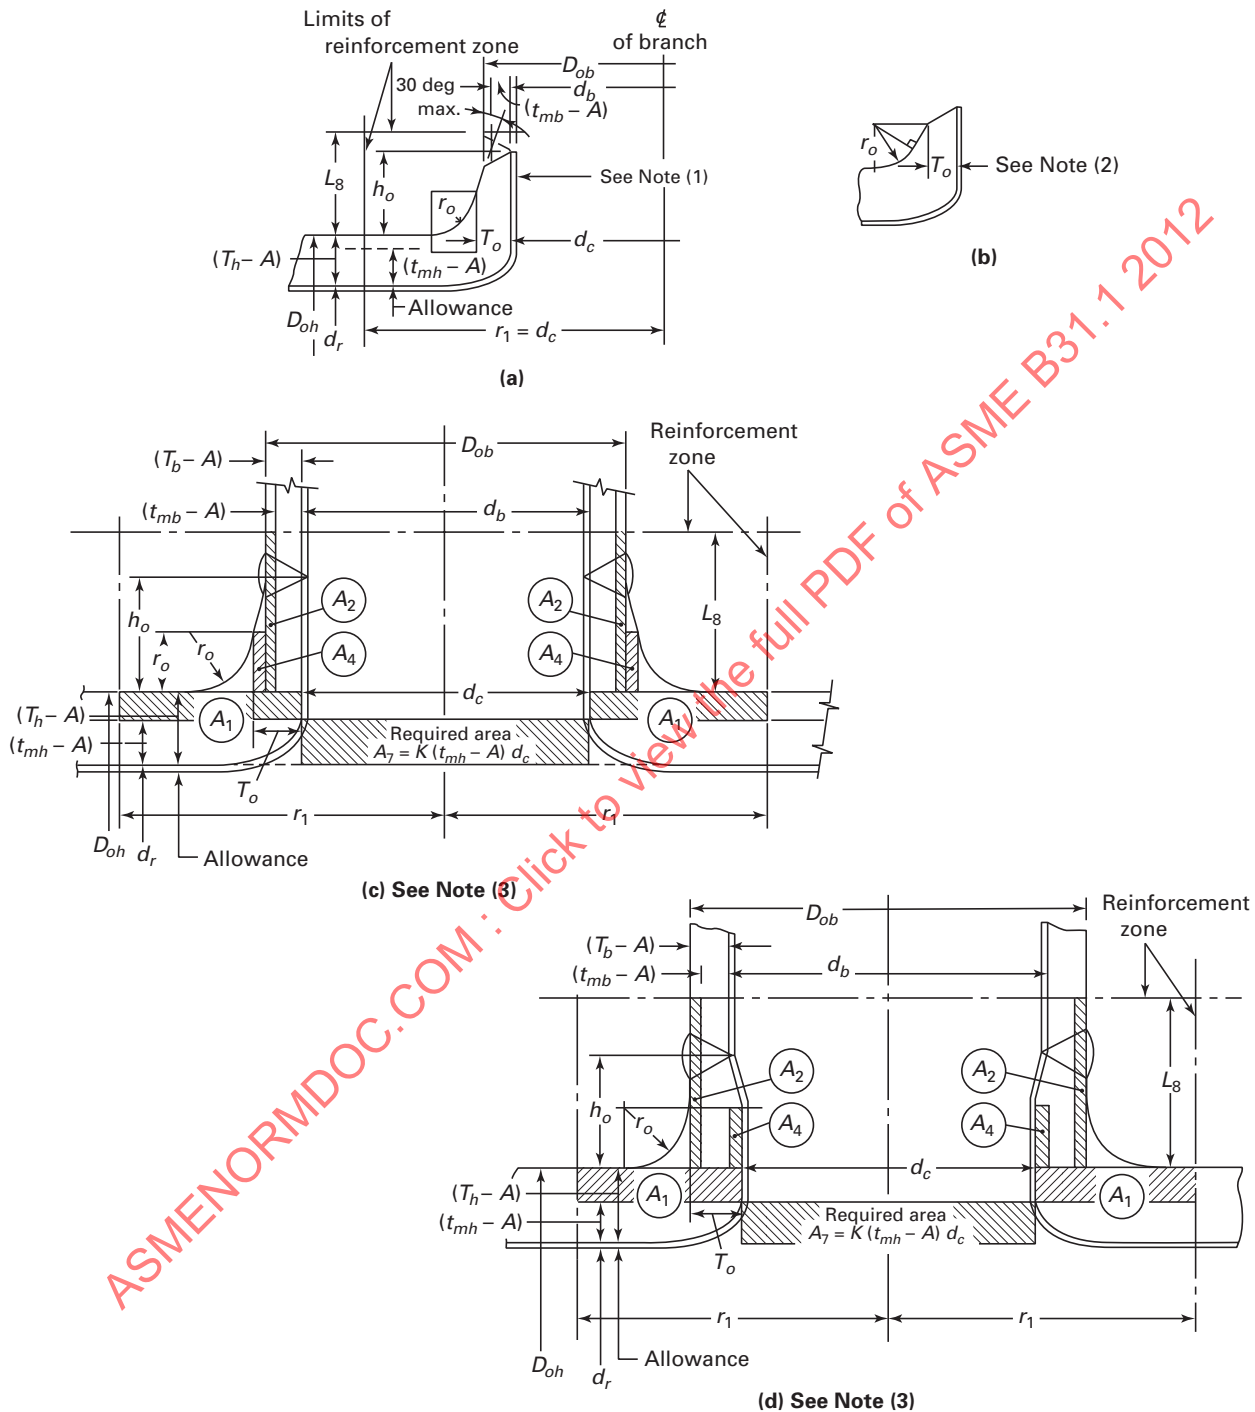**Fig. 104.3.1(G) Reinforced Extruded Outlets**

**NOTES:**

- (1) Taper bore inside diameter (if required) to match branch pipe 1:3 maximum taper.
- (2) Sketch to show method of establishing  $T_o$  when the taper encroaches on the crotch radius.
- (3) Sketch is drawn for condition where  $k = 1.00$ .

(G.4.4) Machining other than grinding for weld cleanup shall not be employed in order to meet the above requirements.

(G.5) *Required Area.* The required area is defined as

$$A_7 = K (t_{mh} - A) d_c$$

where  $K$  shall be taken as follows:

For  $D_{ob}/D_{oh}$  greater than 0.60,

$$K = 1.00$$

For  $D_{ob}/D_{oh}$  greater than 0.15 and not exceeding 0.60,

$$K = 0.6 + \frac{2}{3} D_{ob}/D_{oh}$$

For  $D_{ob}/D_{oh}$  equal to or less than 0.15,

$$K = 0.70$$

The design must meet criteria that the reinforcement area defined in (G.6) below is not less than the required area.

(G.6) *Reinforcement Area.* The reinforcement area shall be the sum of areas

$$A_1 + A_2 + A_4$$

as defined below.

(G.6.1) Area  $A_1$  is the area lying within the reinforcement zone resulting from any excess thickness available in the run wall.

$$A_1 = d_c(T_h - t_{mh})$$

(G.6.2) Area  $A_2$  is the area lying within the reinforcement zone resulting from any excess thickness available in the branch pipe wall.

$$A_2 = 2L_b(T_b - t_{mb})$$

(G.6.3) Area  $A_4$  is the area lying within the reinforcement zone resulting from excess thickness available in the extruded outlet lip.

$$A_4 = 2r_o [T_o - (T_b - A)]$$

(G.7) *Reinforcement of Multiple Openings.* It is preferred that multiple branch openings be spaced so that their reinforcement zones do not overlap. If closer spacing is necessary, the following requirements shall be met. The two or more openings shall be reinforced in accordance with (G) with a combined reinforcement that has a strength equal to the combined strength of the reinforcement that would be required for separate openings. No portion of the cross section shall be considered as applying to more than one opening, or be evaluated more than once in a combined area.

(G.8) In addition to the above, the manufacturer shall be responsible for establishing and marking on the section containing extruded outlets, the design pressure and temperature. The manufacturer's name or trademarks shall be marked on the section.

**104.3.3 Mitters.** Miter joints, and the terminology related thereto, are described in Mandatory Appendix D. A widely spaced miter with

$$\theta < 9 \sqrt{\frac{t_n}{r}} \text{ deg}$$

shall be considered to be equivalent to a girth butt-welded joint, and the rules of this paragraph do not apply. Miter joints, and fabricated pipe bends consisting of segments of straight pipe welded together, with  $\theta$  equal to or greater than this calculated value may be used within the limitations described below.

(A) Pressure shall be limited to 10 psi (70 kPa) under the following conditions:

(A.1) The assembly includes a miter weld with  $\theta > 22.5$  deg, or contains a segment that has a dimension

$$B < 6t_n$$

(A.2) The thickness of each segment of the miter is not less than that determined in accordance with para. 104.1.

(A.3) The contained fluid is nonflammable, non-toxic, and incompressible, except for gaseous vents to atmosphere.

(A.4) The number of full pressure cycles is less than 7,000 during the expected lifetime of the piping system.

(A.5) Full penetration welds are used in joining miter segments.

(B) Pressure shall be limited to 100 psi (700 kPa) under the conditions defined in (A.2), (A.3), (A.4), and (A.5) above, in addition to the following:

(B.1) the angle  $\theta$  does not exceed 22.5 deg

(B.2) the assembly does not contain any segment that has a dimension

$$B < 6t_n$$

(C) Mitters to be used in other services or at design pressures above 100 psi (700 kPa) shall meet the requirements of para. 104.7.

(C.1) When justification under para. 104.7 is based on comparable service conditions, such conditions must be established as comparable with respect to cyclic as well as static loadings.

(C.2) When justification under para. 104.7 is based on an analysis, that analysis and substantiating tests shall consider the discontinuity stresses that exist at the juncture between segments; both for static (including brittle fracture) and cyclic internal pressure.

(C.3) The wall thickness,  $t_s$ , of a segment of a miter shall not be less than specified in (C.3.1) or (C.3.2) below, depending on the spacing.

(C.3.1) For closely spaced miter bends (see Mandatory Appendix D for definition)

$$t_s = t_m \frac{2 - r/R}{2(1 - r/R)}$$

(C.3.2) For widely spaced miters (see Mandatory Appendix D for definition)

$$t_s = t_m(1 + 0.64\sqrt{r/t_s} \tan \theta)$$

(The above equation requires an iterative or quadratic solution for  $t_s$ .)

**104.3.4 Attachments.** External and internal attachments to piping shall be designed so as not to cause flattening of the pipe, excessive localized bending stresses, or harmful thermal gradients in the pipe wall. It is important that such attachments be designed to minimize stress concentrations in applications where the number of stress cycles, due either to pressure or thermal effect, is relatively large for the expected life of the equipment.

#### 104.4 Closures

**104.4.1 General.** Closures for power piping systems shall meet the applicable requirements of this Code and shall comply with the requirements described in (A) or (B) below. Closures may be made

(A) by use of closure fittings, such as threaded or welded plugs, caps, or blind flanges, manufactured in accordance with standards listed in Table 126.1, and used within the specified pressure-temperature ratings, or

(B) in accordance with the rules contained in the ASME Boiler and Pressure Vessel Code, Section I, Power Boilers, PG-31, or Section VIII, Pressure Vessels, Division 1, UG-34 and UW-13, calculated from

$$t_m = t + A$$

where

$t$  = pressure design thickness, calculated for the given closure shape and direction of loading using appropriate equations and procedures in Section I or Section VIII, Division 1 of the ASME Boiler and Pressure Vessel Code

The definition of  $A$  and the symbols used in determining  $t$  shall have the definitions shown herein, instead of those given in the ASME Boiler and Pressure Vessel Code.

Attachment of a welded flat permanent closure with only a single fillet weld is not permitted.

**104.4.2 Openings in Closures.** Openings in closures may be made by welding, extruding, or threading.

Attachment to the closure shall be in accordance with the limitations provided for such connections in para. 104.3.1 for branch connections. If the size of the opening is greater than one-half of the inside diameter of the closure, the opening shall be designed as a reducer in accordance with para. 104.6.

Other openings in closures shall be reinforced in accordance with the requirements of reinforcement for a branch connection. The total cross-sectional area required for reinforcement in any plane passing through the center of the opening and normal to the surface of the closure shall not be less than the quantity of  $d_5 t$ , where

$d_5$  = diameter of the finished opening, in. (mm)

$t$  = as defined in (B) above

#### 104.5 Pressure Design of Flanges and Blanks

##### 104.5.1 Flanges — General

(A) Flanges of sizes NPS 24 and smaller, that are manufactured in accordance with ASME B16.1 and B16.5, shall be considered suitable for use at the primary service ratings (allowable pressure at service temperature) except the slip-on flanges to ASME B16.5 shall be limited in application to no higher than Class 300 primary pressure service rating. Refer to para. 127.4.4.

For flanges larger than NPS 24, and manufactured in accordance with the Specifications and Standards listed in Table 126.1, the designer is cautioned about the dimensionally different designs that are available, as well as the limitations of their application.

Flanges not made in accordance with the Specifications and Standards listed in Table 126.1 shall be designed in accordance with Section VIII, Division 1 of the ASME Boiler and Pressure Vessel Code, except that the requirements for fabrication, assembly, inspection, and testing, and the pressure and temperature limits for materials of this Code for Pressure Piping shall govern. Certain notations used in the ASME Code, namely,  $P$ ,  $S_a$ ,  $S_b$ , and  $S_f$ , shall have the meanings described below instead of those given in the ASME Code. All other notations shall be as defined in the ASME Code.

$P$  = design pressure, psi (kPa) (see paras. 101.2.2 and 101.2.4)


$S_a$  = bolt design stress at atmospheric temperature, psi (kPa)

$S_b$  = bolt design stress at design temperature, psi (kPa)

$S_f$  = allowable stress for flange material or pipe, psi (kPa) (see para. 102.3.1 and Allowable Stress Tables) (stress values converted from MPa to kPa)

For certain specific applications, see the limitations of paras. 122.1.1(F), (G), and (H).

Fig. 104.5.3 Types of Permanent Blanks

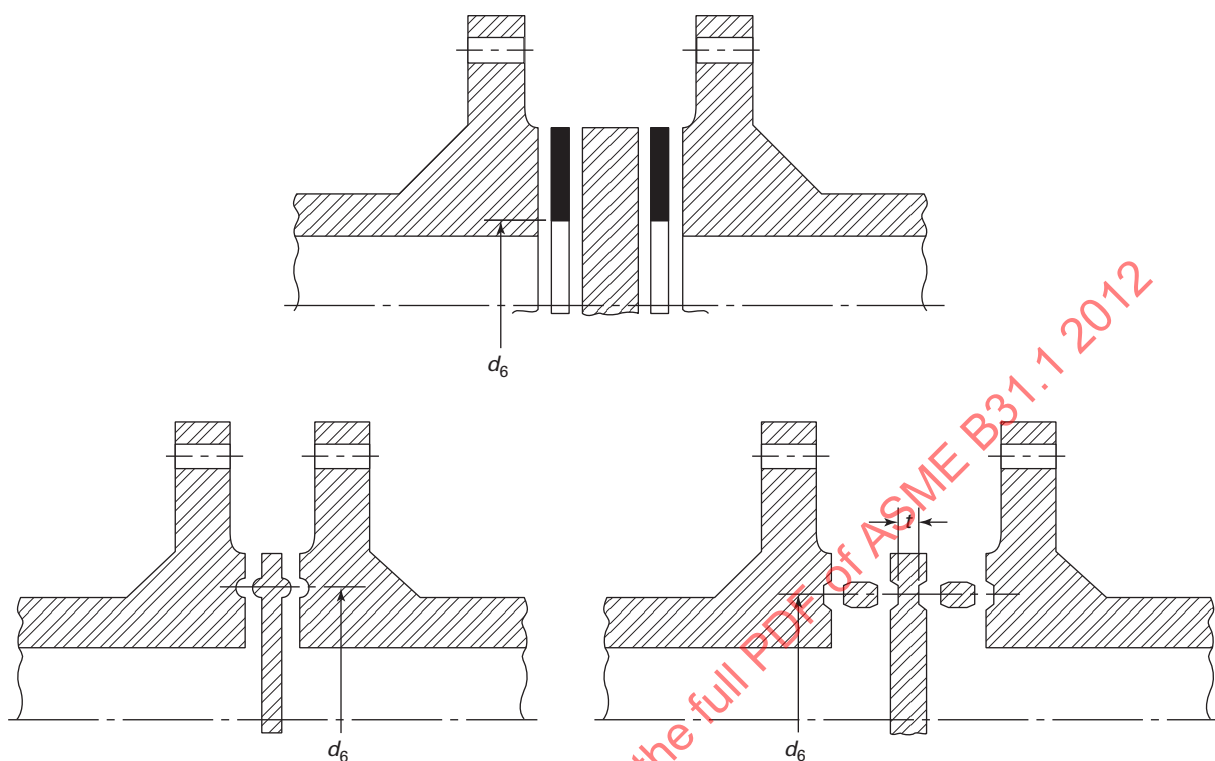

(B) These flange design rules are not applicable to flat face designs employing full face gaskets that extend beyond the bolts.

(C) The bolt design stress in (A) above shall be as established in Section VIII, Division 1 of the ASME Boiler and Pressure Vessel Code, Nonmandatory Appendix P for ferrous materials.

(D) Application of bolting materials for flanged joints is covered in para. 108.5.

#### 104.5.2 Blind Flanges

(A) Blind flanges manufactured in accordance with the standards listed in Table 126.1 shall be considered suitable for use at the pressure-temperature rating specified by such standards.

(B) The required thickness of blind flanges not manufactured in accordance with standards in Table 126.1 shall be calculated from eq. (13).

$$t_m = t + A \quad (13)$$

where

$t$  = pressure design thickness as calculated for the given style of blind flange from the appropriate equations for bolted flat cover plates in Section I of the ASME Boiler and Pressure Vessel Code. Certain notations used in these equations, namely,  $P$  and  $SE$  [see para. 104.1.2(A),

footnote 3], shall be considered to have the meanings described in para. 104.1.2(A) instead of those given in the ASME Code. All other notations shall be as defined in the ASME Code.

#### 104.5.3 Blanks

(A) The required thickness of permanent blanks (see Fig. 104.5.3) shall be calculated from the equation

$$t_m = t + A$$

where

$t$  = pressure design thickness as calculated from eq. (14)

$$t = d_6 \sqrt{\frac{3P}{16SE}} \quad (14)$$

See para. 104.1.2(A), footnote 3.

$d_6$  = inside diameter of gasket for raised or flat (plain) face flanges, or the gasket pitch diameter for retained gasketed flanges, in. (mm)

(B) Blanks to be used for test purposes only shall have a minimum thickness not less than the pressure design thickness  $t$  specified above except that  $P$  shall be not less than the test pressure and  $SE$  [see para. 104.1.2(A), footnote 3] may be taken as the specified minimum yield strength of the blank material if the test fluid is incompressible.

(C) Attachment of a welded flat permanent blank with only a single fillet weld is not permitted.

#### 104.6 Reducers

Flanged reducer fittings manufactured in accordance with the Standards listed in Table 126.1 shall be considered suitable for use at the specified pressure-temperature ratings. Where butt welding reducers are made to a nominal pipe thickness, the reducers shall be considered suitable for use with pipe of the same nominal thickness.

#### 104.7 Other Pressure-Containing Components

**104.7.1** Pressure-containing components manufactured in accordance with the standards listed in Table 126.1 shall be considered suitable for use under normal operating conditions at or below the specified pressure-temperature ratings. However, the user is cautioned that where certain standards or manufacturers may impose more restrictive allowances for variation from normal operation than those established by this Code, the more restrictive allowances shall apply.

- (12) **104.7.2 Specially Designed Components.** The pressure design of components not covered by the standards listed in Table 126.1 or for which design formulas and procedures are not given in this Code shall be based on calculations consistent with the design criteria of this Code. These calculations shall be substantiated by one or more of the means stated in (A), (B), (C), and (D) below.

(A) extensive, successful service experience under comparable conditions with similarly proportioned components of the same or similar material

(B) experimental stress analysis, such as described in the ASME Boiler and Pressure Vessel Code, Section VIII, Division 2, Annex 5-F

(C) proof test in accordance with either ASME B16.9; MSS SP-97; or the ASME Boiler and Pressure Vessel Code, Section I, A-22

(D) detailed stress analysis, such as finite element method, in accordance with the ASME Boiler and Pressure Vessel Code, Section VIII, Division 2, Part 5, except that the basic material allowable stress from the Allowable Stress Tables of Mandatory Appendix A shall be used in place of  $S_m$

For any of (A) through (D) above, it is permissible to interpolate between sizes, wall thicknesses, and pressure classes and to determine analogies among related materials.

Calculations and documentation showing compliance with this paragraph shall be available for the owner's approval, and, for boiler external piping, they shall be available for the Authorized Inspector's review.

#### (12) 104.8 Analysis of Piping Components

To validate a design under the rules in this paragraph, the complete piping system must be analyzed between

anchors for the effects of thermal expansion, weight, other sustained loads, and other occasional loads. Each component in the system must meet the limits in this paragraph. For pipe and fittings, the pressure term in eqs. (15) and (16) may be replaced with the alternative term for  $S_{lp}$  as defined in para. 102.3.2(A.3). The pressure term in eqs. (15) and (16) may not apply for bellows and expansion joints. When evaluating stresses in the vicinity of expansion joints, consideration must be given to actual cross-sectional areas that exist at the expansion joint.

**104.8.1 Stress Due to Sustained Loads.** The effects of pressure, weight, and other sustained mechanical loads shall meet the requirements of eq. (15).

(U.S. Customary Units)

$$S_L = \frac{PD_o}{4t_n} + \frac{0.75iM_A}{Z} \leq 1.0 S_h \quad (15)$$

(SI Units)

$$S_L = \frac{PD_o}{(1\,000)4t_n} + \frac{0.75iM_A}{Z} \leq 1.0 S_h$$

where

$i$  = stress intensification factor (see Mandatory Appendix D). The product  $0.75i$  shall never be taken as less than 1.0.

$M_A$  = resultant moment loading on cross section due to weight and other sustained loads, in-lb (mm-N) (see para. 104.8.4)

$S_h$  = basic material allowable stress at maximum (hot) temperature [see para. 102.3.2(D)]

$S_L$  = sum of the longitudinal stresses due to pressure, weight, and other sustained loads

$Z$  = section modulus, in.<sup>3</sup> (mm<sup>3</sup>) (see para. 104.8.4)

**104.8.2 Stress Due to Occasional Loads.** The effects of pressure, weight, other sustained loads, and occasional loads including earthquake shall meet the requirements of eq. (16).

(U.S. Customary Units)

$$\frac{PD_o}{4t_n} + \frac{0.75iM_A}{Z} + \frac{0.75iM_B}{Z} \leq kS_h \quad (16)$$

(SI Units)

$$\frac{PD_o}{(1\,000)4t_n} + \frac{0.75iM_A}{Z} + \frac{0.75iM_B}{Z} \leq kS_h$$

Terms same as para. 104.8.1, except

$k$  = 1.15 for occasional loads acting for no more than 8 hr at any one time and no more than 800 hr/yr [see para. 102.3.3(A)]

= 1.2 for occasional loads acting for no more than 1 hr at any one time and no more than 80 hr/yr [see para. 102.3.3(A)]

$M_B$  = resultant moment loading on the cross section due to occasional loads, such as thrusts from relief/safety valve loads, from pressure and flow transients, and earthquake, in.-lb (mm-N) [see paras. 102.3.3(A) and 104.8.4]

### 104.8.3 Stress Due to Displacement Load Ranges.

The effects of thermal expansion and other cyclic loads shall meet the requirements of eq. (17).

(U.S. Customary Units)

$$S_E = \frac{iM_C}{Z} \leq S_A \quad (17)$$

(SI Units)

$$S_E = \frac{1\,000(iM_C)}{Z} \leq S_A$$

Terms same as para. 104.8.1, except

$M_C$  = resultant moment loading range on the cross section due to the reference displacement load range. For flexibility analyses, the resultant moment due to the ambient to normal operating load range and eq. (1A) are typically used, in.-lb (mm-N) [see paras. 102.3.2(B), 104.8.4, and 119.7].

### 104.8.4 Moments and Section Modulus

(A) For eqs. (15), (16), and (17), the resultant moments for straight through components, curved pipe, or welding elbows may be calculated as follows:

$$M_j = (M_{xj}^2 + M_{yj}^2 + M_{zj}^2)^{1/2}$$

where

$j = A, B, \text{ or } C$  as defined in paras. 104.8.1, 104.8.2, and 104.8.3

$Z$  = section modulus of piping, in.<sup>3</sup> (mm<sup>3</sup>)

(B) For full outlet branch connections, calculate the resultant moment of each leg separately in accordance with (A) above. Use  $Z$ , section modulus, in eqs. (15), (16), and (17) as applicable to branch or run pipe. Moments are taken at the junction point of the legs. See Fig. 104.8.4.


(C) For reduced outlets, calculate the resultant moment of each leg separately in accordance with (A) above. Moments are to be taken at the junction point of the legs, unless the designer can demonstrate the validity of a less conservative method. See Fig. 104.8.4. For the reduced outlet branch, except for branch connections covered by Fig. D-1,

$$M_A, M_B, \\ M_C = \sqrt{M_{x3}^2 + M_{y3}^2 + M_{z3}^2}$$

and

$$Z = \pi r_b^2 t_e \text{ (effective section modulus)}$$

**Fig. 104.8.4 Cross Section Resultant Moment Loading**

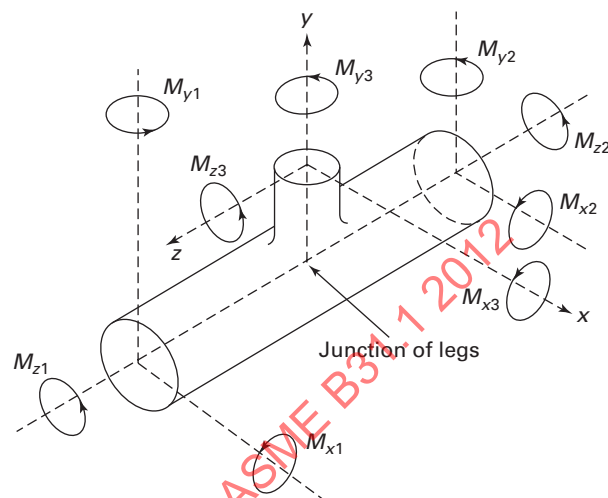

$r_b$  = branch mean cross-sectional radius, in. (mm)

$t_e$  = effective branch wall thickness, in. (mm)  
= lesser of  $t_{nh}$  or  $i t_{nb}$  in eq. (17), or lesser of  $t_{nh}$  or  $0.75 i t_{nb}$ , where  $0.75 i \geq 1.0$ , in eqs. (15) and (16)

For the reduced outlet branch connections covered by Fig. D-1,

$$M_A, M_B, \\ M_C = \sqrt{M_{x3}^2 + M_{y3}^2 + M_{z3}^2}$$

and

$$Z = \pi r_m^2 T_b$$

If  $L_1$  in Fig. D-1, sketches (a), (b), and (c) equals or exceeds  $0.5 \sqrt{r_i T_b}$ , then  $r'_m$  can be taken as the radius to the center of  $T_b$  when calculating the section modulus and the stress intensification factor. For such a case, the transition between branch pipe and nozzle must be evaluated separately from the branch connection.

For the main run outlets,

$$M_A, M_B, \\ M_C = \sqrt{M_{x1}^2 + M_{y1}^2 + M_{z1}^2} \\ = \sqrt{M_{x2}^2 + M_{y2}^2 + M_{z2}^2}$$

and

$$Z = \text{section modulus of pipe, in.}^3 \text{ (mm}^3\text{)}$$

## PART 3 SELECTION AND LIMITATIONS OF PIPING COMPONENTS

### 105 PIPE

#### 105.1 General

Pipe conforming to the standards and specifications listed in Mandatory Appendix A shall be used within the range of temperatures for which allowable stresses are given within the limitations specified herein.

#### 105.2 Metallic Pipe

##### 105.2.1 Ferrous Pipe

(A) Furnace butt welded steel pipe shall not be used for flammable, combustible, or toxic fluids.

(B) Ductile iron pipe may be used for design pressures within the ratings established by the standards and specifications listed in Tables 126.1 and A-5 and Notes thereto, and the limitations herein and in para. 124.6. Ductile iron pipe shall not be used for flammable, combustible, or toxic fluids. Temperature limits for the use of ductile iron pipe are often determined by the type of elastomeric gasket used in the pipe joints, or the lining material used on the internal surface of the pipe. It is the responsibility of the Designer to determine whether these components are suitable for use in the particular application being considered. See para. 106.1(E).

##### 105.2.2 Nonferrous Pipe

(A) Copper and brass pipe for water and steam service may be used for design pressures up to 250 psi (1 750 kPa) and for design temperatures to 406°F (208°C).

(B) Copper and brass pipe for air may be used in accordance with the allowable stresses given in the Allowable Stress Tables.

(C) Copper tubing may be used for dead-end instrument service with the limitations stated in para. 122.3.2(D).

(D) Copper, copper alloy, or aluminum alloy pipe or tube may be used under the conditions stated in para. 124.7. Copper, copper alloy, or aluminum pipe or tube shall not be used for flammable, combustible, or toxic fluids except as permitted in paras. 122.7 and 122.8.

#### 105.3 Nonmetallic Pipe

(A) Plastic pipe may be used for water and nonflammable liquids where experience or tests have demonstrated that the plastic pipe is suitable for the service conditions, and the pressure and temperature conditions are within the manufacturer's recommendations. Until such time as mandatory rules are established for these materials, pressure shall be limited to 150 psi (1 000 kPa) and temperature to 140°F (60°C) for water service. Pressure and temperature limits for other services shall be based on the hazards involved, but in no application shall they exceed 150 psi (1 000 kPa) and 140°F (60°C).

For nonmandatory rules for nonmetallic piping, see Nonmandatory Appendix III of this Code.

(B) Reinforced thermosetting resin pipe may be used, in addition to the services listed in para. 105.3(A), in buried flammable and combustible liquid service subject to the limitations described in para. 122.7.3(F).

(C) Reinforced concrete pipe may be used in accordance with the specifications listed in Table 126.1 for water service up to 150°F (65°C).

(D) A flexible nonmetallic pipe or tube assembly may be used in applications where

(D.1) satisfactory service experience exists

(D.2) the pressure and temperature conditions are within the manufacturer's recommendations

(D.3) the conditions described in paras. 104.7, 124.7, and 124.9 are met

(E) Polyethylene pipe may be used, in addition to the services listed in para. 105.3(A), in buried flammable and combustible liquid and gas service subject to the limitations described in paras. 122.7.2(D) and 122.8.1(B.4).

(F) Metallic piping lined with nonmetals may be used for fluids that would corrode or be contaminated by unprotected metal. See para. 122.9 and Nonmandatory Appendix III.

### 106 FITTINGS, BENDS, AND INTERSECTIONS

#### 106.1 Fittings

(12)

(A) Threaded, flanged, grooved and shouldered socket-welding, butt-welding, compression, push-on, mechanical gland, and solder-joint fittings made in accordance with the applicable standards in Table 126.1 may be used in power piping systems within the material, size, pressure, and temperature limitations of those standards, and within any further limitations specified in this Code. Material for fittings in flammable, combustible, or toxic fluid systems shall in addition conform to the requirements of paras. 122.7 and 122.8.

(B) Fittings not covered by the Standards listed in Table 126.1 may be used if they conform to para. 104.7.

(C) Cast butt-welding steel fittings not covered by the dimensional standards listed in Table 126.1 may be used up to the manufacturer's pressure and temperature ratings, provided they are radiographed in accordance with MSS SP-54. Fittings with discontinuities in excess of those permitted by MSS SP-54 shall be rejected. The purchaser may allow the repair of a rejected fitting provided it is reexamined and accepted in accordance with the requirements of MSS SP-54.

(D) Fabricated ends for grooved and shouldered type joints are acceptable, provided they are attached by full penetration welds, double fillet welds, or by threading. Fabricated ends attached by single fillet welds are not acceptable.

(E) Elastomeric gasket bell end fittings complying with applicable standards listed in Table 126.1 may be used for water service. Temperature limits for gray and ductile iron fittings using ANSI/AWWA C111/A21.11 joints are 65°C (150°F) for push-on joints and 49°C (120°F) for mechanical joints, based on standard water service gasket and lining materials. Fittings of this type using alternative materials, as allowed by AWWA C111, may be used for nonflammable, nontoxic service to 100°C (212°F), where suitability for the fluid and operating conditions has been established by test or experience. Temperature limits for bell and spigot fittings in nonmetallic pipe shall be per para. 105.3.

## 106.2 Bends and Intersections

Bends and extruded branch connections may be used when designed in accordance with the provisions of paras. 104.2 and 104.3, respectively. Miters may be used within the limitations of para. 104.3.3.

## 106.3 Pipe Couplings and Unions

(A) Cast iron and malleable iron pipe couplings shall be limited in application as referenced in paras. 124.4 and 124.5, respectively.

(B) Straight thread couplings shall not be used.

(C) Class 3000 steel pipe unions constructed in accordance with the MSS standard SP-83 may be used, provided the system design conditions are within the standard's listed pressure-temperature ratings.

## 106.4 Flexible Metal Hose Assembly

(A) Flexible metal hose assemblies may be used to provide flexibility in a piping system, to isolate or control vibration, or to compensate for misalignment. The design conditions shall be in accordance with para. 101 and within the limitations of the assembly as recommended by the manufacturer. The basis for their application shall include the following service conditions: thermal cycling, bend radius, cycle life, and the possibility of corrosion and erosion. Installation shall be limited to a single-plane bend, free from any torsion effects during service conditions and nonoperating periods. Type of end-connector components shall be consistent with the requirements of this Code.

(B) A flexible metal hose assembly, consisting of one continuous length of seamless or butt welded tube with helical or annular corrugations, is not limited as to application in piping systems that are within the scope of this Code, provided that the conditions described in (A) above are met. For application subject to internal pressure the flexible element shall be contained within one or more separate layers of braided metal permanently attached at both coupling ends by welding or brazing. For application in toxic fluid systems, it is recommended that the designer also review the standards

published by the relevant fluid industry for any additional safety and materials requirements that may be necessary.

(C) A flexible metal hose assembly consisting of wound interlocking metal strips may be applied to atmospheric vent systems only and shall not be used in systems that convey high temperature, flammable, toxic, or searching-type fluids. Where applicable, as determined by the designer and within the limitations described in para. 122.6 and those imposed by the manufacturer, this type of hose assembly may be used at pressure relieving devices.

## 107 VALVES

### 107.1 General

(A) Valves complying with the standards and specifications listed in Table 126.1 shall be used within the specified pressure-temperature ratings. Unless otherwise required in the individual standards and specifications listed in Table 126.1, such steel valves shall be pressure tested in accordance with MSS SP-61.

(B) Valves not complying with (A) above shall be of a design, or equal to the design, that the manufacturer recommends for the service as stipulated in para. 102.2.2. Such valves shall be pressure tested in accordance with MSS SP-61.

(C) Some valves are capable of sealing simultaneously against a pressure differential between an internal cavity of the valve and the adjacent pipe in both directions. Where liquid is entrapped in such a valve and is subsequently heated, a dangerous rise in pressure can result. Where this condition is possible, the owner shall provide means in design, installation, and/or operation to ensure that the pressure in the valve shall not exceed the rated pressure for the attained temperature. A relief device used solely for the overpressure protection from such entrapped fluid and conforming to (A) or (B) above need not comply with the requirements of para. 107.8. Any penetration of the pressure retaining wall of the valve shall meet the requirements of this Code.

(D) Only valves designed such that the valve stem is retained from blowout by an assembly that functions independently of the stem seal retainer shall be used.

(E) Materials used for pressure retention for valves in flammable, combustible, or toxic fluid systems shall in addition conform to the requirements of paras. 122.7 and 122.8.

(F) When selecting diaphragm valves in accordance with MSS standard SP-88, the designer shall specify the proper category pressure-temperature rating for the system design conditions, and should consider the expected in-service and shelf lives of the diaphragm material.

(G) Pressure regulating valves may have pressure ratings in accordance with ANSI/FCI Standard 79-1. Regulators having two static pressure ratings, i.e., inlet vs. outlet, shall be installed with adequate overpressure protection devices to prevent excessive downstream pressure resulting from any system failure. Refer to paras. 122.5 and 122.14.

## 107.2 Marking

Each valve shall bear the manufacturer's name or trademark and reference symbol to indicate the service conditions for which the manufacturer guarantees the valve. The marking shall be in accordance with ASME B16.5 and B16.34. MSS SP-25 may also be used for guidance.

## 107.3 Ends

Valves may be used with flanged, threaded, butt welding, socket welding, or other ends in accordance with applicable standards as specified in para. 107.1(A).

## 107.4 Stem Threads

Where threaded stem valves are used, stem threads may be internal or external with reference to the valve bonnet. Outside screw and yoke design shall be used for valves NPS 3 and larger for pressures above 600 psi (4 135 kPa). This requirement is not applicable to quarter-turn valves that comply with all other provisions of this Code.

## 107.5 Bonnet Joints

Bonnet joints may be of flanged, welded, pressure seal, union type, or other design, except that screwed bonnet connections in which the seal depends on a steam tight threaded joint shall not be permitted as source valves in steam service at pressures above 250 psi (1 750 kPa).

## 107.6 Bypasses

Sizes of bypasses shall be in accordance with MSS SP-45 as a minimum standard. Pipe for bypasses shall be at least schedule 80 seamless, and of a material of the same nominal chemical composition and physical properties as that used for the main line. Bypasses may be integral or attached.

## (12) 107.8 Pressure-Relieving Valves and Devices

**107.8.1 General.** Pressure-relieving valves and devices shall conform to the requirements specified in this Code for flanges, valves, and fittings for the pressures and temperatures to which they may be subjected.

**107.8.2 Pressure-Relieving Valves on Boiler External Piping.** Safety, safety-relief, and power-actuated pressure-relieving valves on boiler external piping shall be in accordance with para. 122.1.7(D.1) of this Code.

## 107.8.3 Pressure Relief Requirements on Nonboiler External Piping

(A) Reheater safety valves on reheat piping shall conform to para. 122.1.7(D.1).

(B) Safety, safety-relief, relief, and pilot-operated pressure relief valves shall be in accordance with UG-126 of ASME Boiler and Pressure Vessel Code, Section VIII, Division 1.

(C) Nonreclosing pressure relief devices, such as rupture disks, pin devices/valves, and spring-loaded nonreclosing devices shall be in accordance with UG-127 of Section VIII, Division 1.

(D) Valves and devices in (B) and (C) above shall be constructed, manufactured, rated, and marked in accordance with the requirements of UG-128 through UG-132 and UG-136 through UG-138 of Section VIII, Division 1.

(E) An ASME Code Stamp and capacity certification are not required for valves with set pressures 15 psig [100 kPa (gage)] and lower.

**107.8.4 Nonmandatory Appendix.** For nonmandatory rules for the design of safety valve installations, see Nonmandatory Appendix II of this Code.

## 108 PIPE FLANGES, BLANKS, FLANGE FACINGS, GASKETS, AND BOLTING

### 108.1 Flanges

Flanges shall conform to the design requirements of para. 104.5.1 or to the standards listed in Table 126.1. They may be integral or shall be attached to pipe by threading, welding, brazing, or other means within the applicable standards specified in Table 126.1.

### 108.2 Blanks

Blanks shall conform to the design requirements of para. 104.5.3.

### 108.3 Flange Facings

Flange facings shall be in accordance with the applicable standards listed in Tables 112 and 126.1. When bolting Class 150 standard steel flanges to flat face cast iron flanges, the steel flange shall be furnished with a flat face. Steel flanges of Class 300 raised face standard may be bolted to Class 250 raised face cast iron.

### 108.4 Gaskets

Gaskets shall be made of materials that are not injuriously affected by the fluid or by temperature. They shall be in accordance with Table 112.

### 108.5 U.S. Customary Bolting

#### 108.5.1 General

(A) Bolts, bolt studs, nuts, and washers shall comply with applicable standards and specifications listed in Tables 112 and 126.1. Bolts and bolt studs shall extend completely through the nuts.

(B) Washers, when used under nuts, shall be of forged or rolled material with steel washers being used under steel nuts and bronze washers under bronze nuts.

(C) Nuts shall be provided in accordance with the requirements of the specification for the bolts and bolt studs.

(D) Alloy steel bolt studs shall be either threaded full length or provided with reduced shanks of a diameter not less than that at the root of the threads. They shall have ASME heavy hexagonal nuts. Headed alloy bolts shall not be used with other than steel or stainless steel flanges.

(E) All alloy steel bolt studs and carbon steel bolts or bolt studs and accompanying nuts shall be threaded in accordance with ASME B1.1 Class 2A for external threads and Class 2B for internal threads. Threads shall be the coarse-thread series except that alloy steel bolting  $1\frac{1}{8}$  in. and larger in diameter shall be the 8-pitch-thread series.

(F) Carbon steel headed bolts shall have square, hex, or heavy hex heads (ASME B18.2.1) and shall be used with hex or heavy hex nuts (ASME B18.2.2). For bolt sizes smaller than  $\frac{3}{4}$  in., square or heavy hex heads and heavy hex nuts are recommended. For bolt sizes larger than  $1\frac{1}{2}$  in., bolt studs with a hex or heavy hex nut on each end are recommended. For cast iron or bronze flanges using  $\frac{3}{4}$  in. and larger carbon steel headed bolts, square nuts may be used.

**108.5.2** For the various combinations of flange materials, the selection of bolting materials and related rules concerning flange faces and gaskets shall be in accordance with para. 108 and Table 112.

**108.5.3** Bolting requirements for components not covered by para. 108.5.2 shall be in accordance with para. 102.2.2.

## **108.6 Metric Bolting**

**108.6.1 General.** The use of metric bolts, bolt studs, nuts, and washers shall conform to the general requirements of para. 108.5, but the following are allowed:

(A) Threads shall be in accordance with ASME B1.13M, M profile, with tolerance Class 6g for external threads and Class 6H for internal threads.

(B) Threads shall be the coarse-thread series for size M68 and smaller, and 6 mm fine-pitch for M70 and larger sizes, except that alloy steel bolting M30 and larger shall be the 3 mm fine-pitch.

(C) Nuts shall be heavy hex in accordance with ASME B18.2.4.6M. Headed bolts shall be either hex or heavy hex in accordance with ASME B18.2.3.5M and B18.2.3.6M, respectively. Heavy hex heads are recommended for headed bolt sizes M18 and smaller.

(D) Bolt studs are recommended in lieu of headed bolts for sizes M39 and larger.

## **108.6.2 Responsibilities When Specifying or Allowing Metric Bolting**

(A) The piping designer is responsible for specifying the metric bolt size to be used with each class and size of flange.

(B) The designer shall ensure that the selected metric size will fit within the flange bolt holes, and that adequate space exists for bolt heads, nuts, and the assembly tool.

(C) In those instances where the selected metric bolt size is smaller in root thread area than the corresponding U.S. Customary size, the designer shall ensure that the selected size is capable of the required assembly torque and of producing the required gasket loading to adequately seal at design pressure. Further, the designer shall ensure sufficient contact area exists between the flange metal and both the nut and bolt head to withstand the required bolt loading. If not, larger bolting or a higher flange class shall be selected.

## **PART 4**

## **SELECTION AND LIMITATIONS OF PIPING JOINTS**

### **110 PIPING JOINTS**

The type of piping joint used shall be suitable for the design conditions and shall be selected with consideration of joint tightness, mechanical strength, and the nature of the fluid handled.

### **111 WELDED JOINTS**

#### **111.1 General**

Welded joints may be used in any materials allowed by this Code for which it is possible to qualify WPSs, welders, and welding operators in conformance with the rules established in Chapter V.

All welds shall be made in accordance with the applicable requirements of Chapter V.

#### **111.2 Butt Welds**

**111.2.1 Design of Butt Welds.** The design of butt welds shall include the evaluation of any expected joint misalignment [para. 127.3(C)] that may result from specification of joint geometries at variance with the recommendations of this Code.

**111.2.2 Backing Rings for Butt Welds.** If backing rings are used in services where their presence will result in severe corrosion or erosion, the backing ring shall be removed and the internal surface ground smooth. In such services, where it is impractical to remove the backing ring, consideration shall be given to welding the joint without a backing ring, or with a consumable type insert ring.

### 111.3 Socket Welds

**111.3.1** Restrictions on size of socket welded components are given in paras. 104.3.1(B.4), 122.1.1(H), and 122.8.2(C). Special consideration should be given to further restricting the use of socket welded piping joints where temperature or pressure cycling or severe vibration is expected to occur or where the service may accelerate crevice corrosion.

**111.3.2** Dimensions for sockets of socket welding components shall conform to ASME B16.5 for flanges and ASME B16.11 for fittings. Assembly of socket welded joints shall be made in accordance with para. 127.3(E).

**111.3.3** A branch connection socket welded directly into the wall of the run pipe shall be in accordance with requirements of para. 104.3.1(B.4).

**111.3.4** Drains and bypasses may be attached to a fitting or valve by socket welding, provided the socket depth, bore diameter, and shoulder thickness conform to the requirements of ASME B16.11.

### 111.4 Fillet Welds

Fillet welds shall have dimensions not less than the minimum dimensions shown in Figs. 127.4.4(B), 127.4.4(C), and 127.4.8(D).

### 111.5 Seal Welds

Seal welding of connections, including threaded joints, may be used to avoid joint leakage, but the welding shall not be considered as contributing any strength to the joint. Also see para. 127.4.5. Seal welded threaded joints are subject to the limitations of para. 114.

## 112 FLANGED JOINTS

Flanged joints shall conform to paras. 108 and 110 and Table 112.

## 113 EXPANDED OR ROLLED JOINTS

Expanded or rolled joints may be used where experience or test has demonstrated that the joint is suitable for the design conditions and where adequate provisions are made to prevent separation of the joint.

## 114 THREADED JOINTS

Threaded joints may be used within the limitations specified in para. 106 and within the other limitations specified herein.

### 114.1

All threads on piping components shall be taper pipe threads in accordance with the applicable standards listed in Table 126.1. Threads other than taper pipe

threads may be used for piping components where tightness of the joint depends on a seal weld or a seating surface other than the threads, and where experience or test has demonstrated that such threads are suitable.

### 114.2.1

(A) Threaded joints are prohibited where any of the following conditions is expected to occur:

(A.1) temperatures above 496°C (925°F), except as permitted by paras. 114.2.2 and 114.2.3

(A.2) severe erosion

(A.3) crevice corrosion

(A.4) shock

(A.5) vibration

(B) The maximum size limitations in Table 114.2.1 apply to threaded joints in the following services:

(B.1) steam and water at temperatures above 105°C (220°F)

(B.2) flammable gases, toxic gases or liquids, and nonflammable nontoxic gases [also subject to the exceptions identified in paras. 122.8(B) and 122.8.2(C.2)]

### 114.2.2

Threaded access holes with plugs, which serve as openings for radiographic inspection of welds, are not subject to the limitations of para. 114.2.1 and Table 114.2.1, provided their design and installation meets the requirement of para. 114.1. A representative type of access hole and plug is shown in PFI ES-16.

### 114.2.3

Threaded connections for insertion type instrument, control, and sampling devices are not subject to the temperature limitation stated in para. 114.2.1 nor the pressure limitations stated in Table 114.2.1 provided that design and installation meet the requirements of paras. 104.3.1 and 114.1. At temperatures greater than 925°F (495°C) or at pressures greater than 1,500 psi (10 350 kPa), these threaded connections shall be seal welded in accordance with para. 127.4.5. The design and installation of insertion type instrument, control, and sampling devices shall be adequate to withstand the effects of the fluid characteristics, fluid flow, and vibration.

### 114.3

Pipe with a wall thickness less than that of standard weight of ASME B36.10M steel pipe shall not be threaded, regardless of service. See para. 104.1.2(C.1) for additional threading limitations for pipe used in

(A) steam service over 250 psi (1 750 kPa)

(B) water service over 100 psi (700 kPa) and 220°F (105°C)

**Table 112 Piping Flange Bolting, Facing, and Gasket Requirements**  
(Refer to Paras. 108, 110, and 112)

| Flange A Mating With Flange B |                                                                                               |                                                                                                                                                         |                                                                                                                                                                                         |                                                                                                                   |                                                                                                                                                                                                                                                                                           |
|-------------------------------|-----------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Item                          | Flange A                                                                                      | Flange B                                                                                                                                                | Bolting                                                                                                                                                                                 | Flange Facings                                                                                                    | Gaskets                                                                                                                                                                                                                                                                                   |
| (a)                           | Class 25 cast iron                                                                            | Class 25 cast iron                                                                                                                                      | (a)(1) "Low strength"<br>[Notes (1), (2), and (3)]<br>(a)(2) "Higher strength" or<br>"low strength"<br>[Notes (1) through (5)]                                                          | (a)(1) Flat<br>(a)(2) Flat                                                                                        | (a)(1) Flat ring nonmetallic to<br>ASME B16.21, Table 1<br>(a)(2) Full face nonmetallic to<br>ASME B16.21, Table 1                                                                                                                                                                        |
| (b)                           | Class 125 cast iron                                                                           | Class 125 cast iron,<br>Class 150 steel and stainless<br>steel (excluding MSS SP-51),<br>or<br>Class 150 ductile iron                                   | "Low strength"<br>[Notes (1), (2), and (3)]                                                                                                                                             | Flat                                                                                                              | Flat ring; nonmetallic to<br>ASME B16.21, Table 2                                                                                                                                                                                                                                         |
| (c)                           | Class 125 cast iron,<br>Class 150 bronze,<br>MSS SP-51 stainless steel, or<br>Nonmetallic     | Class 125 cast iron,<br>Class 150 bronze,<br>Class 150 steel and stainless<br>steel (including MSS SP-51),<br>Class 150 ductile iron, or<br>Nonmetallic | "Higher strength" or "low<br>strength" [Notes (1)<br>through (7)]                                                                                                                       | Flat                                                                                                              | Full face nonmetallic to<br>ASME B16.21, Table 2<br>[Notes (8), (9)]                                                                                                                                                                                                                      |
| (d)                           | Class 150 steel and stainless<br>steel (excluding MSS SP-51),<br>or<br>Class 150 ductile iron | Class 150 steel and stainless<br>steel (excluding MSS SP-51),<br>or<br>Class 150 ductile iron                                                           | (d)(1) "Low strength"<br>[Notes (1), (2), and (3)]<br>(d)(2) "Higher strength"<br>[Notes (3), (4), and (5)]<br>(d)(3) "Higher strength" or<br>"low strength"<br>[Notes (1) through (5)] | (d)(1) Raised or flat on one<br>or both flanges<br>(d)(2) Raised or flat on one<br>or both flanges<br>(d)(3) Flat | (d)(1) Flat ring nonmetallic to<br>ASME B16.5, Annex C,<br>Group Ia, Table C1<br>[Note (10)]<br>(d)(2) Ring style to ASME<br>B16.5, Annex C,<br>Groups Ia and Ib,<br>Table C1 [Notes (10)<br>and (11)]<br>(d)(3) Full face<br>nonmetallic to<br>ASME B16.5, Annex C,<br>Group Ia material |
| (e)                           | Class 150 steel and stainless<br>steel (excluding MSS SP-51)                                  | Class 150 steel and stainless<br>steel (excluding MSS SP-51)                                                                                            | "Higher strength"<br>[Notes (3), (4), and (5)]                                                                                                                                          | Ring joint                                                                                                        | Ring joint to ASME B16.20                                                                                                                                                                                                                                                                 |

**Table 112 Piping Flange Bolting, Facing, and Gasket Requirements (Cont'd)**  
(Refer to Paras. 108, 110, and 112)

| Flange A Mating With Flange B |                        |                                                                                                                   |                                                                          |                                                 |                                                                                                |
|-------------------------------|------------------------|-------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------|-------------------------------------------------|------------------------------------------------------------------------------------------------|
| Item                          | Flange A               | Flange B                                                                                                          | Bolting                                                                  | Flange Facings                                  | Gaskets                                                                                        |
| (f)                           | Class 250 cast iron    | Class 250 cast iron,                                                                                              | (f)(1) "Low strength"<br>[Notes (1), (2), and (3)]                       | (f)(1) Raised or flat on one<br>or both flanges | (f)(1) Flat ring nonmetallic to<br>ASME B16.21, Table 3                                        |
|                               |                        | Class 300 steel and stainless<br>steel, or<br>Class 300 ductile iron                                              | (f)(2) "Higher strength" or<br>"low strength"<br>[Notes (1) through (5)] | (f)(2) Flat                                     | (f)(2) Full face nonmetallic to<br>ASME B16.21 Table 6<br>(Class 300)                          |
| (g)                           | Class 300 bronze       | Class 250 cast iron,<br>Class 300 bronze,<br>Class 300 steel and stainless<br>steel, or<br>Class 300 ductile iron | "Higher strength" or "low<br>strength" [Notes (1)<br>through (7)]        | Flat                                            | Full face nonmetallic to<br>ASME B16.21, Table 11<br>[Note (8)]                                |
| (h)                           | Class 300 ductile iron | Class 300 steel and stainless<br>steel, or<br>Class 300 ductile iron                                              | (h)(1) "Low strength"<br>[Notes (1), (2), and (3)]                       | (h)(1) Raised or flat on one or<br>both flanges | (h)(1) Flat ring nonmetallic to<br>ASME B16.5, Annex C,<br>Group Ia, Table C1<br>[Note (10)]   |
|                               |                        |                                                                                                                   | (h)(2) "Higher strength"<br>[Notes (3), (4) and (5)]                     | (h)(2) Raised or flat on one or<br>both flanges | (h)(2) Ring style to<br>ASME B16.5, Annex C<br>[Notes (10) and (11)]                           |
|                               |                        |                                                                                                                   | (h)(3) "Higher strength" or<br>"low strength"<br>[Notes (1) through (5)] | (h)(3) Flat                                     | (h)(3) Full face<br>nonmetallic to<br>ASME B16.5, Annex C,<br>Group Ia material<br>[Note (10)] |

**Table 112 Piping Flange Bolting, Facing, and Gasket Requirements (Cont'd)**  
(Refer to Paras. 108, 110, and 112)

| Flange A Mating With Flange B |                                                         |                                                         |                                                       |                                                                                                                |                                                                                                   |
|-------------------------------|---------------------------------------------------------|---------------------------------------------------------|-------------------------------------------------------|----------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------|
| Item                          | Flange A                                                | Flange B                                                | Bolting                                               | Flange Facings                                                                                                 | Gaskets                                                                                           |
| (i)                           | Class 300 and higher classes, steel and stainless steel | Class 300 and higher classes, steel and stainless steel | (i)(1) "Low strength"<br>[Notes (1), (2), and (3)]    | (i)(1) Raised or flat on one or both flanges; large or small male and female; large or small tongue and groove | (i)(1) Flat ring nonmetallic to ASME B16.5, para. 6.11 and Annex C, Group la material [Note (10)] |
|                               |                                                         |                                                         | (i)(2) "Higher strength"<br>[Notes (3), (4), and (5)] | (i)(2) Raised or flat on one or both flanges; large or small male and female; large or small tongue and groove | (i)(2) Ring style to ASME B16.5, para. 6.11 and Annex C [Notes (10) and (11)]                     |
|                               |                                                         |                                                         | (i)(3) "Higher strength"<br>[Notes (3), (4), and (5)] | (i)(3) Ring joint                                                                                              | (i)(3) Ring joint to ASME B16.20                                                                  |
| (j)                           | Class 800 cast iron                                     | Class 800 cast iron                                     | "Low strength"<br>[Notes (1), (2), and (3)]           | Raised or large male and female                                                                                | Flat ring nonmetallic to ASME B16.21, Table 4                                                     |

**GENERAL NOTES:**

- (a) Bolting (including nuts), flange facing, and gasket selection (materials, dimensions, bolt stress, gasket factor, seating stress, etc.) shall be suitable for the flanges, service conditions, and hydrostatic tests. There shall be no overstressing of the gasket or flanges from the expected bolt loading or external bending loads.
- (b) Unless otherwise stated, the flange facing described applies to both flanges A and B.
- (c) For flanges other than to ASME B16.1, in sizes larger than NPS 24 (NPS 12 in Class 2500), gasket dimensions should be verified against the flanges specified (e.g., MSS SP-44 and API 605).
- (d) The effective seating of a full face gasket shall extend to the outside edge of the flange. For flat or raised face flanges, a flat ring or ring style gasket shall be self-centering, extending to the inner edge of the bolt holes or bolts. Where the joint contains a cast iron, bronze, nonmetallic, or MSS SP-51 stainless steel flange, the effective gasket seating shall extend to the outside diameter of the gasket.
- (e) Unconfined nonmetallic gaskets shall not be used on flat or raised face flanges if the expected normal operating pressure exceeds 720 psi (4 950 kPa) or the temperature exceeds 750°F (400°C). Metal gaskets, spiral wound gaskets of metal with nonmetallic filler, and confined nonmetallic gaskets are not limited as to pressure or temperature provided the gasket materials are suitable for the maximum fluid temperatures.

**Table 112 Piping Flange Bolting, Facing, and Gasket Requirements (Cont'd)**  
(Refer to Paras. 108, 110, and 112)

**NOTES:**

- (1) "Low strength" bolting shall conform to ASTM:
 

|                                                                                   |                                                                                                                                                        |
|-----------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------|
| A193, Grade B8A, B8CA, B8MA, or B8TA<br>A193, Class 1, Grade B8, B8C, B8M, or B8T | A307, Grade B [bolting to A307, Grade B shall not be used at temperatures greater than 400°F (200°C)]<br><br>A320, Class 1, Grade B8, B8C, B8M, or B8T |
|-----------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------|
- (2) Nuts for "low strength" bolting shall conform to the grade of ASTM A194 or A563 as required by the bolting specification.
- (3) For temperatures below -20°F (-29°C), bolting conforming to the ASTM A320 classes and grades listed, respectively, in Note (4) "higher strength" and Note (1) "low strength" shall be used. For this bolting to ASTM A320, Grades L7, L7A, L7B, L7C, and L43, the nuts shall conform to ASTM A194, Grade 4 or 7 with impact requirements of A320. For bolting to the other grades of A320, the nuts shall conform to A320.
- (4) "Higher strength" bolting shall conform to ASTM:
 

|                                                                                                                                                                                      |                                                                                        |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------|
| A193, Grade B5, B6, B6X, B7, B7M, or B16<br>A193, Class 2, Grade B8, B8C, B8M, or B8T<br><br>A320, Grade L7, L7A, L7B, L7C, or L43<br>A320, Class 2, Grade B8, B8C, B8F, B8M, or B8T | A354, Grade BC or BD<br><br>A437, Grade B4B, B4C, or B4D<br><br>A453, Grade 651 or 660 |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------|
- (5) Nuts for "higher strength" bolting shall conform to the grade of ASTM A194, A437, A453, A563, or A564, as required by the bolting specification.
- (6) Additionally, for joints containing bronze flanges, nonferrous bolting conforming to the following may be used:
 

|                                                                                                                                                                                                |                                                                                                                                                                                                                                |
|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| ASTM B98, UNS C65100, C65500, and C66100; half hard; to 350°F (177°C) maximum<br>ASTM B150, UNS C61400, to 500°F (260°C) maximum<br>ASTM B150, UNS C63000 and C64200, to 550°F (288°C) maximum | ASTM B164, UNS N04400 and N04405; hot finish; 550°F (288°C) maximum<br>ASTM B164, UNS N04400, cold drawn, cold drawn and stress relieved, or cold drawn and stress equalized; and N04405, cold drawn, to 500°F (260°C) maximum |
|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
- (7) Where a flanged joint contains dissimilar materials (e.g., bronze flanges with steel bolting) and has a design temperature exceeding 300°F (149°C), the differences in coefficients of expansion shall be considered.
- (8) For bronze flanges where "low strength" or nonferrous bolting is used, nonmetallic gaskets having seating stresses greater than 1,600 psi shall not be used.
- (9) For stainless steel flanges to MSS SP-51 and for nonmetallic flanges, preference shall be given to gasket materials having the lower minimum design seating stress as listed in ASME B16.5, Table C1, Group Ia.
- (10) Where asbestos sheet, fiber or filler material for gaskets is specified in ASME B16.5, this limitation shall not apply to ASME B31.1 applications. Any nonmetallic material suitable for the operating conditions may be used in lieu of asbestos provided the requirements of Table 112 are met.
- (11) For items (d)(2), and (i)(2), where two flat face flanges are used in a joint and the gasket seating width (considering both the gasket and the flanges) is greater than that of an ASME B16.5 flange having a standard raised face, the gasket material shall conform to ASME B16.5, Annex C, Group Ia.

**Table 114.2.1 Threaded Joints Limitations**

| Maximum<br>Nominal Size, in. | Maximum Pressure |        |
|------------------------------|------------------|--------|
|                              | psi              | kPa    |
| 3                            | 400              | 2 750  |
| 2                            | 600              | 4 150  |
| 1                            | 1,200            | 8 300  |
| 3/4 and<br>smaller           | 1,500            | 10 350 |

GENERAL NOTE: For instrument, control, and sampling lines, refer to para. 122.3.6(A.5).

## 115 FLARED, FLARELESS, AND COMPRESSION JOINTS, AND UNIONS

Flared, flareless, and compression type tubing fittings may be used for tube sizes not exceeding 2 in. (50 mm) and unions may be used for pipe sizes not exceeding NPS 3 (DN 80) within the limitations of applicable standards and specifications listed in Table 126.1. Pipe unions shall comply with the limitations of para. 114.2.1.

In the absence of standards, specifications, or allowable stress values for the material used to manufacture the fitting, the designer shall determine that the type and the material of the fitting selected is adequate and safe for the design conditions in accordance with the following requirements:

(A) The pressure design shall meet the requirements of para. 104.7.

(B) A suitable quantity of the type, size, and material of the fittings to be used shall meet successful performance tests to determine the safety of the joint under simulated service conditions. When vibration, fatigue, cyclic conditions, low temperature, thermal expansion, or hydraulic shock are expected, the applicable conditions shall be incorporated in the test.

### 115.1 Compatibility

Fittings and their joints shall be compatible with the tubing or pipe with which they are to be used and shall conform to the range of wall thicknesses and method of assembly recommended by the manufacturer.

### 115.2 Pressure-Temperature Ratings

Fittings shall be used at pressure-temperature ratings not exceeding the recommendations of the manufacturer. Unions shall comply with the applicable standards listed within Table 126.1 and shall be used within the specified pressure-temperature ratings. Service conditions, such as vibration and thermal cycling, shall be considered in the application.

### 115.3 Threads

See para. 114.1 for requirements of threads on piping components.

## 115.4 Fitting and Gripping

Flareless fittings shall be of a design in which the gripping member or sleeve shall grip or bite into the outer surface of the tube with sufficient strength to hold the tube against pressure, but without appreciably distorting the inside tube diameter. The gripping member shall also form a pressure seal against the fitting body.

When using bite type fittings, a spot check shall be made for adequate depth of bite and condition of tubing by disassembling and reassembling selected joints.

Grip-type fittings that are tightened in accordance with manufacturer's instructions need not be disassembled for checking.

## 116 BELL END JOINTS

### 116.1 Elastomeric-Gasket Joints

Elastomeric-gasket bell end joints may be used for water and other nonflammable, nontoxic service where experience or tests have demonstrated that the joint is safe for the operating conditions and the fluid being transported. Provisions shall be made to prevent disengagement of the joints at bends and dead ends, and to support lateral reactions produced by branch connections or other causes.

### 116.2 Caulked Joints

Caulked joints, if used, shall be restricted to cold water service, shall not use lead as the caulking material in potable water service, and shall be qualified as specially designed components in accordance with para. 104.7.2. Provisions shall be made to prevent disengagement of the joints at bends and dead ends, and to support lateral reactions produced by branch connections or other causes.

## 117 BRAZED AND SOLDERED JOINTS

### 117.1 Brazed Joints

Brazed socket-type joints shall be made with suitable brazing alloys. The minimum socket depth shall be sufficient for the intended service. Brazing alloy shall either be end-fed into the socket or shall be provided in the form of a preinserted ring in a groove in the socket. The brazing alloy shall be sufficient to fill completely the annular clearance between the socket and the pipe or tube. The limitations of paras. 117.3(A) and (D) shall apply.

### 117.2 Soldered Joints

Soft soldered socket-type joints made in accordance with applicable standards listed in Table 126.1 may be used within their specified pressure-temperature ratings. The limitations in paras. 117.3 and 122.3.2(E.2.3) for instrument piping shall apply. The allowances of para. 102.2.4 do not apply.

### 117.3 Limitations

(A) Brazed socket-type joints shall not be used on systems containing flammable or toxic fluids in areas where fire hazards are involved.

(B) Soldered socket-type joints shall be limited to systems containing nonflammable and nontoxic fluids.

(C) Soldered socket-type joints shall not be used in piping subject to shock or vibration.

(D) Brazed or soldered joints depending solely upon a fillet, rather than primarily upon brazing or soldering material between the pipe and sockets, are not acceptable.

## 118 SLEEVE COUPLED AND OTHER PROPRIETARY JOINTS

Coupling type, mechanical gland type, and other proprietary joints may be used where experience or tests have demonstrated that the joint is safe for the operating conditions, and where adequate provision is made to prevent separation of the joint.

## PART 5 EXPANSION, FLEXIBILITY, AND PIPE SUPPORTING ELEMENT

### 119 EXPANSION AND FLEXIBILITY

#### 119.1 General

In addition to the design requirements for pressure, weight, and other sustained or occasional loadings (see paras. 104.1 through 104.7, 104.8.1, and 104.8.2), power piping systems subject to thermal expansion, contraction, or other displacement stress producing loads shall be designed in accordance with the flexibility and displacement stress requirements specified herein.

#### 119.2 Displacement Stress Range

Piping system stresses caused by thermal expansion and piping displacements, referred to as displacement stresses, when of sufficient initial magnitude during system startup or extreme displacements, relax in the maximum stress condition as the result of local yielding or creep. A stress reduction takes place and usually appears as a stress of reversed sign when the piping system returns to the cold condition for thermal loads or the neutral position for extreme displacement loads. This phenomenon is designated as self-springing (or shake-down) of the piping and is similar in effect to cold springing. The extent of self-springing depends upon the material, the magnitude of the displacement stresses, the fabrication stresses, the hot service temperature, and the elapsed time. While the displacement stresses in the hot or displaced condition tend to diminish with time and yielding, the sum of the displacement strains for the maximum and minimum stress conditions during any one cycle remains substantially constant. This sum

is referred to as the strain range. However, to simplify the evaluation process, the strain range is converted to a stress range to permit the more usual association with an allowable stress range. The allowable stress range shall be as determined in accordance with para. 102.3.2(B).

#### 119.3 Local Overstrain

Most of the commonly used methods of piping flexibility and cyclic stress analysis assume elastic or partly elastic behavior of the entire piping system. This assumption is sufficiently accurate for systems where plastic straining occurs at many points or over relatively wide regions, but fails to reflect the actual strain distribution in unbalanced systems where only a small portion of the piping undergoes plastic strain or where, in piping operating in the creep range, the strain distribution is very uneven. In these cases, the weaker or higher stressed portions will be subjected to strain concentrations due to elastic follow-up of the stiffer or lower stressed portions. Unbalance can be produced

(A) by use of small pipe runs in series with larger or stiffer pipe, with the small lines relatively highly stressed

(B) by local reduction in size or cross section, or local use of a weaker material

(C) in a system of uniform size, by use of a line configuration for which the neutral axis or thrust line is situated close to the major portion of the line itself, with only a very small offset portion of the line absorbing most of the expansion strain

Conditions of this type should preferably be avoided, particularly where materials of relatively low ductility are used.

#### 119.5 Flexibility

Power piping systems shall be designed to have sufficient flexibility to prevent piping displacements from causing failure from overstress of the piping components, overloading of anchors and other supports, leakage at joints, or detrimental distortion of connected equipment. Flexibility shall be provided by changes in direction in the piping through the use of fittings, bends, loops, and offsets. When piping bends, loops, and offsets are not able to provide adequate flexibility, provisions may be made to absorb piping displacements by utilizing expansion, swivel, or ball joints, or flexible metal hose assemblies.

**119.5.1 Expansion, Swivel, or Ball Joints, and Flexible Metal Hose Assemblies.** Except as stated in para. 101.7.2, these components may be used where experience or tests have demonstrated that they are suitable for expected conditions of pressure, temperature, service, and cyclic life.

Restraints and supports shall be provided, as required, to limit movements to those directions and magnitudes permitted for the specific joint or hose assembly selected.

## 119.6 Piping Properties

The coefficient of thermal expansion and moduli of elasticity shall be determined from Appendices B and C, which cover more commonly used piping materials. For materials not included in those Appendices, reference shall be to authoritative source data such as publications of the National Institute of Standards and Technology.

**119.6.1 Coefficient of Thermal Expansion.** The coefficient of thermal expansion shall be determined from values given in Mandatory Appendix B. The coefficient used shall be based on the highest average operating metal temperature and the lowest ambient metal temperature, unless other temperatures are justified. Mandatory Appendix B values are based on the assumption that the lowest ambient metal temperature is 70°F (20°C). If the lowest metal temperature of a thermal range to be evaluated is not 70°F (20°C), adjustment of the values in Mandatory Appendix B may be required.

**119.6.2 Moduli of Elasticity.** The cold and hot moduli of elasticity,  $E_c$  and  $E_h$ , shall be as shown in Mandatory Appendix C, Table C-1 for ferrous materials and Table C-2 for nonferrous materials, based on the temperatures established in para. 119.6.1.

**119.6.3 Poisson's Ratio.** Poisson's ratio, when required for flexibility calculations, shall be taken as 0.3 at all temperatures for all materials.

**119.6.4 Stresses.** Calculations for the stresses shall be based on the least cross section area of the component, using nominal dimensions at the location under consideration. Calculation for the reference displacement stress range,  $S_E$ , shall be based on the modulus of elasticity,  $E_c$ , at room temperature, unless otherwise justified.

## 119.7 Flexibility Analysis

(12) **119.7.1 Method of Analysis.** All piping shall meet the following requirements with respect to flexibility:

(A) It shall be the designer's responsibility to perform an analysis unless the system meets one of the following criteria:

(A.1) The piping system duplicates a successfully operating installation or replaces a system with a satisfactory service record.

(A.2) The piping system can be adjudged adequate by comparison with previously analyzed systems.

(A.3) The piping system is of uniform size, has not more than two anchors and no intermediate restraints, is designed for essentially noncyclic service (less than 7,000 total cycles), and satisfies the following approximate criterion:

*U.S. Customary Units*

$$\frac{DY}{(L - U)^2} \leq 30 \frac{S_A}{E_c}$$

*SI Units*

$$\frac{DY}{(L - U)^2} \leq 208\,000 \frac{S_A}{E_c}$$

where

$D$  = nominal pipe size (NPS), in. (mm)

$E_c$  = modulus of elasticity at room temperature, psi (kPa)

$L$  = developed length of pipe (total length of pipe taken along the piping longitudinal axes), ft (m)

$S_A$  = allowable displacement stress range determined in accordance with para. 102.3.2(B), eq. (1A), psi (kPa)

$U$  = anchor distance (length of straight line between the anchors), ft (m)

$Y$  = resultant displacement between the anchors to be absorbed by the piping system, in. (mm)

**WARNING:** No general proof can be offered that this equation will yield accurate or consistently conservative results. It was developed for ferrous materials and is not applicable to systems used under severe cyclic conditions. It should be used with caution in configurations such as unequal leg U-bends, or near straight "saw-tooth" runs, or for large diameter thin-wall pipe, or where extraneous displacements (not in the direction connecting anchor points) constitute a large part of the total displacement, or where piping operates in the creep range. There is no assurance that anchor reactions will be acceptably low, even when a piping system meets the above requirements.

(B) All systems not meeting the above criteria, or where reasonable doubt exists as to adequate flexibility between the anchors, shall be analyzed by simplified, approximate, or comprehensive methods of analysis that are appropriate for the specific case. The results of such analysis shall be evaluated using para. 104.8.3, eq. (17).

(C) Approximate or simplified methods may be applied only if they are used for the range of configurations for which their adequate accuracy has been demonstrated.

(D) Acceptable comprehensive methods of analysis include: analytical, model tests, and chart methods that provide an evaluation of the forces, moments, and stresses caused by bending and torsion from the simultaneous consideration of terminal and intermediate restraints to thermal expansion of the entire piping system under consideration, and including all external movements transmitted to the piping by its terminal and intermediate attachments. Correction factors shall be applied for the stress intensification of curved pipe and branch connections, as provided by the details of these rules, and may be applied for the increased flexibility of such component parts.

**119.7.3 Basic Assumptions and Requirements.** In calculating the flexibility or displacement stresses of a piping system between anchor points, the system between anchor points shall be treated as a whole. The

significance of all parts of the line and of all restraints, such as supports or guides, including intermediate restraints introduced for reducing moments and forces on equipment or small branch lines, shall be considered.

Flexibility calculations shall take into account stress intensifying conditions found in components and joints. Credit may be taken when extra flexibility exists in such components. In the absence of more directly applicable data, the flexibility factors and stress-intensification factors shown in Mandatory Appendix D may be used.<sup>4</sup>

Dimensional properties of pipe and fittings used in flexibility calculations shall be based on nominal dimensions.

The total reference displacement range resulting from using the coefficient of thermal expansion determined in accordance with para. 119.6.1 shall be used, whether or not the piping is cold sprung. Not only the expansion of the line itself, but also linear and angular movements of the equipment to which it is attached, shall be considered.

Where simplifying assumptions are used in calculations or model tests, the likelihood of attendant underestimates of forces, moments, and stresses, including the effects of stress intensification, shall be evaluated.

### 119.8 Movements

Movements caused by thermal expansion and loadings shall be determined for consideration of obstructions and design of proper supports.

### 119.9 Cold Spring

The beneficial effect of judicious cold springing in assisting a system to attain its most favorable position sooner is recognized. Inasmuch as the life of a system under cyclic conditions depends on the stress range rather than the stress level at any one time, no credit for cold spring is allowed with regard to stresses. In calculating end thrusts and moments acting on equipment, the actual reactions at any one time, rather than their range, are significant. Credit for cold springing is accordingly allowed in the calculation of thrusts and moments, provided an effective method of obtaining the designed cold spring is specified and used.

### 119.10 Reactions

**119.10.1 Computing Hot and Cold Reactions.** In a piping system with no cold spring or an equal percentage of cold springing in all directions, the reactions (forces and moments) of  $R_h$  and  $R_c$  in the hot and cold

conditions, respectively, shall be obtained from the reaction,  $R$ , derived from the flexibility calculations based on the modulus of elasticity at room temperature,  $E_c$ , using eqs. (18) and (19).

$$R_h = \left(1 - \frac{2}{3}C\right) \left(\frac{E_h}{E_c}\right) R \quad (18)$$

$$R_c = -CR, \text{ or}$$

$$= - \left[1 - \frac{(S_h)}{(S_E)} \cdot \frac{(E_c)}{(E_h)}\right] R \quad (19)$$

whichever is greater, and with the further condition that

$$\frac{(S_h)}{(S_E)} \cdot \frac{(E_c)}{(E_h)} \leq 1$$

where

$C$  = cold spring factor varying from zero for no cold spring to 1.00 for 100% cold spring

$E_c$  = modulus of elasticity in the cold condition, psi (MPa)

$E_h$  = modulus of elasticity in the hot condition, psi (MPa)

$R$  = maximum reaction for full expansion range based on  $E_c$ , which assumes the most severe condition (100% cold spring, whether such is used or not), lb and in.-lb (N and mm·N)

$R_c, R_h$  = maximum reactions estimated to occur in the cold and hot conditions, respectively, lb and in.-lb (N and mm·N)

$S_E$  = computed thermal expansion stress range, psi (MPa)

$S_h$  = basic material allowable stress at maximum (hot) temperature, without the 20 ksi limitation as noted in para. 102.3.2(C)

If a piping system is designed with different percentages of cold spring in various directions, eqs. (18) and (19) are not applicable. In this case, the piping system shall be analyzed by a comprehensive method. The calculated hot reactions shall be based on theoretical cold springs in all directions not greater than two-thirds of the cold springs as specified or measured.

**119.10.2 Reaction Limits.** The reactions computed shall not exceed limits that the attached equipment can sustain. Equipment allowable reaction limits (forces and moments) on piping connections are normally established by the equipment manufacturer.

## 120 LOADS ON PIPE SUPPORTING ELEMENTS

### 120.1 General

(A) The broad terms "supporting elements" or "supports" as used herein shall encompass the entire range of the various methods of carrying the weight of pipe

<sup>4</sup> The stress-intensification factors in Mandatory Appendix D have been developed from fatigue tests of representative commercially available, matching product forms and assemblies manufactured from ductile ferrous materials. The allowable stress range is based on tests of carbon and stainless steels. Caution should be exercised when applying eqs. (1) and (13) for the allowable stress range for certain nonferrous materials (e.g., copper and aluminum alloys) for other than low cycle applications.

lines, insulation, and the fluid carried. It, therefore, includes “hangers” that are generally considered as those elements that carry the weight from above, with the supporting members being mainly in tension. Likewise, it includes “supports” that on occasion are delineated as those that carry the weight from below, with the supporting members being mainly in compression. In many cases a supporting element may be a combination of both of these.

(B) In addition to the weight effects of piping components, consideration shall be given in the design of pipe supports to other load effects introduced by service pressure, wind, earthquake, etc., as defined in para. 101. Hangers and supporting elements shall be fabricated and assembled to permit the free movement of piping caused by thermal expansion and contraction. The design of elements for supporting or restraining piping systems, or components thereof, shall be based on all the concurrently acting loads transmitted into the supporting elements.

(C) Where the resonance with imposed vibration and/or shock occurs during operation, suitable dampeners, restraints, anchors, etc., shall be added to remove these effects.

## 120.2 Supports, Anchors, and Guides

### 120.2.1 Rigid-Type Supports

(A) The required strength of all supporting elements shall be based on the loadings as given in para. 120.1, including the weight of the fluid transported or the fluid used for testing, whichever is heavier. The allowable stress in supporting equipment shall be as specified in para. 121.2.

(B) Exceptions may be made in the case of supporting elements for large size gas or air piping, exhaust steam, relief or safety valve relief piping, but only under the conditions where the possibility of the line becoming full of water or other liquid is very remote.

**120.2.2 Variable and Constant Supports.** Load calculations for variable and constant supports, such as springs or counterweights, shall be based on the design operating conditions of the piping. They shall not include the weight of the hydrostatic test fluid. However, the support shall be capable of carrying the total load under test conditions, unless additional support is provided during the test period.

**120.2.3 Anchors or Guides.** Where anchors or guides are provided to restrain, direct, or absorb piping movements, their design shall take into account the forces and moments at these elements caused by internal pressure and thermal expansion.

**120.2.4 Supplementary Steel.** Where it is necessary to frame structural members between existing steel members, such supplementary steel shall be designed in accordance with American Institute of Steel

Construction specifications, or similar recognized structural design standards. Increases of allowable stress values shall be in accordance with the structural design standard being used. Additional increases of allowable stress values, such as allowed in para. 121.2(I), are not permitted.

## 121 DESIGN OF PIPE SUPPORTING ELEMENTS

### 121.1 General

Design of standard pipe supporting elements shall be in accordance with the rules of MSS SP-58. Allowable stress values and other design criteria shall be in accordance with this paragraph. Supporting elements shall be capable of carrying the sum of all concurrently acting loads as listed in para. 120. They shall be designed to provide the required supporting effort and allow pipe-line movement with thermal changes without causing overstress. The design shall also prevent complete release of the piping load in the event of spring failure or misalignment. All parts of the supporting equipment shall be fabricated and assembled so that they will not be disengaged by movement of the supported piping. The maximum safe loads for bolts, threaded hanger rods, and all other threaded members shall be based on the root area of the threads. MSS SP-69 may be used for guidance with respect to selection and application of pipe hangers and supports.

### 121.2 Allowable Stress Values

(A) Allowable stress values tabulated in MSS SP-58 or in Mandatory Appendix A of this Code Section may be used for the base materials of all parts of pipe supporting elements.

(B) Where allowable stress values for a material specification listed in Table 126.1 are not tabulated in Mandatory Appendix A or in MSS SP-58, allowable stress values from Section II, Part D, Tables 1A and 1B of the ASME Boiler and Pressure Vessel Code may be used, provided the requirements of para. 102.3.1(B) are met. Where there are no stress values given in Section II, Part D, Tables 1A and 1B, an allowable stress value of 25% of the minimum tensile strength given in the material specification may be used, for temperatures not exceeding 650°F (345°C).

(C) For a steel material of unknown specification, or of a specification not listed in Table 126.1 or MSS SP-58, an allowable stress value of 30% of yield strength (0.2% offset) at room temperature may be used at temperatures not exceeding 650°F (345°C). The yield strength shall be determined through a tensile test of a specimen of the material and shall be the value corresponding to 0.2% permanent strain (offset) of the specimen. The allowable stress values for such materials shall not exceed 9,500 psi (65.5 MPa).

(D) The allowable shear stress shall not exceed 80% of the values determined in accordance with the rules of (A), (B), and (C) above.

(E) The allowable compressive stress shall not exceed the value as determined in accordance with the rules of (A), (B), or (C) above. In addition, consideration shall be given to structural stability.

(F) The allowable bearing stress shall not exceed 160% of the value as determined in accordance with the rules of (A), (B), or (C) above.

(G) The allowable stress in tension determined from (A), (B), or (C) above shall be reduced 25% for threaded hanger rods.

(H) The allowable stress in partial penetration or fillet welds in support assemblies shall be reduced 25% from those determined in accordance with (A), (B), (C), or (D) above for the weaker of the two metals joined.

(I) If materials for attachments have different allowable stress values than the pipe, then the allowable stress for the weld shall be based on the lower allowable stress of the materials being joined.

(J) Increases in the allowable stress values shall be permitted as follows:

(J.1) an increase of 20% for short time overloading during operation.

(J.2) an increase to 80% of the minimum yield strength at room temperature during hydrostatic testing. Where the material allowable stress has been established in accordance with the rules of (C) above, the allowable stress value during hydrostatic testing shall not exceed 16,000 psi (110.3 MPa).

### 121.3 Temperature Limitations

Parts of supporting elements that are subjected principally to bending or tension loads and that are subjected to working temperatures for which carbon steel is not recommended shall be made of suitable alloy steel, or shall be protected so that the temperature of the supporting member will be maintained within the appropriate temperature limits of the material.

### 121.4 Hanger Adjustments

Hangers used for the support of piping, NPS 2½ and larger, shall be designed to permit adjustment after erection while supporting the load. Screwed adjustments shall have threaded parts to conform to ASME B1.1.

Class 2 fit turnbuckles and adjusting nuts shall have the full length of thread in engagement. Means shall be provided for determining that full thread length is in engagement. All screw and equivalent adjustments shall be provided with suitable locking devices.

### 121.5 Hanger Spacing

Supports for piping with the longitudinal axis in approximately a horizontal position shall be spaced to prevent excessive sag, bending and shear stresses in the

**Table 121.5 Suggested Pipe Support Spacing**

| Nominal<br>Pipe Size,<br>NPS | Suggested Maximum Span |     |                               |      |
|------------------------------|------------------------|-----|-------------------------------|------|
|                              | Water<br>Service       |     | Steam, Gas,<br>or Air Service |      |
|                              | ft                     | m   | ft                            | m    |
| 1                            | 7                      | 2.1 | 9                             | 2.7  |
| 2                            | 10                     | 3.0 | 13                            | 4.0  |
| 3                            | 12                     | 3.7 | 15                            | 4.6  |
| 4                            | 14                     | 4.3 | 17                            | 5.2  |
| 6                            | 17                     | 5.2 | 21                            | 6.4  |
| 8                            | 19                     | 5.8 | 24                            | 7.3  |
| 12                           | 23                     | 7.0 | 30                            | 9.1  |
| 16                           | 27                     | 8.2 | 35                            | 10.7 |
| 20                           | 30                     | 9.1 | 39                            | 11.9 |
| 24                           | 32                     | 9.8 | 42                            | 12.8 |

#### GENERAL NOTES:

- Suggested maximum spacing between pipe supports for horizontal straight runs of standard and heavier pipe at maximum operating temperature of 750°F (400°C).
- Does not apply where span calculations are made or where there are concentrated loads between supports, such as flanges, valves, specialties, etc.
- The spacing is based on a fixed beam support with a bending stress not exceeding 2,300 psi (15.86 MPa) and insulated pipe filled with water or the equivalent weight of steel pipe for steam, gas, or air service, and the pitch of the line is such that a sag of 0.1 in. (2.5 mm) between supports is permissible.

piping, with special consideration given where components, such as flanges and valves, impose concentrated loads. Where calculations are not made, suggested maximum spacing of supports for standard and heavier pipe are given in Table 121.5. Vertical supports shall be spaced to prevent the pipe from being overstressed from the combination of all loading effects.

### 121.6 Springs

The springs used in variable or constant effort type supports shall be designed and manufactured in accordance with MSS SP-58.

### 121.7 Fixtures

#### 121.7.1 Anchors and Guides

(A) Anchors, guides, pivots, and restraints shall be designed to secure the desired points of piping in relatively fixed positions. They shall permit the piping to expand and contract freely in directions away from the anchored or guided point and shall be structurally suitable to withstand the thrusts, moments, and other loads imposed.

(B) Rolling or sliding supports shall permit free movement of the piping, or the piping shall be designed to include the imposed load and frictional resistance of these types of supports, and dimensions shall provide for the expected movement of the supported piping.

Materials and lubricants used in sliding supports shall be suitable for the metal temperature at the point of sliding contact.

(C) Where corrugated or slip-type expansion joints, or flexible metal hose assemblies are used, anchors and guides shall be provided where necessary to direct the expansion into the joint or hose assembly. Such anchors shall be designed to withstand the force specified by the manufacturer for the design conditions at which the joint or hose assembly is to be used. If this force is otherwise unknown, it shall be taken as the sum of the product of the maximum internal area times the design pressure plus the force required to deflect the joint or hose assembly. Where expansion joints or flexible metal hose assemblies are subjected to a combination of longitudinal and transverse movements, both movements shall be considered in the design and application of the joint or hose assembly.

Flexible metal hose assemblies, applied in accordance with para. 106.4, shall be supported in such a manner as to be free from any effects due to torsion and undue strain as recommended by the manufacturer.

### 121.7.2 Other Rigid Types

(A) *Hanger Rods.* Safe loads for threaded hanger rods shall be based on the root area of the threads and 75% of the allowable stress of the material as provided in para. 121.2(G). In no case shall hanger rods less than  $\frac{3}{8}$  in. (9.5 mm) diameter be used for support of pipe NPS 2 and smaller, or less than  $\frac{1}{2}$  in. (12.5 mm) diameter rod for supporting pipe NPS  $2\frac{1}{2}$  and larger. See Table 121.7.2(A) for carbon steel rods.

Pipe, straps, or bars of strength and effective area equal to the equivalent hanger rod may be used instead of hanger rods.

Hanger rods, straps, etc., shall be designed to permit the free movement of piping caused by thermal expansion and contraction.

(B) Welded link chain of  $\frac{3}{16}$  in. (5.0 mm) or larger diameter stock, or equivalent area, may be used for pipe hangers with a design stress of 9,000 psi (62 MPa) maximum.

(C) Cast iron in accordance with ASTM A48 may be used for bases, rollers, anchors, and parts of supports where the loading will be mainly compression. Cast iron parts shall not be used in tension.

(D) Malleable iron castings in accordance with ASTM A47 may be used for pipe clamps, beam clamps, hanger flanges, clips, bases, swivel rings, and parts of pipe supports, but their use shall be limited to temperatures not in excess of 450°F (230°C). This material is not recommended for services where impact loads are anticipated.

(E) Brackets shall be designed to withstand forces and moments induced by sliding friction in addition to other loads.

### 121.7.3 Variable Supports

(A) Variable spring supports shall be designed to exert a supporting force equal to the load, as determined by weight balance calculations, plus the weight of all hanger parts (such as clamp, rod, etc.) that will be supported by the spring at the point of attachment to the pipe.

(B) Variable spring supports shall be provided with means to limit misalignment, buckling, eccentric loading, or to prevent overstressing of the spring.

(C) It is recommended that all hangers employing springs be provided with means to indicate at all times the compression of the spring with respect to the approximate hot and cold positions of the piping system, except where they are used either to cushion against shock or where the operating temperature of the piping system does not exceed 250°F (120°C).

(D) It is recommended that the support be designed for a maximum variation in supporting effort of 25% for the total travel resulting from thermal movement.

**121.7.4 Constant Supports.** On high temperature and critical service piping at locations subject to appreciable movement with thermal changes, the use of constant support hangers, designed to provide a substantially uniform supporting force throughout the range of travel, is recommended.

(A) Constant support hangers shall have a support variation of no more than 6% throughout the total travel range.

(B) Counterweight type supports shall be provided with stops, and the weights shall be positively secured. Chains, cables, hanger and rocker arm details, or other devices used to attach the counterweight load to the piping, shall be subject to requirements of para. 121.7.2.

(C) Hydraulic type supports utilizing a hydraulic head may be installed to give a constant supporting effort. Safety devices and stops shall be provided to support the load in case of hydraulic failure.

(D) Boosters may be used to supplement the operation of constant support hangers.

**121.7.5 Sway Braces.** Sway braces or vibration dampeners shall be used to control the movement of piping due to vibration.

**121.7.6 Shock Suppressors.** For the control of piping due to dynamic loads, hydraulic or mechanical types of shock suppressors are permitted. These devices do not support pipe weight.

## 121.8 Structural Attachments

### 121.8.1 Nonintegral Type

(A) Nonintegral attachments include clamps, slings, cradles, saddles, straps, and clevises.

(B) When clamps are used to support vertical lines, it is recommended that shear lugs be welded to the pipe

**Table 121.7.2(A) Carrying Capacity of Threaded ASTM A36, A575, and A576 Hot-Rolled Carbon Steel**

| Nominal Rod Diameter, in. | Root Area of Thread, in. <sup>2</sup> | Max. Safe Load at Rod Temp. of 650°F (343°C) |      |
|---------------------------|---------------------------------------|----------------------------------------------|------|
|                           |                                       | lb                                           | kN   |
| 3/8                       | 0.0678                                | 730                                          | 3.23 |
| 1/2                       | 0.126                                 | 1,350                                        | 5.98 |
| 5/8                       | 0.202                                 | 2,160                                        | 9.61 |
| 3/4                       | 0.302                                 | 3,230                                        | 14.4 |
| 7/8                       | 0.419                                 | 4,480                                        | 19.9 |
| 1                         | 0.551                                 | 5,900                                        | 26.2 |
| 1 1/4                     | 0.890                                 | 9,500                                        | 42.4 |
| 1 1/2                     | 1.29                                  | 13,800                                       | 61.6 |
| 1 3/4                     | 1.74                                  | 18,600                                       | 82.8 |
| 2                         | 2.30                                  | 24,600                                       | 109  |
| 2 1/4                     | 3.02                                  | 32,300                                       | 144  |
| 2 1/2                     | 3.72                                  | 39,800                                       | 177  |
| 2 3/4                     | 4.62                                  | 49,400                                       | 220  |
| 3                         | 5.62                                  | 60,100                                       | 267  |
| 3 1/4                     | 6.72                                  | 71,900                                       | 320  |
| 3 1/2                     | 7.92                                  | 84,700                                       | 377  |
| 3 3/4                     | 9.21                                  | 98,500                                       | 438  |
| 4                         | 10.6                                  | 114,000                                      | 505  |
| 4 1/4                     | 12.1                                  | 129,000                                      | 576  |
| 4 1/2                     | 13.7                                  | 146,000                                      | 652  |
| 4 3/4                     | 15.4                                  | 165,000                                      | 733  |
| 5                         | 17.2                                  | 184,000                                      | 819  |

**GENERAL NOTES:**

- (a) Tabulated loads are based on a minimum tensile stress of 50 ksi (345 MPa) divided by a safety factor of 3.5, reduced by 25%, resulting in an allowable stress of 10.7 ksi.
- (b) Root areas of thread are based upon the following thread series: diameters 4 in. and below — coarse thread (UNC); diameters above 4 in. — 4 thread (4-UN).
- (c) The corresponding table for metric size rods is available in MSS SP-58.

to prevent slippage. The provisions of para. 121.8.2(B) shall apply.

(C) In addition to the provision of (B) above, clamps to support vertical lines should be designed to support the total load on either arm in the event the load shifts due to pipe and/or hanger movement.

**121.8.2 Integral Type**

(A) Integral attachments include ears, shoes, lugs, cylindrical attachments, rings, and skirts that are fabricated so that the attachment is an integral part of the piping component. Integral attachments shall be used in conjunction with restraints or braces where multiaxial restraint in a single member is to be maintained. Consideration shall be given to the localized stresses induced into the piping component by the integral attachments. Where applicable, the conditions of para. 121.8.1(C) are to apply.

(B) Integral lugs, plates, angle clips, etc., used as part of an assembly for the support or guiding of pipe may

be welded directly to the pipe provided the materials are compatible for welding and the design is adequate for the temperature and load. The design of hanger lugs for attachment to piping for high temperature service shall be such as to provide for differential expansion between the pipe and the attached lug.

**121.9 Loads and Supporting Structures**

Considerations shall be given to the load carrying capacity of equipment and the supporting structure. This may necessitate closer spacing of hangers on lines with extremely high loads.

**121.10 Requirements for Fabricating Pipe Supports**

Pipe supports shall be fabricated in accordance with the requirements of para. 130.

## PART 6 SYSTEMS

### 122 DESIGN REQUIREMENTS PERTAINING TO SPECIFIC PIPING SYSTEMS

Except as specifically stated otherwise in this Part 6, all provisions of the Code apply fully to the piping systems described herein.

#### 122.1 Boiler External Piping; in Accordance With Para. 100.1.2(A) — Steam, Feedwater, Blowoff, and Drain Piping

- (12) **122.1.1 General.** The minimum pressure and temperature and other special requirements to be used in the design for steam, feedwater, blowoff, and drain piping from the boiler to the valve or valves required by para. 122.1 shall be as specified in the following paragraphs. Design requirements for desuperheater spray piping connected to desuperheaters located in the boiler proper and in main steam piping are provided in para. 122.4.

(A) It is intended that the design pressure and temperature be selected sufficiently in excess of any expected operating conditions, not necessarily continuous, to permit satisfactory operation without operation of the overpressure protection devices. Also, since the operating temperatures of fired equipment can vary, the expected temperature at the connection to the fired equipment shall include the manufacturer's maximum temperature tolerance.

(B) In a forced flow steam generator with no fixed steam and water line, it is permissible to design the external piping, valves, and fittings attached to the pressure parts for different pressure levels along the path through the steam generator of water-steam flow. The values of design pressure and the design temperature to be used for the external piping, valves, and fittings shall be not less than that required for the expected maximum sustained operating pressure and temperature to which the abutted pressure part is subjected except when one or more of the overpressure protection devices covered by PG-67.4 of Section I of the ASME Boiler and Pressure Vessel Code is in operation. The steam piping shall comply with the requirements for the maximum sustained operating conditions as used in (A) above, or for the design throttle pressure plus 5%, whichever is greater.

(C) Provision shall be made for the expansion and contraction of piping connected to boilers to limit forces and moments transmitted to the boiler, by providing substantial anchorage at suitable points, so that there shall be no undue strain transmitted to the boiler. Steam reservoirs shall be used on steam mains when heavy pulsations of the steam currents cause vibration.

(D) Piping connected to the outlet of a boiler for any purpose shall be attached by

(D.1) welding to a nozzle or socket welding fitting  
(D.2) threading into a tapped opening with a threaded fitting or valve at the other end

(D.3) screwing each end into tapered flanges, fittings, or valves with or without rolling or peening

(D.4) bolted joints including those of the Van Stone type

(D.5) blowoff piping of firetube boilers shall be attached in accordance with (D.2) above if exposed to products of combustion or in accordance with (D.2), (D.3), or (D.4) above if not so exposed

(E) Nonferrous pipe or tubes shall not exceed NPS 3 in diameter.

(F) American National Standard slip-on flanges shall not exceed NPS 4. Attachment of slip-on flanges shall be by double fillet welds. The throats of the fillet welds shall not be less than 0.7 times the thickness of the part to which the flange is attached.

(G) Hub-type flanges shall not be cut from plate material.

(H) American National Standard socket welded flanges may be used in piping or boiler nozzles provided the dimensions do not exceed NPS 3 for Class 600 and lower and NPS 2½ in Class 1500.

(I) The use of expansion joints of all types, swivel and ball joints, and flexible metal hose assemblies as described in para. 101.7.2 is prohibited.

#### 122.1.2 Steam Piping

(A) The value of  $P$  to be used in the formulas in para. 104 shall be as follows:

(A.1) For steam piping connected to the steam drum or to the superheater inlet header up to the first stop valve in each connection, the value of  $P$  shall be not less than the lowest pressure at which any drum safety valve is set to blow, and the  $S$  value shall not exceed that permitted for the corresponding saturated steam temperature.

(A.2) For steam piping connected to the superheater outlet header up to the first stop valve in each connection, the design pressure, except as otherwise provided in (A.4) below shall be not less than the lowest pressure at which any safety valve on the superheater is set to blow, or not less than 85% of the lowest pressure at which any drum safety valve is set to blow, whichever is greater, and the  $S$  value for the material used shall not exceed that permitted for the expected steam temperature.

(A.3) For steam piping between the first stop valve and the second valve, when one is required by para. 122.1.7, the design pressure shall be not less than the expected maximum sustained operating pressure or 85% of the lowest pressure at which any drum safety valve is set to blow, whichever is greater, and the  $S$  value for the material used shall not exceed that permitted for the expected steam temperature.

(A.4) For boilers installed on the unit system (i.e., one boiler and one turbine or other prime mover) and provided with automatic combustion control equipment responsive to steam header pressure, the design pressure for the steam piping shall be not less than the design pressure at the throttle inlet plus 5%, or not less than 85% of the lowest pressure at which any drum safety valve is set to blow, or not less than the expected maximum sustained operating pressure at any point in the piping system, whichever is greater, and the  $S$  value for the material used shall not exceed that permitted for the expected steam temperature at the superheater outlet. For forced-flow steam generators with no fixed steam and water line, the design pressure shall also be no less than the expected maximum sustained operating pressure.

(A.5) The design pressure shall not be taken at less than 100 psig [700 kPa (gage)] for any condition of service or material.

### 122.1.3 Feedwater Piping

(A) The value of  $P$  to be used in the formulas in para. 104 shall be as follows:

(A.1) For piping from the boiler to and including the required stop valve and the check valve, the minimum value of  $P$  except as permitted in para. 122.1.3(A.4) shall exceed the maximum allowable working pressure of the boiler by either 25% or 225 psi (1 550 kPa), whichever is the lesser. For an installation with an integral economizer without valves between the boiler and economizer, this paragraph shall apply only to the piping from the economizer inlet header to and including the required stop valve and the check valve.

(A.2) For piping between the required check valve and the globe or regulating valve, when required by para. 122.1.7(B), and including any bypass piping up to the shutoff valves in the bypass, the value of  $P$  shall be not less than the pressure required to feed the boiler.

(A.3) The value of  $P$  in the formula shall not be taken at less than 100 psig [700 kPa (gage)] for any condition of service or material, and shall never be less than the pressure required to feed the boiler.

(A.4) In a forced flow steam generator with no fixed steam and water line, the value of  $P$  for feedwater piping from the boiler to and including the required stop valve may be in accordance with the requirements of para. 122.1.1(B).

(B) The  $S$  value used, except as permitted in (A.4) above, shall not exceed that permitted for the temperature of saturated steam at the maximum allowable working pressure of the boiler.

(C) The size of the feed piping between the boiler and the first required valve [para. 122.1.7(B)] or the branch feed connection [para. 122.1.7(B.4)] shall, as a minimum, be the same as the boiler connection.

**122.1.4 Blowoff and Blowdown Piping.** Blowoff and blowdown piping are defined as piping connected to a

boiler and provided with valves or cocks through which the water in the boiler may be blown out under pressure. This definition is not intended to apply to (i) drain piping, and (ii) piping such as used on water columns, gage glasses, or feedwater regulators, etc., for the purpose of determining the operating condition of the equipment. Requirements for (i) and (ii) are described in paras. 122.1.5 and 122.1.6, respectively. Blowoff systems are operated intermittently to remove accumulated sediment from equipment and/or piping, or to lower boiler water level in a rapid manner. Blowdown systems are primarily operated continuously to control the concentrations of dissolved solids in the boiler water.

(A) Blowoff piping systems from water spaces of a boiler, up to and including the blowoff valves, shall be designed in accordance with (A.1) to (A.4) below. Two shutoff valves are required in the blowoff system; specific valve requirements and exceptions are given in para. 122.1.7(C).

(A.1) The value of  $P$  to be used in the formulas in para. 104 shall exceed the maximum allowable working pressure of the boiler by either 25% or 225 psi (1 550 kPa) whichever is less, but shall be not less than 100 psig [690 kPa (gage)]. The exception to this requirement pertains to miniature boilers as described in Section I, Parts PEB and PMB of the ASME Boiler and Pressure Vessel Code, where the value of  $P$  to be used in the formulas in para. 104 shall be 100 psi [690 kPa (gage)].

(A.2) The allowable stress value for the piping materials shall not exceed that permitted for the temperature of saturated steam at the maximum allowable working pressure of the boiler.

(A.3) All pipe shall be steel except as permitted below. Galvanized steel pipe and fittings shall not be used for blowoff piping. When the value of  $P$  does not exceed 100 psig [690 kPa (gage)], nonferrous pipe may be used and the fittings may be bronze, cast iron, malleable iron, ductile iron, or steel.

**CAUTION:** Nonferrous alloys and austenitic stainless steels may be sensitive to stress corrosion cracking in certain aqueous environments.

When the value of  $P$  exceeds 100 psig [690 kPa (gage)], the fittings shall be steel, and the thickness of pipe and fittings shall not be less than that of Schedule 80 pipe.

(A.4) The size of blowoff piping shall be not less than the size of the connection on the boiler, and shall be in accordance with the rules contained in the ASME Boiler and Pressure Vessel Code, Section I, PG-59.3, PMB-12, and PEB-12.

(B) The blowdown piping system from the boiler, to and including the shutoff valve, shall be designed in accordance with (B.1) through (B.4) below. Only one shutoff valve is required in the blowdown system.

(B.1) The value of  $P$  to be used in the formulas in para. 104 shall be not less than the lowest set pressure of any safety valve on the boiler drum.

(B.2) The allowable stress value for the piping materials shall not exceed that permitted for the temperature of saturated steam at the maximum allowable working pressure of the boiler.

(B.3) All pipe shall be steel except as permitted below. Galvanized steel pipe and fittings shall not be used for blowdown piping. When the value of  $P$  does not exceed 100 psig [690 kPa (gage)], nonferrous pipe may be used and the fittings may be bronze, cast iron, malleable iron, ductile iron, or steel.

**CAUTION:** Nonferrous alloys and austenitic stainless steels may be sensitive to stress corrosion cracking in certain aqueous environments.

When the value of  $P$  exceeds 100 psig [690 kPa (gage)], the fittings shall be steel and the thickness of pipe and fittings shall not be less than that of Schedule 80 pipe.

(B.4) The size of blowdown piping shall be not less than the size of the connection on the boiler, and shall be in accordance with the rules contained in the ASME Boiler and Pressure Vessel Code, Section I, PG-59.3, PMB-12, and PEB-12.

(C) The blowoff and blowdown piping beyond the required valves described in (A) and (B) above are classified as nonboiler external piping. The requirements are given in para. 122.2.

#### (12) 122.1.5 Boiler Drains

(A) Complete drainage of the boiler and attached piping shall be provided to the extent necessary to ensure proper operation of the steam supply system. The pipe, fittings, and valves of any drain line shall not be smaller than the drain connection. Double valving shall be required for each boiler drain connection except as permitted in (C) and (D) below.

(B) If the drain lines are intended to be used both as drains and as blowoffs, then two valves are required and all conditions of paras. 122.1.4, 122.1.7(C), and 122.2 shall be met.

(C) Miniature boilers constructed in accordance with the rules contained in the ASME Boiler and Pressure Vessel Code, Section I, Parts PMB and PEB may use a single valve where drain lines are intended to be used for both blowoff and periodic automatic or manual flushing prior to startup. The single valve shall be designed for blowoff service but need not have locking capability.

(D) When a drain is intended for use only when the boiler is not under pressure (pressurizing the boiler for rapid drainage is an exception), a single shutoff valve is acceptable under the following conditions: either the valve shall be a type that can be locked in the closed position, or a suitable flanged and bolted connection that accepts a blank insert shall be located on the downstream side of the valve. When a single valve is used, it need not be designed for blowoff service. Single valves on miniature boilers constructed in accordance with the rules contained in the ASME Boiler and Pressure Vessel

Code, Section I, Parts PMB and PEB do not require locking capability.

(E) Drain piping from the drain connection, including the required valve(s) or the blanked flange connection, shall be designed for the temperature and pressure of the drain connection. The remaining piping shall be designed for the expected maximum temperature and pressure. Static head and possible choked flow conditions shall be considered. In no case shall the design pressure and temperature be less than 100 psig [690 kPa (gage)] and 220°F (105°C), respectively.

#### 122.1.6 Boiler External Piping – Miscellaneous Systems

(A) Materials, design, fabrication, examination, and erection of piping for miscellaneous accessories, such as water level indicators, water columns, gage cocks, and pressure gages, shall be in accordance with the applicable sections of this Code.

(B) The value of  $P$  to be used in the formulas in para. 104 shall be not less than the maximum allowable working pressure of the boiler except as provided by para. 122.1.1(B).

(C) Valve requirements for water level indicators or water columns, special gage glass and gage cock requirements, minimum line sizes, and special piping configurations required specifically for cleaning, access, or reliability shall be in accordance with PG-60 of Section I of the ASME Boiler and Pressure Vessel Code.

**122.1.7 Valves and Fittings.** The minimum pressure and temperature rating for all valves and fittings in steam, feedwater, blowoff, and miscellaneous piping shall be equal to the pressure and temperature specified for the connected piping on the side that has the higher pressure, except that in no case shall the pressure be less than 100 psig [690 kPa (gage)], and for pressures not exceeding 100 psig [690 kPa (gage)] in feedwater and blowoff service, the valves and fittings shall be equal at least to the requirements of the ASME standards for Class 125 cast iron or bronze, or Class 150 steel or bronze.

(A) *Steam Stop Valves.* Each boiler discharge outlet, except safety valve or safety relief valve connections, or reheater inlet and outlet connections, shall be fitted with a stop valve located at an accessible point in the steam-delivery line and as near to the boiler nozzle as is convenient and practicable.

(A.1) Boiler stop valves shall provide bidirectional shutoff at design conditions. The valve or valves shall meet the requirements of para. 107. Valves with resilient (nonmetallic) seats shall not be used where the boiler maximum allowable working pressure exceeds 150 psig (1 035 kPa) or where the system design temperature exceeds 366°F (186°C). Valves of the outside screw and yoke, rising stem style are preferred. Valves other than those of the outside screw and yoke, rising stem style shall meet the following additional requirements.

(A.1.A) Each valve shall be equipped with a position indicator to visually indicate from a distance whether the valve is open or closed.

(A.1.B) Quarter turn valves shall be equipped with a slow operating mechanism to minimize dynamic loadings on the boiler and attached piping. Either a quick-opening manual quarter-turn valve or an automatic solenoid valve may be used on miniature boilers constructed in accordance with the rules contained in the ASME Boiler and Pressure Vessel Code, Section I, Parts PMB and PEB. Manual quarter-turn valves shall be provided with a handle or other position indicator to indicate from a distance whether the valve is open or closed.

(A.2) In the case of a single boiler and prime mover installation, the stop valve required herein may be omitted provided the prime mover throttle valve is equipped with an indicator to show whether it is opened or closed, and it is designed to withstand the required boiler hydrostatic test.

(A.3) When two or more boilers are connected to a common header, or when a single boiler is connected to a header having another steam source, the connection from each boiler having a manhole opening shall be fitted with two stop valves having an ample free-blow drain between them. The preferred arrangement consists of one stop-check valve (located closest to the boiler) and one valve of the style and design described in (A.1) above. Alternatively, both valves may be of the style and design described in (A.1) above.

When a second stop valve is required, it shall have a pressure rating at least equal to that required for the expected steam pressure and temperature at the valve, or a pressure rating at least equal to 85% of the lowest set pressure of any safety valve on the boiler drum at the expected temperature of the steam at the valve, whichever is greater.

(A.4) All valves and fittings on steam lines shall have a pressure rating of at least 100 psig [690 kPa (gage)] in accordance with the applicable ASME standard.

#### (B) Feedwater Valves

(B.1) The feedwater piping for all boilers, except for high temperature water boilers complying with the requirements of (B.8) below, and for forced flow steam generators with no fixed steam and water line complying with the requirements of (B.9) below, shall be provided with a check valve and a stop valve or cock between the check valve and the boiler. The stop valve or cock shall comply with the requirements of (C.5) below.

(B.2) The relative locations of the check and stop (or cock) valves, as required in (B.1) above, may be reversed on a single boiler-turbine unit installation.

(B.3) If a boiler is equipped with a duplicate feed arrangement, each such arrangement shall be equipped as required by these rules.

(B.4) When the supply line to a boiler is divided into branch feed connections and all such connections are equipped with stop and check valves, the stop and check valves in the common source may be omitted.

(B.5) When two or more boilers are fed from a common source, there shall also be a globe or regulating valve in the branch to each boiler located between the check valve and the source of supply. A typical arrangement is shown in Fig. 100.1.2(B).

(B.6) A combination stop and check valve in which there is only one seat and disk, and in which a valve stem is provided to close the valve, shall be considered only as a stop valve, and a check valve shall be installed as otherwise provided.

(B.7) Where an economizer or other feedwater heating device is connected directly to the boiler without intervening valves, the feed valves and check valves required shall be placed on the inlet of the economizer or feedwater heating device.

(B.8) The recirculating return line for a high temperature water boiler shall be provided with the same stop valve, or valves, required by (B.1) and (B.3) above. The use of a check valve in the recirculating return line is optional. A check valve shall not be a substitute for a stop valve.

(B.9) The feedwater boiler external piping for a forced flow steam generator with no fixed steam and water line may terminate up to and including the stop valve(s) and omitting the check valve(s) provided that a check valve having a pressure rating no less than the boiler inlet design pressure is installed at the discharge of each boiler feed pump or elsewhere in the feedline between the feed pump and the stop valve(s).

(B.10) Wherever globe valves are used within BEP feedwater piping for either isolation or regulation, the inlet shall be under the disk of the valve.


#### (C) Blowoff Valves

(C.1) Ordinary globe valves as shown in Fig. 122.1.7(C), sketch (a), and other types of valves that have dams or pockets where sediment can collect, shall not be used on blowoff connections.

(C.2) Y-type globe valves as shown in Fig. 122.1.7(C), sketch (b) or angle valves may be used in vertical pipes, or they may be used in horizontal runs of piping provided they are so constructed or installed that the lowest edge of the opening through the seat is at least 25% of the inside diameter below the centerline of the valve.

(C.3) The blowoff valve or valves, the pipe between them, and the boiler connection shall be of the same size except that a larger pipe for the return of condensate may be used.

Fig. 122.1.7(C) Typical Globe Valves

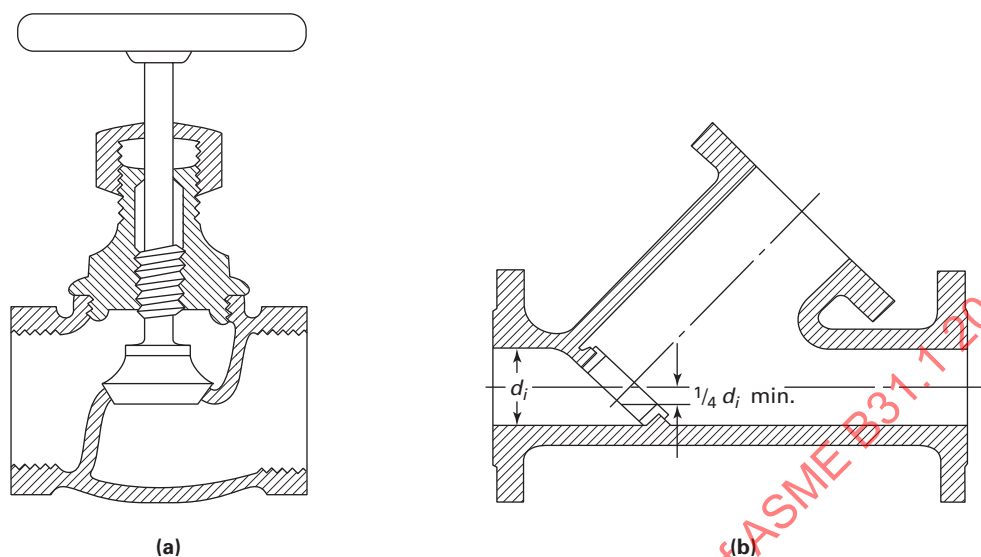

(C.4) For all boilers [except electric steam boilers having a normal water content not exceeding 100 gal (380 L), traction-purpose, and portable steam boilers; see (C.11) and (C.12) below] with allowable working pressure in excess of 100 psig [690 kPa (gage)], each bottom blowoff pipe shall have two slow-opening valves, or one quick-opening valve or cock, at the boiler nozzle followed by a slow-opening valve. All valves shall comply with the requirements of (C.5) and (C.6) below.

(C.5) When the value of  $P$  required by para. 122.1.4(A.1) does not exceed 250 psig [1 725 kPa (gage)], the valves or cocks shall be bronze, cast iron, ductile iron, or steel. The valves or cocks, if of cast iron, shall not exceed NPS 2½ and shall meet the requirements of the applicable ASME standard for Class 250, as given in Table 126.1, and if of bronze, steel, or ductile iron construction, shall meet the requirements of the applicable standards as given in Table 126.1 or para. 124.6.

(C.6) When the value of  $P$  required by para. 122.1.4(A.1) is higher than 250 psig [1 725 kPa (gage)], the valves or cocks shall be of steel construction equal at least to the requirements of Class 300 of the applicable ASME standard listed in Table 126.1. The minimum pressure rating shall be equal to the value of  $P$  required by para. 122.1.4(A.1).

(C.7) If a blowoff cock is used, the plug shall be held in place by a guard or gland. The plug shall be distinctly marked in line with the passage.

(C.8) A slow-opening valve is a valve that requires at least five 360 deg turns of the operating mechanism to change from fully closed to fully opened.

(C.9) On a boiler having multiple blowoff pipes, a single master valve may be placed on the common

blowoff pipe from the boiler, in which case only one valve on each individual blowoff is required. In such a case, either the master valve or the individual valves or cocks shall be of the slow-opening type.

(C.10) Two independent slow-opening valves, or a slow-opening valve and a quick-opening valve or cock, may be combined in one body and may be used provided the combined fitting is the equivalent of two independent slow-opening valves, or a slow-opening valve and a quick-opening valve or cock, and provided further that the failure of one to operate cannot affect the operation of the other.

(C.11) Only one blowoff valve, which shall be either a slow-opening or quick-opening blowoff valve or a cock, is required on traction and/or portable boilers.

(C.12) Only one blowoff valve, which shall be of a slow-opening type, is required for the blowoff piping for forced circulation and electric steam boilers having a normal water content not exceeding 100 gal (380 L). Electric boilers not exceeding a normal water content of 100 gal (380 L) and a maximum MAWP of 100 psig [690 kPa (gage)] may use a quick-opening manual or slow-opening automatic quarter-turn valve up to NPS 1. Electric boilers not exceeding a normal water content of 100 gal (380 L) but with a MAWP greater than 100 psig [690 kPa (gage)] shall only use either a slow-opening type manual or automatic valve, regardless of size.

#### (D) Pressure-Relieving Valves

(D.1) Safety, safety-relief, and power-actuated pressure-relieving valves shall conform to the requirements of PG-67, PG-68, PG-69, PG-70, PG-71, PG-72, and PG-73 of Section I of the ASME Boiler and Pressure Vessel Code.

**Table 122.2 Design Pressure for Blowoff/Blowdown Piping Downstream of BEP Valves**

| Boiler or Vessel Pressure |                   | Design Pressure [Note (1)] |            |
|---------------------------|-------------------|----------------------------|------------|
| MAWP                      | kPa (gage)        | psig                       | kPa (gage) |
| Below 250                 | 1 725             | Note (2)                   | Note (2)   |
| 250–600                   | 1 725–4 135       | 250                        | 1 725      |
| 601–900                   | 4 136–6 205       | 400                        | 2 760      |
| 901–1,500                 | 6 206–10 340      | 600                        | 4 135      |
| 1,501 and higher          | 10 341 and higher | 900                        | 6 205      |

**NOTES:**

- (1) The allowable stress value for the piping material need not exceed that permitted for the temperature of saturated steam at the design pressure.
- (2) For boiler or vessel pressures below 250 psig [1 725 kPa (gage)], the design pressure shall be determined in accordance with para. 122.1.4(B.1), but need not exceed 250 psig [1 725 kPa (gage)].

**122.2 Blowoff and Blowdown Piping in Nonboiler External Piping**

Blowoff and blowdown piping systems shall be, where possible, self-draining and without pockets. If unavoidable, valved drains at low points shall allow system draining prior to operation. In order to minimize pipeline shock during the operation of blowoff systems, 3D pipe bends (minimum) should be used in preference to elbows, and wye or lateral fittings should be used in preference to tee connections.

*(A) From Boilers*

(A.1) Blowoff piping, located between the valves described in para. 122.1.4(A) and the blowoff tank or other point where the pressure is reduced approximately to atmospheric pressure and cannot be increased by closing a downstream valve, shall be designed for the appropriate pressure in accordance with Table 122.2. The provisions of paras. 122.1.4(A.3) and 122.1.7 shall apply. The size of non-BEP blowoff header to the safe point of discharge shall not be smaller than the largest connected BEP blowoff terminal [see para. 122.1.4(A.4)].

(A.2) Blowdown piping, in which the pressure cannot be increased by closing a downstream valve, shall be designed for the appropriate pressure and temperature in accordance with Table 122.2. The provisions of para. 122.1.4(B.3) shall apply. The size of non-BEP blowdown piping between the shutoff valve described in para. 122.1.4(B) and the flow control valve shall not be smaller than the BEP boiler shutoff valve [see para. 122.1.4(B.4)] unless engineering calculations confirm that the design flow rate can be achieved with a smaller piping size without flashing the blowdown prior to the flow control valve.

(A.3) When the design pressure of Table 122.2 can be exceeded due to closing of a downstream valve, calculated pressure drop, or other means, the entire blowoff or blowdown piping system shall be designed in accordance with paras. 122.1.4(A) and 122.1.7 for blowoff and para. 122.1.4(B) for blowdown piping.

(A.4) Non-BEP blowdown piping downstream of the flow control valve shall not be smaller — and preferably will be larger — than the connection on the boiler [see para. 122.1.4(B.4)].

*(B) From Pressure Vessels Other Than Boilers*

(B.1) The design pressure and temperature of the blowoff piping from the pressure vessel to and including the blowoff valve(s) shall not be less than the vessel MAWP and corresponding design temperature.

**122.3 Instrument, Control, and Sampling Piping**

(A) The requirements of this Code, as supplemented by para. 122.3, shall apply to the design of instrument, control, and sampling piping for safe and proper operation of the piping itself.

(B) The term “Instrument Piping” shall apply to all valves, fittings, tubing, and piping used to connect instruments to main piping or to other instruments or apparatus or to measuring equipment as used within the classification of para. 100.1.

(C) The term “Control Piping” shall apply to all valves, fittings, tubing, and piping used to interconnect pneumatically or hydraulically operated control apparatus, also classified in accordance with para. 100.1, as well as to signal transmission systems used to interconnect instrument transmitters and receivers.

(D) The term “Sampling Piping” shall apply to all valves, fittings, tubing, and piping used for the collection of samples, such as steam, water, oil, gas, and chemicals.

(E) Paragraph 122.3 does not apply to tubing used in permanently closed systems, such as fluid-filled temperature responsive devices, or the temperature responsive devices themselves.

(F) Paragraph 122.3 does not apply to the devices, apparatus, measuring, sampling, signalling, transmitting, controlling, receiving, or collecting instruments to which the piping is connected.

**122.3.1 Materials and Design.** The materials utilized for valves, fittings, tubing, and piping shall meet

the particular conditions of service and the requirements of the applicable specifications listed under general paras. 105, 106, 107, and 108 with allowable stresses in accordance with the Allowable Stress Tables in Mandatory Appendix A.

The materials for pressure retention components used for piping specialties such as meters, traps, and strainers in flammable, combustible, or toxic fluid systems shall in addition conform to the requirements of paras. 122.7 and 122.8.

### 122.3.2 Instrument Piping

#### (A) Takeoff Connections

(A.1) Takeoff connections at the source, together with attachment bosses, nozzles, and adapters, shall be made of material at least equivalent to that of the pipe or vessel to which they are attached. The connections shall be designed to withstand the source design pressure and temperature and be capable of withstanding loadings induced by relative displacement and vibration. The nominal size of the takeoff connections shall not be less than NPS  $\frac{1}{2}$  for service conditions not in excess of either 900 psi (6 200 kPa) or 800°F (425°C), and NPS  $\frac{3}{4}$  (for adequate physical strength) for design conditions that exceed either of these limits. Where the size of the main is smaller than the limits given above, the takeoff connection shall not be less than the size of the main line.

(A.2) To prevent thermal shock to the main steam line by contact with the colder condensate return from the instrument, steam meter or instrument takeoff connections shall be lagged in with the steam main. For temperature in excess of 800°F (425°C), they may also be arranged to make metallic contact lengthwise with the steam main.

#### (B) Valves

(B.1) *Shutoff Valves.* Shutoff valves shall be provided at takeoff connections. They shall be capable of withstanding the design pressure and temperature of the pipe or vessel to which the takeoff adapters or nipples are attached.

#### (B.2) Blowdown Valves

(B.2.1) Blowdown valves at or near the instrument shall be of the gradual opening type. For subcritical pressure steam service, the design pressure for blowdown valves shall be not less than the design pressure of the pipe or vessel; the design temperature shall be the corresponding temperature of saturated steam. For all other services, blowdown valves shall meet the requirements of (B.1) above.

(B.2.2) When blowdown valves are used, the valves at the instrument as well as any intervening fittings and tubing between such blowdown valves and the meter shall be suitable at 100°F (40°C) for at least  $1\frac{1}{2}$  times the design pressure of the piping system, but the rating of the valve at the instrument need not exceed the rating of the blowdown valve.

(B.2.3) When blowdown valves are not used, instrument valves shall conform to the requirements of (B.2.1) above.

(C) *Reservoirs or Condensers.* In dead end steam service, the condensing reservoirs and connecting nipples, which immediately follow the shutoff valves, shall be made of material suitable for the saturated steam temperature corresponding to the main line design pressure.

#### (D) Materials for Lines Between Shutoff Valves and Instruments

(D.1) Copper, copper alloys, and other nonferrous materials may be used in dead end steam or water services up to the design pressure and temperature conditions used for calculating the wall thickness in accordance with para. 104 provided that the temperature within the connecting lines for continuous services does not exceed 406°F (208°C).

Where water temperature in the reservoir of condensers is above 406°F (208°C), a length of uninsulated steel tubing at least 5 ft (1.5 m) long shall immediately follow the condenser ahead of the connecting copper tubing to the instrument.

(D.2) The minimum size of the tubing or piping is a function of its length, the volume of fluid required to produce full scale deflections of the instrument, and the service of the instrument. When required to prevent plugging as well as to obtain sufficient mechanical strength, the inside diameter of the pipe or tube should not be less than 0.36 in. (9.14 mm), with a wall thickness of not less than 0.049 in. (1.25 mm). When these requirements do not apply, smaller sizes with wall thickness in due proportions may be used. In either case, wall thickness of the pipe or tube shall meet the requirements of (D.3) below.

(D.3) The piping or tubing shall be designed in accordance with para. 104 with consideration for water hammer.

#### (E) Fittings and Joints

(E.1) For dead end steam service and for water above 150°F (65°C), fittings of the flared, flareless, or socket welding type, or other suitable type of similar design shall be used. The fittings shall be suitable for the header pressure and corresponding saturated steam temperature or water temperature, whichever applies. For supercritical pressure conditions the fittings shall be suitable for the design pressure and temperature of the main fluid line.

(E.2) For water, oil and similar instrument services, any of the following types may be used, within the pressure-temperature limitations of each:

(E.2.1) For main line hydraulic pressures above 500 psi (3 450 kPa) and temperatures up to 150°F (65°C), steel fittings either of the flared, flareless, socket welded, fusion welded, or silver brazed socket type shall be used.

(E.2.2) For main line pressures up to 500 psi (3 450 kPa) and temperatures up to 150°F (65°C), the

fittings may be flared or silver brazed socket type, inverted flared or flareless compression type, all of brass or bronze.

(E.2.3) For pressures up to 175 psi (1 200 kPa) or temperatures up to 250°F (120°C), soldered type fittings may be used with water-filled or air-filled tubing under adjusted pressure-temperature ratings. These fittings are not recommended where mechanical vibration, hydraulic shock, or thermal shock are encountered.

### 122.3.3 Control Piping

#### (A) Takeoff Connections

(A.1) Takeoff connections shall be in accordance with para. 122.3.2(A.1).

#### (B) Valves

(B.1) Shutoff valves shall be in accordance with para. 122.3.2(B.1).

#### (C) Materials

(C.1) The same materials may be used for control lines as for instrument lines, except that the minimum inside diameter shall be 0.178 in. (4.52 mm) with a minimum wall thickness of 0.028 in. (0.71 mm), provided that this wall thickness is not less than that required by para. 122.3.2(D.3). If a control device has a connection smaller than ¼ in. (6.0 mm), the size reduction from the control tubing to the control device shall be made as close to the control device as possible.

#### (D) Fittings and Joints

(D.1) Fittings and joints shall be in accordance with para. 122.3.2(E.2).

### 122.3.4 Sampling Piping

#### (A) Takeoff Connections

(A.1) Takeoff connections shall be in accordance with para. 122.3.2(A.1).

#### (B) Valves

(B.1) Shutoff valves shall be in accordance with para. 122.3.2(B.1).

(B.2) Blowdown valves shall be of the gradual opening type and shall be suitable for main line design pressure and temperature.

#### (C) Materials

(C.1) The materials to be used for sampling lines shall conform to minimum requirements for the main line to which they connect.

#### (D) Fittings and Joints

(D.1) For subcritical and supercritical pressure steam, and for water above 150°F (65°C), fittings of the flared, flareless, or socket welding type, or other suitable type of similar design shall be used. The fittings shall be suitable for main line design pressure and temperature.

(D.2) For water below 150°F (65°C), fittings and joints shall be suitable for main line design pressure and temperature and shall be in accordance with para. 122.3.2(E.2).

### 122.3.6 Fittings and Joints

(A) All fittings shall be in accordance with standards and specifications listed in Table 126.1.

(A.1) Socket welded joints shall comply with the requirements of para. 111.3.

(A.2) Flared, flareless, and compression type fittings and their joints shall comply with the requirements of para. 115.

(A.3) Silver brazed socket type joints shall comply with the requirements of paras. 117.1 and 117.3.

(A.4) Solder type joints shall comply with the requirements of paras. 117.2 and 117.3.

(A.5) The use of taper threaded joints up to and including NPS ½ is permitted at pressures up to 5,000 psi (34 500 kPa) in dead end service from outlet end and downstream of shutoff valve located at instrument, at control apparatus, or at discharge of sample cooler.

### 122.3.7 Special Safety Provisions

(A) Connecting piping subject to clogging from solids or deposits shall be provided with suitable connections for cleaning.

(B) Connecting piping handling air and gases containing moisture or other extraneous materials shall be provided with suitable drains or settling chambers or traps.

(C) Connecting piping that may contain liquids shall be protected from damage due to freezing by heating or other adequate means.

**122.3.8 Supports.** Supports shall be furnished as specified in para. 121 not only for safety but also to protect the piping against detrimental sagging, external mechanical injury abuse, and exposure to unusual service conditions.

### 122.3.9 Installations

(A) Instrument, control, and sampling piping shall be inspected and tested in accordance with paras. 136 and 137.


(B) The inside of all piping, tubing, valves, and fittings shall be smooth, clean, and free from blisters, loose mill scale, sand, and dirt when erected. All lines shall be cleaned after installation and before placing in service.

## 122.4 Spray-Type Desuperheater Piping for Use on Steam Generators, Main Steam, and Reheat Steam Piping

#### (A) Valves and Piping Arrangement

(A.1) Each spraywater pipe connected to a desuperheater shall be provided with a stop valve and a regulating (spray control) valve. The regulating valve shall be installed upstream of the stop valve. In addition, if the steam generator supplies steam to a steam turbine, a power-operated block valve<sup>5</sup> shall be installed upstream of the regulating valve.

<sup>5</sup> For information on the prevention of water damage to steam turbines used for electric power generation, see ASME TDP-1.

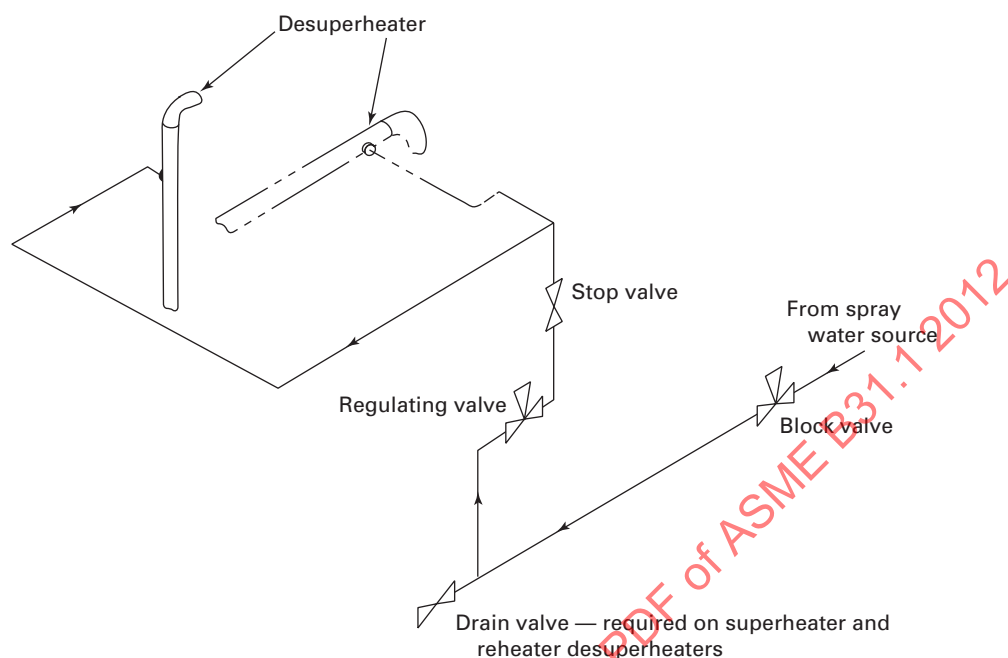**Fig. 122.4 Desuperheater Schematic Arrangement**

GENERAL NOTE: This Figure is a schematic only and is not intended to show equipment layout or orientation.

(A.2) A bypass valve around the regulating valve is permitted.

(A.3) A bypass valve around the power-operated block valve is prohibited.

(A.4) On a superheater or reheater desuperheater, a drain valve shall be installed between the power-operated block valve and the regulating valve.

(A.5) If the spraywater supply is from the boiler feedwater system and its source is not downstream of the feedwater check valve required by para. 122.1.7, a check valve shall be provided in the spraywater piping between the desuperheater and the spraywater source.

(A.6) It is recommended that the valves and piping be arranged to provide a head of water on the downstream side of the stop valve.

(A.7) A typical arrangement is shown in Fig. 122.4.

(A.8) Provisions shall be made to both steam and water systems to accommodate the operating conditions associated with this service including: water hammer, thermal shock and direct water impingement. The connection for the spraywater pipe should be located per the requirements established by the manufacturer so that complete flow mixing is achieved prior to any bends, elbows, or other flow directional changes being encountered.

(A.9) Insertable-type desuperheaters, which include an integral stop and spraywater regulating valve, may be used within the limitations established by the manufacturer. If this type is used, the individual stop and regulating valves shown in Fig. 122.4 may be

omitted. All other requirements described in para. 122.4 shall apply.

(A.10) *For Desuperheaters Located Within Main Steam or Reheat Steam Piping.* The steam system to be desuperheated shall be provided with proper drainage during all water flow conditions. The drainage system shall function both manually and automatically.

#### (B) Design Requirements

(B.1) The value of  $P$  to be used in the formulas of para. 104 shall be as follows:

(B.1.1) For piping from the desuperheater back to the stop valve required by (A.1) above, the value of  $P$  shall be equal to or greater than the maximum allowable working pressure of the desuperheater.

(B.1.2) For the remainder of the spraywater piping system, the value of  $P$  shall be not less than the maximum sustained pressure exerted by the spraywater.

(B.2) The stop valve required by (A.1) above shall be designed for the pressure requirement of (B.1.1) above or the maximum sustained pressure exerted by the spraywater, whichever is greater.

(B.3) The  $S$  value used for the spraywater piping shall not exceed that permitted for the expected temperature.

NOTE: The temperature varies from that of the desuperheater to that of the spraywater source and is highly dependent on the piping arrangement. It is the responsibility of the designer to determine the design temperature to be used for the various sections of the piping system.

**(12) 122.5 Pressure-Reducing Valves**

**122.5.1 General.** Where pressure-reducing valves are used, one or more pressure-relieving valves or devices shall be provided on the low pressure side of the system. Otherwise, the piping and equipment on the low pressure side of the system shall be designed to withstand the upstream design pressure. The pressure-relieving valves or devices shall be located adjoining or as close as practicable to the reducing valve. The combined relieving capacity provided shall be such that the design pressure of the low pressure system will not be exceeded if the reducing valve fails open.

**122.5.2 Bypass Valves.** Hand controlled bypass valves having a capacity no greater than the reducing valve may be installed around pressure reducing valves if the downstream piping is protected by pressure-relieving valves or devices as required in para. 122.5.1 or if the design pressure of the downstream piping system and equipment is at least as high as the upstream design pressure.

**122.5.3 Design of Valves and Pressure-Relieving Valves and Devices.** Pressure reducing and bypass valves, and pressure-relieving valves and devices, shall be designed for inlet pressure and temperature conditions. Pressure-relieving valves and devices shall be in accordance with the requirements of para. 107.8 of this Code.

**(12) 122.6 Pressure Relief Piping**

Pressure relief piping within the scope of this Code shall be supported to sustain reaction forces, and shall conform to the requirements of paras. 122.6.1 and 122.6.2.

**122.6.1 Piping to Pressure-Relieving Valves and Devices**

(A) There shall be no intervening stop valve(s) between piping being protected and the protective valve(s) or device(s).

(B) Diverter or changeover valves designed to allow servicing of redundant protective valves or devices without system depressurization may be installed between the piping to be protected and the required protective valves or devices under the following conditions:

(B.1) Diverter or changeover valves are prohibited on boiler external piping and reheat piping.

(B.2) One hundred percent (100%) of the required relieving capacity shall be continuously available any time the system is in service.

(B.3) Positive position indicators shall be provided on diverter or changeover valves.

(B.4) Positive locking mechanisms and seals shall be provided on diverter or changeover valves to preclude unauthorized or accidental operation.

(B.5) Diverter or changeover valves shall be designed for the most severe conditions of pressure,

temperature, and loading to which they are exposed, and shall be in accordance with para. 107.

(B.6) Provision shall be made to safely bleed off the pressure between the isolated protective valve or device and the diverter or changeover valve.

**122.6.2 Discharge Piping From Pressure-Relieving Valves and Devices**

(A) There shall be no intervening stop valve between the protective valve(s) or device(s) and the point of discharge.

(B) When discharging directly to the atmosphere, discharge shall not impinge on other piping or equipment and shall be directed away from platforms and other areas used by personnel.

(C) It is recommended that individual discharge lines be used, but if two or more reliefs are combined, the discharge piping shall be designed with sufficient flow area to prevent blowout of steam or other fluids. Sectional areas of a discharge pipe shall not be less than the full area of the valve or device outlets discharging thereto, and the discharge pipe shall be as short and straight as possible and so arranged as to avoid undue stresses on the valve(s) or device(s).

(D) Discharge lines from pressure-relieving valves and devices within the scope of this Code shall be designed to facilitate drainage.

(E) When the umbrella or drip pan type of connection is used, the discharge piping shall be so designed as to prevent binding due to expansion movements.

(F) Drainage shall be provided to remove water collected above the seat of the pressure-relieving valve or device.

(G) Carbon steel materials listed in Mandatory Appendix A may be used for discharge piping that is subjected to temperatures above 800°F (427°C) only during operation of pressure-relieving valves [see para. 107.8.3(B)] provided that

(G.1) the duration of the pressure-relieving valve's operation is self-limiting

(G.2) the piping discharges directly to atmosphere

(G.3) the allowable stresses for carbon steel materials at temperatures above 800°F (427°C) shall be taken from Section II, Part D, Table 1A for materials applicable to Section I and Section VIII, Division 1 of the ASME Boiler and Pressure Vessel Code

**122.7 Piping for Flammable or Combustible Liquids**

**122.7.1 General.** Piping for flammable or combustible liquids including fuel and lubricating oils is within the scope of this Code. Piping for synthetic lubricants having no flash or fire point need not meet the requirements of para. 122.7.

The designer is cautioned that, among other criteria, static electricity may be generated by the flowing fluid. Additionally, the designer is cautioned of the extreme chilling effect of a liquefied gas flashing to vapor during

loss of pressure. This is a factor for determining the lowest expected service temperature relative to the possibility of brittle fracture of materials. Consideration shall also be given to the pressure rise that may occur as a cold fluid absorbs heat from the surroundings.

### 122.7.2 Materials

(A) Seamless steel or nickel alloy piping materials shall be used in all areas where the line is within 25 ft (7.6 m) of equipment or other lines having an open flame or exposed parts with an operating temperature above 400°F (204°C). Seamless steel or nickel alloy pipe shall also be used for fuel oil systems located downstream of burner shutoff valve(s). The burner shutoff valve(s) shall be located as close to the burner as is practical.

(B) In all other areas, piping systems may include pipe or tube of steel, nickel alloy, copper, or brass construction. Copper tubing shall have a thickness not less than that required by para. 104.1.2(C.3), regardless of pressure. Refer also to paras. 105, 124.6, and 124.7(A).

Wherever materials other than steel or nickel alloy are used, they shall be so located that any spill resulting from the failure of these materials will not unduly expose persons, buildings, or structures, or can be readily controlled by remote valves.

(C) For lubricating oil systems, steel tubing is an acceptable alternative to steel pipe.

(D) Polyethylene (PE) and reinforced thermosetting resin (RTR) pipe may be used for flammable or combustible liquids in buried installations only. The fluid temperatures shall not exceed 140°F (60°C) and pressures shall be limited to 150 psi (1 000 kPa). Where such PE or RTR pipe is used in flammable or combustible liquid service, the rules of Nonmandatory Appendix III shall be considered mandatory. Where jurisdictional requirements mandate that double containment pipe be used, the rules of Nonmandatory Appendix III shall be applied to both the inner and outer pipe.

Particular care must be exercised to prevent damage to RTR piping at the connection to the main or other facility. Precautions shall be taken to prevent crushing or shearing of RTR piping due to external loading or settling of backfill and to prevent damage or pull out from the terminal connection resulting from thermal expansion or contraction.

RTR piping may terminate above ground and outside a building, provided that:

(D.1) the above ground portion of the RTR pipe is completely enclosed in a conduit or casing of sufficient strength to provide protection from external damage and deterioration. Where a flexible conduit is used, the top of the riser must be attached to a solid support. The conduit or casing shall extend a minimum of 6 in. (150 mm) below grade.

(D.2) the RTR pipe is not subjected to excessive stresses due to external loading.

### 122.7.3 Piping Joints

(A) Welded joints shall be used between steel or nickel alloy piping components where practicable. Where bolted flanged joints are necessary, the gasket material shall be suitable for the service. Where threaded joints and compression fittings are unavoidable, the following requirements shall be met:

(A.1) For threaded joints, the pipe thickness shall be not less than Extra Strong regardless of pressure or type of material.

(A.2) The requirements of para. 114 shall apply to all threaded joints.

(A.3) Threaded joints and compression fittings shall be assembled carefully to ensure leak tightness. Threaded joints shall meet the requirements of para. 135.5. Compression fittings shall meet the requirements of paras. 115 and 135.6. A thread sealant, suitable for the service, shall be used in threaded joints unless the joint is to be seal welded or a gasket or O-ring is used to provide sealing at a surface other than the threads.

(B) Threaded joints in copper or brass pipe shall be subject to the same limitations as for steel pipe in (A.1), (A.2), and (A.3), above.

(C) Copper tubing shall be assembled with flared, flareless, or compression type joints as prescribed in para. 115, or brazed in accordance with para. 117. Soft solder type joints are prohibited.

(D) RTR pipe shall be adhesive bonded in accordance with the pipe manufacturer's recommended procedures.

(E) Pipe joints dependent on the friction characteristics or resiliency of combustible materials for mechanical or leak tightness of piping shall not be used inside buildings.

(F) Steel tubing shall be assembled with fittings in accordance with para. 115, or with socket weld fittings.

**122.7.4 Valves and Specialties.** Valves, strainers, meters, and other specialties shall be of steel or nickel alloy construction. As an alternative, ductile or malleable iron or copper alloy valves and specialties may be used, subject to the restrictions in paras. 124.6 and 124.7, where metal temperatures do not exceed 400°F (204°C).

### 122.8 Piping for Flammable Gases, Toxic Fluids (Gases or Liquids), or Nonflammable Nontoxic Gases

(A) Although some gases are liquefied for storage or transport, they shall be considered as gases if their Reid vapor pressure is greater than 40 psia [2 068.6 mm Hg (absolute)] at 100°F (37.8°C).

(B) Threaded joints and compression fittings may be used subject to the limitations of para. 114.2.1(B) and other specific limitations identified below, except they are permitted at connections to refillable storage containers and associated pressure regulators, shutoff valves, pumps, and meters, to a maximum pressure of 5,000 psig

[34 475 kPa (gage)], provided the size does not exceed NPS  $\frac{3}{4}$  (DN 20).

**(12) 122.8.1 Flammable Gas**

(A) Some of the common flammable gases are acetylene, ethane, ethylene, hydrogen, methane, propane, butane, and natural or manufactured gas used for fuel. It shall be the designers' responsibility to determine the limiting concentrations (upper and lower explosive limits) and the properties of the gas under consideration. The use of explosive concentrations shall be avoided, or the piping shall be designed to withstand explosive forces.

Vent lines shall be routed in such a way as to avoid explosive concentrations while venting. Each flammable gas vent point shall be subjected to a hazard analysis that requires owner approval. The hazard analysis shall address

- (A.1) dissipation of the flammable gases
- (A.2) avoiding explosive concentrations
- (A.3) mitigating possible ignition sources by stopping hot work and other means
- (A.4) impingement of gases on nearby objects
- (A.5) foreign objects propelled by venting
- (A.6) chilling effect from the venting operation
- (A.7) protection of people by evacuation, by use of appropriate personal protective equipment, or by other means

The chilling effect from venting is a factor for determining the lowest expected service temperature relative to the possibility of brittle fracture of materials.

(B) *Materials.* Steel piping, subject to the limitations in para. 105, shall be used for all flammable gases, except as otherwise permitted in (B.2), (B.3), and (B.4) below.

(B.1) Welded joints shall be used between steel components where practicable. Where bolted flanged joints are necessary, the gasket material shall be suitable for the service. Where threaded joints and compression fittings are unavoidable, the following requirements shall be met:

(B.1.1) For threaded joints, the pipe thickness shall be not less than Extra Strong regardless of pressure or type of material.

(B.1.2) Threaded joints and compression fittings may be used subject to the limitations of para. 122.8(B).

(B.1.3) Threaded joints and compression fittings shall be assembled carefully to ensure leak tightness. Threaded joints shall meet the requirements of para. 135.5. Compression fittings shall meet the requirements of paras. 115 and 135.6. A thread sealant, suitable for the service, shall be used in threaded joints unless the joint is to be seal welded or a gasket or O-ring is used to provide sealing at a surface other than the threads.

(B.2) For hydrogen systems, the following alternative materials may be used:

(B.2.1) seamless steel tubing with welded joints;

(B.2.2) seamless copper or brass pipe or tubing with brazed, threaded, or compression fitting joints. Threaded fittings shall not exceed NPS  $\frac{3}{4}$  (DN 20). For protection against damage, tubing shall be installed in a guarded manner that will prevent damage during construction, operation, or service. Valves with suitable packing, gages, regulators, and other equipment may also consist of copper alloy materials. Safety relief devices shall be vented individually, and connected vent piping shall be designed to convey the fluid, without pockets, to the outside atmosphere; and then directed away from equipment ventilation systems, and vents from other systems.

(B.3) For fuel gas instrumentation and control, seamless copper tubing subject to the following restrictions may be used:

(B.3.1) The design pressure shall not exceed 100 psi (690 kPa).

(B.3.2) Tubing shall not exceed  $\frac{5}{8}$  in. (15.9 mm) nominal outside diameter.

(B.3.3) All joints shall be made with compression or flared fittings.

(B.3.4) Copper tubing shall not be used if the fuel gas contains more than 0.3 grains (19.4 mg) of hydrogen sulfide per 100 ft<sup>3</sup>/min (47 liters/sec) of gas at standard conditions.

(B.3.5) Consideration shall be given in the design to the lower strength and melting point of copper compared to steel. Adequate support and protection from high ambient temperatures and vibration shall be provided.

(B.3.6) Tubing shall be installed in a guarded manner that will prevent damage during construction, operation, and service.

(B.4) Polyethylene (PE) pipe may be used for natural gas service in buried installations only. The fluid temperatures shall not exceed 140°F (60°C) nor be below -20°F (-30°C), and pressures shall be limited to 100 psi (690 kPa). Pipe joints shall be heat fused in accordance with manufacturer's recommended procedures. Where PE pipe is used in flammable gas service, the rules of Nonmandatory Appendix III shall be considered mandatory.

(C) *Valves and Specialties.* Valves, strainers, meters, and other specialties shall be of steel or nickel alloy construction. As an alternative, ductile iron or copper alloy valves and specialties may be used, subject to the restrictions in paras. 124.6 and 124.7, where metal temperatures do not exceed 400°F (204°C).

(D) For in-plant fuel gas distribution system(s) where the use of a full-relieving-capacity safety or safety-relief valve(s) as described in para. 107.8.3(B) could create an undue venting hazard, an alternative pressure limiting design may be substituted. The alternative design shall include all provisions below:

(D.1) *Tandem Gas Pressure Reducing Valves.* To protect the low pressure system, two gas pressure reducing valves capable of independent operation shall be installed in series. Each shall have the capability of closing off against the maximum upstream pressure, and of controlling the pressure on the low pressure side at or below the design pressure of the low pressure system, in the event that the other valve fails open. Control lines must be suitably protected, designed, and installed so that damage to any one control line will not result in over pressurizing the downstream piping.

(D.2) *Trip Stop Valve.* A fail-safe trip stop valve shall be installed to automatically close, in less than 1 sec, at or below the design pressure of the downstream piping. It shall be a manually reset design. The pressure switch for initiating closure of the trip stop valve shall be hard-wired directly to the valve tripping circuit. The pressure switch shall be mounted directly on the low pressure piping without an intervening isolation valve. The trip stop valve shall be located so that it is accessible and protected from mechanical damage and from weather or other ambient conditions that could impair its proper functioning. It may be located upstream or downstream of the tandem gas pressure reducing valves. The trip stop valve and all upstream piping shall be designed for the maximum upstream supply pressure. The trip stop valve may also serve as the upstream isolation valve of a double-block and vent gas supply isolation system. Provision shall be made to safely bleed off the pressure downstream of the trip stop valve.

(D.3) *Safety Pressure Relief.* The low pressure system shall be protected from any leakage through the pressure reducing valves, when closed, by a safety-relief valve constructed and designed in accordance with para. 107.8.3(B), and sized for the possible leakage rate.

### 122.8.2 Toxic Fluids (Gas or Liquid)

(A) For the purpose of this Code, a toxic fluid is one that may be lethal, or capable of producing injury and/or serious illness through contact, inhalation, ingestion, or absorption through any body surface. It shall be the designers' responsibility to adopt the safety precautions published by the relevant fluid industry which may be more stringent than those described in this Code for toxic fluids. In addition, the piping shall be installed in such a manner that will minimize the possibility of damage from external sources.

(B) Preferably, pipe and pipe fittings should be seamless steel. Wall thickness shall not be less than that in Table 122.8.2(B).

If the fluid is known to be corrosive to the steels in Table 122.8.2(B), the materials and wall thickness selected shall be suitable for the service. (Refer to para. 104.1.2.)

(C) Welded joints shall be used between steel components where practicable. Backing rings used for making girth butt welds shall be removed after welding. Miter

**Table 122.8.2(B) Minimum Wall Thickness Requirements for Toxic Fluid Piping**

|                           | Carbon and Low Alloy Steel<br>(Mandatory Appendix A, Tables A-1 and A-2) | Stainless and Nickel Alloy Steel<br>(Mandatory Appendix A, Tables A-3 and A-4) |
|---------------------------|--------------------------------------------------------------------------|--------------------------------------------------------------------------------|
| NPS 2 (DN 50) and smaller | Extra strong                                                             | Schedule 10S                                                                   |
| Larger than NPS 2 (DN 50) | Standard weight                                                          | Schedule 5S                                                                    |

welds are prohibited. Fabricated branch connections (shaped branch pipe welded directly to run pipe) may be used only if other types of branch connections permitted by para. 104.3.1 are not available. Socket welded joints shall be used only with steel materials and shall not be larger than NPS 2½ (DN 65). Where bolted flanged joints are necessary, socket weld or welding neck flanges shall be used. Gasket materials shall be suitable for the service. Compression fittings are prohibited. Where the use of threaded joints is unavoidable, all of the following requirements shall be met:

(C.1) The pipe thickness shall be not less than Extra Strong, regardless of pressure or type of material.

(C.2) In addition to the provisions of para. 122.8(B), threaded joints and compression fittings may be used at connections to refillable storage containers and associated pressure regulators, shutoff valves, pumps, and meters to a maximum pressure of 50 psig [345 kPa (gage)], provided the size does not exceed NPS 2 (DN 50).

(C.3) Threaded joints shall be assembled carefully to ensure leak tightness. The requirements of para. 135.5 shall be met. A thread sealant, suitable for the service, shall be used unless the joint is to be seal welded or a gasket or O-ring is used to provide sealing at a surface other than the threads.

(D) Steel valves shall be used. Bonnet joints with tapered threads are not permitted. Special consideration shall be given to valve design to prevent stem leakage to the environment. Bonnet or cover plate closures and other body joints shall be one of the following types:

(D.1) union

(D.2) flanged with suitable gasketing and secured by at least four bolts

(D.3) proprietary, attached by bolts, lugs, or other substantial means, and having a design that increases gasket compression as fluid pressure increases

(D.4) threaded with straight threads sufficient for mechanical strength, metal-to-metal seats, and a seal weld made in accordance with para. 127.4.5, all acting in series

(E) Tubing not larger than  $\frac{5}{8}$  in. (16 mm) O.D. with socket welding fittings may be used to connect instruments to the process line. An accessible root valve shall be provided at the process lines to permit isolating the tubing from the process piping. The layout and mounting of tubing shall minimize vibration and exposure to possible damage.

(F) The provisions of para. 102.2.4 are not permitted. The simplified rules for analysis in para. 119.7.1 (A.3) are not permitted. The piping system shall be designed to minimize impact and shock loads. Suitable dynamic analysis shall be made where necessary to avoid or minimize vibration, pulsation, or resonance effects in the piping. The designer is cautioned to consider the possibility of brittle fracture of the steel material selected over the entire range of temperatures to which it may be subjected.

(G) For dry chlorine service between  $-29^{\circ}\text{C}$  ( $-20^{\circ}\text{F}$ ) and  $149^{\circ}\text{C}$  ( $300^{\circ}\text{F}$ ), the pipe material shall not be less in thickness than seamless Extra Strong steel.

(H) Toxic fluid piping shall be pneumatic leak tested in accordance with para. 137.5. Alternatively, mass spectrometer or halide leak testing in accordance with para. 137.6, and a hydrostatic test in accordance with para. 137.3 may be performed.

### 122.8.3 Nonflammable Nontoxic Gas

(A) Piping for nonflammable and nontoxic gases, such as air, oxygen, carbon dioxide, and nitrogen, shall comply with the requirements of this Code, except as otherwise permitted in (B) (below). The designer is cautioned of the extreme chilling effect during rapid expansion. This is a factor for determining the lowest expected service temperature relative to the brittle fracture of the material selected.

(B) Threaded joints and compression fittings may be used subject to the conditions of para. 122.8(B).

### 122.9 Piping for Corrosive Liquids and Gases

Where it is necessary to use special material, such as glass, plastics, or metallic piping lined with nonmetals, not listed in Table 126.1, for conveying corrosive or hazardous liquids and gases, the design shall meet the requirements of para. 104.7.

### (12) 122.10 Temporary Piping Systems

Prior to test and operation of the power plant and its included piping systems, most power and auxiliary service piping are subjected to flushing or chemical cleaning to remove internal foreign material such as rust particles, scale, welding or brazing residue, dirt, etc., which may have accumulated within the piping during the construction period. This Code does not address the flushing or cleaning operations. Temporary piping, that is piping attached to the permanent piping system whose function is to provide means for introducing and removing the fluids used in the flushing or cleaning

operations, shall be designed and constructed to withstand the operating conditions during flushing and cleaning. The following minimum requirements shall apply to temporary piping systems:

(A) Each such system shall be analyzed for compliance with para. 103.

(B) Connections for temporary piping to the permanent piping systems that are intended to remain, shall meet the design and construction requirements of the permanent system to which they are attached.

(C) The temporary systems shall be supported such that forces and moments due to static, dynamic and expansion loadings will not be transferred in an unacceptable manner to the connected permanent piping system. Paragraphs 120 and 121 shall be used as guidance for the design of the temporary piping systems supporting elements.

(D) The temporary systems shall be capable of withstanding the cyclic loadings that occur during the flushing and cleaning operations. Particular attention shall be given to the effects of large thrust forces that may be generated during high velocity blowing cycles. Where steam piping is to be subjected to high velocity blowing operations, continuous or automatic draining of trapped or potentially trapped water within the system shall be incorporated. Supports at the exhaust terminals of blowdown piping shall provide for restraint of potential pipe whip.

(E) Where necessary, temporary systems containing cast iron or carbon steel material subject to chemical cleaning shall be prewarmed to avoid the potential for brittle failure of the material.

(F) Where temporary piping has been installed and it does not comply with the requirements of this Code for permanent piping systems, it shall be physically removed or separated from the permanent piping to which it is attached prior to testing of the permanent piping system and prior to plant startup.

### 122.11 Steam Trap Piping

**122.11.1 Drip Lines.** Drip lines from piping or equipment operating at different pressures shall not be connected to discharge through the same trap.

**122.11.2 Discharge Piping.** Trap discharge piping shall be designed to the same pressure as the inlet piping unless the discharge is vented to atmosphere, or is operated under low pressure and has no stop valves. In no case shall the design pressure of trap discharge piping be less than the maximum discharge pressure to which it may be subjected. Where two or more traps discharge into the same header, a stop valve shall be provided in the discharge line from each trap. Where the pressure in the discharge piping can exceed the pressure in the inlet piping, a check valve shall be provided in the trap discharge line. A check valve is not required if either the stop valve or the steam trap is designed to automatically

prevent reverse flow and is capable of withstanding a reverse differential pressure equal to the design pressure of the discharge piping.

(12) **122.12 Exhaust and Pump Suction Piping**

Exhaust and pump suction lines for any service and pressure shall have pressure-relieving valves or devices of suitable size unless the lines and attached equipment are designed for the maximum pressure to which they may accidentally or otherwise be subjected, or unless a suitable alarm indicator, such as a whistle or free blowing pressure-relieving valve, is installed where it will warn the operator.

(12) **122.13 Pump Discharge Piping**

Pump discharge piping from the pump up to and including the valve normally used for isolation or flow control shall be designed for the maximum sustained pressure exerted by the pump and for the highest coincident fluid temperature, as a minimum. Variations in pressure and temperature due to occasional inadvertent operation are permitted as limited in para. 102.2.4 under any of the following conditions:

(A) during operation of overpressure relieving valves designed to protect the piping system and the attached equipment

(B) during a short period of abnormal operation, such as pump overspeed

(C) during uncontrolled transients of pressure or temperature

(12) **122.14 District Heating and Steam Distribution Systems**

**122.14.1 General.** Where pressure reducing valves are used, one or more pressure-relieving valves or

devices shall be provided on the low pressure side of the system. Otherwise, the piping and equipment on the low pressure side of the system shall be designed to withstand the upstream design pressure. The pressure-relieving valve(s) or device(s) shall be located adjoining or as close as practicable to the reducing valve. The combined relieving capacity provided shall be such that the design pressure of the low pressure system will not be exceeded if the reducing valve fails open.

**122.14.2 Alternative Systems.** In district heating and steam distribution systems where the steam pressure does not exceed 400 psi (2 750 kPa) and where the use of pressure-relieving valves or devices as described in para. 122.14.1 is not feasible (e.g., because there is no acceptable discharge location for the vent piping), alternative designs may be substituted for the relief valve(s) or device(s). In either case, it is recommended that alarms be provided that will reliably warn the operator of failure of any pressure reducing valve.

(A) *Tandem Steam Pressure Reducing Valves.* Two or more steam pressure reducing valves capable of independent operation may be installed in series, each set at or below the safe working pressure of the equipment and piping system served. In this case, no relief valve or device is required.

Each pressure reducing valve shall have the capability of closing off against full line pressure, and of controlling the reduced pressure at or below the design pressure of the low pressure system, in the event that the other valve fails open.

(B) *Trip Stop Valves.* A trip stop steam valve set to close at or below the design pressure of the low pressure system may be used in place of a second reducing valve or a relief valve.

## Chapter III Materials

### 123 GENERAL REQUIREMENTS

Chapter III contains limitations and required qualifications for materials based on their inherent properties. Use of these materials in piping systems is also subject to requirements and limitations in other parts of this Code.

#### 123.1 Materials and Specifications

**123.1.1 Listed Materials.** Material meeting the following requirements shall be considered listed and acceptable material:

(A) Materials for which allowable stress values are listed in Mandatory Appendix A or that have been approved by the procedure established by (C) below.

(B) A material conforming to a specification for which allowable stresses are not listed in Mandatory Appendix A is acceptable provided its use is not specifically prohibited by this Code Section and it satisfies one of the following requirements:

(B.1) It is referenced in a standard listed in Table 126.1. Such a material shall be used only within the scope of and in the product form covered by the referencing standard listed in Table 126.1.

(B.2) It is referenced in other parts of this Code Section and shall be used only within the scope of and in the product form permitted by the referencing text.

(C) Where it is desired to use materials that are not currently acceptable under the rules of this Code Section, written application shall be made to the Committee fully describing the proposed material and the contemplated use. Such material shall not be considered listed and not used as a listed material until it has been approved by the Committee and allowable stress values have been assigned. Details of information that should be included in such applications are given in Nonmandatory Appendix VI. See para. 123.1.2.

(D) Materials conforming to ASME SA or SB specifications may be used interchangeably with material specified to the listed ASTM A or B specifications of the same number, except where the requirements of para. 123.2.2 apply.

(E) The tabulated stress values in Mandatory Appendix A that are shown in italics are at temperatures in the range where creep and stress rupture strength govern the selection of stresses.

**123.1.2 Unlisted Materials.** Materials other than those meeting the requirements of para. 123.1.1 shall be

considered unlisted materials. Such unlisted materials may only be used for nonboiler external piping provided they satisfy all of the following requirements:

(A) Unlisted materials are certified by the material manufacturer to satisfy the requirements of a specification listed in any Code Section of the ASME B31 Code for Pressure Piping, the ASME Boiler and Pressure Vessel Code, Section II, Part D, or to a published specification covering chemistry, physical and mechanical properties, method and process of manufacture, heat treatment, and quality control.

(B) The allowable stresses of the unlisted materials shall be determined in accordance with the rules of para. 102.3.1(C).

(C) Unlisted materials shall be qualified for service within a stated range of minimum and maximum temperatures based upon data associated with successful experience, tests, or analysis; or a combination thereof.

(D) The designer shall document the owner's acceptance for use of unlisted material.

(E) All other requirements of this Code are satisfied.

**123.1.3 Unknown Materials.** Materials of unknown specification shall not be used for pressure containing piping components.

**123.1.5 Size or Thickness.** Materials outside the limits of size or thickness given in the title or scope clause of any specification listed in Table 126.1 may be used if the material is in compliance with the other requirements of the specification, and no other similar limitation is given in the rules for construction.

**123.1.6 Marking of Materials or Products.** Materials or products marked as meeting the requirements for more than one grade, type, or alloy of a material specification or multiple specifications, are acceptable provided

(A) one of the markings includes the material specification, grade, class, and type or alloy of the material permitted by this Code and the material meets all the requirements of that specification

(B) the appropriate allowable stress for the specified grade, type, or alloy of a material specification from Mandatory Appendix A is used

(C) all other requirements of this Code are satisfied for the material permitted

**123.1.7 Materials Manufactured to Other Specification Editions.** Materials may meet the requirements of material specification editions other than the editions listed in Mandatory Appendix F provided

(A) the materials are the same specification, grade, type, class, or alloy, and heat-treated condition, as applicable.

(B) the material tensile and yield strengths shall be compared and any differences shall be evaluated. If the material has a lower strength than required by the edition of the specification in Mandatory Appendix F, the effect of the reduction on the allowable stress and the design shall be reconciled.

## 123.2 Piping Components

**123.2.1 General.** Materials that do not comply with the rules of para. 123.1 may be used for flared, flareless, and compression type tubing fittings, provided that the requirements of para. 115 are met.

### 123.2.2 Boiler External Piping

(A) Materials for boiler external piping, as defined in para. 100.1.2(A), shall be specified in accordance with ASME SA, SB, or SFA specifications. Material produced under an ASTM specification may be used, provided that the requirements of the ASTM specification are identical or more stringent than the ASME specification for the Grade, Class, or Type produced. The material manufacturer or component manufacturer shall certify, with evidence acceptable to the Authorized Inspector, that the ASME specification requirements have been met. Materials produced to ASME or ASTM material specifications are not limited as to country of origin.

(B) Materials that are not fully identified shall comply with PG-10 of Section I of the ASME Boiler and Pressure Vessel Code.

(C) In addition to materials listed in Mandatory Appendix A without Note (1), materials that are listed in Section I of the ASME Boiler and Pressure Vessel Code may be used in boiler external piping. When such Section I materials are used, the allowable stresses shall be those listed in Section II, Part D, Subpart 1, Tables 1A and 1B applicable to Section I. For these Section I materials, the applicable requirements in Table 1A, Table 1B, and Section I paras. PG-5 through PG-13, PW-5, PWT-5, PMB-5, and PEB-5 shall be met.

## 123.3 Pipe-Supporting Elements

Materials used for pipe-supporting elements shall be suitable for the service and shall comply with the requirements of para. 121.2(C), para. 121.7.2(C), para. 121.7.2(D), para. 123.1, or MSS SP-58. When utilizing MSS SP-58, the allowable stresses for unlisted materials shall be established in accordance with the rules of para. 102.3.1(C) of ASME B31.1 in lieu of para. 4.4 of MSS SP-58.

## 123.4 Longitudinal-Welded or Spiral-Welded Pipe With Filler Metal Added

(A) For the purposes of para. 104.1.1, the start of the creep range is the highest temperature where the non-italicized stress values end in Mandatory Appendix A.

(B) All welds in longitudinal-welded or spiral-welded pipe operating in the creep range shall receive and pass a 100% volumetric examination (RT or UT) per the applicable material specification or in accordance with para. 136.4.5 or 136.4.6 and Table 136.4, or the joint efficiency factor (used as a multiplier to the weld strength reduction factor) from Table 102.4.7 shall be used.

## 124 LIMITATIONS ON MATERIALS

### 124.1 Temperature Limitations

**124.1.1 Upper Temperature Limits.** The materials listed in the Allowable Stress Tables A-1 through A-10, Mandatory Appendix A, shall not be used at design temperatures above those for which stress values are given except as permitted by para. 122.6.2(G).

**124.1.2 Lower Temperature Limits.** The designer shall give consideration to the possibility of brittle fracture at low service temperature.

### 124.2 Steel

(12)

(A) Upon prolonged exposure to temperatures above 800°F (427°C), the carbide phase of plain carbon steel, plain nickel alloy steel, carbon-manganese alloy steel, manganese-vanadium alloy steel, and carbon-silicon steel may be converted to graphite.

(B) Upon prolonged exposure to temperatures above 875°F (468°C), the carbide phase of alloy steels, such as carbon-molybdenum, manganese-molybdenum-vanadium, manganese-chromium-vanadium, and chromium-vanadium, may be converted to graphite.

(C) Carbon or alloy steel having carbon content of more than 0.35% shall not be used in welded construction or be shaped by oxygen cutting process or other thermal cutting processes.

(D) Where low alloy 2¼% chromium steels are used at temperatures above 850°F (454°C), the carbon content of the base material and weld filler metal shall be 0.05% or higher.

### 124.4 Cast Gray Iron

(12)

The low ductility of cast gray iron may result in sudden failure if shock loading (pressure, temperature, or mechanical) should occur. Possible shock loadings and consequences of failure must be considered before specifying the use of such material. Cast iron components may be used within the nonshock pressure-temperature ratings established by the standards and specifications herein and in para. 105.2.1(B). Castings to ASME SA-278 and ASTM A278 shall have maximum limits of 250 psig [1 725 kPa (gage)] and 450°F (232°C).

The following referenced paragraphs prohibit or restrict the use of gray cast iron for certain applications or to certain pressure–temperature ratings:

|                                  |                                |
|----------------------------------|--------------------------------|
| Pipe supports                    | 121.7.2(C)                     |
| BEP blowoff                      | 122.1.4(A.3)                   |
| BEP blowdown                     | 122.1.4(B.3)                   |
| BEP valves and fittings          | 122.1.7                        |
| Blowoff valves                   | 122.1.7(C.5) and (C.6)         |
| Non-BEP blowoff                  | 122.2(A.1)                     |
| Non-BEP blowdown                 | 122.2(A.2)                     |
| Flammable or combustible liquids | 122.7.2(A) and (B),<br>122.7.4 |
| Flammable gases                  | 122.8.1(B) and (C)             |
| Toxic gases or liquids           | 122.8.2(B) and (D)             |

## (12) 124.5 Malleable Iron

Certain types of malleable iron have low ductility characteristics and may be subject to brittle fracture. Malleable iron may be used for design conditions not to exceed 350 psig [2 415 kPa (gage)] or 450°F (232°C).

The following referenced paragraphs prohibit or restrict the use of malleable iron for certain applications or to certain pressure–temperature ratings:

|                                  |                                |
|----------------------------------|--------------------------------|
| Pipe supports                    | 121.7.2(D)                     |
| BEP blowoff                      | 122.1.4(A.3)                   |
| BEP blowdown                     | 122.1.4(B.3)                   |
| Non-BEP blowoff                  | 122.2(A.1)                     |
| Non-BEP blowdown                 | 122.2(A.2)                     |
| Flammable or combustible liquids | 122.7.2(A) and (B),<br>122.7.4 |
| Flammable gases                  | 122.8.1(B) and (C)             |
| Toxic gases or liquids           | 122.8.2(B) and (D)             |

## (12) 124.6 Ductile (Nodular) Iron

Ductile iron components complying with ANSI/AWWA C110/A21.10, C115/A21.15, C151/A21.51, or C153/A21.53 may be used for water and other nontoxic, nonflammable service, with pressure limits as specified in those standards and temperature limits as specified in para. 106(E). These components may not be used for boiler external piping.

Ductile (nodular) iron components conforming to ASME B16.42 may be used for services including boiler external piping under the following conditions:

(A) Components for boiler external piping shall be used only within the following limitations.

(A.1) Only ASME SA-395 material may be used.

(A.2) Design pressure shall not exceed 350 psig [2 415 kPa (gage)].

(A.3) Design temperature shall not exceed 450°F (232°C).

(B) Welding shall not be used, either in fabrication of the components or in their assembly as a part of a piping system.

(C) The following referenced paragraphs prohibit or restrict the use of ductile iron for certain applications or to certain pressure–temperature ratings:

|                                  |                                |
|----------------------------------|--------------------------------|
| BEP blowoff                      | 122.1.4(A.3)                   |
| BEP blowdown                     | 122.1.4(B.3)                   |
| BEP blowoff valves               | 122.1.7(C.5) and (C.6)         |
| Non-BEP blowoff                  | 122.2(A.1)                     |
| Non-BEP blowdown                 | 122.2(A.2)                     |
| Flammable or combustible liquids | 122.7.2(A) and (B),<br>122.7.4 |
| Flammable gases                  | 122.8.1(B) and (C)             |
| Toxic gases or liquids           | 122.8.2(B) and (D)             |
| Pipe supports                    | 123.3                          |

## 124.7 Nonferrous Metals

Nonferrous metals may be used in piping systems under the following conditions:

(A) The melting points of copper, copper alloys, aluminum, and aluminum alloys must be considered particularly where there is a fire hazard.

(B) The Designer shall consider the possibility of galvanic corrosion when combinations of dissimilar metals, such as copper, aluminum, and their alloys, are used in conjunction with each other or with steel or other metals in the presence of an electrolyte.

(C) *Threaded Connections.* A suitable thread compound shall be used in making up threaded joints in aluminum pipe to prevent seizing that might cause leakage and perhaps prevent disassembly. Pipe in the annealed temper should not be threaded.

## 124.8 Cladding and Lining Materials

Materials with cladding or lining may be used provided that

(A) the base material is an approved Code material. The allowable stress used shall be that of the base metal at the design temperature.

(B) the cladding or lining is a material that in the judgment of the user is suitable for the intended service, and the cladding/lining and its method of application do not detract from the serviceability of the base material.

(C) bending procedures are such that damaging or detrimental thinning of the cladding material is prevented.

(D) welding and the inspection of welds is in accordance with the provisions of Chapters V and VI of this Code.

(E) the thickness of the cladding is not credited for structural strength in the piping design.

## 124.9 Nonmetallic Pipe

This Code recognizes the existence of a wide variety of nonmetallic piping materials that may be used on corrosive (either internal or external) or other specialized applications. Extreme care must be taken in their selection as their design properties vary greatly and depend

upon the material, type and grade. Particular consideration shall be given to the possibility of

(A) destruction where fire hazard is involved.

(B) decrease in tensile strength at slight increase in temperature.

(C) effects of toxicity. Another consideration is that of providing adequate support for the flexible pipe.

For nonmandatory rules for nonmetallic piping, see Nonmandatory Appendix III of this Code.

#### **124.10 Deterioration of Materials in Service**

It is the responsibility of the engineer to select materials suitable for the intended application. Some guideline

for selection of protective coatings for metallic piping are provided in Nonmandatory Appendix IV.

### **125 MATERIALS APPLIED TO MISCELLANEOUS PARTS**

#### **125.1 Gaskets**

Limitations on gasket materials are covered in para. 108.4.

#### **125.2 Bolting**

Limitations on bolting materials are covered in para. 108.5.

ASMENORMDOC.COM : Click to view the full PDF of ASME B31.1 2012

The fabrication, assembly, examination, inspection, and testing requirements of Chapters V and VI apply to the construction of piping systems. These requirements are not applicable to piping components manufactured in accordance with the documents listed in Table 126.1 unless specifically so stated.

**Table 126.1 Specifications and Standards****(12)**

| Designator                                  | Title                                                                                                                       |
|---------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------|
| <b>AISC Publication</b>                     |                                                                                                                             |
| ...                                         | Manual of Steel Construction Allowable Stress Design                                                                        |
| <b>ASCE Standard</b>                        |                                                                                                                             |
| ASCE/SEI 7                                  | Minimum Design Loads for Buildings and Other Structures                                                                     |
| <b>ASTM Ferrous Material Specifications</b> |                                                                                                                             |
| <b>Bolts, Nuts, and Studs</b>               |                                                                                                                             |
| A193/A193M                                  | Alloy-Steel and Stainless Steel Bolting Materials for High-Temperature Service                                              |
| A194/A194M                                  | Carbon and Alloy Steel Nuts for Bolts for High-Pressure and High-Temperature Service                                        |
| A307                                        | Carbon Steel Bolts and Studs, 60,000 psi Tensile Strength                                                                   |
| A320/A320M                                  | Alloy-Steel Bolting Materials for Low-Temperature Service                                                                   |
| A354                                        | Quenched and Tempered Alloy Steel Bolts, Studs and Other Externally-Threaded Fasteners                                      |
| A437/A437M                                  | Stainless and Alloy-Steel Turbine-Type Bolting Material Specially Heat-Treated for High Temperature Service                 |
| A449                                        | Hex Cap Screws, Bolts, and Studs, Steel, Heat Treated                                                                       |
| A453 / A453M                                | High-Temperature Bolting Materials, With Expansion Coefficients Comparable to Austenitic Steels                             |
| <b>Castings</b>                             |                                                                                                                             |
| A47/A47M                                    | Ferritic Malleable Iron Castings                                                                                            |
| A48/A48M                                    | Gray Iron Castings                                                                                                          |
| A126                                        | Gray Iron Castings for Valves, Flanges, and Pipe Fittings                                                                   |
| A197/A197M                                  | Cupola Malleable Iron                                                                                                       |
| A216/A216M                                  | Steel Castings, Carbon Suitable for Fusion Welding for High Temperature Service                                             |
| A217/A217M                                  | Steel Castings, Martensitic Stainless and Alloy, for Pressure-Containing Parts Suitable for High-Temperature Service        |
| A278/A278M                                  | Gray Iron Castings for Pressure-Containing Parts for Temperatures Up to 650°F (350°C)                                       |
| A351/A351M                                  | Steel Castings, Austenitic, for High-Temperature Service                                                                    |
| A389/A389M                                  | Steel Castings, Alloy, Specially Heat-Treated for Pressure-Containing Parts Suitable for High-Temperature Service           |
| A395/A395M                                  | Ferritic Ductile Iron Pressure-Retaining Castings for Use at Elevated Temperatures                                          |
| A536                                        | Ductile Iron Castings                                                                                                       |
| <b>Forgings</b>                             |                                                                                                                             |
| A105/A105M                                  | Carbon Steel Forgings for Piping Applications                                                                               |
| A181/A181M                                  | Carbon Steel Forgings for General Purpose Piping                                                                            |
| A182/A182M                                  | Forged or Rolled Alloy and Stainless Steel Pipe Flanges, Forged Fittings, and Valves and Parts for High-Temperature Service |
| A336/A336M                                  | Alloy Steel Forgings for Pressure and High-Temperature Parts                                                                |
| A350/A350M                                  | Carbon and Low-Alloy Steel Forgings Requiring Notch Toughness Testing for Piping                                            |
| <b>Cast Pipe</b>                            |                                                                                                                             |
| A377                                        | Standard Index of Specifications for Ductile Iron Pressure Pipe                                                             |
| A426/A426M                                  | Centrifugally Cast Ferritic Alloy Steel Pipe for High-Temperature Service                                                   |
| A451/A451M                                  | Centrifugally Cast Austenitic Steel Pipe for High-Temperature Service                                                       |
| <b>Seamless Pipe and Tube</b>               |                                                                                                                             |
| A106/A106M                                  | Seamless Carbon Steel Pipe for High-Temperature Service                                                                     |
| A179/A179M                                  | Seamless Cold-Drawn Low-Carbon Steel Heat-Exchanger and Condenser Tubes                                                     |
| A192/A192M                                  | Seamless Carbon Steel Boiler Tubes for High-Pressure Service                                                                |
| A210/A210M                                  | Seamless Medium-Carbon Steel Boiler and Superheater Tubes                                                                   |
| A213/A213M                                  | Seamless Ferritic and Austenitic Alloy-Steel Boiler, Superheater, and Heat-Exchanger Tubes                                  |
| A335/A335M                                  | Seamless Ferritic Alloy Steel Pipe for High-Temperature Service                                                             |
| A369/A369M                                  | Carbon and Ferritic Alloy Steel Forged and Bored Pipe for High-Temperature Service                                          |
| A376/A376M                                  | Seamless Austenitic Steel Pipe for High-Temperature Central-Station Service                                                 |

(12)

**Table 126.1 Specifications and Standards (Cont'd)**

| Designator                                           | Title                                                                                                              |
|------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------|
| <b>ASTM Ferrous Material Specifications (Cont'd)</b> |                                                                                                                    |
| <b>Seamless and Welded Pipe and Tube</b>             |                                                                                                                    |
| A53/A53M                                             | Pipe, Steel, Black and Hot-Dipped, Zinc-Coated Welded and Seamless                                                 |
| A268/A268M                                           | Seamless and Welded Ferritic and Martensitic Stainless Steel Tubing for General Service                            |
| A312/A312M                                           | Seamless and Welded and Heavily Cold Worked Austenitic Stainless Steel Pipe                                        |
| A333/A333M                                           | Seamless and Welded Steel Pipe for Low-Temperature Service                                                         |
| A450/A450M                                           | General Requirements for Carbon and Low Alloy Steel Tubes                                                          |
| A530/A530M                                           | General Requirements for Specialized Carbon and Alloy Steel Pipe                                                   |
| A714                                                 | High-Strength Low-Alloy Welded and Seamless Steel Pipe                                                             |
| A789/A789M                                           | Standard Specification for Seamless and Welded Ferritic/Austenitic Stainless Steel Tubing for General Service      |
| A790/A790M                                           | Standard Specification for Seamless and Welded Ferritic/Austenitic Stainless Steel Pipe                            |
| <b>Welded Pipe and Tube</b>                          |                                                                                                                    |
| A134                                                 | Pipe, Steel, Electric-Fusion (Arc)-Welded (Sizes NPS 16 and Over)                                                  |
| A135/A135M                                           | Electric-Resistance-Welded Steel Pipe                                                                              |
| A139/A139M                                           | Electric-Fusion (Arc)-Welded Steel Pipe (NPS 4 and Over)                                                           |
| A178/A178M                                           | Electric-Resistance-Welded Carbon and Carbon-Manganese Steel Boiler and Superheater Tubes                          |
| A214/A214M                                           | Electric-Resistance-Welded Carbon Steel Heat-Exchanger and Condenser Tubes                                         |
| A249/A249M                                           | Welded Austenitic Steel Boiler, Superheater, Heat-Exchanger, and Condenser Tubes                                   |
| A254                                                 | Copper Brazed Steel Tubing                                                                                         |
| A358/A358M                                           | Electric-Fusion-Welded Austenitic Chromium-Nickel Stainless Steel Pipe for High-Temperature Service                |
| A409/A409M                                           | Welded Large Diameter Austenitic Steel Pipe for Corrosive or High-Temperature Service                              |
| A587                                                 | Electric-Resistance-Welded Low-Carbon Steel Pipe for the Chemical Industry                                         |
| A671                                                 | Electric-Fusion-Welded Steel Pipe for Atmospheric and Lower Temperatures                                           |
| A672                                                 | Electric-Fusion-Welded Steel Pipe for High-Pressure Service at Moderate Temperatures                               |
| A691                                                 | Carbon and Alloy Steel Pipe, Electric-Fusion-Welded for High-Pressure Service at High Temperatures                 |
| A928/A928M                                           | Ferritic/Austenitic (Duplex) Stainless Steel Pipe Electric Fusion Welded with Addition of Filler Metal             |
| <b>Fittings</b>                                      |                                                                                                                    |
| A234/A234M                                           | Piping Fittings of Wrought Carbon Steel and Alloy Steel for Moderate and High Temperature Service                  |
| A403/A403M                                           | Wrought Austenitic Stainless Steel Piping Fittings                                                                 |
| A420/A420M                                           | Piping Fittings of Wrought Carbon Steel and Alloy Steel for Low-Temperature Service                                |
| A815/A815M                                           | Wrought Ferritic, Ferritic/Austenitic, and Martensitic Stainless Steel Piping Fittings                             |
| <b>Plate, Sheet, and Strip</b>                       |                                                                                                                    |
| A240/A240M                                           | Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and General Applications |
| A283/A283M                                           | Low and Intermediate Tensile Strength Carbon Steel Plates                                                          |
| A285/A285M                                           | Pressure Vessel Plates, Carbon Steel, Low- and Intermediate-Tensile Strength                                       |
| A299/A299M                                           | Pressure Vessel Plates, Carbon Steel, Manganese-Silicon                                                            |
| A387/A387M                                           | Pressure Vessel Plates, Alloy Steel, Chromium-Molybdenum                                                           |
| A515/A515M                                           | Pressure Vessel Plates, Carbon Steel for Intermediate- and Higher-Temperature Service                              |
| A516/A516M                                           | Pressure Vessel Plates, Carbon Steel, for Moderate- and Lower-Temperature Service                                  |
| <b>Rods, Bars, and Shapes</b>                        |                                                                                                                    |
| A276/A276M                                           | Stainless Steel Bars and Shapes                                                                                    |
| A322                                                 | Steel Bars, Alloy, Standard Grades                                                                                 |
| A479/A479M                                           | Stainless Steel Bars and Shapes for Use in Boilers and Other Pressure Vessels                                      |
| A564/A564M                                           | Hot-Rolled and Cold-Finished Age-Hardening Stainless Steel Bars and Shapes                                         |
| A575                                                 | Steel Bars, Carbon, Merchant Quality, M-Grades                                                                     |
| A576                                                 | Steel Bars, Carbon, Hot-Wrought, Special Quality                                                                   |
| <b>Structural Components</b>                         |                                                                                                                    |
| A36/A36M                                             | Structural Steel                                                                                                   |
| A125                                                 | Steel Springs, Helical, Heat Treated                                                                               |
| A229/A229M                                           | Steel Wire, Oil-Tempered for Mechanical Springs                                                                    |
| A242/A242M                                           | High-Strength Low Alloy Structural Steel                                                                           |
| A992/A992M                                           | Structural Steel Shapes                                                                                            |

**Table 126.1 Specifications and Standards (Cont'd)**

(12)

| Designator                                     | Title                                                                                                                                                                                                                                                      |
|------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>ASTM Nonferrous Material Specifications</b> |                                                                                                                                                                                                                                                            |
| <b>Castings</b>                                |                                                                                                                                                                                                                                                            |
| B26/B26M                                       | Aluminum-Alloy Sand Castings                                                                                                                                                                                                                               |
| B61                                            | Steam or Valve Bronze Castings                                                                                                                                                                                                                             |
| B62                                            | Composition Bronze or Ounce Metal Castings                                                                                                                                                                                                                 |
| B108                                           | Aluminum-Alloy Permanent Mold Castings                                                                                                                                                                                                                     |
| B148                                           | Aluminum-Bronze Sand Castings                                                                                                                                                                                                                              |
| B367                                           | Titanium and Titanium Alloy Castings                                                                                                                                                                                                                       |
| B584                                           | Copper Alloy Sand Castings for General Applications                                                                                                                                                                                                        |
| <b>Forgings</b>                                |                                                                                                                                                                                                                                                            |
| B247 & B247M                                   | Aluminum and Aluminum-Alloy Die, Hand, and Rolled Ring Forgings                                                                                                                                                                                            |
| B283                                           | Copper and Copper-Alloy Die Forgings (Hot Pressed)                                                                                                                                                                                                         |
| B381                                           | Titanium and Titanium Alloy Forgings                                                                                                                                                                                                                       |
| B462                                           | Forged or Rolled UNS N06030, N06022, N06035, N06200, N06059, N10362, N06686, N08020, N08024, N08026, N08367, N10276, N10665, N10675, N10629, N08031, and N06045 Pipe Flanges, Forged Fittings, and Valves and Parts for Corrosive High-Temperature Service |
| B564                                           | Nickel Alloy Forgings                                                                                                                                                                                                                                      |
| <b>Seamless Pipe and Tube</b>                  |                                                                                                                                                                                                                                                            |
| B42                                            | Seamless Copper Pipe, Standard Sizes                                                                                                                                                                                                                       |
| B43                                            | Seamless Red Brass Pipe, Standard Sizes                                                                                                                                                                                                                    |
| B68 & B68M                                     | Seamless Copper Tube, Bright Annealed                                                                                                                                                                                                                      |
| B75                                            | Seamless Copper Tube                                                                                                                                                                                                                                       |
| B88 & B88M                                     | Seamless Copper Water Tube                                                                                                                                                                                                                                 |
| B111 & B111M                                   | Copper and Copper-Alloy Seamless Condenser Tubes and Ferrule Stock                                                                                                                                                                                         |
| B161                                           | Nickel Seamless Pipe and Tube                                                                                                                                                                                                                              |
| B163                                           | Seamless Nickel and Nickel-Alloy (UNS N06845) Condenser and Heat-Exchanger Tubes                                                                                                                                                                           |
| B165                                           | Nickel-Copper Alloy (UNS N04400) Seamless Pipe and Tube                                                                                                                                                                                                    |
| B167                                           | Nickel-Chromium-Iron Alloys (UNS N06600, N06601, N06603, N06690, N06693, N06025, N06045, and N06696), Nickel-Chromium-Cobalt-Molybdenum Alloy (UNS N06617) and Nickel-Iron-Chromium-Tungsten Alloy (UNS N06674) Seamless Pipe and Tube                     |
| B210 & B210M                                   | Aluminum and Aluminum Alloy Drawn Seamless Tubes                                                                                                                                                                                                           |
| B234 & B234M                                   | Aluminum and Aluminum-Alloy Drawn Seamless Tubes for Condensers and Heat Exchangers                                                                                                                                                                        |
| B241/B241M                                     | Aluminum and Aluminum-Alloy Seamless Pipe and Seamless Extruded Tube                                                                                                                                                                                       |
| B251 & B251M                                   | General Requirements for Wrought Seamless Copper and Copper-Alloy Tube                                                                                                                                                                                     |
| B280                                           | Seamless Copper Tube for Air Conditioning and Refrigeration Field Service                                                                                                                                                                                  |
| B302                                           | Threadless Copper Pipe, Standard Sizes                                                                                                                                                                                                                     |
| B315                                           | Seamless Copper Alloy Pipe and Tube                                                                                                                                                                                                                        |
| B407                                           | Nickel-Iron-Chromium Alloy Seamless Pipe and Tube                                                                                                                                                                                                          |
| B423                                           | Nickel-Iron-Chromium-Molybdenum-Copper Alloy (UNS N08825, N08221, and N06845) Seamless Pipe and Tube                                                                                                                                                       |
| B466/B466M                                     | Seamless Copper-Nickel Pipe and Tube                                                                                                                                                                                                                       |
| B622                                           | Seamless Nickel and Nickel-Cobalt Alloy Pipe and Tube                                                                                                                                                                                                      |
| B677                                           | UNS N08925, UNS N08354, and UNS N08926 Seamless Pipe and Tube                                                                                                                                                                                              |
| B690                                           | Iron-Nickel-Chromium-Molybdenum Alloys (UNS N08366 and UNS N08367) Seamless Pipe and Tube                                                                                                                                                                  |
| B729                                           | Seamless UNS N08020, UNS N08026, and UNS N08024 Nickel-Alloy Pipe and Tube                                                                                                                                                                                 |
| B861                                           | Titanium and Titanium Alloy Seamless Pipe                                                                                                                                                                                                                  |
| <b>Seamless and Welded Pipe and Tube</b>       |                                                                                                                                                                                                                                                            |
| B338                                           | Seamless and Welded Titanium and Titanium Alloy Tubes for Condensers and Heat Exchangers                                                                                                                                                                   |
| B444                                           | Nickel-Chromium-Molybdenum-Columbium Alloy (UNS N06625 and UNS N06852) and Nickel-Chromium-Molybdenum-Silicon Alloy (UNS N06219) Pipe and Tube                                                                                                             |

(12)

**Table 126.1 Specifications and Standards (Cont'd)**

| Designator                                              | Title                                                                                                                                                                                                                                    |
|---------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>ASTM Nonferrous Material Specifications (Cont'd)</b> |                                                                                                                                                                                                                                          |
| <b>Welded Pipe and Tube</b>                             |                                                                                                                                                                                                                                          |
| B464                                                    | Welded (UNS N08020, N08024, and N08026) Alloy Pipe                                                                                                                                                                                       |
| B467                                                    | Welded Copper-Nickel Pipe                                                                                                                                                                                                                |
| B468                                                    | Welded (UNS N08020, N08024, and N08026) Alloy Tubes                                                                                                                                                                                      |
| B546                                                    | Electric Fusion-Welded Ni-Cr-Co-Mo Alloy (UNS N06617), Ni-Fe-Cr-Si Alloys (UNS N08330 and UNS N08332), Ni-Cr-Fe-Al Alloy (UNS N06603), Ni-Cr-Fe Alloy (UNS N06025), and Ni-Cr-Fe-Si Alloy (UNS N06045) Pipe                              |
| B547/B547M                                              | Aluminum and Aluminum-Alloy Formed and Arc-Welded Round Tube                                                                                                                                                                             |
| B608                                                    | Welded Copper-Alloy Pipe                                                                                                                                                                                                                 |
| B619                                                    | Welded Nickel and Nickel-Cobalt Alloy Pipe                                                                                                                                                                                               |
| B626                                                    | Welded Nickel and Nickel-Cobalt Alloy Tube                                                                                                                                                                                               |
| B673                                                    | UNS N08925, UNS N08354, and UNS N08926 Welded Pipe                                                                                                                                                                                       |
| B674                                                    | UNS N08925, UNS N08354, and UNS N08926 Welded Tube                                                                                                                                                                                       |
| B675                                                    | UNS N08367 Welded Pipe                                                                                                                                                                                                                   |
| B676                                                    | UNS N08367 Welded Tube                                                                                                                                                                                                                   |
| B704                                                    | Welded UNS N06625, N06219, and N08825 Alloy Tubes                                                                                                                                                                                        |
| B705                                                    | Nickel-Alloy (UNS N06625, N06219, and N08825) Welded Pipe                                                                                                                                                                                |
| B804                                                    | UNS N08367 and UNS N08926 Welded Pipe                                                                                                                                                                                                    |
| B862                                                    | Titanium and Titanium Alloy Welded Pipe                                                                                                                                                                                                  |
| <b>Fittings</b>                                         |                                                                                                                                                                                                                                          |
| B361                                                    | Factory-Made Wrought Aluminum and Aluminum-Alloy Welding Fittings                                                                                                                                                                        |
| B366                                                    | Factory-Made Wrought Nickel and Nickel Alloy Fittings                                                                                                                                                                                    |
| <b>Plate, Sheet, and Strip</b>                          |                                                                                                                                                                                                                                          |
| B168                                                    | Nickel-Chromium-Iron Alloys (UNS N06600, N06601, N06603, N06690, N06693, N06025, N06045, and N06696), Nickel-Chromium-Cobalt-Molybdenum Alloy (UNS N06617), and Nickel-Iron-Chromium-Tungsten Alloy (UNS N06674) Plate, Sheet, and Strip |
| B171/B171M                                              | Copper-Alloy Plate and Sheet for Pressure Vessels, Condensers, and Heat Exchangers                                                                                                                                                       |
| B209                                                    | Aluminum and Aluminum-Alloy Sheet and Plate                                                                                                                                                                                              |
| B265                                                    | Titanium and Titanium-Alloy Strip, Sheet, and Plate                                                                                                                                                                                      |
| B409                                                    | Nickel-Iron-Chromium Alloy Plate, Sheet, and Strip                                                                                                                                                                                       |
| B424                                                    | Ni-Fe-Cr-Mo-Cu Alloy (UNS N08825, UNS N08221, and UNS N06845) Plate, Sheet, and Strip                                                                                                                                                    |
| B435                                                    | UNS N06002, UNS N06230, UNS N12160, and UNS R30556 Plate, Sheet, and Strip                                                                                                                                                               |
| B443                                                    | Nickel-Chromium-Molybdenum-Columbium Alloy (UNS N06625) and Nickel-Chromium-Molybdenum-Silicon Alloy (UNS N06219) Plate, Sheet, and Strip                                                                                                |
| B463                                                    | UNS N08020 Alloy Plate, Sheet, and Strip                                                                                                                                                                                                 |
| B575                                                    | Low-Carbon Nickel-Chromium-Molybdenum, Low-Carbon Nickel-Chromium-Molybdenum-Copper, Low-Carbon Nickel-Chromium-Molybdenum-Tantalum, and Low-Carbon Nickel-Chromium-Molybdenum-Tungsten Alloy Plate, Sheet, and Strip                    |
| B625                                                    | UNS N08925, UNS N08031, UNS N08932, UNS N08926, UNS N08354, and UNS R20033 Plate, Sheet, and Strip                                                                                                                                       |
| B688                                                    | Chromium-Nickel-Molybdenum-Iron (UNS N08366 and UNS N08367) Plate, Sheet, and Strip                                                                                                                                                      |
| <b>Rods, Bars, and Shapes</b>                           |                                                                                                                                                                                                                                          |
| B150/B150M                                              | Aluminum Bronze Rod, Bar, and Shapes                                                                                                                                                                                                     |
| B151/B151M                                              | Copper-Nickel-Zinc Alloy (Nickel Silver) and Copper-Nickel Rod and Bar                                                                                                                                                                   |
| B166                                                    | Nickel-Chromium-Iron Alloys (UNS N06600, N06601, N06603, N06690, N06693, N06025, N06045, and N06696), Nickel-Chromium-Cobalt-Molybdenum Alloy (UNS N06617), and Nickel-Iron-Chromium-Tungsten Alloy (UNS N06674) Rod, Bar, and Wire      |
| B221                                                    | Aluminum and Aluminum Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes                                                                                                                                                               |
| B348                                                    | Titanium and Titanium Alloy Bars and Billets                                                                                                                                                                                             |
| B408                                                    | Nickel-Iron-Chromium Alloy Rod and Bar                                                                                                                                                                                                   |
| B425                                                    | Ni-Fe-Cr-Mo-Cu Alloy (UNS N08825, UNS N08221, and UNS N06845) Rod and Bar                                                                                                                                                                |
| B446                                                    | Nickel-Chromium-Molybdenum-Columbium Alloy (UNS N06625), Nickel-Chromium-Molybdenum-Silicon Alloy (UNS N06214), and Nickel-Chromium-Molybdenum-Tungsten Alloy (UNS N06650) Rod and Bar                                                   |
| B473                                                    | UNS N08020, UNS N08024, and UNS N08026 Nickel Alloy Bar and Wire                                                                                                                                                                         |
| B572                                                    | UNS N06002, UNS N06230, UNS N12160, and UNS R30556 Rod                                                                                                                                                                                   |

**Table 126.1 Specifications and Standards (Cont'd)**

(12)

| Designator                                              | Title                                                                                                                                                                                             |
|---------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>ASTM Nonferrous Material Specifications (Cont'd)</b> |                                                                                                                                                                                                   |
| <b>Rods, Bars, and Shapes (Cont'd)</b>                  |                                                                                                                                                                                                   |
| B574                                                    | Low-Carbon Nickel-Chromium-Molybdenum, Low-Carbon Nickel-Molybdenum-Chromium-Tantalum, Low-Carbon Nickel-Chromium-Molybdenum-Copper, and Low-Carbon Nickel-Chromium-Molybdenum-Tungsten Alloy Rod |
| B649                                                    | Ni-Fe-Cr-Mo-Cu-N Low-Carbon Alloys (UNS N08925, UNS N08031, UNS N08354, and UNS N08926), Cr-Ni-Fe-N Low-Carbon Alloy (UNS R20033) Bar and Wire, and Ni-Cr-Fe-Mo-N Alloy (UNS N08936) Wire         |
| B691                                                    | Iron-Nickel-Chromium-Molybdenum Alloys (UNS N08366 and UNS N08367) Rod, Bar, and Wire                                                                                                             |
| <b>Solder</b>                                           |                                                                                                                                                                                                   |
| B32                                                     | Solder Metal                                                                                                                                                                                      |
| B828                                                    | Standard Practice for Making Capillary Joints by Soldering of Copper and Copper Alloy Tube and Fittings                                                                                           |
| <b>ASTM Standard Test Methods</b>                       |                                                                                                                                                                                                   |
| D323                                                    | Standard Test Method for Vapor Pressure of Petroleum Products (Reid Method)                                                                                                                       |
| E94                                                     | Standard Guide for Radiographic Examination                                                                                                                                                       |
| E125                                                    | Standard Reference Photographs for Magnetic Particle Indications on Ferrous Castings                                                                                                              |
| E186                                                    | Standard Reference Radiographs for Heavy-Walled (2 to 4½-in. [51 to 114-mm] Steel Castings                                                                                                        |
| E280                                                    | Standard Reference Radiographs for Heavy-Walled (4½ to 12-in. [114 to 305-mm] Steel Castings                                                                                                      |
| E446                                                    | Standard Reference Radiographs for Steel Castings Up to 2 in. [51 mm] in Thickness                                                                                                                |
| <b>API Specification</b>                                |                                                                                                                                                                                                   |
| <b>Seamless and Welded Pipe</b>                         |                                                                                                                                                                                                   |
| 5L                                                      | Line Pipe                                                                                                                                                                                         |
| <b>American National Standard</b>                       |                                                                                                                                                                                                   |
| Z223.1                                                  | National Fuel Gas Code (ANSI/NFPA 54)                                                                                                                                                             |
| <b>MSS Standard Practices</b>                           |                                                                                                                                                                                                   |
| SP-6                                                    | Standard Finishes for Contact Faces of Pipe Flanges and Connecting-End Flanges of Valves and Fittings                                                                                             |
| SP-9                                                    | Spot-Facing for Bronze, Iron and Steel Flanges                                                                                                                                                    |
| SP-25                                                   | Standard Marking System for Valves, Fittings, Flanges and Unions                                                                                                                                  |
| SP-42 [Note (1)]                                        | Corrosion Resistant Gate, Globe, Angle and Check Valves With Flanged and Butt Weld Ends (Classes 150, 300 & 600)                                                                                  |
| SP-43                                                   | Wrought and Fabricated Butt-Welding Fittings for Low Pressure, Corrosion Resistant Applications                                                                                                   |
| SP-45                                                   | Bypass & Drain Connection                                                                                                                                                                         |
| SP-51                                                   | Class 150 LW Corrosion Resistant Cast Flanges and Flanged Fittings                                                                                                                                |
| SP-53                                                   | Quality Standard for Steel Castings and Forgings for Valves, Flanges, and Fittings and Other Piping Components — Magnetic Particle Examination Method                                             |
| SP-54                                                   | Quality Standard for Steel Castings for Valves, Flanges, and Fittings and Other Piping Components — Radiographic Examination Method                                                               |
| SP-55                                                   | Quality Standard for Steel Castings for Valves, Flanges, and Fittings and Other Piping Components — Visual Method for Evaluation of Surface Irregularities                                        |
| SP-58                                                   | Pipe Hangers and Supports — Materials, Design, Manufacture, Selection, Application, and Installation                                                                                              |
| SP-61                                                   | Pressure Testing of Steel Valves                                                                                                                                                                  |
| SP-67 [Note (1)]                                        | Butterfly Valves                                                                                                                                                                                  |
| SP-68                                                   | High Pressure Butterfly Valves with Offset Design                                                                                                                                                 |
| SP-75                                                   | Specification for High Test Wrought Butt-Welding Fittings                                                                                                                                         |
| SP-79                                                   | Socket Welding Reducer Inserts                                                                                                                                                                    |
| SP-80                                                   | Bronze Gate, Globe, Angle and Check Valves                                                                                                                                                        |
| SP-83                                                   | Class 3000 Steel Pipe Unions, Socket Welding and Threaded                                                                                                                                         |
| SP-88                                                   | Diaphragm Valves                                                                                                                                                                                  |
| SP-93                                                   | Quality Standard for Steel Castings and Forgings for Valves, Flanges, and Fittings and Other Piping Components — Liquid Penetrant Examination Method                                              |

**Table 126.1 Specifications and Standards (Cont'd)**

| Designator                             | Title                                                                                                                                                      |
|----------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>MSS Standard Practices (Cont'd)</b> |                                                                                                                                                            |
| SP-94                                  | Quality Standard for Ferritic and Martensitic Steel Castings for Valves, Flanges, and Fittings and Other Piping Components — Ultrasonic Examination Method |
| SP-95                                  | Swaged Nipples and Bull Plugs                                                                                                                              |
| SP-97                                  | Integrally Reinforced Forged Branch Outlet Fittings — Socket Welding, Threaded and Buttwelding Ends                                                        |
| SP-105                                 | Instrument Valves for Code Applications                                                                                                                    |
| SP-106                                 | Cast Copper Alloy Flanges and Flanged Fittings, Class 125, 150, and 300                                                                                    |
| <b>ASME Codes &amp; Standards</b>      |                                                                                                                                                            |
| ...                                    | ASME Boiler and Pressure Vessel Code                                                                                                                       |
| B1.1                                   | Unified Inch Screw Threads                                                                                                                                 |
| B1.13M                                 | Metric Screw Threads — M Profile                                                                                                                           |
| B1.20.1                                | Pipe Threads, General Purpose (Inch)                                                                                                                       |
| B1.20.3                                | Dryseal Pipe Threads (Inch)                                                                                                                                |
| B16.1                                  | Cast Iron Pipe Flanges and Flanged Fittings — 25, 125, 250 & 800 Classes                                                                                   |
| B16.3                                  | Malleable Iron Threaded Fittings                                                                                                                           |
| B16.4                                  | Gray Iron Threaded Fittings                                                                                                                                |
| B16.5                                  | Pipe Flanges and Flanged Fittings                                                                                                                          |
| B16.9                                  | Factory-Made Wrought Buttwelding Fittings                                                                                                                  |
| B16.10                                 | Face-to-Face and End-to-End Dimensions of Valves                                                                                                           |
| B16.11                                 | Forged Fittings, Socket-Welding and Threaded                                                                                                               |
| B16.14                                 | Ferrous Pipe Plugs, Bushings, and Locknuts With Pipe Threads                                                                                               |
| B16.15                                 | Cast Bronze Threaded Fittings, Classes 125 and 250                                                                                                         |
| B16.18                                 | Cast Copper Alloy Solder-Joint Pressure Fittings                                                                                                           |
| B16.20                                 | Metallic Gaskets for Pipe Flanges — Ring Joint, Spiral Wound, and Jacketed                                                                                 |
| B16.21                                 | Nonmetallic Flat Gaskets for Pipe Flanges                                                                                                                  |
| B16.22                                 | Wrought Copper and Copper Alloy Solder Joint Pressure Fittings                                                                                             |
| B16.24                                 | Cast Copper Alloy Pipe Flanges and Flanged Fittings — Class 150, 300, 400, 600, 900, 1500, and 2500                                                        |
| B16.25                                 | Butt Welding Ends                                                                                                                                          |
| B16.34                                 | Valves — Flanged, Threaded, and Welding End                                                                                                                |
| B16.42                                 | Ductile Iron Pipe Flanges and Flanged Fittings — Classes 150 and 300                                                                                       |
| B16.47                                 | Large Diameter Steel Flanges                                                                                                                               |
| B16.48                                 | Steel Line Blanks                                                                                                                                          |
| B16.50                                 | Wrought Copper and Copper Alloy Braze-Joint Pressure Fittings                                                                                              |
| B18.2.1                                | Square and Hex Bolts and Screws — Inch Series                                                                                                              |
| B18.2.2                                | Square and Hex Nuts (Inch Series)                                                                                                                          |
| B18.2.3.5M                             | Metric Hex Bolts                                                                                                                                           |
| B18.2.3.6M                             | Metric Heavy Hex Bolts                                                                                                                                     |
| B18.2.4.6M                             | Hex Nuts, Heavy, Metric                                                                                                                                    |
| B18.21.1                               | Lock Washers (Inch Series)                                                                                                                                 |
| B18.22M                                | Washers, Metric Plain                                                                                                                                      |
| B18.22.1 [Note (2)]                    | Plain Washers                                                                                                                                              |
| B31.3                                  | Process Piping                                                                                                                                             |
| B31.4                                  | Pipeline Transportation Systems for Liquid Hydrocarbons and Other Liquids                                                                                  |
| B31.8                                  | Gas Transmission and Distribution Piping Systems                                                                                                           |
| B36.10M                                | Welded and Seamless Wrought Steel Pipe                                                                                                                     |
| B36.19M                                | Stainless Steel Pipe                                                                                                                                       |
| TDP-1                                  | Recommended Practices for the Prevention of Water Damage to Steam Turbines Used for Electric Power Generation — Fossil Fueled Plants                       |
| <b>AWS Specifications</b>              |                                                                                                                                                            |
| A3.0                                   | Standard Welding Terms and Definitions                                                                                                                     |
| D10.10                                 | Recommended Practices for Local Heating of Welds in Piping and Tubing                                                                                      |
| QC1                                    | Qualification and Certification of Welding Inspectors                                                                                                      |

**Table 126.1 Specifications and Standards (Cont'd)**

| Designator                          | Title                                                                                                                                               |
|-------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>AWWA and ANSI/AWWA Standards</b> |                                                                                                                                                     |
| C110/A21.10                         | Ductile-Iron and Gray-Iron Fittings, 3 in. Through 48 in. (76 mm Through 1200 mm), for Water and Other Liquids                                      |
| C111/A21.11                         | Rubber-Gasket Joints for Ductile-Iron Pressure Pipe and Fittings                                                                                    |
| C115/A21.15                         | Flanged Ductile-Iron Pipe With Threaded Flanges                                                                                                     |
| C150/A21.50                         | Thickness Design of Ductile-Iron Pipe                                                                                                               |
| C151/A21.51                         | Ductile-Iron Pipe, Centrifugally Cast, for Water                                                                                                    |
| C153/A21.53                         | Ductile-Iron Compact Fittings, 3 in. Through 24 in. (76 mm Through 610 mm) and 54 in. Through 64 in. (1,400 mm Through 1,600 mm), for Water Service |
| C200                                | Steel Water Pipe—6 in. (150 mm) and Larger                                                                                                          |
| C207                                | Steel Pipe Flanges for Waterworks Service—Sizes 4 in. Through 144 in. (100 mm Through 3,600 mm)                                                     |
| C208                                | Dimensions for Fabricated Steel Water Pipe Fittings                                                                                                 |
| C300                                | Reinforced Concrete Pressure Pipe, Steel-Cylinder Type, for Water and Other Liquids (Includes Addendum C300a-93.)                                   |
| C301                                | Prestressed Concrete Pressure Pipe, Steel-Cylinder Type, for Water and Other Liquids                                                                |
| C302                                | Reinforced Concrete Pressure Pipe, Noncylinder Type, for Water and Other Liquids                                                                    |
| C304                                | Design of Prestressed Concrete Cylinder Pipe                                                                                                        |
| C500                                | Metal-Seated Gate Valves for Water Supply Service                                                                                                   |
| C504 [Note (1)]                     | Rubber Seated Butterfly Valves                                                                                                                      |
| C509                                | Resilient-Seated Gate Valves for Water Supply Service                                                                                               |
| C600                                | Installation of Ductile-Iron Water Mains and Their Appurtenances                                                                                    |
| C606                                | Grooved and Shouldered Joints                                                                                                                       |
| <b>National Fire Codes</b>          |                                                                                                                                                     |
| NFPA 54/ANSI Z223.1                 | National Fuel Gas Code                                                                                                                              |
| NFPA 85                             | Boiler and Combustion Systems Hazards Code                                                                                                          |
| NFPA 1963                           | Standard for Fire Hose Connections                                                                                                                  |
| <b>PFI Standards</b>                |                                                                                                                                                     |
| ES-16                               | Access Holes and Plugs for Radiographic Inspection of Pipe Welds                                                                                    |
| ES-24                               | Pipe Bending Methods, Tolerances, Process and Material Requirements                                                                                 |
| <b>FCI Standard</b>                 |                                                                                                                                                     |
| 79-1                                | Proof of Pressure Ratings for Pressure Regulators                                                                                                   |

**GENERAL NOTES:**

- For boiler external piping application, see para. 123.2.2.
- For all other piping, materials conforming to an ASME SA or SB specification may be used interchangeably with material specified to an ASTM A or B specification of the same number listed in Table 126.1.
- The approved year of issue of the specifications and standards is not given in this Table. This information is given in Mandatory Appendix F of this Code.
- The addresses and phone numbers of organizations whose specifications and standards are listed in this Table are given at the end of Mandatory Appendix F.

**NOTES:**

- See para. 107.1(D) for valve stem retention requirements.
- ANSI B18.22.1 is nonmetric.

## Chapter V

# Fabrication, Assembly, and Erection

### 127 WELDING

#### 127.1 General

Piping systems shall be constructed in accordance with the requirements of this Chapter and of materials that have been manufactured in accordance with the requirements of Chapter IV. These requirements apply to all fabrication, assembly, and erection operations, whether performed in a shop or at a construction site. The following applies essentially to the welding of ferrous materials. The welding of aluminum, copper, etc., requires different preparations and procedures.

**127.1.1** The welding processes that are to be used under this part of this Code shall meet all the test requirements of Section IX of the ASME Boiler and Pressure Vessel Code.

#### 127.2 Material

- (12) **127.2.1 Electrodes and Filler Metal.** Welding electrodes and filler metal, including consumable inserts, shall conform to the requirements of the ASME Boiler and Pressure Vessel Code, Section II, Part C. An electrode or filler metal not conforming to the above may be used provided the WPS and the welders and welding operators who will follow the WPS have been qualified as required by ASME Section IX. Unless otherwise specified by the designer, welding electrodes and filler metals used shall produce weld metal that complies with the following:

(A) The nominal tensile strength of the weld metal shall equal or exceed the minimum specified tensile strength of the base metals being joined.

(B) If base metals of different tensile strengths are to be joined, the nominal tensile strength of the weld metal shall equal or exceed the minimum specified tensile strength of the weaker of the two.

(C) The nominal chemical analysis of the weld metal shall be similar to the nominal chemical analysis of the base metal, including consideration of both major and essential minor alloying elements [e.g.,  $2\frac{1}{4}\%$  Cr, 1% Mo steels should be joined using  $2\frac{1}{4}\%$  Cr, 1% Mo filler metals; see also para. 124.2(D)].

(D) If base metals of different chemical analysis are being joined, the nominal chemical analysis of the weld metal shall be similar to either base metal or an intermediate composition, except as specified below for austenitic steels joined to ferritic steels.

(E) When austenitic steels are joined to ferritic steels, the weld metal shall have an austenitic structure.

(F) For nonferrous metals, the weld metal shall be that recommended by the manufacturer of the nonferrous metal or by industry associations for that metal.

(G) Filler metals not meeting the requirements of (A) through (F) above may be accepted by agreement between the fabricator/erector and the designer. Examples of conditions where this may apply include (but may not be limited to) where unusual materials or combinations of materials are used; where highly corrosive environments may require a more electrochemically noble weld metal; where dissimilar materials are welded; or where it is desired to achieve a weld with different mechanical properties than the base material.

**127.2.2 Backing Rings.** Backing rings, when used, shall conform to the following requirements:

(A) *Ferrous Rings.* Ferrous metal backing rings that become a permanent part of the weld shall be made from material of weldable quality, compatible with the base material and the sulfur content shall not exceed 0.05%.

(A.1) Backing rings may be of the continuous machined or split band type.

(A.2) If two abutting surfaces are to be welded to a third member used as a backing ring and one or two of the three members are ferritic and the other member or members are austenitic, the satisfactory use of such materials shall be determined by the WPS qualified as required in para. 127.5.

(A.3) Backing strips used at longitudinal welded joints shall be removed.

(B) *Nonferrous and Nonmetallic Rings.* Backing rings of nonferrous or nonmetallic materials may be used for backing provided they are included in a WPS as required in para. 127.5. Nonmetallic or nonfusing rings shall be removed.


**127.2.3 Consumable Inserts.** Consumable inserts may be used provided they are made from material compatible with the chemical and physical properties of the base material. Qualification of the WPS shall be as required by para. 127.5.

#### 127.3 Preparation for Welding

(A) *End Preparation*

(A.1) Oxygen or arc cutting is acceptable only if the cut is reasonably smooth and true, and all slag is

**Fig. 127.3 Butt Welding of Piping Components With Internal Misalignment**

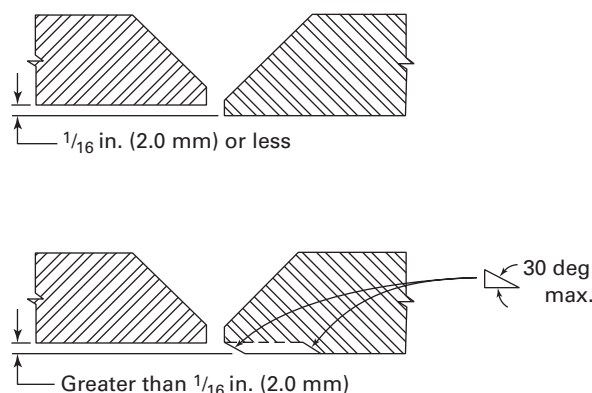

cleaned from the flame cut surfaces. Discoloration that may remain on the flame cut surface is not considered to be detrimental oxidation.

(A.2) Butt-welding end preparation dimensions contained in ASME B16.25 or any other end preparation that meets the WPS are acceptable.

(A.3) If piping component ends are bored, such boring shall not result in the finished wall thickness after welding less than the minimum design thickness. Where necessary, weld metal of the appropriate analysis may be deposited on the inside or outside of the piping component to provide sufficient material for machining to insure satisfactory fitting of rings.

(A.4) If the piping component ends are upset, they may be bored to allow for a completely recessed backing ring, provided the remaining net thickness of the finished ends is not less than the minimum design thickness.

(B) *Cleaning.* Surfaces for welding shall be clean and shall be free from paint, oil, rust, scale, or other material that is detrimental to welding.

(C) *Alignment.* The inside diameters of piping components to be butt welded shall be aligned as accurately as is practicable within existing commercial tolerances on diameters, wall thicknesses, and out-of-roundness. Alignment shall be preserved during welding. The internal misalignment of the ends to be joined shall not exceed  $\frac{1}{16}$  in. (2.0 mm) unless the piping design specifically states a different allowable misalignment.

When the internal misalignment exceeds the allowable, it is preferred that the component with the wall extending internally be internally trimmed per Fig. 127.3. However, trimming shall result in a piping component thickness not less than the minimum design thickness, and the change in contour shall not exceed 30 deg (see Fig. 127.3).

(D) *Spacing.* The root opening of the joint shall be as given in the WPS.

(E) *Socket Weld Assembly.* In assembly of the joint before welding, the pipe or tube shall be inserted into the socket to the maximum depth and then withdrawn approximately  $\frac{1}{16}$  in. (2.0 mm) away from contact between the end of the pipe and the shoulder of the socket [see Figs. 127.4.4(B) and (C)]. In sleeve-type joints without internal shoulder, there shall be a distance of approximately  $\frac{1}{16}$  in. (2.0 mm) between the butting ends of the pipe or tube.

The fit between the socket and the pipe shall conform to applicable standards for socket weld fittings and in no case shall the inside diameter of the socket or sleeve exceed the outside diameter of the pipe or tube by more than 0.080 in. (2.0 mm).

## 127.4 Procedure

### 127.4.1 General

(A) Qualification of the WPS to be used, and of the performance of welders and operators, is required, and shall comply with the requirements of para. 127.5.

(B) No welding shall be done if there is impingement of rain, snow, sleet, or high wind on the weld area.

(C) Tack welds permitted to remain in the finished weld shall be made by a qualified welder. Tack welds made by an unqualified welder shall be removed. Tack welds that remain shall be made with an electrode and WPS that is the same as or equivalent to the electrode and WPS to be used for the first pass. The stopping and starting ends shall be prepared by grinding or other means so that they can be satisfactorily incorporated into the final weld. Tack welds that have cracked shall be removed.


(D) *CAUTION:* Arc strikes outside the area of the intended weld should be avoided on any base metal.

### 127.4.2 Girth Butt Welds

(A) Girth butt welds shall be complete penetration welds and shall be made with a single vee, double vee, or other suitable type of groove, with or without backing rings or consumable inserts. The depth of the weld measured between the inside surface of the weld preparation and the outside surface of the pipe shall not be less than the minimum thickness required by Chapter II for the particular size and wall of pipe used.

(B) To avoid abrupt transitions in the contour of the finished weld, the requirements of (B.1) through (B.4) below shall be met.

(B.1) When components with different outside diameters or wall thicknesses are welded together, the welding end of the component with the larger outside diameter shall fall within the envelope defined by solid lines in Fig. 127.4.2. The weld shall form a gradual transition not exceeding a slope of 30 deg from the smaller to the larger diameter component. This condition may be met by adding welding filler material, if necessary, beyond what would otherwise be the edge of the weld.

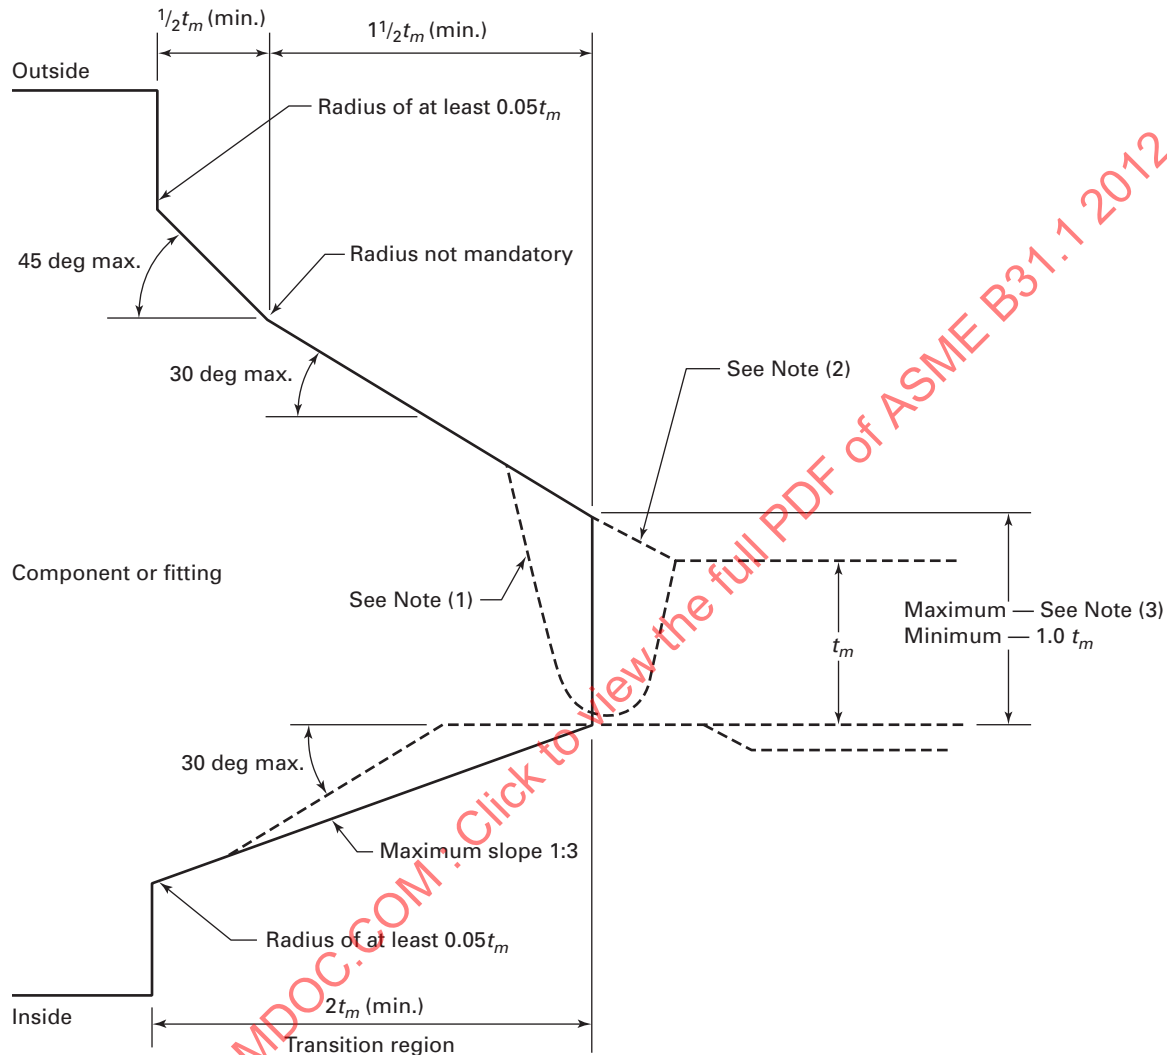**Fig. 127.4.2 Welding End Transition — Maximum Envelope****GENERAL NOTES:**

- (a) The value of  $t_m$  is whichever of the following is applicable:
- as defined in para. 104.1.2(A)
  - the minimum ordered wall thickness of the cylindrical welding end of a component or fitting (or the thinner of the two) when the joint is between two components
- (b) The maximum envelope is defined by solid lines.

**NOTES:**

- Weld is shown for illustration only.
- The weld transition and weld reinforcement shall comply with paras. 127.4.2(B) and (C.2) and may be outside the maximum envelope.
- The maximum thickness at the end of the component is
  - the greater of  $(t_m + 0.15 \text{ in.})$  or  $1.15t_m$  when ordered on a minimum wall basis
  - the greater of  $(t_m + 0.15 \text{ in.})$  or  $1.10t_{nom}$  when ordered on a nominal wall basis

(B.2) When both components to be welded (other than pipe to pipe) have a transition from a thicker section to the weld end preparation, the included angle between the surface of the weld and the surface of either of the components shall not be less than 150 deg. Refer to para. 119.3(B) for additional concerns related to this design.

(B.3) When welding pipe to pipe, the surface of the weld shall, as a minimum, be flush with the outer surface of the pipe, except as permitted in para. 127.4.2(B.4).

(B.4) For welds made without the addition of filler metal, concavity shall be limited to  $\frac{1}{32}$  in. (1 mm) below the outside surface of the pipe, but shall not encroach upon minimum required thickness.

(C) As-welded surfaces are permitted; however, the surface of welds shall be sufficiently free from coarse ripples, grooves, overlaps, abrupt ridges, and valleys to meet the following:

(C.1) The surface condition of the finished welds shall be suitable for the proper interpretation of radiographic and other nondestructive examinations when nondestructive examinations are required by Table 136.4. In those cases where there is a question regarding the surface condition on the interpretation of a radiographic film, the film shall be compared to the actual weld surface for interpretation and determination of acceptability.

(C.2) Reinforcements are permitted in accordance with Table 127.4.2.

(C.3) Undercuts shall not exceed  $\frac{1}{32}$  in. (1.0 mm) and shall not encroach on the minimum required section thickness.

(C.4) If the surface of the weld requires grinding to meet the above criteria, care shall be taken to avoid reducing the weld or base material below the minimum required thickness.

(C.5) Concavity on the root side of a single welded circumferential butt weld is permitted when the resulting thickness of the weld is at least equal to the thickness of the thinner member of the two sections being joined and the contour of the concavity is smooth without sharp edges. The internal condition of the root surface of a girth weld, which has been examined by radiography, is acceptable only when there is a gradual change in the density, as indicated in the radiograph. If a girth weld is not designated to be examined by radiography, a visual examination may be performed at welds that are readily accessible.

**127.4.3 Longitudinal Butt Welds.** Longitudinal butt welds not covered by the applicable material specifications listed in Table 126.1 shall meet the requirements for girth butt welds in para. 127.4.2. For longitudinal welds and spiral welds in pipe intended for sustained operation in the creep range (see paras. 104.1.1 and 123.4, and Table 102.4.7), any welding using the SAW process shall use a flux with a basicity index  $\geq 1.0$ .

**127.4.4 Fillet Welds.** In making fillet welds, the weld metal shall be deposited in such a way as to secure adequate penetration into the base metal at the root of the weld.

Fillet welds may vary from convex to concave. The size of a fillet weld is determined as shown in Fig. 127.4.4(A). Typical minimum fillet weld details for slip-on flanges and socket-welding components are shown in Figs. 127.4.4(B) and (C).

**127.4.5 Seal Welds.** Where seal welding of threaded joints is performed, threads shall be entirely covered by the seal weld. Seal welding shall be done by qualified welders.

#### 127.4.8 Welded Branch Connections

(A) Welded branch connections shall be made with full penetration welds, except as allowed in para. 127.4.8(F). Figures 127.4.8(A), (B), and (C) show typical details of branch connections with and without added reinforcement. No attempt has been made to show all acceptable types of construction and the fact that a certain type of construction is illustrated does not indicate that it is recommended over other types not illustrated.

(B) Figure 127.4.8(D) shows basic types of weld attachments used in the fabrication of branch connections. The location and minimum size of these attachment welds shall conform to the requirements of para. 127.4.8. Welds shall be calculated in accordance with para. 104.3.1 but shall not be less than the sizes shown in Fig. 127.4.8(D).

The notations and symbols used in this paragraph, Fig. 127.4.8(D), and Fig. 127.4.8(E) are as follows:

- $t_c$  = the smaller of  $\frac{1}{4}$  in. (6.0 mm) or  $0.7t_{nb}$
- $t_{min}$  = the smaller of  $t_{nb}$  or  $t_{nr}$
- $t_{nb}$  = nominal thickness of branch wall, in. (mm)
- $t_{nh}$  = nominal thickness of header wall, in. (mm)
- $t_{nr}$  = nominal thickness of reinforcing element (ring or saddle), in. (mm)

(C) Figure 127.4.8(F) shows branch connections made by welding half couplings or adapters directly to the run pipe.

Figure 127.4.8(E) shows branch connections using specifically reinforced branch outlet fittings welded directly to the run pipe. These branch connection fittings, half couplings, or adapters, which abut the outside surface of the run wall, or which are inserted through an opening cut in the run wall, shall have opening and branch contour to provide a good fit and shall be attached by means of full penetration groove welds except as otherwise permitted in (F) below.

The full penetration groove welds shall be finished with cover fillet welds and meet the requirements of para. 104. The cover fillet welds shall have a minimum throat dimension not less than that shown in Fig. 127.4.8(E) or Fig. 127.4.8(F), as applicable.


**Table 127.4.2 Reinforcement of Girth and Longitudinal Butt Welds**

| Thickness of Base Metal,<br>in. (mm)                      | Maximum Thickness of Reinforcement<br>for Design Temperature |     |                                                                                                                  |     |                    |     |
|-----------------------------------------------------------|--------------------------------------------------------------|-----|------------------------------------------------------------------------------------------------------------------|-----|--------------------|-----|
|                                                           | > 750°F<br>(400°C)                                           |     | 350°F–750°F<br>(175°C–400°C)                                                                                     |     | < 350°F<br>(175°C) |     |
|                                                           | in.                                                          | mm  | in.                                                                                                              | mm  | in.                | mm  |
| Up to $\frac{1}{8}$ (3.0), incl.                          | $\frac{1}{16}$                                               | 2.0 | $\frac{3}{32}$                                                                                                   | 2.5 | $\frac{3}{16}$     | 5.0 |
| Over $\frac{1}{8}$ to $\frac{3}{16}$ (3.0 to 5.0), incl.  | $\frac{1}{16}$                                               | 2.0 | $\frac{1}{8}$                                                                                                    | 3.0 | $\frac{3}{16}$     | 5.0 |
| Over $\frac{3}{16}$ to $\frac{1}{2}$ (5.0 to 13.0), incl. | $\frac{1}{16}$                                               | 2.0 | $\frac{5}{32}$                                                                                                   | 4.0 | $\frac{3}{16}$     | 5.0 |
| Over $\frac{1}{2}$ to 1 (13.0 to 25.0), incl.             | $\frac{3}{32}$                                               | 2.5 | $\frac{3}{16}$                                                                                                   | 5.0 | $\frac{3}{16}$     | 5.0 |
| Over 1 to 2 (25.0 to 50.0), incl.                         | $\frac{1}{8}$                                                | 3.0 | $\frac{1}{4}$                                                                                                    | 6.0 | $\frac{1}{4}$      | 6.0 |
| Over 2 (50.0)                                             | $\frac{5}{32}$                                               | 4.0 | The greater of $\frac{1}{4}$ in. (6 mm) or $\frac{1}{8}$ times<br>the width of the weld in inches (millimeters). |     |                    |     |

## GENERAL NOTES:

- For double welded butt joints, this limitation on reinforcement given above shall apply separately to both inside and outside surfaces of the joint.
- For single welded butt joints, the reinforcement limits given above shall apply to the outside surface of the joint only.
- The thickness of weld reinforcement shall be based on the thickness of the thinner of the materials being joined.
- The weld reinforcement thicknesses shall be determined from the higher of the abutting surfaces involved.
- Weld reinforcement may be removed if so desired.


Fig. 127.4.4(A) Fillet Weld Size

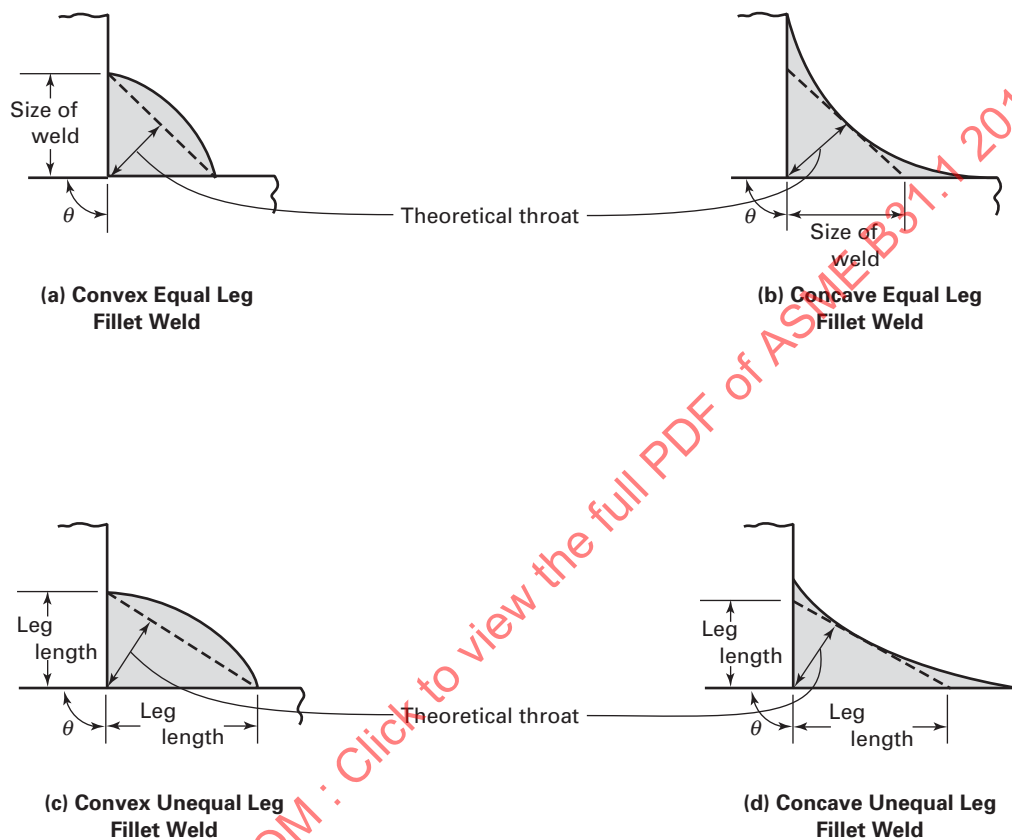

## GENERAL NOTES:

- The "size" of an equal leg fillet weld shall be described by the leg length of the largest inscribed isosceles triangle.
- The "size" of an unequal leg fillet weld shall be described using both leg lengths and their location on the members to be joined.
- Angle  $\theta$ , as noted in the above figures, may vary from the 90 deg angle as shown based on the angle between the surfaces to be welded.
- For an equal leg fillet weld where the angle  $\theta$  between the members being joined is 90 deg, the theoretical throat shall be  $0.7 \times \text{leg length}$ . For other fillet welds, the theoretical throat shall be based on the leg lengths and the angle  $\theta$  between the members to be joined.
- For all fillet welds, particularly unequal leg fillet welds with angle  $\theta$  less than 90 deg, the theoretical throat shall lie within the cross section of the deposited weld metal and shall not be less than the minimum distance through the weld.

**Fig. 127.4.4(B) Welding Details for Slip-On and Socket-Welding Flanges; Some Acceptable Types of Flange Attachment Welds**

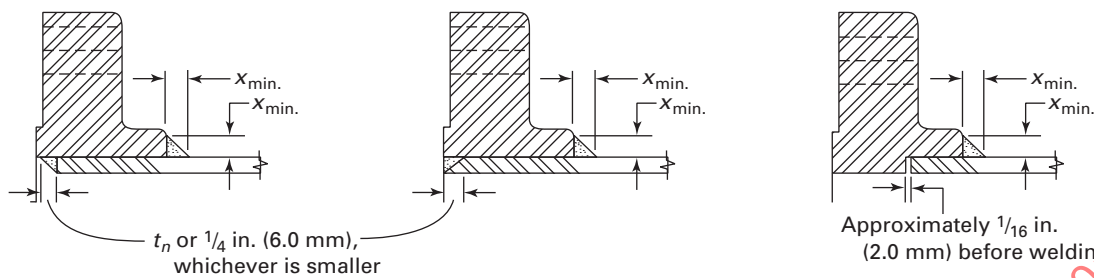

**(a) Front and Back Weld**  
[See Notes (1) and (2)]

**(b) Face and Back Welds**  
[See Notes (1) and (2)]

**(c) Socket Welding Flange**  
[See Notes (2) and (3)]


$t_n$  = nominal pipe wall thickness

$x_{min.}$  =  $1.4t_n$  or thickness of the hub, whichever is smaller


**NOTES:**

- (1) Refer to para. 122.1.1(F) for limitations of use.
- (2) Refer to para. 104.5.1 for limitations of use.
- (3) Refer to para. 122.1.1(H) for limitations of use.


**Fig. 127.4.4(C) Minimum Welding Dimensions Required for Socket Welding Components Other Than Flanges**

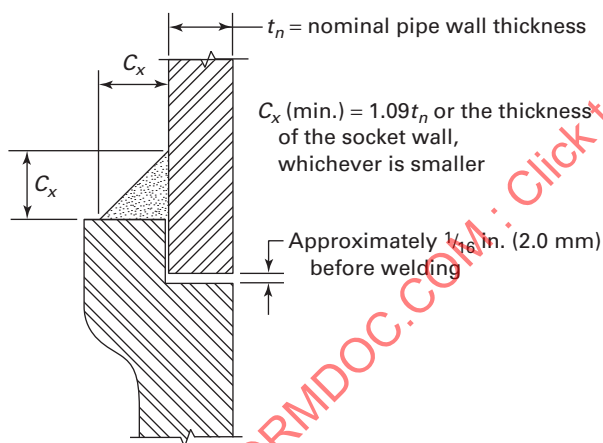


**Fig. 127.4.8(B) Typical Welded Branch Connection With Additional Reinforcement**

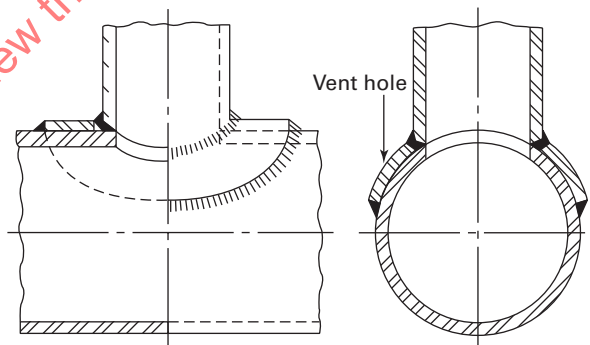


**Fig. 127.4.8(A) Typical Welded Branch Connection Without Additional Reinforcement**

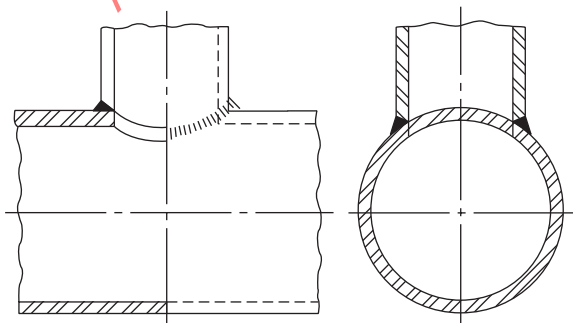


**Fig. 127.4.8(C) Typical Welded Angular Branch Connection Without Additional Reinforcement**

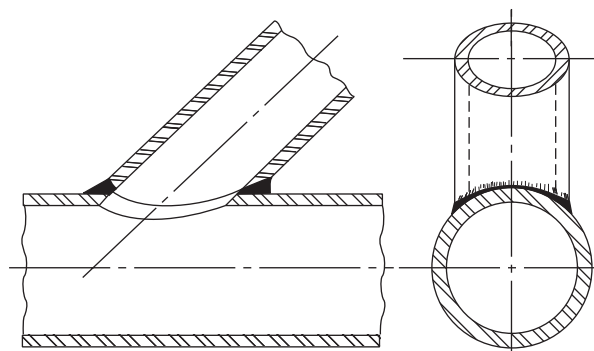

**Fig. 127.4.8(D) Some Acceptable Types of Welded Branch Attachment Details Showing Minimum Acceptable Welds**

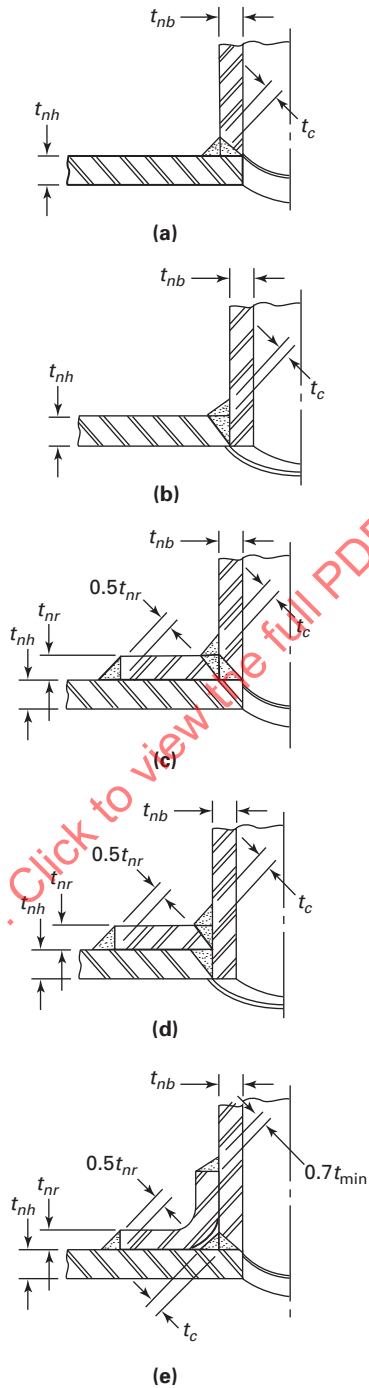

GENERAL NOTE: Weld dimensions may be larger than the minimum values shown here.

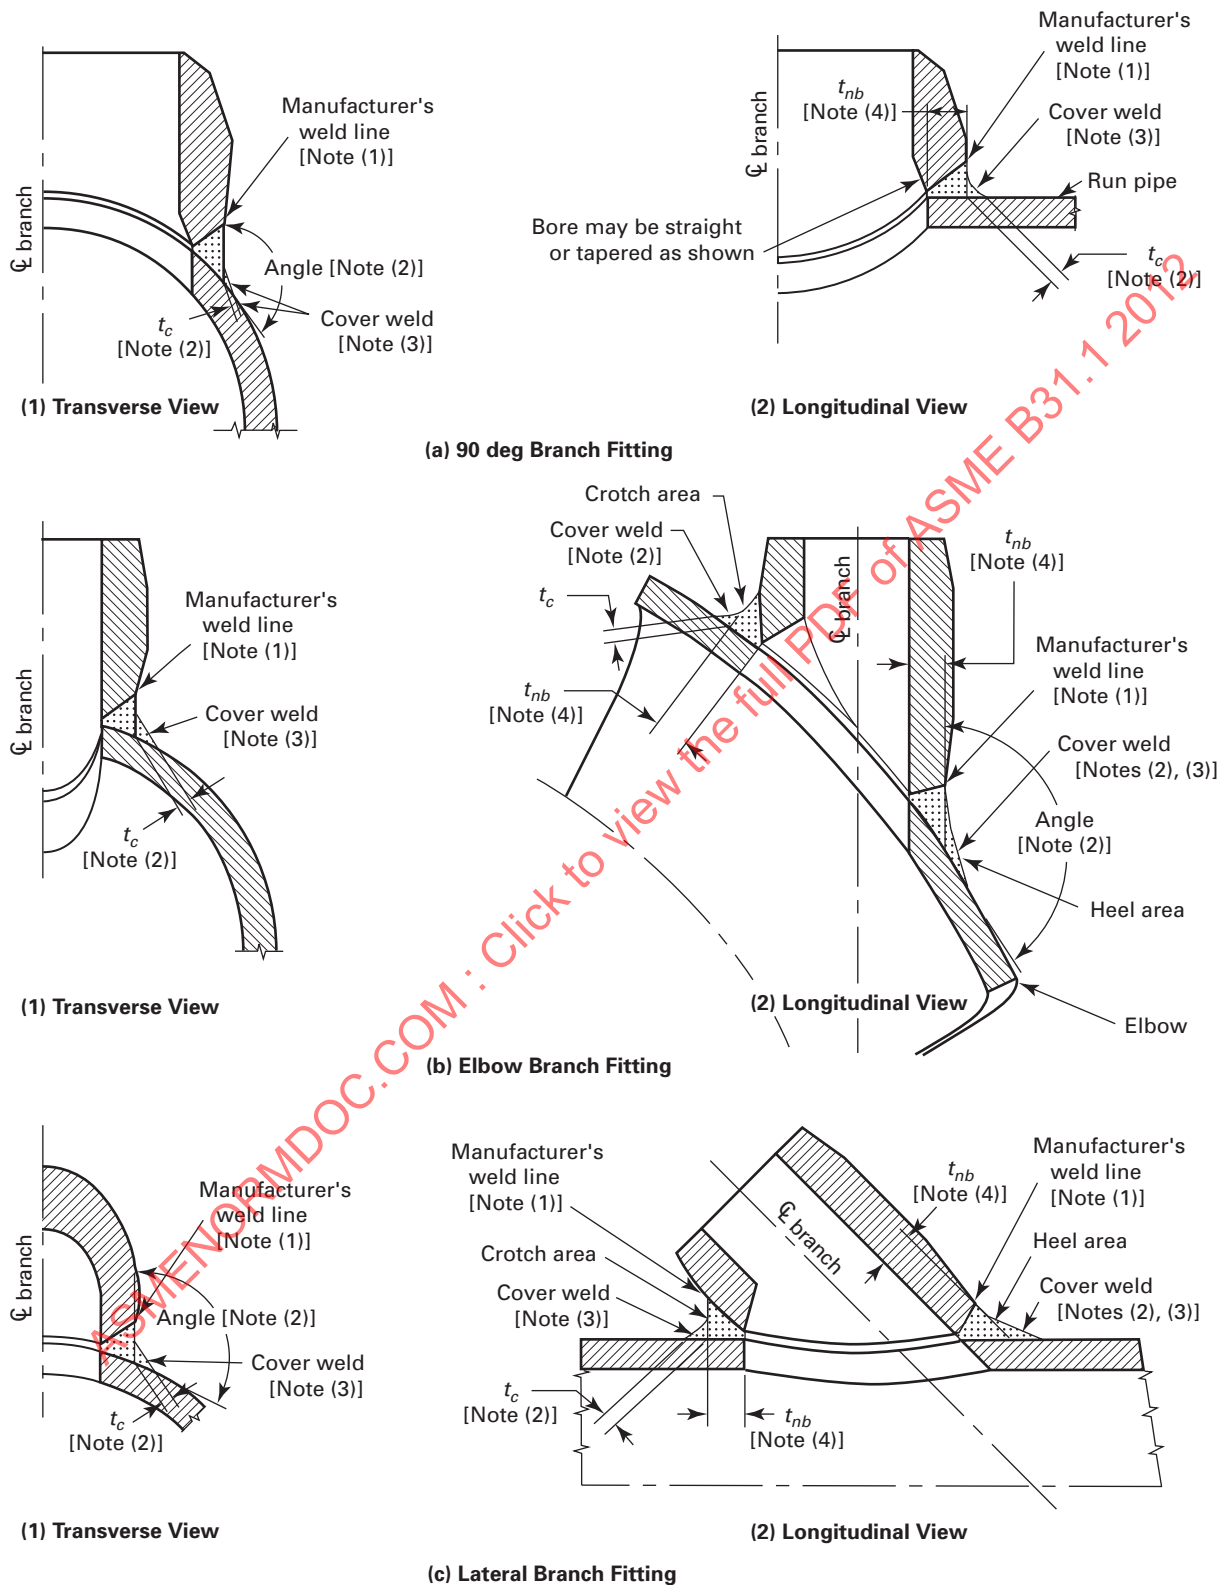**Fig. 127.4.8(E) Some Acceptable Details for Integrally Reinforced Outlet Fittings**


**Fig. 127.4.8(E) Some Acceptable Details for Integrally Reinforced Outlet Fittings (Cont'd)**

## GENERAL NOTES;

- (a) Welds shall be in accordance with para. 127.4.8(C).
- (b) Weld attachment details for branch fittings that do not match the schedule or weight designation of the run pipe as defined by MSS SP-97 Table 1 shall be designed to meet the requirements in paras. 104.3.1 and 104.7.2.
- (c) The stress intensification factors as required by paras. 104.8 and 119.7.3, for the fittings represented by drawings (b-1), (b-2), (c-1), and (c-2), should be obtained from the fitting manufacturer.


## NOTES;

- (1) When the fitting manufacturer has not provided a visible scribe line on the branch fitting, the weld line shall be the edge of the first bevel on the branch fitting adjacent to the run pipe.
- (2) The minimum cover weld throat thickness,  $t_c$ , applies when the angle between the branch fitting groove weld face and the run pipe surface is less than 135 deg. For areas where the angle between the groove weld face and the run pipe surface is 135 deg or greater, the cover weld may transition to nothing.
- (3) Cover weld shall provide a smooth transition to the run pipe.
- (4)  $t_{nb}$  shall be measured at the longitudinal centerline of the branch fitting. When  $t_{nb}$  in the crotch area does not equal  $t_{nb}$  in the heel area, the thicker of the two shall govern in determining the heat treatment in accordance with para. 132.4.

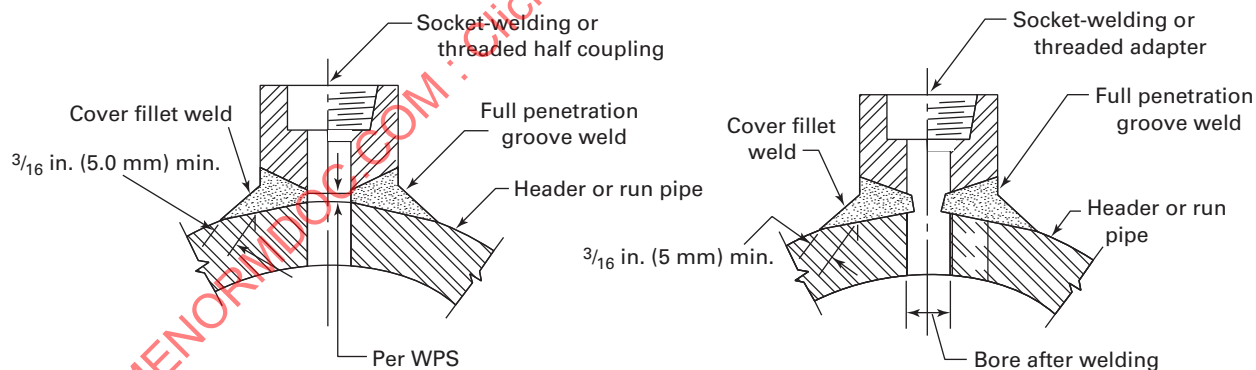**Fig. 127.4.8(F) Typical Full Penetration Weld Branch Connections for NPS 3 and Smaller Half Couplings or Adapters****(a) Branch Connection Using ASME B16.11 Forged Steel Socket-Welding or Threaded Half Coupling [See Note (1)]****(b) Branch Connection Using Forged Steel Socket-Welding or Threaded Adapter for Pressure and Temperature Conditions Greater Than Permitted for ASME B16.11 Forged Steel Fittings**

## NOTE:

- (1) Refer to para. 104.3.1(C.2) for branch connections not requiring reinforcement calculations.

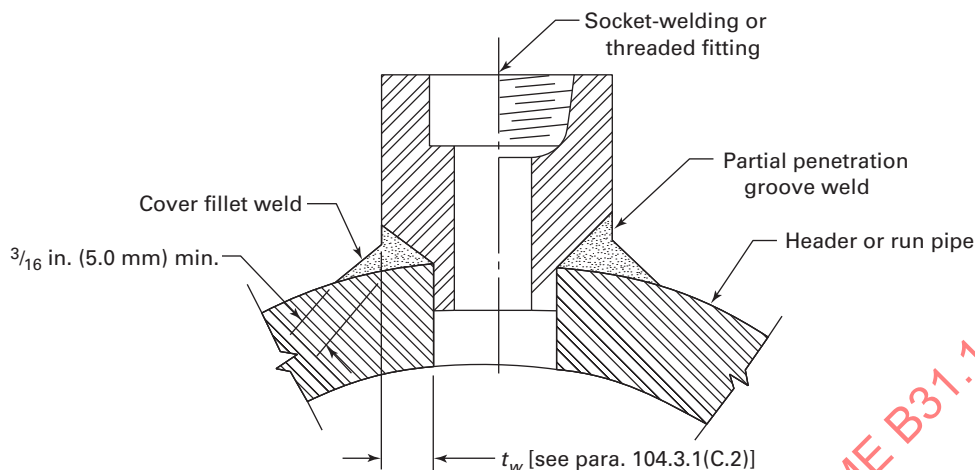**Fig. 127.4.8(G) Typical Partial Penetration Weld Branch Connection for NPS 2 and Smaller Fittings**

(D) In branch connections having reinforcement pads or saddles, the reinforcement shall be attached by welds at the outer edge and at the branch periphery as follows:

(D.1) If the weld joining the added reinforcement to the branch is a full penetration groove weld, it shall be finished with a cover fillet weld having a minimum throat dimension not less than  $t_c$ ; the weld at the outer edge, joining the added reinforcement to the run, shall be a fillet weld with a minimum throat dimension of  $0.5t_m$ .

(D.2) If the weld joining the added reinforcement to the branch is a fillet weld, the throat dimension shall not be less than  $0.7t_{min}$ . The weld at the outer edge joining the outer reinforcement to the run shall also be a fillet weld with a minimum throat dimension of  $0.5t_m$ .

(E) When rings or saddles are used, a vent hole shall be provided (at the side and not at the crotch) in the ring or saddle to reveal leakage in the weld between branch and main run and to provide venting during welding and heat treating operations. Rings or saddles may be made in more than one piece if the joints between the pieces have strength equivalent to ring or saddle parent metal and if each piece is provided with a vent hole. A good fit shall be provided between reinforcing rings or saddles and the parts to which they are attached.

(F) Branch connections NPS 2 and smaller that do not require reinforcements (see para. 104.3) may be constructed as shown in Fig. 127.4.8(G). The groove welds shall be finished with cover fillet welds with a minimum throat dimension not less than that shown in Fig. 127.4.8(G). This construction shall not be used at design temperatures greater than 750°F (400°C) nor at design pressures greater than 1,025 psi (7 100 kPa).

**127.4.9 Attachment Welds.** Structural attachments may be made by complete penetration, partial penetration, or fillet welds.

(A) Capacitor discharge welding may be used for the welding of temporary attachments or permanent non-structural attachments, such as strain gages or thermocouples, directly to pressure parts, provided that the welding is performed in accordance with the requirements of para. 132.3.3. Performance and procedure qualifications are not required.

(B) Temporary attachments shall, after their removal, have the weld affected areas examined in accordance with para. 136.4.

**127.4.10 Heat Treatment.** Preheat and postweld heat treatment for welds shall be in accordance with para. 131 or 132 as applicable.

#### 127.4.11 Repair Welding

(A) *Defect Removal.* All defects in welds or base materials requiring repair shall be removed by flame or arc gouging, grinding, chipping, or machining. Preheating may be required for flame or arc gouging on certain alloy materials of the air hardening type in order to prevent surface checking or cracking adjacent to the flame or arc gouged surface. When a defect is removed but welding repair is unnecessary, the surface shall be contoured to eliminate any sharp notches or corners. The contoured surface shall be reinspected by the same means originally used for locating the defect.

(B) *Repair Welds.* Repair welds shall be made in accordance with a WPS using qualified welders or welding operators (see para. 127.5), recognizing that the cavity to be repair welded may differ in contour and dimension from a normal joint preparation and may present different restraint conditions. The types, extent, and methods of examination shall be in accordance with Table 136.4. For repairs to welds the minimum examination shall be the same method that revealed the defect in the original

weld. For repairs to base material, the minimum examination shall be the same as required for butt welds.

## 127.5 Qualification

**127.5.1 General.** Qualification of the WPS to be used, and of the performance of welders and welding operators, is required, and shall comply with the requirements of the ASME Boiler and Pressure Vessel Code (Section IX) except as modified herein.

Certain materials listed in Mandatory Appendix A do not appear in ASME Section IX P-Number groups. Where these materials have been assigned P-Numbers in Mandatory Appendix A, they may be welded under this Code for nonboiler external piping only without separate qualification as if they were listed in ASME Section IX.

**127.5.2 Welding Responsibility.** Each employer (see para. 100.2) shall be responsible for the welding performed by his/her organization and the performance of welders or welding operators employed by that organization.

### 127.5.3 Qualification Responsibility

(A) *Procedures.* Each employer shall be responsible for qualifying any WPS that he/she intends to have used by personnel of his/her organization. However, to avoid duplication of effort, and subject to approval of the owner, a WPS qualified by a technically competent group or agency may be used:

(A.1) if the group or agency qualifying the WPS meets all of the procedure qualification requirements of this Code

(A.2) if the fabricator accepts the WPS thus qualified

(A.3) if the user of the WPS has qualified at least one welder using the WPS

(A.4) if the user of the WPS assumes specific responsibility for the procedure qualification work done for him/her by signing the records required by para. 127.6

All four of the above conditions shall be met before a WPS thus qualified may be used.

(B) *Welders and Welding Operators.* Each employer shall be responsible for qualifying all the welders and welding operators employed by him/her.

However, to avoid duplication of effort, he/she may accept a Welder/Welding Operator Performance Qualification (WPQ) made by a previous employer (subject to the approval of the owner or his/her agent) on piping using the same or an equivalent procedure wherein the essential variables are within the limits established in Section IX, ASME Boiler and Pressure Vessel Code. An employer accepting such qualification tests by a previous employer shall obtain a copy of the original WPQ, showing the name of the employer by whom the welders or welding operators were qualified,

the dates of such qualification, and evidence that the welder or welding operator has maintained qualification in accordance with QW-322 of Section IX, ASME Boiler and Pressure Vessel Code. The evidence of process usage to maintain continuity may be obtained from employers other than the original qualifying employer. The employer shall then prepare and sign the record required in para. 127.6 accepting responsibility for the ability of the welder or welding operator.

**127.5.4 Standard Welding Procedure Specifications.** Standard Welding Procedure Specifications published by the American Welding Society and listed in Mandatory Appendix E of Section IX of the ASME Boiler and Pressure Vessel Code are permitted for Code construction within the limitations established by Article V of ASME Section IX.

## 127.6 Welding Records

The employer shall maintain a record (WPS and/or WPQ) signed by him/her, and available to the purchaser or his/her agent and the inspector, of the WPSs used and the welders and/or welding operators employed by him/her, showing the date and results of procedure and performance qualification.

The WPQ shall also show the identification symbol assigned to the welder or welding operator employed by him/her, and the employer shall use this symbol to identify the welding performed by the welder or welding operator. This may be accomplished by the application of the symbol on the weld joint in a manner specified by the employer. Alternatively, the employer shall maintain records that identify the weld(s) made by the welder or welding operator.

## 128 BRAZING AND SOLDERING

### 128.1 General

**128.1.1** The brazing processes that are to be used under this part of the Code shall meet all the test requirements of Section IX of the ASME Boiler and Pressure Vessel Code.

**128.1.2 Soldering.** Solderers shall follow the procedure in ASTM B828, Standard Practice for Making Capillary Joints by Soldering of Copper and Copper Alloy Tube and Fittings.

### 128.2 Materials

**128.2.1 Filler Metal.** The brazing alloy or solder shall melt and flow freely within the specified or desired temperature range and, in conjunction with a suitable flux or controlled atmosphere, shall wet and adhere to the surfaces to be joined.

**128.2.2 Flux.** A flux that is fluid and chemically active at brazing or soldering temperature shall be used when necessary to eliminate oxidation of the filler metal

and the surfaces to be joined, and to promote free flow of the brazing alloy or solder.

### 128.3 Preparation

**128.3.1 Surface Preparation.** The surfaces to be brazed or soldered shall be clean and free from grease, oxides, paint, scale, dirt, or other material that is detrimental to brazing. A suitable chemical or mechanical cleaning method shall be used if necessary to provide a clean wettable surface.

**128.3.2 Joint Clearance.** The clearance between surfaces to be joined by brazing or soldering shall be no larger than is necessary to allow complete capillary distribution of the brazing alloy or solder.

### 128.4 Procedure

#### 128.4.1 General

(A) Qualification of the brazing procedures to be used and of the performance of the brazer and brazing operators is required and shall comply with the requirements of para. 128.5.

(B) No brazing shall be done if there is impingement of rain, snow, sleet, or high wind on the area to be brazed.

**128.4.2 Heating.** To minimize oxidation, the joint shall be brought to brazing or soldering temperature in as short a time as possible without localized underheating or overheating.

**128.4.3 Flux Removal.** Residual flux shall be removed if detrimental.

### 128.5 Brazing Qualification

**128.5.1 General.** The qualification of the brazing procedure and of the performance of brazers and brazing operators shall be in accordance with the requirements of Part QB, Section IX, ASME Boiler and Pressure Vessel Code, except as modified herein.

**128.5.2 Brazing Responsibility.** Each employer (see para. 100.2) shall be responsible for the brazing performed by his/her organization and the performance of brazers or brazing operators employed by that organization.

#### 128.5.3 Qualification Responsibility

(A) *Procedures.* Each employer shall be responsible for qualifying any Brazing Procedure Specification (BPS) that he/she intends to have used by personnel of his/her organization. However, to avoid duplication of effort, and subject to approval of the owner, a BPS qualified by a technically competent group or agency may be used:

(A.1) if the group or agency qualifying the procedures meets all of the procedure qualification requirements of this Code

(A.2) if the fabricator accepts the procedure thus qualified

(A.3) if the user of the procedure has qualified at least one brazer using the BPS

(A.4) if the user of the procedure assumes specific responsibility for the procedure qualification work done by him/her by signing the records required by para. 128.6

All four of the above conditions shall be met before a procedure thus qualified may be used.

(B) *Brazers and Brazing Operators.* Each employer shall be responsible for qualifying all the brazers and brazing operators employed by him/her.

However, to avoid duplication of effort, he/she may accept a Brazer/Brazing Operator Performance Qualification (BPQ) made by a previous employer (subject to the approval of the owner or his/her agent) on piping using the same or an equivalent procedure wherein the essential variables are within the limits established in Section IX, ASME Boiler and Pressure Vessel Code. An employer accepting such qualification tests by a previous employer shall obtain a copy (from the previous employer) of the BPQ, showing the name of the employer by whom the brazers or brazing operators were qualified, the dates of such qualification, and the date the brazer last brazed pressure piping components under such qualification. The employer shall then prepare and sign the record required in para. 128.6 accepting responsibility for the ability of the brazer or brazing operator.

### 128.6 Brazing Records

The employer shall maintain a record signed by him/her and available to the purchaser or his/her agent and the inspector, showing the date and results of procedure and performance qualification.

The BPQ shall also show the identification symbol assigned to the brazer or brazing operator employed by him/her, and the employer shall use this symbol to identify the brazing performed by the brazer or brazing operator. This may be accomplished by the application of the symbol on the braze joint in a manner specified by the employer. Alternatively, the employer shall maintain records that identify the braze joints(s) made by the brazer or brazing operator.

## 129 BENDING AND FORMING

### 129.1 Bending

Pipe may be bent by any hot or cold method and to any radius that will result in a bend surface free of cracks. Such bends shall meet the design requirements of para. 102.4.5 with regard to minimum wall thickness. Where limits on flattening and buckling are not specified by design, as delineated in para. 104.2.1, manufacturing limits of PFI ES-24 shall be met. When defaulting to

(12) **Table 129.3.1 Approximate Lower Critical Temperatures**

| Material                          | Approximate Lower Critical Temperature, °F (°C) [Note (1)] |
|-----------------------------------|------------------------------------------------------------|
| Carbon steel (P-No. 1)            | 1,340 (725)                                                |
| Carbon-molybdenum steel (P-No. 3) | 1,350 (730)                                                |
| 1Cr-½Mo (P-No. 4, Gr. No. 1)      | 1,375 (745)                                                |
| 1¼Cr-½Mo (P-No. 4, Gr. No. 1)     | 1,430 (775)                                                |
| 2¼Cr-1Mo, 3Cr-1Mo (P-No. 5A)      | 1,480 (805)                                                |
| 5Cr-½Mo (P-No. 5B, Gr. No. 1)     | 1,505 (820)                                                |
| 9Cr                               | 1,475 (800)                                                |
| 9Cr-1Mo-V, 9Cr-2W (P-No. 15E)     | 1,470 (800)                                                |

**NOTE:**

- (1) These values are intended for guidance only. The user may apply values obtained for the specific material in lieu of these values.

PFI ES-24, mutual agreement between purchaser and fabricator beyond the stated manufacturing limits shall not be allowed without the approval of the designer.

The use of bends designed as creased or corrugated is not prohibited.

**129.2 Forming**

Piping components may be formed (swedging, lapping, or upsetting of pipe ends, extrusion of necks, etc.) by any suitable hot or cold working method, provided such processes result in formed surfaces that are uniform and free of cracks or other defects, as determined by method of inspection specified in the design.

**129.3 Heat Treatment of Bends and Formed Components**

**129.3.1** Hot bending or forming is performed at a temperature above  $T_{crit} - 100^{\circ}\text{F}$  ( $56^{\circ}\text{C}$ ), where  $T_{crit}$  is the lower critical temperature of the material. Cold bending or forming is performed at a temperature below  $T_{crit} - 100^{\circ}\text{F}$  ( $56^{\circ}\text{C}$ ). (See Table 129.3.1 for lower critical temperatures.)

**129.3.2** A postbending or postforming heat treatment at the time and temperature cycles listed for postweld heat treatment in Table 132 is required on all carbon steel (P-No. 1) materials with a nominal wall thickness in excess of  $\frac{3}{4}$  in. (19.0 mm) unless the bending or forming operations are performed and completed at temperatures of  $1,650^{\circ}\text{F}$  ( $900^{\circ}\text{C}$ ) or greater.

**129.3.3** A postforming or postbending heat treatment as defined below is required for all ferritic alloy steel (excluding P-No. 1) materials with a nominal pipe size 4 in. and larger or with a nominal thickness of  $\frac{1}{2}$  in. (13.0 mm) or greater.

(A) If hot bending or forming is performed, the material shall receive a full anneal, normalize and temper, or tempering heat treatment as specified by the designer.

(B) If cold bending or forming is performed, a heat treatment is required at the time and temperature cycle listed for the material in Table 132.

**129.3.4** Postbending or postforming heat treatment of austenitic materials shall be performed as follows: (12)

**129.3.4.1** Cold-formed areas of components manufactured of austenitic alloys shall be heat treated after forming if they exceed both the design temperatures and forming strains shown in Table 129.3.4.1. Forming strains shall be calculated as follows:

(A) For cylinders formed from plate

$$\% \text{ strain} = 50t_n/R_f(1 - R_f/R_g)$$

(B) For spherical or dished heads formed from plate

$$\% \text{ strain} = 75t_n/R_f(1 - R_f/R_g)$$

(C) For tube and pipe bends

$$\% \text{ strain} = 100r_{od}/R$$

where

$R$  = centerline radius of bend

$R_f$  = mean radius after forming

$R_g$  = original mean radius (equal to infinity for a flat plate)

$r_{od}$  = nominal outside radius of pipe or tube

$t_n$  = nominal thickness of the plate, pipe, or tube before forming

**129.3.4.2** When forming strains cannot be calculated as shown in para. 129.3.4.1, the manufacturer shall have the responsibility to determine the maximum forming strain.

**129.3.4.3** For flares, swages, or upsets, heat treatment in accordance with Table 129.3.4.1 shall apply, regardless of the amount of strain, unless the finishing forming temperature is equal to or greater than the minimum heat treatment temperature for a given grade or UNS number material, provided the requirements of para. 129.3.4.5 are met.

**129.3.4.4** Heat treatment, in accordance with Table 129.3.4.1, shall not be required if the finishing forming temperature is equal to or greater than the minimum heat treatment temperature for a given grade or UNS number material, provided the requirements of para. 129.3.4.5 are met.

**129.3.4.5** The piping components being heat treated shall be held at the temperatures given in Table 129.3.4.1 for 20 min/in. of thickness, or for 10 min, whichever is greater.

(12)

**Table 129.3.4.1**  
**Post Cold-Forming Strain Limits and Heat-Treatment Requirements**

| Grade | UNS Number | Limitations in Lower Temperature Range |     |                           |     |                               | Limitations in Higher Temperature Range |     |                               | Minimum Heat-Treatment Temperature When Design Temperature and Forming Strain Limits Are Exceeded [Notes (1) and (2)] |       |
|-------|------------|----------------------------------------|-----|---------------------------|-----|-------------------------------|-----------------------------------------|-----|-------------------------------|-----------------------------------------------------------------------------------------------------------------------|-------|
|       |            | For Design Temperature                 |     |                           |     |                               |                                         |     |                               |                                                                                                                       |       |
|       |            | Exceeding                              |     | But Less Than or Equal to |     | And Forming Strains Exceeding | For Design Temperature Exceeding        |     | And Forming Strains Exceeding |                                                                                                                       |       |
|       |            | °F                                     | °C  | °F                        | °C  |                               | °F                                      | °C  |                               | °F                                                                                                                    | °C    |
| 304   | S30400     | 1,075                                  | 580 | 1,250                     | 675 | 20%                           | 1,250                                   | 675 | 10%                           | 1,900                                                                                                                 | 1 040 |
| 304H  | S30409     | 1,075                                  | 580 | 1,250                     | 675 | 20%                           | 1,250                                   | 675 | 10%                           | 1,900                                                                                                                 | 1 040 |
| 304N  | S30451     | 1,075                                  | 580 | 1,250                     | 675 | 15%                           | 1,250                                   | 675 | 10%                           | 1,900                                                                                                                 | 1 040 |
| 309S  | S30908     | 1,075                                  | 580 | 1,250                     | 675 | 20%                           | 1,250                                   | 675 | 10%                           | 2,000                                                                                                                 | 1 095 |
| 310H  | S31009     | 1,075                                  | 580 | 1,250                     | 675 | 20%                           | 1,250                                   | 675 | 10%                           | 2,000                                                                                                                 | 1 095 |
| 310S  | S31008     | 1,075                                  | 580 | 1,250                     | 675 | 20%                           | 1,250                                   | 675 | 10%                           | 2,000                                                                                                                 | 1 095 |
| 316   | S31600     | 1,075                                  | 580 | 1,250                     | 675 | 20%                           | 1,250                                   | 675 | 10%                           | 1,900                                                                                                                 | 1 040 |
| 316H  | S31609     | 1,075                                  | 580 | 1,250                     | 675 | 20%                           | 1,250                                   | 675 | 10%                           | 1,900                                                                                                                 | 1 040 |
| 316N  | S31651     | 1,075                                  | 580 | 1,250                     | 675 | 15%                           | 1,250                                   | 675 | 10%                           | 1,900                                                                                                                 | 1 040 |
| 321   | S32100     | 1,000                                  | 540 | 1,250                     | 675 | 15% [Note (3)]                | 1,250                                   | 675 | 10%                           | 1,900                                                                                                                 | 1 040 |
| 321H  | S32109     | 1,000                                  | 540 | 1,250                     | 675 | 15% [Note (3)]                | 1,250                                   | 675 | 10%                           | 2,000                                                                                                                 | 1 095 |
| 347   | S34700     | 1,000                                  | 540 | 1,250                     | 675 | 15%                           | 1,250                                   | 675 | 10%                           | 1,900                                                                                                                 | 1 040 |
| 347H  | S34709     | 1,000                                  | 540 | 1,250                     | 675 | 15%                           | 1,250                                   | 675 | 10%                           | 2,000                                                                                                                 | 1 095 |
| 348   | S34800     | 1,000                                  | 540 | 1,250                     | 675 | 15%                           | 1,250                                   | 675 | 10%                           | 1,900                                                                                                                 | 1 040 |
| 348H  | S34809     | 1,000                                  | 540 | 1,250                     | 675 | 15%                           | 1,250                                   | 675 | 10%                           | 2,000                                                                                                                 | 1 095 |
| 600   | N06600     | 1,075                                  | 580 | 1,200                     | 650 | 20%                           | 1,200                                   | 650 | 10%                           | 1,900                                                                                                                 | 1 040 |
| 617   | N06617     | 1,200                                  | 650 | 1,400                     | 760 | 15%                           | 1,400                                   | 760 | 10%                           | 2,100                                                                                                                 | 1 150 |
| 800   | N08800     | 1,100                                  | 595 | 1,250                     | 675 | 15%                           | 1,250                                   | 675 | 10%                           | 1,800                                                                                                                 | 980   |
| 800H  | N08810     | 1,100                                  | 595 | 1,250                     | 675 | 15%                           | 1,250                                   | 675 | 10%                           | 2,050                                                                                                                 | 1 120 |
| ...   | S30815     | 1,075                                  | 580 | 1,250                     | 675 | 15%                           | 1,250                                   | 675 | 10%                           | 1,920                                                                                                                 | 1 050 |
| C-22  | N06022     | 1,075                                  | 580 | 1,250                     | 675 | 15%                           | ...                                     | ... | ...                           | 2,050                                                                                                                 | 1 120 |

GENERAL NOTE: The limits shown are for pipe and tube formed from plate, and pipe and tube bends. When the forming strains cannot be calculated as shown in para. 129.3.4.1, the forming strain limits shall be half those tabulated in this Table (see para. 129.3.4.2).

NOTES:

- (1) Rate of cooling from heat-treatment temperature not subject to specific control limits.
- (2) While minimum heat-treatment temperatures are specified, it is recommended that the heat-treatment temperature range be limited to 150°F (85°C) above that minimum [250°F (140°C) temperature range for 347, 347H, 348, and 348H].
- (3) For simple bends of tubes or pipes whose outside diameter is less than 3.5 in. (89 mm), this limit is 20%.

**129.3.4.6** Postbending or postforming heat treatment of materials not identified in Table 129.3.4.1 is neither required nor prohibited. If a postbending or postforming heat treatment is to be performed, the designer shall fully describe the procedure to be used.

### 130 REQUIREMENTS FOR FABRICATING AND ATTACHING PIPE SUPPORTS

#### 130.1 Pipe Supports

Standard pipe hangers and supports shall be fabricated in accordance with the requirements of MSS SP-58. Welders, welding operators, and WPSs shall be qualified in accordance with the requirements of the ASME Boiler and Pressure Vessel Code, Section IX.

#### 130.2 Alternate Pipe Supports

Special hangers, supports, anchors, and guides, not defined as standard types of hanger components in MSS SP-58, shall be welded in accordance with the requirements of para. 127 (para. 132 is not applicable except as required by the weld procedure used) and inspected in accordance with the requirements of para. 136.4.2.

#### 130.3 Pipe Support Welds

Welds attaching hangers, supports, guides, and anchors to the piping system shall conform to the requirements of Chapters V and VI of this Code.

### 131 WELDING PREHEAT

#### 131.1 Minimum Preheat Requirements

The preheat requirements listed herein are mandatory minimum values.

The base metal temperature prior to welding shall be at or above the specified minimum temperature in all directions from the point of welding for a distance of 3 in. or 1.5 times the base metal thickness (as defined in para. 131.4.1), whichever is greater.

The base metal temperature for tack welds shall be at or above the specified minimum temperature for a distance not less than 1 in. in all directions from the point of welding.

#### 131.2 Different P-Number Materials

When welding two different P-Number materials, the minimum preheat temperature required shall be the higher temperature for the material to be welded.

#### 131.3 Preheat Temperature Verification

The preheat temperature shall be checked by use of temperature-indicating crayons, thermocouple pyrometers, or other suitable methods to ensure that the required preheat temperature is obtained prior to and uniformly maintained during the welding operation.

### 131.4 Preheat Temperature

The minimum preheat for all materials shall be 50°F (10°C) unless stated otherwise in the following paragraphs.

**131.4.1** Thickness referred to is the greater of the nominal thicknesses at the weld of the parts to be joined.

**131.4.2 P-No. 1.** 175°F (80°C) for material that has both a specified maximum carbon content in excess of 0.30% and a thickness at the joint in excess of 1 in. (25.0 mm). Preheat may be based on the actual carbon content as determined from a ladle or product analysis in accordance with the material specification in lieu of the maximum carbon content specified in the material specification.

**131.4.3 P-No. 3.** 175°F (80°C) for material or product form that has either a specified minimum tensile strength in excess of 60,000 psi (413.7 MPa) or a thickness at the joint in excess of ½ in. (13.0 mm).

**131.4.4 P-No. 4.** 250°F (120°C) for all materials.

#### 131.4.5 P-Nos. 5A and 5B

(A) 400°F (200°C) for material that has either a specified minimum tensile strength in excess of 60,000 psi (413.7 MPa), or has both a specified minimum chromium content above 6.0% and a thickness at the joint in excess of ½ in. (13.0 mm)

(B) 300°F (150°C) for all other materials having this P-Number

**131.4.6 P-No. 6.** 400°F (200°C) for all materials.

#### 131.4.7 P-Nos. 9A and 9B

(A) 250°F (120°C) for P-No. 9A materials

(B) 300°F (150°C) for P-No. 9B materials

**131.4.8 P-No. 10I.** 300°F (150°C) with an interpass temperature of 450°F (230°C) maximum.

**131.4.9 P-No. 15E.** 400°F (200°C) for all materials.

### 131.6 Interruption of Welding

**131.6.1** After welding commences, the minimum preheat temperature shall be maintained until any required PWHT is performed on P-Nos. 3, 4, 5A, 5B, 6, and 15E, except when all of the following conditions are satisfied:

(A) A minimum of at least ⅜ in. (9.5 mm) thickness of weld is deposited or 25% of the welding groove is filled, whichever is less (the weldment shall be sufficiently supported to prevent overstressing the weld if the weldment is to be moved or otherwise loaded).

(B) For P-Nos. 3, 4, and 5A (with a chromium content of 3.0% maximum) materials, the weld is allowed to cool slowly to room temperature.

(C) For P-No. 5B (with a chromium content greater than 3.0%), P-No. 6, and P-No. 15E materials, the weld

is subjected to an adequate intermediate heat treatment with a controlled rate of cooling. The preheat temperature may be reduced to 200°F (93°C) (minimum) for the purpose of root examination without performing an intermediate heat treatment.

(D) After cooling and before welding is resumed, visual examination of the weld shall be performed to assure that no cracks have formed.

(E) Required preheat shall be applied before welding is resumed.

- (12) **131.6.2** Intermediate heat treatment for P-No. 5B or 15E materials may be omitted entirely when using low-hydrogen electrodes and filler metals classified by the filler metal specification with an optional supplemental diffusible-hydrogen designator of H4 or lower and suitably controlled by maintenance procedures to avoid contamination by hydrogen-producing sources. The surface of the base metal prepared for welding shall be free of contaminants.

## 132 POSTWELD HEAT TREATMENT

### 132.1 Minimum PWHT Requirements

**132.1.1** Before applying the detailed requirements and exemptions in these paragraphs, satisfactory qualification of the WPS to be used shall be performed in accordance with the essential variables of the ASME Boiler and Pressure Vessel Code, Section IX including the conditions of postweld heat treatment or lack of postweld heat treatment and including other restrictions listed below. Except as otherwise provided in paras. 132.2 and 132.3, all welds in materials included in the P-Numbers listed in Table 132 shall be given a postweld heat treatment within the temperature range specified in Table 132. (The range specified in Table 132 may be modified by Table 132.1 for the lower limit and para. 132.2 for the upper limit.) The materials in Table 132 are listed in accordance with the material P-Number grouping of Mandatory Appendix A. Welds of materials not included in Table 132 shall be heat treated in accordance with the WPS.

**132.1.2** Pressure part welds and attachment welds using ferritic filler metals that have a specified chromium content of more than 3% shall receive a postweld heat treatment. The postweld heat treatment time and temperature range used shall be that shown in Table 132 for a base metal of similar composition.

### (12) 132.2 Mandatory PWHT Requirements

Heat treatment may be accomplished by a suitable heating method that will provide the desired heating and cooling rates, the required metal temperature, temperature uniformity, and temperature control.

(A) The upper limit of the PWHT temperature range in Table 132 is a recommended value that may be

exceeded provided the actual temperature does not exceed the lower critical temperature of either material (see Table 129.3.1).

(B) When parts of two different P-Numbers are joined by welding, the postweld heat treatment shall be that specified for the material requiring the higher PWHT temperature. When a nonpressure part is welded to a pressure part and PWHT is required for either part, the maximum PWHT temperature shall not exceed the maximum temperature acceptable for the pressure retaining part.

(C) Caution is necessary to preclude metallurgical damage to some materials or welds not intended or qualified to withstand the PWHT temperatures required.

### 132.3 Exemptions to Mandatory PWHT Requirements

**132.3.1** Postweld heat treatment is not required (12) for the following conditions:

(A) welds in nonferrous materials

(B) welds exempted in Table 132

(C) welds subject to temperatures above the lower critical temperature (see Table 129.3.1) during fabrication provided the WPS has been qualified with PWHT (see para. 132.1) at the temperature range to be reached during fabrication

**132.3.2** The postweld heat treatment exemption of Table 132 may be based on the actual chemical composition as determined by a ladle or product analysis in accordance with the material specification in lieu of the specified or maximum specified chemical composition limits.

**132.3.3** Capacitor discharge welding may be used (12) for welding temporary attachments and permanent non-structural attachments without subsequent postweld heat treatment on P-No. 1 through P-No. 5B and P-No. 15E materials, provided

(A) a Welding Procedure Specification is prepared, describing the capacitor discharge equipment, the combination of materials to be joined, and the technique of application; qualification of the welding procedure is not required

(B) the energy output of the welding process is limited to 125 W-sec

(C) for P-No. 5A, P-No. 5B, and P-No. 15E materials, the maximum carbon content of the material is 0.15%

### 132.4 Definition of Thickness Governing PWHT

**132.4.1** The term *nominal thickness* as used in Table 132 and Notes is the lesser thickness of (A) or (B) as follows:

(A) the thickness of the weld

(B) the thicker of the materials being joined at the weld

**Table 132 Postweld Heat Treatment**

| P-Number<br>From Mandatory<br>Appendix A | Holding<br>Temperature<br>Range, °F (°C) | Holding Time Based on Nominal Thickness |                                                                            |
|------------------------------------------|------------------------------------------|-----------------------------------------|----------------------------------------------------------------------------|
|                                          |                                          | Up to 2 in.<br>(50 mm)                  | Over 2 in.<br>(50 mm)                                                      |
| P-No. 1<br>Gr. Nos. 1, 2, 3              | 1,100 (600)<br>to<br>1,200 (650)         | 1 hr/in. (25 mm),<br>15 min minimum     | 2 hr plus 15 min for each<br>additional inch (25 mm) over<br>2 in. (50 mm) |

## GENERAL NOTES:

- (a) PWHT of P-No. 1 materials is not mandatory, provided that all of the following conditions are met:
- (1) the nominal thickness, as defined in para. 132.4.1, is  $\frac{3}{4}$  in. (19.0 mm) or less
  - (2) a minimum preheat of 200°F (95°C) is applied when the nominal material thickness of either of the base metals exceeds 1 in. (25.0 mm)
- (b) PWHT of low hardenability P-No. 1 materials with a nominal material thickness, as defined in para. 132.4.3, over  $\frac{3}{4}$  in. (19.0 mm) but not more than  $1\frac{1}{2}$  in. (38 mm) is not mandatory, provided all of the following conditions are met:
- (1) the carbon equivalent,  $CE$ , is  $\leq 0.50$ , using the formula

$$CE = C + (Mn + Si)/6 + (Cr + Mo + V)/5 + (Ni + Cu)/15$$

The maximum chemical composition limit from the material specification or actual values from a chemical analysis or material test report shall be used in computing  $CE$ . If analysis for the last two terms is not available, 0.1% may be substituted for those two terms as follows:

$$CE = C + (Mn + Si)/6 + 0.1$$

- (2) a minimum preheat of 250°F (121°C) is applied
  - (3) the maximum weld deposit thickness of each weld pass shall not exceed  $\frac{1}{4}$  in. (6 mm)
- (c) When it is impractical to PWHT at the temperature range specified in Table 132, it is permissible to perform the PWHT of this material at lower temperatures for longer periods of time in accordance with Table 132.1.

| P-Number<br>From Mandatory<br>Appendix A | Holding<br>Temperature<br>Range, °F (°C) | Holding Time Based on Nominal Thickness |                                                                            |
|------------------------------------------|------------------------------------------|-----------------------------------------|----------------------------------------------------------------------------|
|                                          |                                          | Up to 2 in.<br>(50 mm)                  | Over 2 in.<br>(50 mm)                                                      |
| P-No. 3<br>Gr. Nos. 1, 2                 | 1,100 (600)<br>to<br>1,200 (650)         | 1 hr/in. (25 mm),<br>15 min minimum     | 2 hr plus 15 min for each<br>additional inch (25 mm) over<br>2 in. (50 mm) |

## GENERAL NOTES:

- (a) PWHT of P-No. 3 materials is not mandatory, provided all of the following conditions are met:
- (1) the nominal thickness, as defined in para. 132.4.1, is  $\frac{5}{8}$  in. (16.0 mm) or less
  - (2) a minimum preheat of 200°F (95°C) is applied when the nominal material thickness of either of the base metals exceeds  $\frac{5}{8}$  in. (16.0 mm)
  - (3) the specified carbon content of the P-No. 3 base material is 0.25% or less
- (b) When it is impractical to PWHT at the temperature range specified in Table 132, it is permissible to perform the PWHT of this material at lower temperatures for longer periods of time in accordance with Table 132.1.

**Table 132 Postweld Heat Treatment (Cont'd)**

| P-Number<br>From Mandatory<br>Appendix A | Holding<br>Temperature<br>Range, °F (°C) | Holding Time Based on Nominal Thickness |                                                                            |
|------------------------------------------|------------------------------------------|-----------------------------------------|----------------------------------------------------------------------------|
|                                          |                                          | Up to 2 in.<br>(50 mm)                  | Over 2 in.<br>(50 mm)                                                      |
| P-No. 4<br>Gr. Nos. 1, 2                 | 1,200 (650)<br>to<br>1,300 (700)         | 1 hr/in. (25 mm),<br>15 min minimum     | 2 hr plus 15 min for each<br>additional inch (25 mm) over<br>2 in. (50 mm) |

GENERAL NOTE: PWHT is not mandatory for P-No. 4 material under the following conditions:

- (a) welds in pipe or attachment welds to pipe complying with all of the following conditions:
  - (1) a nominal material thickness of  $\frac{1}{2}$  in. (13.0 mm) or less
  - (2) a specified carbon content of the material to be welded of 0.15% or less
- (b) for seal welding of threaded or other mechanical joints, provided the seal weld has a throat thickness of  $\frac{3}{8}$  in. (9.0 mm) or less
- (c) attachment welds for nonload-carrying attachments provided in addition to (a)(2) above:
  - (1) stud welds or fillet welds made by the SMAW or GTAW process shall be used.
  - (2) the hardened portion of the heat affected zone (HAZ) shall not encroach on the minimum wall thickness of the pipe, as determined by welding procedure qualification using the maximum welding heat input. The depth of the HAZ shall be taken as the point where the HAZ hardness does not exceed the average unaffected base metal hardness by more than 10%.
  - (3) if SMAW is used, the electrode shall be the low hydrogen type.
  - (4) the thickness of the test plate used in making the welding procedure qualification of Section IX shall not be less than that of the material to be welded.
  - (5) the attachment weld has a throat thickness of  $\frac{3}{16}$  in. or less.
- (d) for socket welded components and slip-on flange welds provided
  - (1) the throat thickness is  $\frac{1}{2}$  in. (13 mm) or less
  - (2) the wall thickness of the pipe is  $\frac{1}{2}$  in. (13 mm) or less
  - (3) the specified carbon content of the pipe is 0.15% or less

| P-Number<br>From Mandatory<br>Appendix A | Holding<br>Temperature<br>Range, °F (°C) | Holding Time Based on Nominal Thickness |                                                                            |
|------------------------------------------|------------------------------------------|-----------------------------------------|----------------------------------------------------------------------------|
|                                          |                                          | Up to 2 in.<br>(50 mm)                  | Over 2 in.<br>(50 mm)                                                      |
| P-No. 5A<br>Gr. No. 1                    | 1,300 (700)<br>to<br>1,400 (760)         | 1 hr/in. (25 mm),<br>15 min minimum     | 2 hr plus 15 min for each<br>additional inch (25 mm) over<br>2 in. (50 mm) |

GENERAL NOTE: PWHT is not mandatory for P-No. 5A material under the following conditions:

- (a) welds in pipe or attachment welds to pipe complying with all of the following conditions:
  - (1) a nominal material thickness of  $\frac{1}{2}$  in. (13.0 mm) or less
  - (2) a specified carbon content of the material to be welded of 0.15% or less
- (b) for seal welding of threaded or other mechanical joints, provided the seal weld has a throat thickness of  $\frac{3}{8}$  in. (9.0 mm) or less
- (c) attachment welds for non-load-carrying attachments provided in addition to (a)(2) above:
  - (1) stud welds or fillet welds made by the SMAW or GTAW process shall be used.
  - (2) the hardened portion of the heat affected zone (HAZ) shall not encroach on the minimum wall thickness of the pipe, as determined by welding procedure qualification using the maximum welding heat input. The depth of the HAZ shall be taken as the point where the HAZ hardness does not exceed the average unaffected base metal hardness by more than 10%.
  - (3) if SMAW is used, the electrode shall be the low hydrogen type.
  - (4) the thickness of the test plate used in making the welding procedure qualification of Section IX shall not be less than that of the material to be welded.
  - (5) the attachment weld has a throat thickness of  $\frac{3}{16}$  in. or less.
- (d) for socket welded components and slip-on flange welds provided
  - (1) the throat thickness is  $\frac{1}{2}$  in. (13 mm) or less
  - (2) the wall thickness of the pipe is  $\frac{1}{2}$  in. (13 mm) or less
  - (3) the specified carbon content of the pipe is 0.15% or less

**Table 132 Postweld Heat Treatment (Cont'd)**

| P-Number<br>From Mandatory<br>Appendix A | Holding<br>Temperature<br>Range, °F (°C) | Holding Time Based on Nominal Thickness |                                                                               |
|------------------------------------------|------------------------------------------|-----------------------------------------|-------------------------------------------------------------------------------|
|                                          |                                          | Up to 2 in.<br>(50 mm)                  | Over 2 in.<br>(50 mm)                                                         |
| P-No. 5B<br>Gr. No. 1                    | 1,300 (700)<br>to<br>1,400 (760)         | 1 hr/in. (25 mm),<br>15 min minimum     | 2 hr plus 15 min<br>for each additional inch<br>(25 mm) over 2 in.<br>(50 mm) |
| P-Number<br>From Mandatory<br>Appendix A | Holding<br>Temperature<br>Range, °F (°C) | Holding Time Based on Nominal Thickness |                                                                               |
|                                          |                                          | Up to 2 in.<br>(50 mm)                  | Over 2 in.<br>(50 mm)                                                         |
| P-No. 6<br>Gr. Nos. 1, 2, 3              | 1,400 (760)<br>to<br>1,475 (800)         | 1 hr/in. (25 mm),<br>15 min minimum     | 2 hr plus 15 min<br>for each additional inch<br>(25 mm) over 2 in.<br>(50 mm) |

GENERAL NOTE: PWHT is not mandatory for P-No. 6 Type 410 material, provided all of the following conditions are met:

- (a) the specified carbon content is not more than 0.08%
- (b) the nominal material thickness is  $\frac{3}{8}$  in. (10 mm) or less
- (c) the weld is made with A-No. 8, A-No. 9, or F-No. 43 filler metal

**Table 132 Postweld Heat Treatment (Cont'd)**

| P-Number<br>From Mandatory<br>Appendix A | Holding<br>Temperature<br>Range, °F (°C) | Holding Time Based on Nominal Thickness |                                                                               |
|------------------------------------------|------------------------------------------|-----------------------------------------|-------------------------------------------------------------------------------|
|                                          |                                          | Up to 2 in.<br>(50 mm)                  | Over 2 in.<br>(50 mm)                                                         |
| P-No. 7<br>Gr. Nos. 1, 2                 | 1,350 (730)<br>to<br>1,425 (775)         | 1 hr/in. (25 mm),<br>15 min minimum     | 2 hr plus 15 min<br>for each additional inch<br>(25 mm) over 2 in.<br>(50 mm) |

## GENERAL NOTES:

- (a) In lieu of the cooling rate described in para. 132.5, P-No. 7 material cooling rate shall be not greater than 100°F (55°C) per hr in the range above 1,200°F (650°C), after which the cooling rate shall be sufficiently rapid to prevent embrittlement.
- (b) PWHT is not mandatory for P-No. 7 Type 405 material, provided all of the following conditions are met:
- (1) the specified carbon content is not more than 0.08%
  - (2) the nominal material thickness is  $\frac{3}{8}$  in. (10 mm) or less
  - (3) the weld is made with A-No. 8, A-No. 9, or F-No. 43 filler metal

| P-Number<br>From Mandatory<br>Appendix A | Holding<br>Temperature<br>Range, °F (°C) | Holding Time Based on Nominal Thickness |                       |
|------------------------------------------|------------------------------------------|-----------------------------------------|-----------------------|
|                                          |                                          | Up to 2 in.<br>(50 mm)                  | Over 2 in.<br>(50 mm) |
| P-No. 8<br>Gr. Nos. 1, 2, 3, 4           | None                                     | None                                    | None                  |

GENERAL NOTE: PWHT is neither required nor prohibited for joints between P-No. 8 austenitic stainless steels.

| P-Number<br>From Mandatory<br>Appendix A | Holding<br>Temperature<br>Range, °F (°C) | Holding Time Based on Nominal Thickness |                                                                               |
|------------------------------------------|------------------------------------------|-----------------------------------------|-------------------------------------------------------------------------------|
|                                          |                                          | Up to 2 in.<br>(50 mm)                  | Over 2 in.<br>(50 mm)                                                         |
| P-No. 9A<br>Gr. No. 1                    | 1,100 (600)<br>to<br>1,200 (650)         | 1 hr/in. (25 mm),<br>15 min minimum     | 2 hr plus 15 min<br>for each additional inch<br>(25 mm) over 2 in.<br>(50 mm) |

## GENERAL NOTES:

- (a) PWHT is not mandatory for P-No. 9A material when welds on pipe or attachment welds to pipe comply with all of the following conditions:
- (1) a nominal material thickness of  $\frac{1}{2}$  in. (13.0 mm) or less
  - (2) a specified carbon content of the material to be welded of 0.15% or less
  - (3) a minimum preheat of 250°F (120°C) is maintained during welding
- (b) When it is impractical to PWHT at the temperature range specified in Table 132, it is permissible to perform the PWHT of this material at lower temperatures for longer periods of time in accordance with Table 132.1, but the minimum PWHT shall not be less than 1,000°F (550°C).

| P-Number<br>From Mandatory<br>Appendix A | Holding<br>Temperature<br>Range, °F (°C) | Holding Time Based on Nominal Thickness |                                                                               |
|------------------------------------------|------------------------------------------|-----------------------------------------|-------------------------------------------------------------------------------|
|                                          |                                          | Up to 2 in.<br>(50 mm)                  | Over 2 in.<br>(50 mm)                                                         |
| P-No. 9B<br>Gr. No. 1                    | 1,100 (600)<br>to<br>1,175 (630)         | 1 hr/in. (25 mm),<br>15 min minimum     | 2 hr plus 15 min<br>for each additional inch<br>(25 mm) over 2 in.<br>(50 mm) |

## GENERAL NOTES:

- (a) PWHT of P-No. 9B material is not mandatory for a nominal material thickness of  $\frac{5}{8}$  in. (16.0 mm) or less provided the Welding Procedure Qualification has been made using material of thickness equal to or greater than the production weld.
- (b) When it is impractical to PWHT at the temperature range specified in Table 132, it is permissible to perform the PWHT of this material at lower temperatures for longer periods of time in accordance with Table 132.1, but the minimum PWHT temperature shall not be less than 1,000°F (550°C).

**Table 132 Postweld Heat Treatment (Cont'd)**

| P-Number<br>From Mandatory<br>Appendix A | Holding<br>Temperature<br>Range, °F (°C) | Holding Time Based on Nominal Thickness |                       |
|------------------------------------------|------------------------------------------|-----------------------------------------|-----------------------|
|                                          |                                          | Up to 2 in.<br>(50 mm)                  | Over 2 in.<br>(50 mm) |
| P-No. 10H<br>Gr. No. 1                   | ...                                      | ...                                     | ...                   |

GENERAL NOTE: Postweld heat treatment is neither required nor prohibited. If any heat treatment is performed after forming or welding, it shall be performed within the temperature range listed below for the particular alloy, followed by a rapid cool:

|              |                 |
|--------------|-----------------|
| Alloy S31803 | 1,870°F–2,010°F |
| Alloy S32550 | 1,900°F–2,050°F |
| Alloy S32750 | 1,880°F–2,060°F |
| All others   | 1,800°F–1,900°F |

| P-Number<br>From Mandatory<br>Appendix A | Holding<br>Temperature<br>Range, °F (°C) | Holding Time Based on Nominal Thickness |                       |
|------------------------------------------|------------------------------------------|-----------------------------------------|-----------------------|
|                                          |                                          | Up to 2 in.<br>(50 mm)                  | Over 2 in.<br>(50 mm) |
| P-No. 10I<br>Gr. No. 1                   | 1,350 (730)<br>to<br>1,500 (815)         | 1 hr/in. (25 mm),<br>15 min minimum     | 1 hr/in. (25 mm)      |

## GENERAL NOTES:

- (a) In lieu of the cooling rate described in para. 132.5, the P-No. 10I material cooling rate shall be not greater than 100°F (55°C) per hr in the range above 1,200°F (650°C), after which the cooling rate shall be sufficiently rapid to prevent embrittlement.
- (b) Postweld heat treatment is neither required nor prohibited for a nominal thickness of  $\frac{1}{2}$  in. (13 mm) or less.

**Table 132 Postweld Heat Treatment (Cont'd)**

| P-Number<br>From Mandatory<br>Appendix A | Holding<br>Temperature<br>Range, °F (°C) | Holding Time Based on Nominal Thickness |                                                                                |
|------------------------------------------|------------------------------------------|-----------------------------------------|--------------------------------------------------------------------------------|
|                                          |                                          | Up to 5 in.<br>(125 mm)                 | Over 5 in.<br>(125 mm)                                                         |
| P-No. 15E<br>Gr. No. 1                   | 1,350 (730)<br>to<br>1,425 (775)         | 1 hr/in. (25 mm),<br>30 min minimum     | 5 hr plus 15 min for each<br>additional inch<br>(25 mm) over 5 in.<br>(125 mm) |

## GENERAL NOTES:

- (a) If the nominal weld thickness is  $\leq \frac{1}{2}$  in. (13 mm), the minimum holding temperature is 1,325°F (720°C).
- (b) For dissimilar metal welds (i.e., welds made between a P-No. 15E and another lower chromium ferritic, austenitic, or nickel-based steel), if filler metal chromium content is less than 3.0% or if the filler metal is nickel-based or austenitic, the minimum holding temperature shall be 1,300°F (700°C).
- (c) The maximum holding temperature above is to be used if the actual chemical composition of the matching filler metal used when making the weld is unknown. If the chemical composition of the matching filler metal is known, the maximum holding temperature can be increased as follows:
- (1) If Ni + Mn < 1.50% but  $\geq 1.0\%$ , the maximum PWHT temperature is 1,450°F (790°C).
  - (2) If Ni + Mn < 1.0%, the maximum PWHT temperature is 1,470°F (800°C).

*Explanatory Note to (c) Above:* The lower transformation temperature for matching filler material is affected by alloy content, primarily the total of Ni + Mn. The maximum holding temperature has been set to avoid heat treatment in the intercritical zone.

- (d) If a portion of the component is heated above the heat treatment temperature allowed above, one of the following actions shall be performed:
- (1) The component in its entirety must be renormalized and tempered.
  - (2) If the maximum holding temperature in the Table or Note (c)(1) above is exceeded but does not exceed 1,470°F (800°C), the weld metal shall be removed and replaced.
  - (3) The portion of the component heated above 1,470°F (800°C) and at least 3 in. (75 mm) on either side of the overheated zone must be removed and be renormalized and tempered or replaced.
  - (4) The allowable stress shall be that for Grade 9 material (i.e., SA-213-T9, SA-335-P9, or equivalent product specification) at the design temperature, provided that the portion of the component heated to a temperature greater than that allowed above is reheat treated within the temperature range specified above.

**Table 132.1 Alternate Postweld Heat Treatment Requirements for Carbon and Low Alloy Steels**

| Decrease in Temperatures<br>Below Minimum Specified<br>Temperature,<br>°F (°C) | Minimum Holding Time at<br>Decreased Temperature,<br>hr [Note (1)] |
|--------------------------------------------------------------------------------|--------------------------------------------------------------------|
| 50 (28)                                                                        | 2                                                                  |
| 100 (56)                                                                       | 4                                                                  |
| 150 (84) [Note (2)]                                                            | 10                                                                 |
| 200 (112) [Note (2)]                                                           | 20                                                                 |

GENERAL NOTE: Postweld heat treatment at lower temperatures for longer periods of time, in accordance with this Table, shall be used only where permitted in Table 132.

## NOTES:

- (1) Times shown apply to thicknesses up to 1 in. (25 mm). Add 15 min/in. (15 min/25 mm) of thickness for thicknesses greater than 1 in. (25 mm).
- (2) A decrease of more than 100°F (56°C) below the minimum specified temperature is allowable only for P-No. 1, Gr. Nos. 1 and 2 materials.

**132.4.2** Thickness of the weld, which is a factor in determining the nominal thickness, is defined as follows:

(A) groove welds (girth and longitudinal) — the thicker of the two abutting ends after weld preparation, including I.D. machining

(B) fillet welds — the throat thickness of the weld

(C) partial penetration welds — the depth of the weld groove

(D) material repair welds — the depth of the cavity to be repaired

(E) branch welds — the weld thickness is the dimension existing in the plane intersecting the longitudinal axes and is calculated as indicated for each detail using

$$t_c = \text{the smaller of } \frac{1}{4} \text{ in. or } 0.7t_{nb}$$

(1) for welds described in Fig. 127.4.8(D):

Detail (a)

$$\text{weld thickness} = t_{nb} + t_c$$

Detail (b)

$$\text{weld thickness} = t_{nh} + t_c$$

Detail (c)

$$\text{weld thickness} = \text{greater of } t_{nr} + t_c \text{ or } t_{nb} + t_c$$

Detail (d)

$$\text{weld thickness} = t_{nh} + t_{nr} + t_c$$

Detail (e)

$$\text{weld thickness} = t_{nb} + t_c$$

(2) for welds described in Fig. 127.4.8(E):

$$\text{weld thickness} = t_{nb} + t_c$$

(3) for welds described in Fig. 127.4.8(F) and Fig. 127.4.8(G):

$$\begin{aligned} \text{weld thickness} &= \text{depth of groove weld} \\ &+ \text{throat thickness of cover fillet} \end{aligned}$$

**132.4.3** The term *nominal material thickness* as used in Table 132 is the thicker of the materials being joined at the weld.

### 132.5 PWHT Heating and Cooling Requirements

Above 600°F (315°C), the rate of heating and cooling shall not exceed 600°F/hr (315°C/h) divided by one-half the maximum thickness of material in inches at the weld, but in no case shall the rate exceed 600°F/hr (315°C/h). (See Table 132 for cooling rate requirements for P-Nos. 7 and 10I materials.)

### 132.6 Furnace Heating

(A) Heating an assembly in a furnace should be used when practical; however, the size or shape of the unit or the adverse effect of a desired heat treatment on one or more components where dissimilar materials are involved, may dictate alternative procedures such as heating a section before assembly, or by applying local heating in accordance with para. 132.7.

(B) An assembly may be postweld heat treated in more than one heat in a furnace provided there is at least a 1 ft (300 mm) overlap of the heated sections and the portion of the assembly outside the furnace is shielded so that the temperature gradient is not harmful.

(C) Direct impingement of flame on the assembly is prohibited.

### 132.7 Local Heating

Welds may be locally PWHT by heating a circumferential band around the entire component with the weld located in the center of the band. The width of the band heated to the PWHT temperature for girth welds shall be at least three times the wall thickness at the weld of the thickest part being joined. For nozzle and attachment welds, the width of the band heated to the PWHT temperature shall extend beyond the nozzle weld or attachment weld on each side at least two times the header thickness and shall extend completely around the header. Guidance for the placement of thermocouples on circumferential butt welds is provided in AWS D10.10, Sections 5, 6, and 8. Special consideration shall be given to the placement of thermocouples when heating welds adjacent to large heat sinks such as valves or flanges, or when joining parts of differing thicknesses, to ensure that no part of the materials subjected to the heat source exceeds the lower critical temperature of the material. Particular care must be exercised when the applicable PWHT temperature is close to the material's lower critical temperature, such as for creep strength enhanced ferritic steels.

## 133 STAMPING


Stamping, if used, shall be performed by a method that will not result in sharp discontinuities. In no case shall stamping infringe on the minimum wall thickness or result in dimpling or denting of the material being stamped.

**CAUTIONARY NOTE:** Detrimental effects can result from stamping of material that will be in operation under long-term creep or creep fatigue conditions.

## 135 ASSEMBLY

### 135.1 General

The assembly of the various piping components, whether done in a shop or as field erection, shall be

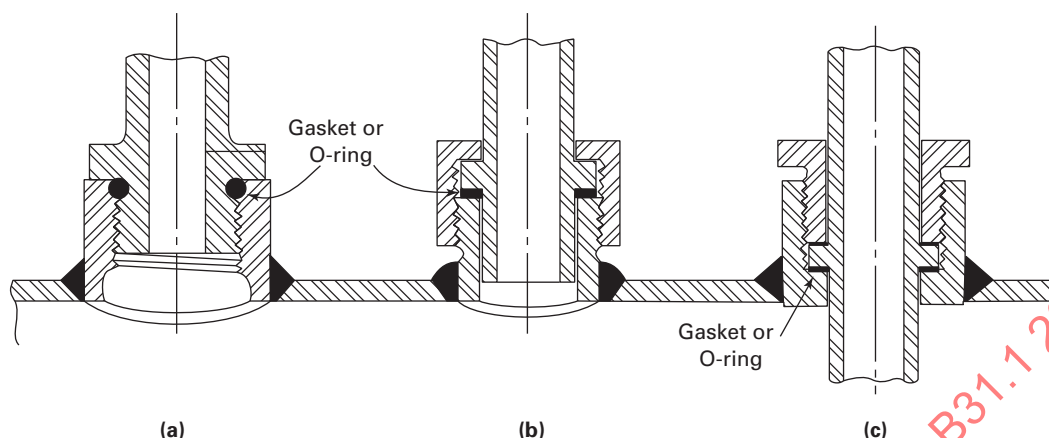**Fig. 135.5.3 Typical Threaded Joints Using Straight Threads**

GENERAL NOTE: Threads are ASME B1.1 straight threads.

done so that the completely erected piping conforms with the requirements of the engineering design.

### 135.2 Alignment

**135.2.1 Equipment Connections.** When making connections to equipment, such as pumps or turbines or other piping components that are sensitive to externally induced loading, forcing the piping into alignment is prohibited if this action introduces end reactions that exceed those permitted by design.

**135.2.2 Cold Springs.** Before assembling joints in piping to be cold sprung, an examination shall be made of guides, supports, and anchors for obstructions that might interfere with the desired movement or result in undesired movement. The gap or overlap of piping prior to assembly shall be checked against the design specifications and corrected if necessary.

### 135.3 Bolted Flanged Connections

**135.3.1 Fit Up.** All flanged joints shall be fitted up so that the gasket contact surfaces bear uniformly on the gasket and then shall be made up with relatively uniform bolt stress.

**135.3.2 Gasket Compression.** When bolting gasketed flange joints, the gasket shall be properly compressed in accordance with the design principles applicable to the type of gasket being used.

**135.3.3 Cast Iron to Steel Joints.** Cast iron to steel flanged joints in accordance with para 108.3 shall be assembled with care to prevent damage to the cast iron flange.

**135.3.4 Bolt Engagement.** All bolts shall be engaged so that there is visible evidence of complete threading through the nut or threaded attachment.

**135.3.5 Nonmetallic Lined Joints.** When assembling nonmetallic lined joints, such as plastic lined steel pipe,

consideration should be given to maintaining electrical continuity between flanged pipe sections where required.

### 135.4 Packed Joints and Caulked Joints

Care shall be used to ensure adequate engagement of joint members. Where packed joints are used to absorb thermal expansion, proper clearance shall be provided at the bottom of the sockets to permit movement.

### 135.5 Threaded Piping

**135.5.1 Thread Compound.** Any compound or lubricant used in threaded joints shall be suitable for the service conditions, and shall be compatible with the piping material and the service fluid.

**135.5.2 Joints for Seal Welding.** Threaded joints that are intended to be seal welded in accordance with para. 127.4.5 *should* be made up without any thread compound.

**135.5.3 Joints Using Straight Threads.** Some joints using straight threads, with sealing at a surface other than threads, are shown in Fig. 135.5.3. Care shall be used to avoid distorting the seal when incorporating such joints into piping assemblies by welding or brazing.

**135.5.4 Backing Off.** Backing off threaded joints to allow for alignment is prohibited.

### 135.6 Tubing Joints

**135.6.1 Flared.** The sealing surface shall be free of injurious defects before installation.

**135.6.2 Flareless and Compression.** Flareless and compression joints shall be assembled in accordance with manufacturer's recommendations.

### 135.7 Ductile Iron Bell End Piping

Assembly of ductile iron pipe, using ANSI/AWWA C111/A21.11 mechanical or push-on joints, shall comply with AWWA C600.

## Chapter VI

# Inspection, Examination, and Testing

### 136 INSPECTION AND EXAMINATION

#### 136.1 Inspection

- (12) **136.1.1 General.** Inspection is the responsibility of the owner and may be performed by employees of the owner or a party authorized by the owner, except for the inspections required by para. 136.2.

- (12) **136.1.2 Verification of Compliance.** Prior to initial operation, a piping installation shall be inspected to ensure that the piping has been constructed in accordance with the design, material, fabrication, assembly, examination, and testing requirements of this Code.

(A) For boiler external piping (BEP), the Authorized Inspector shall verify, in accordance with PG-90 of Section I of the Boiler and Pressure Vessel Code, compliance with the requirements of this Code when a Code stamp for BEP is to be applied. The quality control system requirements of Nonmandatory Appendix A, A-301 and A-302, of Section I of the ASME Boiler and Pressure Vessel Code and Mandatory Appendix J of this Code shall apply.

(B) For nonboiler external piping (NBEP), the owner shall ensure that the design and construction documents and the requirements of this Code have been complied with in accordance with the owner's requirements.

**136.1.3 Rights of Inspectors.** Inspectors shall have access to any place where work concerned with the piping is being performed. This includes manufacture, fabrication, heat treatment, assembly, erection, examination, and testing of the piping. They shall have the right to audit any examination, to inspect the piping using any appropriate examination method required by the engineering design or this Code, and to review all certifications and records necessary to satisfy the owner's responsibility as stated in para. 136.1.1.

#### 136.1.4 Qualifications of the Owner's Inspector

(A) The owner's Inspector shall be designated by the owner and shall be an employee of the owner, an employee of an engineering or scientific organization, or of a recognized insurance or inspection company acting as the owner's agent. The owner's Inspector shall not represent nor be an employee of the piping manufacturer, fabricator, or erector unless the owner is also the manufacturer, fabricator, or erector.

(B) The owner's Inspector shall have not less than 10 years of experience in the design, manufacture, erection, fabrication, or inspection of power piping. Each

year of satisfactorily completed work toward an engineering degree recognized by the Accreditation Board for Engineering and Technology shall be considered equivalent to 1 year of experience, up to 5 years total.

(C) In delegating the performance of inspections, the owner is responsible for determining that a person to whom an inspection function is delegated is qualified to perform that function.

#### 136.2 Inspection and Qualification of Authorized Inspector for Boiler External Piping

**136.2.1** Piping for which inspection and stamping is required as determined in accordance with para. 100.1.2(A) shall be inspected during construction and after completion and at the option of the Authorized Inspector at such stages of the work as he/she may designate. For specific requirements see the applicable parts of Section I of the ASME Boiler and Pressure Vessel Code, PG-104 through PG-113. Each manufacturer, fabricator, or assembler is required to arrange for the services of Authorized Inspectors.

**136.2.1.1** The inspections required by this Section shall be performed by an Inspector employed by an ASME accredited Authorized Inspection Agency.

**136.2.2** Certification by stamping and Data Reports, where required, shall be as per PG-104, PG-105, PG-109, PG-110, PG-111, and PG-112 of Section I of the ASME Boiler and Pressure Vessel Code.

#### 136.3 Examination

**136.3.1 General.** Examination denotes the functions performed by the manufacturer, fabricator, erector, or a party authorized by the owner that include nondestructive examinations (NDE), such as visual, radiography, ultrasonic, eddy current, liquid penetrant, and magnetic particle methods. The degree of examination and the acceptance standards beyond the requirements of this Code shall be a matter of prior agreement between the manufacturer, fabricator, or erector and the owner.

**136.3.2 Qualification of NDE Personnel.** Personnel who perform nondestructive examination of welds shall be qualified and certified for each examination method in accordance with a program established by the employer of the personnel being certified, which shall be based on the following minimum requirements:

(A) instruction in the fundamentals of the nondestructive examination method.

(B) on-the-job training to familiarize the NDE personnel with the appearance and interpretation of indications of weld defects. The length of time for such training shall be sufficient to ensure adequate assimilation of the knowledge required.

(C) an eye examination performed at least once each year to determine optical capability of NDE personnel to perform the required examinations.

(D) upon completion of (A) and (B) above, the NDE personnel shall be given an oral or written examination and performance examination by the employer to determine if the NDE personnel are qualified to perform the required examinations and interpretation of results.

(E) certified NDE personnel whose work has not included performance of a specific examination method for a period of 1 yr or more shall be recertified by successfully completing the examination of (D) above and also passing the visual examination of (C) above. Substantial changes in procedures or equipment shall require recertification of the NDE personnel.

As an alternative to the preceding program, the requirements of the ASME Boiler and Pressure Vessel Code, Section V, Article 1 may be used for the qualification of NDE personnel. Personnel qualified to AWS QC1 may be used for the visual examination of welds.

### 136.4 Examination Methods of Welds

**136.4.1 Nondestructive Examination.** Nondestructive examinations shall be performed in accordance with the requirements of this Chapter. The types and extent of mandatory examinations for pressure welds and welds to pressure retaining components are specified in Table 136.4. For welds other than those covered by Table 136.4, only visual examination is required. Welds requiring nondestructive examination shall comply with the applicable acceptance standards for indications as specified in paras. 136.4.2 through 136.4.6. As a guide, the detection capabilities for the examination method are shown in Table 136.4.1. Welds not requiring examination (i.e., RT, UT, MT, or PT) by this Code or the engineering design shall be judged acceptable if they meet the examination requirements of para. 136.4.2 and the pressure test requirements specified in para. 137. NDE for P-Nos. 3, 4, 5A, 5B, and 15E material welds shall be performed after postweld heat treatment unless directed otherwise by engineering design. Required NDE for welds in all other materials may be performed before or after postweld heat treatment.

(12) **136.4.2 Visual Examination.** Visual examination as defined in para. 100.2 shall be performed in accordance with the methods described in Section V, Article 9, of the ASME Boiler and Pressure Vessel Code. Visual examinations may be conducted, as necessary, during the fabrication and erection of piping components to provide verification that the design and WPS requirements are being met. In addition, visual examination shall be

performed to verify that all completed welds in pipe and piping components comply with the acceptance standards specified in (A) below or with the limitations on imperfections specified in the material specification under which the pipe or component was furnished.

(A) *Acceptance Standards.* The following indications are unacceptable:

(A.1) cracks — external surface.

(A.2) undercut on the surface that is greater than  $\frac{1}{32}$  in. (1.0 mm) deep, or encroaches on the minimum required section thickness.

(A.3) weld reinforcement greater than specified in Table 127.4.2.

(A.4) lack of fusion on surface.

(A.5) incomplete penetration (applies only when inside surface is readily accessible).

(A.6) any other linear indications greater than  $\frac{3}{16}$  in. (5.0 mm) long.

(A.7) surface porosity with rounded indications having dimensions greater than  $\frac{3}{16}$  in. (5.0 mm) or four or more rounded indications separated by  $\frac{1}{16}$  in. (2.0 mm) or less edge to edge in any direction. Rounded indications are indications that are circular or elliptical with their length less than three times their width.

**136.4.3 Magnetic Particle Examination.** Whenever required by this Chapter (see Table 136.4), magnetic particle examination shall be performed in accordance with the methods of Article 7, Section V, of the ASME Boiler and Pressure Vessel Code.

(A) *Evaluation of Indications*

(A.1) Mechanical discontinuities at the surface will be indicated by the retention of the examination medium. All indications are not necessarily defects; however, certain metallurgical discontinuities and magnetic permeability variations may produce similar indications that are not relevant to the detection of unacceptable discontinuities.

(A.2) Any indication that is believed to be nonrelevant shall be reexamined to verify whether or not actual defects are present. Surface conditioning may precede the reexamination. Nonrelevant indications that would mask indications of defects are unacceptable.

(A.3) Relevant indications are those that result from unacceptable mechanical discontinuities. Linear indications are those indications in which the length is more than three times the width. Rounded indications are indications that are circular or elliptical with the length less than three times the width.

(A.4) An indication of a discontinuity may be larger than the discontinuity that causes it; however, the size of the indication and not the size of the discontinuity is the basis of acceptance or rejection.

(B) *Acceptance Standards.* Indications whose major dimensions are greater than  $\frac{1}{16}$  in. (2.0 mm) shall be considered relevant. The following relevant indications are unacceptable:

**Table 136.4 Mandatory Minimum Nondestructive Examinations for Pressure Welds or Welds to Pressure-Retaining Components**

| Piping Design Conditions and Nondestructive Examination                       |                                                                  |                                                                                                                                                                                                                                 |                                      |
|-------------------------------------------------------------------------------|------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------|
| Type Weld                                                                     | Temperatures Over 750°F (400°C) and at All Pressures             | Temperatures Between 350°F (175°C) and 750°F (400°C) Inclusive, With All Pressures Over 1,025 psig [7 100 kPa (gage)]                                                                                                           | All Others                           |
|                                                                               |                                                                  |                                                                                                                                                                                                                                 |                                      |
| Butt welds (girth and longitudinal) [Note (1)]                                | RT or UT for over NPS 2. MT or PT for NPS 2 and less [Note (2)]. | RT or UT for over NPS 2 with thickness over 3/4 in. (19.0 mm). VT for all sizes with thickness 3/4 in. (19.0 mm) or less.                                                                                                       | Visual for all sizes and thicknesses |
| Welded branch connections (size indicated is branch size) [Notes (3) and (4)] | RT or UT for over NPS 4. MT or PT for NPS 4 and less [Note (2)]. | RT or UT for branch over NPS 4 and thickness of branch over 3/4 in. (19.0 mm) MT or PT for branch NPS 4 and less with thickness of branch over 3/4 in. (19 mm) VT for all sizes with branch thickness 3/4 in. (19.0 mm) or less | VT for all sizes and thicknesses     |
| Fillet, socket, attachment, and seal welds                                    | PT or MT for all sizes and thicknesses [Note (5)]                | VT for all sizes and thicknesses                                                                                                                                                                                                | VT for all sizes and thicknesses     |

**GENERAL NOTES:**

- All welds shall be given a visual examination in addition to the type of specific nondestructive examination specified.
- NPS — nominal pipe size.
- RT — radiographic examination; UT — ultrasonic examination; MT — magnetic particle examination; PT — liquid penetrant examination; VT — visual examination.
- For nondestructive examinations of the pressure retaining component, refer to the standards listed in Table 126.1 or manufacturing specifications.
- Acceptance standards for nondestructive examinations performed are as follows: MT — see para. 136.4.3; PT — see para. 136.4.4; VT — see para. 136.4.2; RT — see para. 136.4.5; UT — see para. 136.4.6.
- All longitudinal welds and spiral welds in pipe intended for sustained operation in the creep range (see paras. 104.1.1 and 123.4, and Table 102.4.7) must receive and pass a 100% volumetric examination (RT or UT) per the applicable material specification or in accordance with para. 136.4.5 or 136.4.6.

**NOTES:**

- The thickness of butt welds is defined as the thicker of the two abutting ends after end preparation.
- RT may be used as an alternative to PT or MT when it is performed in accordance with para. 136.4.5.
- RT or UT of branch welds shall be performed before any nonintegral reinforcing material is applied.
- In lieu of volumetric examination (RT, UT) of welded branch connections when required above, surface examination (PT, MT) is acceptable and, when used, shall be performed at the lesser of one-half of the weld thickness or each  $\frac{1}{2}$  in. (12.5 mm) of weld thickness and all accessible final weld surfaces.
- Fillet welds not exceeding  $\frac{1}{4}$  in. (6 mm) throat thickness which are used for the permanent attachment of nonpressure retaining parts are exempt from the PT or MT requirements of the above Table.

**Table 136.4.1 Weld Imperfections Indicated by Various Types of Examination**

| Imperfection                   | Visual             | Magnetic Particle  | Liquid Penetrant   | Radiography | Ultrasonic |
|--------------------------------|--------------------|--------------------|--------------------|-------------|------------|
| Crack — surface                | X [Note (1)]       | X [Note (1)]       | X [Note (1)]       | X           | X          |
| Crack — internal               | ...                | ...                | ...                | X           | X          |
| Undercut — surface             | X [Note (1)]       | X [Note (1)]       | X [Note (1)]       | X           | ...        |
| Weld reinforcement             | X [Note (1)]       | ...                | ...                | X           | ...        |
| Porosity                       | X [Notes (1), (2)] | X [Notes (1), (2)] | X [Notes (1), (2)] | X           | ...        |
| Slag inclusion                 | X [Note (2)]       | X [Note (2)]       | X [Note (2)]       | X           | X          |
| Lack of fusion<br>(on surface) | X [Notes (1), (2)] | X [Notes (1), (2)] | X [Notes (1), (2)] | X           | X          |
| Incomplete penetration         | X [Note (3)]       | X [Note (3)]       | X [Note (3)]       | X           | X          |

**NOTES:**

- (1) Applies when the outside surface is accessible for examination and/or when the inside surface is readily accessible.  
 (2) Discontinuities are detectable when they are open to the surface.  
 (3) Applies *only* when the inside surface is readily accessible.

(B.1) any cracks or linear indications

(B.2) rounded indications with dimensions greater than  $\frac{3}{16}$  in. (5.0 mm)

(B.3) four or more rounded indications in a line separated by  $\frac{1}{16}$  in. (2.0 mm) or less, edge to edge

(B.4) ten or more rounded indications in any 6 in.<sup>2</sup> (3 870 mm<sup>2</sup>) of surface with the major dimension of this area not to exceed 6 in. (150 mm) with the area taken in the most unfavorable location relative to the indications being evaluated

**136.4.4 Liquid Penetrant Examination.** Whenever required by this Chapter (see Table 136.4), liquid penetrant examination shall be performed in accordance with the methods of Article 6, Section V, of the ASME Boiler and Pressure Vessel Code.

(A) *Evaluation of Indications*

(A.1) Mechanical discontinuities at the surface will be indicated by bleeding out of the penetrant; however, localized surface imperfections, such as may occur from machining marks or surface conditions, may produce similar indications that are nonrelevant to the detection of unacceptable discontinuities.

(A.2) Any indication that is believed to be nonrelevant shall be regarded as a defect and shall be reexamined to verify whether or not actual defects are present. Surface conditioning may precede the reexamination. Nonrelevant indications and broad areas of pigmentation that would mask indications of defects are unacceptable.

(A.3) Relevant indications are those that result from mechanical discontinuities. Linear indications are those indications in which the length is more than three times the width. Rounded indications are indications that are circular or elliptical with the length less than three times the width.

(A.4) An indication of a discontinuity may be larger than the discontinuity that causes it; however, the size

of the indication and not the size of the discontinuity is the basis of acceptance or rejection.

(B) *Acceptance Standards.* Indications whose major dimensions are greater than  $\frac{1}{16}$  in. (2.0 mm) shall be considered relevant. The following relevant indications are unacceptable:

(B.1) any cracks or linear indications

(B.2) rounded indications with dimensions greater than  $\frac{3}{16}$  in. (5.0 mm)

(B.3) four or more rounded indications in a line separated by  $\frac{1}{16}$  in. (2.0 mm) or less edge to edge

(B.4) ten or more rounded indications in any 6 in.<sup>2</sup> (3 870 mm<sup>2</sup>) of surface with the major dimension of this area not to exceed 6 in. (150 mm) with the area taken in the most unfavorable location relative to the indications being evaluated

**136.4.5 Radiography.** When required by this Chapter (see Table 136.4), radiographic examination shall be performed in accordance with Article 2 of Section V of the ASME Boiler and Pressure Vessel Code, except that the requirements of T-274 are to be used as a guide but not for the rejection of radiographs unless the geometrical unsharpness exceeds 0.07 in. (2.0 mm).

(A) *Acceptance Standards.* Welds that are shown by radiography to have any of the following types of discontinuities are unacceptable:

(A.1) any type of crack or zone of incomplete fusion or penetration

(A.2) any other elongated indication that has a length greater than

(A.2.1)  $\frac{1}{4}$  in. (6.0 mm) for  $t$  up to  $\frac{3}{4}$  in. (19.0 mm), inclusive

(A.2.2)  $\frac{1}{3}t$  for  $t$  from  $\frac{3}{4}$  in. (19.0 mm) to  $2\frac{1}{4}$  in. (57.0 mm), incl.

(A.2.3)  $\frac{3}{4}$  in. (19.0 mm) for  $t$  over  $2\frac{1}{4}$  in. (57.0 mm) where  $t$  is the thickness of the thinner portion of the weld

NOTE:  $t$  referred to in (A.2.1), (A.2.2), and (A.2.3) above pertains to the thickness of the weld being examined; if a weld joins two members having different thickness at the weld,  $t$  is the thinner of these two thickness.

(A.3) any group of indications in line that have an aggregate length greater than  $t$  in a length of  $12t$ , except where the distance between the successive indications exceeds  $6L$  where  $L$  is the longest indication in the group

(A.4) porosity in excess of that shown as acceptable in Nonmandatory Appendix A, A-250 of Section I of the ASME Boiler and Pressure Vessel Code

(A.5) root concavity when there is an abrupt change in density, as indicated on the radiograph

**136.4.6 Ultrasonic Examination.** When required by this Chapter (see Table 136.4), ultrasonic examination (UT) shall be performed in accordance with Article 4 of Section V of the ASME Boiler and Pressure Vessel Code and the following additional requirements.

(A) The following criteria shall also be met when performing ultrasonic examinations:

(A.1) The equipment used to perform the examination shall be capable of recording the UT data to facilitate the analysis by a third party and for the repeatability of subsequent examinations, should they be required. Where physical obstructions prevent the use of systems capable of recording the UT data, manual UT may be used with the approval of the owner.

(A.2) NDE personnel performing and evaluating UT examinations shall be qualified and certified in accordance with their employer's written practice and the requirements of para. 136.3.2 of this Code. Personnel, procedures, and equipment used to collect and analyze UT data shall have demonstrated their ability to perform an acceptable examination using test blocks approved by the owner.

(B) *Acceptance Standards.* Welds that are shown by ultrasonic examination to have discontinuities that produce an indication greater than 20% of the reference level shall be investigated to the extent that ultrasonic examination personnel can determine their shape, identity, and location so that they may evaluate each discontinuity for acceptance in accordance with (B.1) and (B.2) below.

(B.1) Discontinuities evaluated as being cracks, lack of fusion, or incomplete penetration are unacceptable regardless of length.

(B.2) Other discontinuities are unacceptable if the indication exceeds the reference level and their length exceeds the following:

(B.2.1)  $\frac{1}{4}$  in. (6.0 mm) for  $t$  up to  $\frac{3}{4}$  in. (19.0 mm).

(B.2.2)  $\frac{1}{3}t$  for  $t$  from  $\frac{3}{4}$  in. (19.0 mm) to  $2\frac{1}{4}$  in. (57.0 mm).

(B.2.3)  $\frac{3}{4}$  in. (19.0 mm) for  $t$  over  $2\frac{1}{4}$  in. (57.0 mm) where  $t$  is the thickness of the weld being examined. If the weld joins two members having different thicknesses at the weld,  $t$  is the thinner of these two thicknesses.

## 137 PRESSURE TESTS

### 137.1 General Requirements

**137.1.1 Subassemblies.** When conducted in accordance with the requirements of this Code, the pressure testing of piping systems to ensure leak tightness shall be acceptable for the determination of any leaks in piping subassemblies.

**137.1.2 Temperature of Test Medium.** The temperature of the test medium shall be that of the available source unless otherwise specified by the owner. The test pressure shall not be applied until the system and the pressurizing medium are approximately at the same temperature. When conducting pressure tests at low metal temperatures, the possibility of brittle fracture shall be considered.

**137.1.3 Personnel Protection.** Suitable precautions in the event of piping system rupture shall be taken to eliminate hazards to personnel in the proximity of lines being tested.

**137.1.4 Maximum Stress During Test.** At no time during the pressure test shall any part of the piping system be subjected to a stress greater than that permitted by para. 102.3.3(B).

**137.1.5 Testing Schedule.** Pressure testing shall be performed following the completion of postweld heat treatment, required by para. 132, nondestructive examinations required by Table 136.4, and all other fabrication, assembly and erection activities required to provide the system or portions thereof subjected to the pressure test with pressure retaining capability.

### 137.2 Preparation for Testing

**137.2.1 Exposure of Joints.** All joints including welds not previously pressure tested shall be left uninsulated and exposed for examination during the test. By prior agreement the complete system or portions thereof subject to test may be insulated prior to the test period provided an extended holding time pressurization of the system is performed to check for possible leakage through the insulation barrier.

**137.2.2 Addition of Temporary Supports.** Piping systems designed for vapor or gas shall be provided with additional temporary supports if necessary to support the weight of the test liquid. Such supports shall meet the requirements for testing and system cleanup procedures described in para. 122.10.

**137.2.3 Restraint or Isolation of Expansion Joints.** Expansion joints shall be provided with temporary restraint if required for the additional pressure load under test, or they shall be isolated during the system test.

**137.2.4 Isolation of Equipment and Piping Not Subjected to Pressure Test.** Equipment that is not to be subjected to the pressure test shall be either disconnected from the system or isolated by a blank or similar means. Valves may be used for this purpose provided that valve closure is suitable for the proposed test pressure. Owner shall be aware of the limitations of pressure and temperature for each valve subject to test conditions and as further described in para. 107.1(C). Isolated equipment and piping must be vented.

**137.2.5 Treatment of Flanged Joints Containing Blanks.** Flanged joints at which blanks are inserted to blank off other equipment during the test need not be tested after removal of the blank provided the requirements of para. 137.7.1 are subsequently performed.

**137.2.6 Precautions Against Test Medium Expansion.** If a pressure test is to be maintained for a period of time during which the test medium in the system is subject to thermal expansion, precautions shall be taken to avoid excessive pressure. A pressure relief device set at  $1\frac{1}{3}$  times the test pressure is recommended during the pressure test, provided the requirements of paras. 137.1.4, 137.4.5, and 137.5.5 are not exceeded.

### 137.3 Requirements for Specific Piping Systems

**137.3.1 Boiler External Piping.** Boiler external piping [see para. 100.1.2(A)] shall be hydrostatically tested in accordance with PG-99 of Section I of the ASME Boiler and Pressure Vessel Code. The test shall be conducted in the presence of the Authorized Inspector.

**137.3.2 Nonboiler External Piping.** All nonboiler external piping shall be hydrostatically tested in accordance with para. 137.4. As an alternative, when specified by the owner, the piping may be leak tested in accordance with para. 137.5, 137.6, or 137.7. Lines open to the atmosphere, such as vents or drains downstream of the last shutoff valve, need not be tested.

### 137.4 Hydrostatic Testing

**137.4.1 Material.** When permitted by the Material Specification, a system hydrostatic test may be performed in lieu of the hydrostatic test required by the material specifications for material used in the piping subassembly or system provided the minimum test pressure required for the piping system is met.

**137.4.2 Provision of Air Vents at High Points.** Vents shall be provided at all high points of the piping system in the position in which the test is to be conducted to purge air pockets while the component or system is filling. Venting during the filling of the system may be provided by the loosening of flanges having a minimum of four bolts or by the use of equipment vents.

**137.4.3 Test Medium.** Water shall normally be used as the test medium unless otherwise specified by the

owner. Test water shall be clean and shall be of such quality as to minimize corrosion of the materials in the piping system. Further recommended precautions on the quality of test water used for hydrotesting of austenitic (300 series) and ferritic (400 series) stainless steels are contained in Nonmandatory Appendix IV, para. IV-3.4.

**137.4.4 Check of Test Equipment Before Applying Pressure.** The test equipment shall be examined before pressure is applied to ensure that it is tightly connected. All low-pressure filling lines and all other items not subject to the test pressure shall be disconnected or isolated by valves or other suitable means.

**137.4.5 Required Hydrostatic Test Pressure.** The hydrostatic test pressure at any point in the piping system shall not be less than 1.5 times the design pressure, but shall not exceed the maximum allowable test pressure of any nonisolated components, such as vessels, pumps, or valves, nor shall it exceed the limits imposed by para. 102.3.3(B). The pressure shall be continuously maintained for a minimum time of 10 min and may then be reduced to the design pressure and held for such time as may be necessary to conduct the examinations for leakage. Examinations for leakage shall be made of all joints and connections. The piping system, exclusive of possible localized instances at pump or valve packing, shall show no visual evidence of weeping or leaking.

### 137.5 Pneumatic Testing

**137.5.1 General.** Except for preliminary testing in accordance with para. 137.5.4, pneumatic testing shall not be used unless the owner specifies pneumatic testing or permits its use as an alternative. It is recommended that pneumatic testing be used only when one of the following conditions exists:

(A) when piping systems are so designed that they cannot be filled with water

(B) when piping systems are to be used in services where traces of the testing medium cannot be tolerated

**137.5.2 Test Medium.** The gas used as the test medium shall be nonflammable and nontoxic. Since compressed gas may be hazardous when used as a testing medium, it is recommended that special precautions for protection of personnel be observed when a gas under pressure is used as the test medium.

**137.5.3 Check of Test Equipment Before Applying Pressure.** The test equipment shall be examined before pressure is applied to ensure that it is tightly connected. All items not subjected to the test pressure shall be disconnected or isolated by valves or other suitable means.

**137.5.4 Preliminary Test.** A preliminary pneumatic test not to exceed 25 psig [175 kPa (gage)] may be applied, prior to other methods of leak testing, as a means of locating major leaks. If used, the preliminary

pneumatic test shall be performed in accordance with the requirements of paras. 137.5.2 and 137.5.3.

**137.5.5 Required Pneumatic Test Pressure.** The pneumatic test pressure shall be not less than 1.2 nor more than 1.5 times the design pressure of the piping system. The test pressure shall not exceed the maximum allowable test pressure of any nonisolated component, such as vessels, pumps, or valves, in the system. The pressure in the system shall gradually be increased to not more than one-half of the test pressure, after which the pressure shall be increased in steps of approximately one-tenth of the test pressure until the required test pressure has been reached. The pressure shall be continuously maintained for a minimum time of 10 min. It shall then be reduced to the lesser of design pressure or 100 psig [700 kPa (gage)] and held for such time as may be necessary to conduct the examination for leakage. Examination for leakage detected by soap bubble or equivalent method shall be made of all joints and connections. The piping system, exclusive of possible localized instances at pump or valve packing, shall show no evidence of leaking.

### 137.6 Mass-Spectrometer and Halide Testing

**137.6.1** When specified by the owner, systems with conditions of operation and design that require testing methods having a greater degree of sensitivity than can be obtained by a hydrostatic or pneumatic test shall be tested by a method, such as helium mass-spectrometer test or halide test, which has the required sensitivity.

**137.6.2** When a mass-spectrometer or halide test is performed, it shall be conducted in accordance with the instructions of the manufacturer of the test equipment. In all cases a calibrated reference leak, with a leak rate not greater than the maximum permissible leakage from the system, shall be used. The equipment shall be calibrated against the reference leak in such a way that the system leakage measured by the equipment can be determined to be not greater than the leak rate of the reference leak.

### 137.7 Initial Service Testing

**137.7.1** When specified by the owner, an initial service test and examination is acceptable when other types of tests are not practical or when leak tightness is demonstrable due to the nature of the service. One

example is piping where shut-off valves are not available for isolating a line and where temporary closures are impractical. Others may be systems where during the course of checking out of pumps, compressors, or other equipment, ample opportunity is afforded for examination for leakage prior to full scale operation. An initial service test is not applicable to boiler external piping.

**137.7.2** When performing an initial service test, the piping system shall be gradually brought up to normal operating pressure and continuously held for a minimum time of 10 min. Examination for leakage shall be made of all joints and connections. The piping system exclusive of possible localized instances at pump or valve packing shall show no visual evidence of weeping or leaking.

### 137.8 Retesting After Repair or Additions

**137.8.1** Repairs may be made to the pressure parts of boiler external piping after the hydrostatic test required by para. 137.3.1, provided the requirements of PW-54.2 of Section I of the ASME Boiler and Pressure Vessel Code are met.

**137.8.2** Nonpressure parts may be welded to the pressure parts of boiler external piping after the hydrostatic test required by para. 137.3.1, provided the requirements of PW-54.3 of Section I of the ASME Boiler and Pressure Vessel Code are met.

**137.8.3** If repairs or additions to nonboiler external piping are made following a test, the affected piping shall be retested in accordance with the provisions of para. 137.3.2. However, a system need not be retested after seal welding or after attachments of lugs, brackets, insulation supports, nameplates, or other nonpressure retaining attachments provided

(A) the attachment fillet weld does not exceed  $\frac{3}{8}$  in. (10.0 mm) thickness or, if a full penetration weld is used, the material attached does not exceed the nominal thickness of the pressure retaining member or  $\frac{1}{2}$  in. (12.0 mm), whichever is less

(B) welds shall be preheated as required by para. 131

(C) welds shall be examined as required by Table 136.4

(D) seal welds shall be examined for leakage after system startup

**137.8.4** All weld defect repairs shall be made in accordance with para. 127.4.11.

## Chapter VII

# Operation and Maintenance

### (12) 138 GENERAL

Safety is the overriding concern in design, operation, and maintenance of power piping. Managing safe piping service begins with the initial project concept and continues throughout the service life of the piping system. The Operating Company is responsible for the safe operation and maintenance of its power piping.

The Code does not prescribe a detailed set of operating and maintenance procedures that will encompass all cases. Each Operating Company shall develop operation and maintenance procedures for piping systems deemed necessary to ensure safe facility operations based on the provisions of this Code, relevant industry experience, the Operating Company's experience and knowledge of its facility, and conditions under which the piping systems are operated. The additional requirements described in subsequent paragraphs apply to covered piping systems (CPS).

### 139 OPERATION AND MAINTENANCE PROCEDURES

For CPS, this shall be accomplished by the issuance of written operation and maintenance procedures. The operation and maintenance procedures established by the Operating Company for ensuring safe operation of its CPS may vary, but the following aspects shall be covered:

- (A) operation of piping system within design limits
- (B) documentation of system operating hours and modes of operation
- (C) documentation of actual operating temperatures and pressures
- (D) documentation of significant system transients or excursions including thermal hydraulic events (e.g., steam hammers, liquid slugging)
- (E) documentation of modifications, repairs, and replacements
- (F) documentation of maintenance of pipe supports for piping operating within the creep regime
- (G) documentation of maintenance of piping system elements such as vents, drains, relief valves, desuperheaters, and instrumentation necessary for safe operation
- (H) assessment of degradation mechanisms, including, but not limited to, creep, fatigue, graphitization, corrosion, erosion, and flow accelerated corrosion (FAC)

- (I) quality of flow medium (e.g., dissolved oxygen, pH)
- (J) documentation of the condition assessment (see para. 140)
- (K) other required maintenance

### 140 CONDITION ASSESSMENT OF CPS

A program shall be established to provide for the assessment and documentation of the condition of all CPS. The documentation shall include a statement as to any actions necessary for continued safe operation. A condition assessment shall be performed at periodic intervals as determined by an engineering evaluation.

Condition assessments shall be made of CPS based on established industry practices. The condition assessment may range from a review of previous inspection findings and operating history since the previous inspection, to a thorough nondestructive examination (NDE) and engineering evaluation. The extent of the assessment performed shall be established by the Operating Company or its designee with consideration of the age of the CPS, the previous documented assessment, and anticipated operating conditions.

The condition assessment documentation, in a form established by the Operating Company, should contain (but not be limited to) as many of the following elements as available:

- (A) system name
- (B) listing of original material specifications and their editions
- (C) design diameters and wall thicknesses
- (D) design temperature and pressure
- (E) normal operating temperature and pressure
- (F) operating hours, both cumulative (from initial operation) and since last condition assessment
- (G) actual modes of operation since last condition assessment (such as the number of hot, warm, and cold starts)
- (H) pipe support hot and cold walk-down readings and conditions since last condition assessment for piping systems that are operated within the creep regime
- (I) modifications and repairs since last condition assessment
- (J) description and list of any dynamic events, including thermal hydraulic events, since the last condition assessment

(K) actual pipe wall thickness and outside diameter measurements taken since the last condition assessment as appropriate based on service

(L) summary of pipe system inspection findings, including list of areas of concern

(M) recommendations for reinspection interval and scope

Guidance on condition assessment may be found in Nonmandatory Appendix V of this Code.

#### 141 CPS RECORDS

CPS records shall be maintained and easily accessible for the life of the piping systems and should consist of, but not be limited to

(A) procedures required by para. 139

(B) condition assessment documentation required by para. 140

(C) original, as-built, and as modified or repaired piping drawings

(D) design and modified or repaired pipe support drawings for piping operating within the creep regime

#### (12) 144 CPS WALKDOWNS

The Operating Company shall develop and implement a program requiring documentation of piping support readings and recorded piping system displacements. Guidelines for this program are provided in Nonmandatory Appendix V, para. V-7. Piping system

drawings or sketches, including the identification of all supports, and piping support walkdown forms should be used as part of the hot and cold walkdowns. The condition assessment documentation (on paper or electronic media) shall comply with para. 140(H).

The Operating Company shall evaluate the effects of unexpected piping position changes, significant vibrations, and malfunctioning supports on the piping system's integrity and safety. Significant displacement variations from the expected design displacements shall be considered to assess the piping system's integrity. Subsequent evaluations and corrective actions may necessitate activities such as detailed examinations of critical weldments and support adjustments, repairs, and replacement of individual supports and restraints.

#### 145 MATERIAL DEGRADATION MECHANISMS

(12)

Creep is stress-, time-, temperature-, and material-dependent plastic deformation under load. Stress allowables for materials having time-dependent properties are noted with italics in Mandatory Appendix A. Material stress rupture or creep properties govern the stress allowables within this temperature regime and may be important in the piping system evaluation.

The Operating Company shall develop and implement a program requiring data collection and evaluation of high-priority areas for CPS materials operating in the creep range. Guidelines provided in para. V-12 may be used for this program, which may also include non-CPS piping operating in the creep regime.

INTENTIONALLY LEFT BLANK

ASMENORMDOC.COM : Click to view the full PDF of ASME B31.1 2012

# MANDATORY APPENDICES

---

## MANDATORY APPENDIX A ALLOWABLE STRESS TABLES

Begins on next page.

ASMENORMDOC.COM : Click to view the full PDF of ASME B31.1 2012

Table A-1 Carbon Steel

|      | Spec.<br>No.                             | Grade | Type or Class | Nominal<br>Composition | P-<br>No. | Notes      | Specified<br>Minimum<br>Tensile,<br>ksi | Specified<br>Minimum<br>Yield,<br>ksi | E<br>or<br>F |
|------|------------------------------------------|-------|---------------|------------------------|-----------|------------|-----------------------------------------|---------------------------------------|--------------|
|      | Seamless Pipe and Tube                   |       |               |                        |           |            |                                         |                                       |              |
| (12) | A53                                      | A     | S             | C                      | 1         | (2)        | 48                                      | 30                                    | 1.00         |
|      |                                          | B     | S             | C–Mn                   | 1         | (2)        | 60                                      | 35                                    | 1.00         |
|      | A106                                     | A     | ...           | C–Si                   | 1         | (2)        | 48                                      | 30                                    | 1.00         |
|      |                                          | B     | ...           | C–Si                   | 1         | (2)        | 60                                      | 35                                    | 1.00         |
|      |                                          | C     | ...           | C–Si                   | 1         | (2)        | 70                                      | 40                                    | 1.00         |
|      | A179                                     | ...   | ...           | C                      | 1         | (1)(2)(5)  | (47)                                    | 26                                    | 1.00         |
|      | A192                                     | ...   | ...           | C–Si                   | 1         | (2)(5)     | (47)                                    | 26                                    | 1.00         |
|      | A210                                     | A-1   | ...           | C–Si                   | 1         | (2)        | 60                                      | 37                                    | 1.00         |
|      |                                          | C     | ...           | C–Mn–Si                | 1         | (2)        | 70                                      | 40                                    | 1.00         |
|      | A333                                     | 1     | ...           | C–Mn                   | 1         | (1)        | 55                                      | 30                                    | 1.00         |
|      |                                          | 6     | ...           | C–Mn–Si                | 1         | ...        | 60                                      | 35                                    | 1.00         |
|      | A369                                     | FPA   | ...           | C–Si                   | 1         | (2)        | 48                                      | 30                                    | 1.00         |
|      | FPB                                      | ...   | C–Mn          | 1                      | (2)       | 60         | 35                                      | 1.00                                  |              |
| (12) | API 5L                                   | A     | ...           | C                      | 1         | (1)(2)(14) | 48                                      | 30                                    | 1.00         |
|      |                                          | B     | ...           | C–Mn                   | 1         | (1)(2)(14) | 60                                      | 35                                    | 1.00         |
|      | Furnace Butt Welded Pipe                 |       |               |                        |           |            |                                         |                                       |              |
|      | A53                                      | ...   | F             | C                      | 1         | (4)        | 48                                      | 30                                    | 0.60         |
|      | API 5L                                   | A25   | I & II        | C                      | 1         | (1)(4)(14) | 45                                      | 25                                    | 0.60         |
|      | Electric Resistance Welded Pipe and Tube |       |               |                        |           |            |                                         |                                       |              |
| (12) | A53                                      | A     | E             | C                      | 1         | (2)        | 48                                      | 30                                    | 0.85         |
|      |                                          | B     | E             | C–Mn                   | 1         | (2)        | 60                                      | 35                                    | 0.85         |
|      | A135                                     | A     | ...           | C                      | 1         | (1)(2)     | 48                                      | 30                                    | 0.85         |
|      |                                          | B     | ...           | C–Mn                   | 1         | (1)(2)     | 60                                      | 35                                    | 0.85         |
|      | A178                                     | A     | ...           | C                      | 1         | (2)(5)     | (47)                                    | 26                                    | 0.85         |
|      |                                          | C     | ...           | C                      | 1         | (2)        | 60                                      | 37                                    | 0.85         |
|      | A214                                     | ...   | ...           | C                      | 1         | (1)(2)(5)  | (47)                                    | 26                                    | 0.85         |
|      | A333                                     | 1     | ...           | C–Mn                   | 1         | (1)        | 55                                      | 30                                    | 0.85         |
|      |                                          | 6     | ...           | C–Mn–Si                | 1         | ...        | 60                                      | 35                                    | 0.85         |
|      |                                          |       |               |                        |           |            |                                         |                                       |              |
|      |                                          |       |               |                        |           |            |                                         |                                       |              |
|      |                                          |       |               |                        |           |            |                                         |                                       |              |
|      |                                          |       |               |                        |           |            |                                         |                                       |              |
|      |                                          |       |               |                        |           |            |                                         |                                       |              |
|      |                                          |       |               |                        |           |            |                                         |                                       |              |
|      |                                          |       |               |                        |           |            |                                         |                                       |              |
|      |                                          |       |               |                        |           |            |                                         |                                       |              |

**Table A-1 Carbon Steel**

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |       | Spec.<br>No. |      |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|-------|--------------|------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | Grade |              |      |
| Seamless Pipe and Tube                                                                    |      |      |      |      |      |      |      |      |      |       |              |      |
| 13.7                                                                                      | 13.7 | 13.7 | 13.7 | 13.7 | 13.7 | 13.7 | 12.5 | 10.7 | 9.0  | A     | A53          |      |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 15.6 | 13.0 | 10.8 | B     |              |      |
| 13.7                                                                                      | 13.7 | 13.7 | 13.7 | 13.7 | 13.7 | 13.7 | 12.5 | 10.7 | 9.3  | A     | A106         | (12) |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 15.6 | 13.0 | 10.8 | B     |              |      |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 19.8 | 18.3 | 14.8 | 12.0 | C     |              |      |
| 13.4                                                                                      | 13.4 | 13.4 | 13.4 | 13.4 | 13.3 | 12.8 | 12.4 | 10.7 | 9.2  | ...   | A179         | (12) |
| 13.4                                                                                      | 13.4 | 13.4 | 13.4 | 13.4 | 13.3 | 12.8 | 12.4 | 10.7 | 9.0  | ...   | A192         |      |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 15.6 | 13.0 | 10.8 | A-1   | A210         |      |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 19.8 | 18.3 | 14.8 | 12.0 | C     |              |      |
| 15.7                                                                                      | 15.7 | 15.7 | 15.7 | 15.7 | 15.3 | 14.8 | ...  | ...  | ...  | 1     | A333         | (12) |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 15.6 | ...  | ...  | 6     |              |      |
| 13.7                                                                                      | 13.7 | 13.7 | 13.7 | 13.7 | 13.7 | 13.7 | 12.5 | 10.7 | 9.0  | FPA   | A369         | (12) |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 15.6 | 13.0 | 10.8 | FPB   |              |      |
| 13.7                                                                                      | 13.7 | 13.7 | 13.7 | 13.7 | 13.7 | 13.7 | 12.5 | 10.7 | 9.0  | A     | API 5L       | (12) |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 15.6 | 13.0 | 10.8 | B     |              |      |
| Furnace Butt Welded Pipe                                                                  |      |      |      |      |      |      |      |      |      |       |              |      |
| 8.2                                                                                       | 8.2  | 8.2  | 8.2  | 8.2  | 8.2  | 8.2  | 7.5  | ...  | ...  | ...   | A53          | (12) |
| 7.7                                                                                       | 7.7  | 7.7  | 7.7  | ...  | ...  | ...  | ...  | ...  | ...  | A25   | API 5L       |      |
| Electric Resistance Welded Pipe and Tube                                                  |      |      |      |      |      |      |      |      |      |       |              |      |
| 11.7                                                                                      | 11.7 | 11.7 | 11.7 | 11.7 | 11.7 | 11.7 | 10.6 | 9.1  | 7.7  | A     | A53          | (12) |
| 14.6                                                                                      | 14.6 | 14.6 | 14.6 | 14.6 | 14.6 | 14.6 | 13.3 | 11.1 | 9.2  | B     |              |      |
| 11.7                                                                                      | 11.7 | 11.7 | 11.7 | 11.7 | 11.7 | 11.7 | 10.6 | 9.1  | 7.9  | A     | A135         | (12) |
| 14.6                                                                                      | 14.6 | 14.6 | 14.6 | 14.6 | 14.6 | 14.6 | 13.3 | 11.1 | 9.2  | B     |              |      |
| 11.4                                                                                      | 11.4 | 11.4 | 11.4 | 11.4 | 11.3 | 10.9 | 10.5 | 9.1  | 7.7  | A     | A178         | (12) |
| 14.6                                                                                      | 14.6 | 14.6 | 14.6 | 14.6 | 14.6 | 14.6 | 13.3 | 11.1 | 9.2  | C     |              |      |
| 11.4                                                                                      | 11.4 | 11.4 | 11.4 | 11.4 | 11.3 | 10.9 | 10.5 | 9.1  | 7.8  | ...   | A214         | (12) |
| 13.4                                                                                      | 13.4 | 13.4 | 13.4 | 13.4 | 13.0 | 12.6 | ...  | ...  | ...  | 1     | A333         |      |
| 14.6                                                                                      | 14.6 | 14.6 | 14.6 | 14.6 | 14.6 | 14.6 | 13.3 | ...  | ...  | 6     |              |      |

(12)

Table A-1 Carbon Steel (Cont'd)

| Spec. No.                                                | Grade | Type or Class | Nominal Composition | P-No. | Notes      | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|----------------------------------------------------------|-------|---------------|---------------------|-------|------------|--------------------------------|------------------------------|--------|
| <b>Electric Resistance Welded Pipe and Tube (Cont'd)</b> |       |               |                     |       |            |                                |                              |        |
| API 5L                                                   | A25   | I & II        | C                   | 1     | (1)(14)    | 45                             | 25                           | 0.85   |
|                                                          | A     | ...           | C                   | 1     | (1)(2)(14) | 48                             | 30                           | 0.85   |
|                                                          | B     | ...           | C-Mn                | 1     | (1)(2)(14) | 60                             | 35                           | 0.85   |
| A587                                                     | ...   | ...           | C                   | 1     | (1)(2)     | 48                             | 30                           | 0.85   |
| <b>Electric Fusion Welded Pipe — Filler Metal Added</b>  |       |               |                     |       |            |                                |                              |        |
| A134                                                     | A283A | ...           | C                   | 1     | (1)(7)     | 45                             | 24                           | 0.80   |
|                                                          | A283B | ...           | C                   | 1     | (1)(7)     | 50                             | 27                           | 0.80   |
|                                                          | A283C | ...           | C                   | 1     | (1)(7)     | 55                             | 30                           | 0.80   |
|                                                          | A283D | ...           | C                   | 1     | (1)(7)     | 60                             | 33                           | 0.80   |
| A134                                                     | A285A | ...           | C                   | 1     | (1)(2)(8)  | 45                             | 24                           | 0.80   |
|                                                          | A285B | ...           | C                   | 1     | (1)(2)(8)  | 50                             | 27                           | 0.80   |
|                                                          | A285C | ...           | C                   | 1     | (1)(2)(8)  | 55                             | 30                           | 0.80   |
| A139                                                     | A     | ...           | C                   | 1     | (1)(2)(14) | 48                             | 30                           | 0.80   |
|                                                          | B     | ...           | C-Mn                | 1     | (1)(2)(14) | 60                             | 35                           | 0.80   |
| API 5L                                                   | A     | ...           | C                   | 1     | (1)(2)(14) | 48                             | 30                           | 0.90   |
|                                                          | B     | ...           | C-Mn                | 1     | (1)(2)(14) | 60                             | 35                           | 0.90   |
| A671                                                     | CA55  | 10,13         | C                   | 1     | (1)(2)(15) | 55                             | 30                           | 0.90   |
|                                                          | CA55  | 11,12         | C                   | 1     | (1)(2)(15) | 55                             | 30                           | 1.00   |
|                                                          | CA55  | 20,23,30,33   | C                   | 1     | (1)(2)     | 55                             | 30                           | 0.90   |
|                                                          | CA55  | 21,22,31,32   | C                   | 1     | (1)(2)     | 55                             | 30                           | 1.00   |
| A671                                                     | CB60  | 10,13         | C-Si                | 1     | (1)(2)(15) | 60                             | 32                           | 0.90   |
|                                                          | CB60  | 11,12         | C-Si                | 1     | (1)(2)(15) | 60                             | 32                           | 1.00   |
|                                                          | CB60  | 20,23,30,33   | C-Si                | 1     | (1)(2)     | 60                             | 32                           | 0.90   |
|                                                          | CB60  | 21,22,31,32   | C-Si                | 1     | (1)(2)     | 60                             | 32                           | 1.00   |
| A671                                                     | CB65  | 10,13         | C-Si                | 1     | (1)(2)(15) | 65                             | 35                           | 0.90   |
|                                                          | CB65  | 11,12         | C-Si                | 1     | (1)(2)(15) | 65                             | 35                           | 1.00   |
|                                                          | CB65  | 20,23,30,33   | C-Si                | 1     | (1)(2)     | 65                             | 35                           | 0.90   |
|                                                          | CB65  | 21,22,31,32   | C-Si                | 1     | (1)(2)     | 65                             | 35                           | 1.00   |
| A671                                                     | CB70  | 10,13         | C-Si                | 1     | (1)(2)(15) | 70                             | 38                           | 0.90   |
|                                                          | CB70  | 11,12         | C-Si                | 1     | (1)(2)(15) | 70                             | 38                           | 1.00   |
|                                                          | CB70  | 20,23,30,33   | C-Si                | 1     | (1)(2)     | 70                             | 38                           | 0.90   |
|                                                          | CB70  | 21,22,31,32   | C-Si                | 1     | (1)(2)     | 70                             | 38                           | 1.00   |
| A671                                                     | CC60  | 10,13         | C-Mn-Si             | 1     | (1)(2)(15) | 60                             | 32                           | 0.90   |
|                                                          | CC60  | 11,12         | C-Mn-Si             | 1     | (1)(2)(15) | 60                             | 32                           | 1.00   |
|                                                          | CC60  | 20,23,30,33   | C-Mn-Si             | 1     | (1)(2)     | 60                             | 32                           | 0.90   |
|                                                          | CC60  | 21,22,31,32   | C-Mn-Si             | 1     | (1)(2)     | 60                             | 32                           | 1.00   |

Table A-1 Carbon Steel (Cont'd)

(12)

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |       | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|-------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | Grade |              |
| Electric Resistance Welded Pipe and Tube (Cont'd)                                         |      |      |      |      |      |      |      |      |      |       |              |
| 10.9                                                                                      | 10.9 | 10.9 | 10.9 | ...  | ...  | ...  | ...  | ...  | ...  | A25   | API 5L       |
| 11.7                                                                                      | 11.7 | 11.7 | 11.7 | 11.7 | 11.7 | 11.7 | 10.6 | 9.1  | 7.7  | A     |              |
| 14.6                                                                                      | 14.6 | 14.6 | 14.6 | 14.6 | 14.6 | 14.6 | 13.3 | 11.1 | 9.2  | B     |              |
| 11.7                                                                                      | 11.7 | 11.7 | 11.7 | 11.7 | 11.7 | 11.7 | 10.6 | 9.1  | 7.8  | ...   | A587         |
| Electric Fusion Welded Pipe — Filler Metal Added                                          |      |      |      |      |      |      |      |      |      |       |              |
| 10.3                                                                                      | 10.3 | 10.3 | 10.3 | 10.3 | 9.8  | 9.5  | ...  | ...  | ...  | A283A | A134         |
| 11.4                                                                                      | 11.4 | 11.4 | 11.4 | 11.4 | 11.0 | 10.7 | ...  | ...  | ...  | A283B |              |
| 12.6                                                                                      | 12.6 | 12.6 | 12.6 | 12.6 | 12.3 | 11.9 | ...  | ...  | ...  | A283C |              |
| 13.7                                                                                      | 13.7 | 13.7 | 13.7 | 13.7 | 13.5 | 13.0 | ...  | ...  | ...  | A283D |              |
| 10.3                                                                                      | 10.3 | 10.3 | 10.3 | 10.3 | 9.8  | 9.5  | 9.2  | 8.6  | 6.6  | A285A | A134         |
| 11.4                                                                                      | 11.4 | 11.4 | 11.4 | 11.4 | 11.0 | 10.7 | 10.0 | 8.8  | 6.5  | A285B |              |
| 12.6                                                                                      | 12.6 | 12.6 | 12.6 | 12.6 | 12.3 | 11.9 | 11.5 | 10.4 | 8.6  | A285C |              |
| 11.0                                                                                      | 11.0 | 11.0 | 11.0 | 11.0 | 11.0 | 11.0 | 10.0 | 8.6  | 7.4  | A     | A139         |
| 13.7                                                                                      | 13.7 | 13.7 | 13.7 | 13.7 | 13.7 | 13.7 | 12.5 | 10.4 | 8.6  | B     |              |
| 12.3                                                                                      | 12.3 | 12.3 | 12.3 | 12.3 | 12.3 | 12.3 | 11.3 | 9.6  | 8.3  | A     | API 5L       |
| 15.4                                                                                      | 15.4 | 15.4 | 15.4 | 15.4 | 15.4 | 15.4 | 14.0 | 11.7 | 9.7  | B     |              |
| 14.1                                                                                      | 14.1 | 14.1 | 14.1 | 14.1 | 13.8 | 13.3 | 12.9 | 11.7 | 9.7  | CA55  | A671         |
| 15.7                                                                                      | 15.7 | 15.7 | 15.7 | 15.7 | 15.3 | 14.8 | 14.3 | 13.0 | 10.8 | CA55  |              |
| 14.1                                                                                      | 14.1 | 14.1 | 14.1 | 14.1 | 13.8 | 13.3 | 12.9 | 11.7 | 9.7  | CA55  |              |
| 15.7                                                                                      | 15.7 | 15.7 | 15.7 | 15.7 | 15.3 | 14.8 | 14.3 | 13.0 | 10.8 | CA55  |              |
| 15.4                                                                                      | 15.4 | 15.4 | 15.4 | 15.4 | 14.7 | 14.2 | 13.7 | 11.7 | 9.7  | CB60  | A671         |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 17.1 | 16.4 | 15.8 | 15.3 | 13.0 | 10.8 | CB60  |              |
| 15.4                                                                                      | 15.4 | 15.4 | 15.4 | 15.4 | 14.7 | 14.2 | 13.7 | 11.7 | 9.7  | CB60  |              |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 17.1 | 16.4 | 15.8 | 15.3 | 13.0 | 10.8 | CB60  |              |
| 16.7                                                                                      | 16.7 | 16.7 | 16.7 | 16.7 | 16.1 | 15.6 | 15.0 | 12.5 | 10.3 | CB65  | A671         |
| 18.6                                                                                      | 18.6 | 18.6 | 18.6 | 18.6 | 17.9 | 17.3 | 16.7 | 13.9 | 11.4 | CB65  |              |
| 16.7                                                                                      | 16.7 | 16.7 | 16.7 | 16.7 | 16.1 | 15.6 | 15.0 | 12.5 | 10.3 | CB65  |              |
| 18.6                                                                                      | 18.6 | 18.6 | 18.6 | 18.6 | 17.9 | 17.3 | 16.7 | 13.9 | 11.4 | CB65  |              |
| 18.0                                                                                      | 18.0 | 18.0 | 18.0 | 18.0 | 17.5 | 16.9 | 16.3 | 13.3 | 10.8 | CB70  | A671         |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 19.4 | 18.8 | 18.1 | 14.8 | 12.0 | CB70  |              |
| 18.0                                                                                      | 18.0 | 18.0 | 18.0 | 18.0 | 17.5 | 16.9 | 16.3 | 13.3 | 10.8 | CB70  |              |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 19.4 | 18.8 | 18.1 | 14.8 | 12.0 | CB70  |              |
| 15.4                                                                                      | 15.4 | 15.4 | 15.4 | 15.4 | 14.7 | 14.2 | 13.7 | 11.7 | 9.7  | CC60  | A671         |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 17.1 | 16.4 | 15.8 | 15.3 | 13.0 | 10.8 | CC60  |              |
| 15.4                                                                                      | 15.4 | 15.4 | 15.4 | 15.4 | 14.7 | 14.2 | 13.7 | 11.7 | 9.7  | CC60  |              |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 17.1 | 16.4 | 15.8 | 15.3 | 13.0 | 10.8 | CC60  |              |

Table A-1 Carbon Steel (Cont'd)

| Spec. No.                                                 | Grade | Type or Class | Nominal Composition | P-No. | Notes      | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|-----------------------------------------------------------|-------|---------------|---------------------|-------|------------|--------------------------------|------------------------------|--------|
| Electric Fusion Welded Pipe — Filler Metal Added (Cont'd) |       |               |                     |       |            |                                |                              |        |
| A671                                                      | CC65  | 10,13         | C-Mn-Si             | 1     | (1)(2)(15) | 65                             | 35                           | 0.90   |
|                                                           | CC65  | 11,12         | C-Mn-Si             | 1     | (1)(2)(15) | 65                             | 35                           | 1.00   |
|                                                           | CC65  | 20,23,30,33   | C-Mn-Si             | 1     | (1)(2)     | 65                             | 35                           | 0.90   |
|                                                           | CC65  | 21,22,31,32   | C-Mn-Si             | 1     | (1)(2)     | 65                             | 35                           | 1.00   |
| A671                                                      | CC70  | 10,13         | C-Mn-Si             | 1     | (1)(2)(15) | 70                             | 38                           | 0.90   |
|                                                           | CC70  | 11,12         | C-Mn-Si             | 1     | (1)(2)(15) | 70                             | 38                           | 1.00   |
|                                                           | CC70  | 20,23,30,33   | C-Mn-Si             | 1     | (1)(2)     | 70                             | 38                           | 0.90   |
|                                                           | CC70  | 21,22,31,32   | C-Mn-Si             | 1     | (1)(2)     | 70                             | 38                           | 1.00   |
| A671                                                      | CK75  | 10,13         | C-Mn-Si             | 1     | (1)(2)(15) | 75                             | 42                           | 0.90   |
|                                                           | CK75  | 11,12         | C-Mn-Si             | 1     | (1)(2)(15) | 75                             | 42                           | 1.00   |
|                                                           | CK75  | 20,23,30,33   | C-Mn-Si             | 1     | (1)(2)     | 75                             | 40                           | 0.90   |
|                                                           | CK75  | 21,22,31,32   | C-Mn-Si             | 1     | (1)(2)     | 75                             | 40                           | 1.00   |
| A671                                                      | CD70  | 10,13         | C-Mn-Si             | 1     | (1)(2)(15) | 70                             | 50                           | 0.90   |
|                                                           | CD70  | 11,12         | C-Mn-Si             | 1     | (1)(2)(15) | 70                             | 50                           | 1.00   |
|                                                           | CD70  | 20,23,30,33   | C-Mn-Si             | 1     | (1)(3)     | 70                             | 50                           | 0.90   |
|                                                           | CD70  | 21,22,31,32   | C-Mn-Si             | 1     | (1)(3)     | 70                             | 50                           | 1.00   |
| A671                                                      | CD80  | 10,13         | C-Mn-Si             | 1     | (1)(15)    | 80                             | 60                           | 0.90   |
|                                                           | CD80  | 11,12         | C-Mn-Si             | 1     | (1)(15)    | 80                             | 60                           | 1.00   |
|                                                           | CD80  | 20,23         | C-Mn-Si             | 1     | (1)(3)     | 80                             | 60                           | 0.90   |
|                                                           | CD80  | 21,22         | C-Mn-Si             | 1     | (1)(3)     | 80                             | 60                           | 1.00   |
| A672                                                      | A45   | 10,13         | C                   | 1     | (1)(2)(15) | 45                             | 24                           | 0.90   |
|                                                           | A45   | 11,12         | C                   | 1     | (1)(2)(15) | 45                             | 24                           | 1.00   |
|                                                           | A45   | 20,23,30,33   | C                   | 1     | (1)(2)     | 45                             | 24                           | 0.90   |
|                                                           | A45   | 21,22,31,32   | C                   | 1     | (1)(2)     | 45                             | 24                           | 1.00   |
| A672                                                      | A50   | 10,13         | C                   | 1     | (1)(2)(15) | 50                             | 27                           | 0.90   |
|                                                           | A50   | 11,12         | C                   | 1     | (1)(2)(15) | 50                             | 27                           | 1.00   |
|                                                           | A50   | 20,23,30,33   | C                   | 1     | (1)(2)     | 50                             | 27                           | 0.90   |
|                                                           | A50   | 21,22,31,32   | C                   | 1     | (1)(2)     | 50                             | 27                           | 1.00   |
| A672                                                      | A55   | 10,13         | C                   | 1     | (1)(2)(15) | 55                             | 30                           | 0.90   |
|                                                           | A55   | 11,12         | C                   | 1     | (1)(2)(15) | 55                             | 30                           | 1.00   |
|                                                           | A55   | 20,23,30,33   | C                   | 1     | (1)(2)     | 55                             | 30                           | 0.90   |
|                                                           | A55   | 21,22,31,32   | C                   | 1     | (1)(2)     | 55                             | 30                           | 1.00   |
| A672                                                      | B55   | 10,13         | C                   | 1     | (1)(2)(15) | 55                             | 30                           | 0.90   |
|                                                           | B55   | 11,12         | C                   | 1     | (1)(2)(15) | 55                             | 30                           | 1.00   |
|                                                           | B55   | 20,23,30,33   | C                   | 1     | (1)(2)     | 55                             | 30                           | 0.90   |
|                                                           | B55   | 21,22,31,32   | C                   | 1     | (1)(2)     | 55                             | 30                           | 1.00   |
| A672                                                      | B60   | 10,13         | C                   | 1     | (1)(2)(15) | 60                             | 32                           | 0.90   |
|                                                           | B60   | 11,12         | C                   | 1     | (1)(2)(15) | 60                             | 32                           | 1.00   |
|                                                           | B60   | 20,23,30,33   | C                   | 1     | (1)(2)     | 60                             | 32                           | 0.90   |
|                                                           | B60   | 21,22,31,32   | C                   | 1     | (1)(2)     | 60                             | 32                           | 1.00   |

Table A-1 Carbon Steel (Cont'd)

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |       | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|-------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | Grade |              |
| Electric Fusion Welded Pipe — Filler Metal Added (Cont'd)                                 |      |      |      |      |      |      |      |      |      |       |              |
| 16.7                                                                                      | 16.7 | 16.7 | 16.7 | 16.7 | 16.1 | 15.6 | 15.0 | 12.5 | 10.3 | CC65  | A671         |
| 18.6                                                                                      | 18.6 | 18.6 | 18.6 | 18.6 | 17.9 | 17.3 | 16.7 | 13.9 | 11.4 | CC65  |              |
| 16.7                                                                                      | 16.7 | 16.7 | 16.7 | 16.7 | 16.1 | 15.6 | 15.0 | 12.5 | 10.3 | CC65  |              |
| 18.6                                                                                      | 18.6 | 18.6 | 18.6 | 18.6 | 17.9 | 17.3 | 16.7 | 13.9 | 11.4 | CC65  |              |
| 18.0                                                                                      | 18.0 | 18.0 | 18.0 | 18.0 | 17.5 | 16.9 | 16.3 | 13.3 | 10.8 | CC70  | A671         |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 19.4 | 18.8 | 18.1 | 14.8 | 12.0 | CC70  |              |
| 18.0                                                                                      | 18.0 | 18.0 | 18.0 | 18.0 | 17.5 | 16.9 | 16.3 | 13.3 | 10.8 | CC70  |              |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 19.4 | 18.8 | 18.1 | 14.8 | 12.0 | CC70  |              |
| 19.3                                                                                      | 19.3 | 19.3 | 19.3 | 19.3 | 19.3 | 18.7 | 17.6 | 14.1 | 11.3 | CK75  | A671         |
| 21.4                                                                                      | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 20.8 | 19.6 | 15.7 | 12.6 | CK75  |              |
| 19.3                                                                                      | 19.3 | 19.3 | 19.3 | 19.3 | 18.4 | 17.8 | 17.2 | 14.1 | 11.3 | CK75  |              |
| 21.4                                                                                      | 21.4 | 21.4 | 21.4 | 21.4 | 20.4 | 19.8 | 19.1 | 15.7 | 12.6 | CK75  |              |
| 18.0                                                                                      | 18.0 | 17.7 | 17.6 | 17.6 | 17.6 | 17.6 | ...  | ...  | ...  | CD70  | A671         |
| 20.0                                                                                      | 20.0 | 19.7 | 19.5 | 19.5 | 19.5 | 19.5 | ...  | ...  | ...  | CD70  |              |
| 18.0                                                                                      | 18.0 | 17.7 | 17.6 | 17.6 | 17.6 | 17.6 | ...  | ...  | ...  | CD70  |              |
| 20.0                                                                                      | 20.0 | 19.7 | 19.5 | 19.5 | 19.5 | 19.5 | ...  | ...  | ...  | CD70  |              |
| 20.6                                                                                      | 20.6 | 20.3 | 20.1 | 20.1 | 20.1 | 20.1 | ...  | ...  | ...  | CD80  | A671         |
| 22.9                                                                                      | 22.9 | 22.6 | 22.3 | 22.3 | 22.3 | 22.3 | ...  | ...  | ...  | CD80  |              |
| 20.6                                                                                      | 20.6 | 20.3 | 20.1 | 20.1 | 20.1 | 20.1 | ...  | ...  | ...  | CD80  |              |
| 22.9                                                                                      | 22.9 | 22.6 | 22.3 | 22.3 | 22.3 | 22.3 | ...  | ...  | ...  | CD80  |              |
| 11.6                                                                                      | 11.6 | 11.6 | 11.6 | 11.6 | 11.0 | 10.7 | 10.3 | 9.6  | 8.1  | A45   | A672         |
| 12.9                                                                                      | 12.9 | 12.9 | 12.9 | 12.9 | 12.3 | 11.9 | 11.5 | 10.7 | 9.0  | A45   |              |
| 11.6                                                                                      | 11.6 | 11.6 | 11.6 | 11.6 | 11.0 | 10.7 | 10.3 | 9.6  | 8.1  | A45   |              |
| 12.9                                                                                      | 12.9 | 12.9 | 12.9 | 12.9 | 12.3 | 11.9 | 11.5 | 10.7 | 9.0  | A45   |              |
| 12.9                                                                                      | 12.9 | 12.9 | 12.9 | 12.9 | 12.4 | 12.0 | 11.3 | 10.1 | 8.6  | A50   | A672         |
| 14.3                                                                                      | 14.3 | 14.3 | 14.3 | 14.3 | 13.8 | 13.3 | 12.5 | 11.2 | 9.6  | A50   |              |
| 12.9                                                                                      | 12.9 | 12.9 | 12.9 | 12.9 | 12.4 | 12.0 | 11.3 | 10.1 | 8.6  | A50   |              |
| 14.3                                                                                      | 14.3 | 14.3 | 14.3 | 14.3 | 13.8 | 13.3 | 12.5 | 11.2 | 9.6  | A50   |              |
| 14.1                                                                                      | 14.1 | 14.1 | 14.1 | 14.1 | 13.8 | 13.3 | 12.9 | 10.9 | 9.2  | A55   | A672         |
| 15.7                                                                                      | 15.7 | 15.7 | 15.7 | 15.7 | 15.3 | 14.8 | 14.3 | 12.1 | 10.2 | A55   |              |
| 14.1                                                                                      | 14.1 | 14.1 | 14.1 | 14.1 | 13.8 | 13.3 | 12.9 | 10.9 | 9.2  | A55   |              |
| 15.7                                                                                      | 15.7 | 15.7 | 15.7 | 15.7 | 15.3 | 14.8 | 14.3 | 12.1 | 10.2 | A55   |              |
| 14.1                                                                                      | 14.1 | 14.1 | 14.1 | 14.1 | 13.8 | 13.3 | 12.9 | 10.9 | 9.2  | B55   | A672         |
| 15.7                                                                                      | 15.7 | 15.7 | 15.7 | 15.7 | 15.3 | 14.8 | 14.3 | 12.1 | 10.2 | B55   |              |
| 14.1                                                                                      | 14.1 | 14.1 | 14.1 | 14.1 | 13.8 | 13.3 | 12.9 | 10.9 | 9.2  | B55   |              |
| 15.7                                                                                      | 15.7 | 15.7 | 15.7 | 15.7 | 15.3 | 14.8 | 14.3 | 12.1 | 10.2 | B55   |              |
| 15.4                                                                                      | 15.4 | 15.4 | 15.4 | 15.4 | 14.7 | 14.2 | 13.7 | 11.7 | 9.7  | B60   | A672         |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 17.1 | 16.4 | 15.8 | 15.3 | 13.0 | 10.8 | B60   |              |
| 15.4                                                                                      | 15.4 | 15.4 | 15.4 | 15.4 | 14.7 | 14.2 | 13.7 | 11.7 | 9.7  | B60   |              |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 17.1 | 16.4 | 15.8 | 15.3 | 13.0 | 10.8 | B60   |              |

Table A-1 Carbon Steel (Cont'd)

| Spec. No.                                                 | Grade   | Type or Class | Nominal Composition | P-No. | Notes      | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|-----------------------------------------------------------|---------|---------------|---------------------|-------|------------|--------------------------------|------------------------------|--------|
| Electric Fusion Welded Pipe — Filler Metal Added (Cont'd) |         |               |                     |       |            |                                |                              |        |
| A672                                                      | B65     | 10,13         | C                   | 1     | (1)(2)(15) | 65                             | 35                           | 0.90   |
|                                                           | B65     | 11,12         | C                   | 1     | (1)(2)(15) | 65                             | 35                           | 1.00   |
|                                                           | B65     | 20,23,30,33   | C                   | 1     | (1)(2)     | 65                             | 35                           | 0.90   |
|                                                           | B65     | 21,22,31,32   | C                   | 1     | (1)(2)     | 65                             | 35                           | 1.00   |
| A672                                                      | B70     | 10,13         | C                   | 1     | (1)(2)(15) | 70                             | 38                           | 0.90   |
|                                                           | B70     | 11,12         | C                   | 1     | (1)(2)(15) | 70                             | 38                           | 1.00   |
|                                                           | B70     | 20,23,30,33   | C                   | 1     | (1)(2)     | 70                             | 38                           | 0.90   |
|                                                           | B70     | 21,22,31,32   | C                   | 1     | (1)(2)     | 70                             | 38                           | 1.00   |
| A672                                                      | C55     | 10,13         | C                   | 1     | (1)(2)(15) | 55                             | 30                           | 0.90   |
|                                                           | C55     | 11,12         | C                   | 1     | (1)(2)(15) | 55                             | 30                           | 1.00   |
|                                                           | C55     | 20,23,30,33   | C                   | 1     | (1)(2)     | 55                             | 30                           | 0.90   |
|                                                           | C55     | 21,22,31,32   | C                   | 1     | (1)(2)     | 55                             | 30                           | 1.00   |
| A672                                                      | C60     | 10,13         | C                   | 1     | (1)(2)(15) | 60                             | 32                           | 0.90   |
|                                                           | C60     | 11,12         | C                   | 1     | (1)(2)(15) | 60                             | 32                           | 1.00   |
|                                                           | C60     | 20,23,30,33   | C                   | 1     | (1)(2)     | 60                             | 32                           | 0.90   |
|                                                           | C60     | 21,22,31,32   | C                   | 1     | (1)(2)     | 60                             | 32                           | 1.00   |
| A672                                                      | C65     | 10,13         | C                   | 1     | (1)(2)(15) | 65                             | 35                           | 0.90   |
|                                                           | C65     | 11,12         | C                   | 1     | (1)(2)(15) | 65                             | 35                           | 1.00   |
|                                                           | C65     | 20,23,30,33   | C                   | 1     | (1)(2)     | 65                             | 35                           | 0.90   |
|                                                           | C65     | 21,22,31,32   | C                   | 1     | (1)(2)     | 65                             | 35                           | 1.00   |
| A672                                                      | C70     | 10,13         | C                   | 1     | (1)(2)(15) | 70                             | 38                           | 0.90   |
|                                                           | C70     | 11,12         | C                   | 1     | (1)(2)(15) | 70                             | 38                           | 1.00   |
|                                                           | C70     | 20,23,30,33   | C                   | 1     | (1)(2)     | 70                             | 38                           | 0.90   |
|                                                           | C70     | 21,22,31,32   | C                   | 1     | (1)(2)     | 70                             | 38                           | 1.00   |
| A672                                                      | D70     | 10,13         | C-Mn-Si             | 1     | (1)(15)    | 70                             | 50                           | 0.90   |
|                                                           | D70     | 11,12         | C-Mn-Si             | 1     | (1)(15)    | 70                             | 50                           | 1.00   |
|                                                           | D70     | 20,23,30,33   | C-Mn-Si             | 1     | (1)(3)     | 70                             | 50                           | 0.90   |
|                                                           | D70     | 21,22,31,32   | C-Mn-Si             | 1     | (1)(3)     | 70                             | 50                           | 1.00   |
| A672                                                      | D80     | 10,13         | C-Mn-Si             | 1     | (1)(15)    | 80                             | 60                           | 0.90   |
|                                                           | D80     | 11,12         | C-Mn-Si             | 1     | (1)(15)    | 80                             | 60                           | 1.00   |
|                                                           | D80     | 20,23         | C-Mn-Si             | 1     | (1)(3)     | 80                             | 60                           | 0.90   |
|                                                           | D80     | 21,22         | C-Mn-Si             | 1     | (1)(3)     | 80                             | 60                           | 1.00   |
| A672                                                      | N75     | 10,13         | C-Mn-Si             | 1     | (1)(2)(15) | 75                             | 42                           | 0.90   |
|                                                           | N75     | 11,12         | C-Mn-Si             | 1     | (1)(2)(15) | 75                             | 42                           | 1.00   |
|                                                           | N75     | 20,23,30,33   | C-Mn-Si             | 1     | (1)(2)     | 75                             | 40                           | 0.90   |
|                                                           | N75     | 21,22,31,32   | C-Mn-Si             | 1     | (1)(2)     | 75                             | 40                           | 1.00   |
| A691                                                      | CMSH-70 | 10,13         | C-Mn-Si             | 1     | (1)(15)    | 70                             | 50                           | 0.90   |
|                                                           | CMSH-70 | 11,12         | C-Mn-Si             | 1     | (1)(15)    | 70                             | 50                           | 1.00   |
|                                                           | CMSH-70 | 20,23,30,33   | C-Mn-Si             | 1     | (1)(3)     | 70                             | 50                           | 0.90   |
|                                                           | CMSH-70 | 21,22,31,32   | C-Mn-Si             | 1     | (1)(3)     | 70                             | 50                           | 1.00   |

Table A-1 Carbon Steel (Cont'd)

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |         | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|---------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | Grade   |              |
| Electric Fusion Welded Pipe — Filler Metal Added (Cont'd)                                 |      |      |      |      |      |      |      |      |      |         |              |
| 16.7                                                                                      | 16.7 | 16.7 | 16.7 | 16.7 | 16.1 | 15.6 | 15.0 | 12.5 | 10.3 | B65     | A672         |
| 18.6                                                                                      | 18.6 | 18.6 | 18.6 | 18.6 | 17.9 | 17.3 | 16.7 | 13.9 | 11.4 | B65     |              |
| 16.7                                                                                      | 16.7 | 16.7 | 16.7 | 16.7 | 16.1 | 15.6 | 15.0 | 12.5 | 10.3 | B65     |              |
| 18.6                                                                                      | 18.6 | 18.6 | 18.6 | 18.6 | 17.9 | 17.3 | 16.7 | 13.9 | 11.4 | B65     |              |
| 18.0                                                                                      | 18.0 | 18.0 | 18.0 | 18.0 | 17.5 | 16.9 | 16.3 | 13.3 | 10.8 | B70     | A672         |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 19.4 | 18.8 | 18.1 | 14.8 | 12.0 | B70     |              |
| 18.0                                                                                      | 18.0 | 18.0 | 18.0 | 18.0 | 17.5 | 16.9 | 16.3 | 13.3 | 10.8 | B70     |              |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 19.4 | 18.8 | 18.1 | 14.8 | 12.0 | B70     |              |
| 14.1                                                                                      | 14.1 | 14.1 | 14.1 | 14.1 | 13.8 | 13.3 | 12.9 | 10.9 | 9.2  | C55     | A672         |
| 15.7                                                                                      | 15.7 | 15.7 | 15.7 | 15.7 | 15.3 | 14.8 | 14.3 | 12.1 | 10.2 | C55     |              |
| 14.1                                                                                      | 14.1 | 14.1 | 14.1 | 14.1 | 13.8 | 13.3 | 12.9 | 10.9 | 9.2  | C55     |              |
| 15.7                                                                                      | 15.7 | 15.7 | 15.7 | 15.7 | 15.3 | 14.8 | 14.3 | 12.1 | 10.2 | C55     |              |
| 15.4                                                                                      | 15.4 | 15.4 | 15.4 | 15.4 | 14.7 | 14.2 | 13.7 | 11.7 | 9.7  | C60     | A672         |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 17.1 | 16.4 | 15.8 | 15.3 | 13.0 | 10.8 | C60     |              |
| 15.4                                                                                      | 15.4 | 15.4 | 15.4 | 15.4 | 14.7 | 14.2 | 13.7 | 11.7 | 9.7  | C60     |              |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 17.1 | 16.4 | 15.8 | 15.3 | 13.0 | 10.8 | C60     |              |
| 16.7                                                                                      | 16.7 | 16.7 | 16.7 | 16.7 | 16.1 | 15.6 | 15.0 | 12.5 | 10.3 | C65     | A672         |
| 18.6                                                                                      | 18.6 | 18.6 | 18.6 | 18.6 | 17.9 | 17.3 | 16.7 | 13.9 | 11.4 | C65     |              |
| 16.7                                                                                      | 16.7 | 16.7 | 16.7 | 16.7 | 16.1 | 15.6 | 15.0 | 12.5 | 10.3 | C65     |              |
| 18.6                                                                                      | 18.6 | 18.6 | 18.6 | 18.6 | 17.9 | 17.3 | 16.7 | 13.9 | 11.4 | C65     |              |
| 18.0                                                                                      | 18.0 | 18.0 | 18.0 | 18.0 | 17.5 | 16.9 | 16.3 | 13.3 | 10.8 | C70     | A672         |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 19.4 | 18.8 | 18.1 | 14.8 | 12.0 | C70     |              |
| 18.0                                                                                      | 18.0 | 18.0 | 18.0 | 18.0 | 17.5 | 16.9 | 16.3 | 13.3 | 10.8 | C70     |              |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 19.4 | 18.8 | 18.1 | 14.8 | 12.0 | C70     |              |
| 18.0                                                                                      | 18.0 | 17.7 | 17.6 | 17.6 | 17.6 | 17.6 | ...  | ...  | ...  | D70     | A672         |
| 20.0                                                                                      | 20.0 | 19.7 | 19.5 | 19.5 | 19.5 | 19.5 | ...  | ...  | ...  | D70     |              |
| 18.0                                                                                      | 18.0 | 17.7 | 17.6 | 17.6 | 17.6 | 17.6 | ...  | ...  | ...  | D70     |              |
| 20.0                                                                                      | 20.0 | 19.7 | 19.5 | 19.5 | 19.5 | 19.5 | ...  | ...  | ...  | D70     |              |
| 20.6                                                                                      | 20.6 | 20.3 | 20.1 | 20.1 | 20.1 | 20.1 | ...  | ...  | ...  | D80     | A672         |
| 22.9                                                                                      | 22.9 | 22.6 | 22.3 | 22.3 | 22.3 | 22.3 | ...  | ...  | ...  | D80     |              |
| 20.6                                                                                      | 20.6 | 20.3 | 20.1 | 20.1 | 20.1 | 20.1 | ...  | ...  | ...  | D80     |              |
| 22.9                                                                                      | 22.9 | 22.6 | 22.3 | 22.3 | 22.3 | 22.3 | ...  | ...  | ...  | D80     |              |
| 19.3                                                                                      | 19.3 | 19.3 | 19.3 | 19.3 | 18.4 | 17.8 | 17.2 | 14.1 | 11.3 | N75     | A672         |
| 21.4                                                                                      | 21.4 | 21.4 | 21.4 | 21.4 | 20.4 | 19.8 | 19.1 | 15.7 | 12.6 | N75     |              |
| 19.3                                                                                      | 19.3 | 19.3 | 19.3 | 19.3 | 18.4 | 17.8 | 17.2 | 14.1 | 11.3 | N75     |              |
| 21.4                                                                                      | 21.4 | 21.4 | 21.4 | 21.4 | 20.4 | 19.8 | 19.1 | 15.7 | 12.6 | N75     |              |
| 18.0                                                                                      | 18.0 | 17.7 | 17.6 | 17.6 | 17.6 | 17.6 | ...  | ...  | ...  | CMSH-70 | A691         |
| 20.0                                                                                      | 20.0 | 19.7 | 19.5 | 19.5 | 19.5 | 19.5 | ...  | ...  | ...  | CMSH-70 |              |
| 18.0                                                                                      | 18.0 | 17.7 | 17.6 | 17.6 | 17.6 | 17.6 | ...  | ...  | ...  | CMSH-70 |              |
| 20.0                                                                                      | 20.0 | 19.7 | 19.5 | 19.5 | 19.5 | 19.5 | ...  | ...  | ...  | CMSH-70 |              |

Table A-1 Carbon Steel (Cont'd)

| Spec. No.                                                        | Grade   | Type or Class | Nominal Composition | P-No. | Notes      | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|------------------------------------------------------------------|---------|---------------|---------------------|-------|------------|--------------------------------|------------------------------|--------|
| <b>Electric Fusion Welded Pipe — Filler Metal Added (Cont'd)</b> |         |               |                     |       |            |                                |                              |        |
| A691                                                             | CMSH-80 | 10,13         | C-Mn-Si             | 1     | (1)(15)    | 80                             | 60                           | 0.90   |
|                                                                  | CMSH-80 | 11,12         | C-Mn-Si             | 1     | (1)(15)    | 80                             | 60                           | 1.00   |
|                                                                  | CMSH-80 | 20,23         | C-Mn-Si             | 1     | (1)(3)     | 80                             | 60                           | 0.90   |
|                                                                  | CMSH-80 | 21,22         | C-Mn-Si             | 1     | (1)(3)     | 80                             | 60                           | 1.00   |
| A691                                                             | CMS-75  | 10,13         | C-Mn-Si             | 1     | (1)(2)(15) | 75                             | 42                           | 0.90   |
|                                                                  | CMS-75  | 11,12         | C-Mn-Si             | 1     | (1)(2)(15) | 75                             | 42                           | 1.00   |
|                                                                  | CMS-75  | 20,23,30,33   | C-Mn-Si             | 1     | (1)(2)     | 75                             | 40                           | 0.90   |
|                                                                  | CMS-75  | 21,22,31,32   | C-Mn-Si             | 1     | (1)(2)     | 75                             | 40                           | 1.00   |
| <b>Copper Brazed Tubing</b>                                      |         |               |                     |       |            |                                |                              |        |
| A254                                                             | ...     | ...           | C                   | ...   | (1)(9)(10) | 42                             | 25                           | 1.00   |
| <b>Plate</b>                                                     |         |               |                     |       |            |                                |                              |        |
| A36                                                              | ...     | ...           | C-Mn-Si             | 1     | (1)(7)(11) | 58                             | 36                           | 0.92   |
| A283                                                             | A       | ...           | C                   | 1     | (1)(7)     | 45                             | 24                           | 0.92   |
|                                                                  | B       | ...           | C                   | 1     | (1)(7)     | 50                             | 27                           | 0.92   |
|                                                                  | C       | ...           | C                   | 1     | (1)(7)     | 55                             | 30                           | 0.92   |
|                                                                  | D       | ...           | C                   | 1     | (1)(7)     | 60                             | 33                           | 0.92   |
| A285                                                             | A       | ...           | C                   | 1     | (2)        | 45                             | 24                           | 1.00   |
|                                                                  | B       | ...           | C                   | 1     | (2)        | 50                             | 27                           | 1.00   |
|                                                                  | C       | ...           | C                   | 1     | (2)        | 55                             | 30                           | 1.00   |
| A299                                                             | ...     | ...           | C-Mn-Si             | 1     | (2)(13)    | 75                             | 40                           | 1.00   |
|                                                                  | ...     | ...           | C-Mn-Si             | 1     | (2)(12)    | 75                             | 42                           | 1.00   |
| A515                                                             | 60      | ...           | C-Si                | 1     | (2)        | 60                             | 32                           | 1.00   |
|                                                                  | 65      | ...           | C-Si                | 1     | (2)        | 65                             | 35                           | 1.00   |
|                                                                  | 70      | ...           | C-Si                | 1     | (2)        | 70                             | 38                           | 1.00   |
| A516                                                             | 55      | ...           | C-Si                | 1     | (2)        | 55                             | 30                           | 1.00   |
|                                                                  | 60      | ...           | C-Mn-Si             | 1     | (2)        | 60                             | 32                           | 1.00   |
|                                                                  | 65      | ...           | C-Mn-Si             | 1     | (2)        | 65                             | 35                           | 1.00   |
|                                                                  | 70      | ...           | C-Mn-Si             | 1     | (2)        | 70                             | 38                           | 1.00   |
| <b>Forgings</b>                                                  |         |               |                     |       |            |                                |                              |        |
| A105                                                             | ...     | ...           | C-Si                | 1     | (2)        | 70                             | 36                           | 1.00   |
| A181                                                             | ...     | 60            | C-Si                | 1     | (2)        | 60                             | 30                           | 1.00   |
|                                                                  | ...     | 70            | C-Si                | 1     | (2)        | 70                             | 36                           | 1.00   |

**Table A-1 Carbon Steel (Cont'd)**

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |         | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|---------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | Grade   |              |
| Electric Fusion Welded Pipe — Filler Metal Added (Cont'd)                                 |      |      |      |      |      |      |      |      |      |         |              |
| 20.6                                                                                      | 20.6 | 20.3 | 20.1 | 20.1 | 20.1 | 20.1 | ...  | ...  | ...  | CMSH-80 | A 691        |
| 22.9                                                                                      | 22.9 | 22.6 | 22.3 | 22.3 | 22.3 | 22.3 | ...  | ...  | ...  | CMSH-80 |              |
| 20.6                                                                                      | 20.6 | 20.3 | 20.1 | 20.1 | 20.1 | 20.1 | ...  | ...  | ...  | CMSH-80 |              |
| 22.9                                                                                      | 22.9 | 22.6 | 22.3 | 22.3 | 22.3 | 22.3 | ...  | ...  | ...  | CMSH-80 |              |
| 19.3                                                                                      | 19.3 | 19.3 | 19.3 | 19.3 | 18.4 | 17.8 | 17.2 | 14.1 | 11.3 | CMS-75  | A691         |
| 21.4                                                                                      | 21.4 | 21.4 | 21.4 | 21.4 | 20.4 | 19.8 | 19.1 | 15.7 | 12.6 | CMS-75  |              |
| 19.3                                                                                      | 19.3 | 19.3 | 19.3 | 19.3 | 18.4 | 17.8 | 17.2 | 14.1 | 11.3 | CMS-75  |              |
| 21.4                                                                                      | 21.4 | 21.4 | 21.4 | 21.4 | 20.4 | 19.8 | 19.1 | 15.7 | 12.6 | CMS-75  |              |
| Copper Brazed Tubing                                                                      |      |      |      |      |      |      |      |      |      |         |              |
| 6.0                                                                                       | 5.5  | 4.8  | 3.0  | ...  | ...  | ...  | ...  | ...  | ...  | ...     | A254         |
| Plate                                                                                     |      |      |      |      |      |      |      |      |      |         |              |
| 15.2                                                                                      | 15.2 | 15.2 | 15.2 | 15.2 | 15.2 | 15.2 | ...  | ...  | ...  | ...     | A36          |
| 11.8                                                                                      | 11.8 | 11.8 | 11.8 | 11.8 | 11.3 | 10.9 | ...  | ...  | ...  | A       | A283         |
| 13.1                                                                                      | 13.1 | 13.1 | 13.1 | 13.1 | 12.7 | 12.3 | ...  | ...  | ...  | B       |              |
| 14.5                                                                                      | 14.5 | 14.5 | 14.5 | 14.5 | 14.1 | 13.6 | ...  | ...  | ...  | C       |              |
| 15.8                                                                                      | 15.8 | 15.8 | 15.8 | 15.8 | 15.5 | 15.0 | ...  | ...  | ...  | D       |              |
| 12.9                                                                                      | 12.9 | 12.9 | 12.9 | 12.9 | 12.3 | 11.9 | 11.5 | 10.7 | 8.3  | A       | A285         |
| 14.3                                                                                      | 14.3 | 14.3 | 14.3 | 14.3 | 13.8 | 13.3 | 12.5 | 11.0 | 9.4  | B       |              |
| 15.7                                                                                      | 15.7 | 15.7 | 15.7 | 15.7 | 15.3 | 14.8 | 14.3 | 13.0 | 10.8 | C       |              |
| 21.4                                                                                      | 21.4 | 21.4 | 21.4 | 21.4 | 20.4 | 19.8 | 19.1 | 15.7 | 12.6 | ...     | A299         |
| 21.4                                                                                      | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 20.8 | 19.6 | 15.7 | 12.6 | ...     |              |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 17.1 | 16.4 | 15.8 | 15.3 | 13.0 | 10.8 | 60      | A515         |
| 18.6                                                                                      | 18.6 | 18.6 | 18.6 | 18.6 | 17.9 | 17.3 | 16.7 | 13.9 | 11.4 | 65      |              |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 19.4 | 18.8 | 18.1 | 14.8 | 12.6 | 70      |              |
| 15.7                                                                                      | 15.7 | 15.7 | 15.7 | 15.7 | 15.3 | 14.8 | 14.3 | 13.0 | 10.8 | 55      | A516         |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 17.1 | 16.4 | 15.8 | 15.3 | 13.0 | 10.8 | 60      |              |
| 18.6                                                                                      | 18.6 | 18.6 | 18.6 | 18.6 | 17.9 | 17.3 | 16.7 | 13.9 | 11.4 | 65      |              |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 19.4 | 18.8 | 18.1 | 14.8 | 12.0 | 70      |              |
| Forgings                                                                                  |      |      |      |      |      |      |      |      |      |         |              |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 19.6 | 18.4 | 17.8 | 17.2 | 14.8 | 12.0 | ...     | A105         |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 16.3 | 15.3 | 14.8 | 14.3 | 13.0 | 10.8 | ...     | A181         |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 19.6 | 18.4 | 17.8 | 17.2 | 14.8 | 12.0 | ...     |              |

Table A-1 Carbon Steel (Cont'd)

| Spec. No.                                     | Grade | Type or Class | Nominal Composition | P-No. | Notes  | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|-----------------------------------------------|-------|---------------|---------------------|-------|--------|--------------------------------|------------------------------|--------|
| <b>Wrought Fittings (Seamless and Welded)</b> |       |               |                     |       |        |                                |                              |        |
| A234                                          | WPB   | ...           | C-Si                | 1     | (2)    | 60                             | 35                           | 1.00   |
|                                               | WPC   | ...           | C-Si                | 1     | (2)    | 70                             | 40                           | 1.00   |
| <b>Castings</b>                               |       |               |                     |       |        |                                |                              |        |
| A216                                          | WCA   | ...           | C-Si                | 1     | (2)(6) | 60                             | 30                           | 0.80   |
|                                               | WCB   | ...           | C-Si                | 1     | (2)(6) | 70                             | 36                           | 0.80   |
|                                               | WCC   | ...           | C-Mn-Si             | 1     | (2)(6) | 70                             | 40                           | 0.80   |
| <b>Bars and Shapes</b>                        |       |               |                     |       |        |                                |                              |        |
| A36                                           | ...   | ...           | C-Mn-Si             | 1     | (1)(2) | 58                             | 36                           | 1.00   |
| A992                                          | ...   | ...           | C-Mn-Si             | 1     | (1)(2) | 65                             | 50                           | 1.00   |

## GENERAL NOTES:

- The tabulated specifications are ANSI/ASTM or ASTM, except API 5L. For ASME Boiler and Pressure Vessel Code applications, see related specifications in Section II of the ASME Code.
- The stress values in this Table may be interpolated to determine values for intermediate temperatures.
- The P-Numbers indicated in this Table are identical to those adopted by ASME Boiler and Pressure Vessel Code. Qualification of welding procedures, welders, and welding operators is required and shall comply with the ASME Boiler and Pressure Vessel Code (Section IX) except as modified by para. 127.5.
- Tensile strengths and allowable stresses shown in "ksi" are "thousands of pounds per square inch."
- The materials listed in this Table shall not be used at design temperatures above those for which allowable stress values are given except as permitted by para. 122.6.2(G).
- The tabulated stress values are  $S \times E$  (weld joint efficiency factor) or  $S \times F$  (material quality factor), as applicable. Weld joint efficiency factors are shown in Table 102.4.3.
- Pressure-temperature ratings of piping components, as published in standards referenced in this Code, may be used for components meeting the requirements of those standards. The allowable stress values given in this Table are for use in designing piping components which are not manufactured in accordance with referenced standards.
- All the materials listed are classified as ferritic [see Table 104.1.2(A)].
- The tabulated stress values that are shown in *italics* are at temperatures in the range where creep and stress rupture strength govern the selection of stresses.

## (12) NOTES:

- THIS MATERIAL IS NOT ACCEPTABLE FOR CONSTRUCTION OF PRESSURE RETAINING PARTS OF BOILER EXTERNAL PIPING — SEE FIGS. 100.1.2(A) AND (B).
- Upon prolonged exposure to temperatures above 800°F (427°C), the carbide phase of carbon steel may be converted to graphite.
- The allowable stress values given are for pipe fabricated from plate not exceeding  $2\frac{1}{2}$  in. in thickness.
- This material shall not be used for flammable fluids. Refer to para. 105.2.1(A).
- Tensile value in parentheses is expected minimum.
- The 0.80 material quality factor for casting may be increased in accordance with para. 102.4.6.
- The stress values for structural quality plate include a material quality factor of 0.92. The allowable stresses for A283 Grade D and A36 plate have been limited to 12.7 ksi.
- These stress values are permitted only if killed or semikilled steels are used.
- A254 is copper brazed (not welded) steel pipe.
- For saturated steam at 250 psi (406°F), the values given for 400°F may be used.
- The allowable stress values listed in MSS SP-58 for this material may be used for pipe supporting elements designed in accordance with MSS SP-58.
- These values apply to material less than or equal to 1 in. thick.
- These values apply to material greater than 1 in. thick.
- This material is not listed in the ASME Boiler and Pressure Vessel Code, Section IX. However, weld procedures shall be qualified in accordance with the P-Number shown. See para. 127.5.1.
- This material shall not be used in nominal wall thicknesses exceeding  $\frac{3}{4}$  in.
- These allowable stress values are for pipe made using a butt-welded joint process. Pipe made by other processes shall not be used.

**Table A-1 Carbon Steel (Cont'd)**

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |       | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|-------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | Grade |              |
| Wrought Fittings (Seamless and Welded)                                                    |      |      |      |      |      |      |      |      |      |       |              |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 15.6 | 13.0 | 10.8 | WPB   | A234         |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 19.8 | 18.3 | 14.8 | 12.0 | WPC   |              |
| Castings                                                                                  |      |      |      |      |      |      |      |      |      |       |              |
| 13.7                                                                                      | 13.7 | 13.7 | 13.7 | 13.0 | 12.2 | 11.8 | 11.4 | 10.4 | 8.6  | WCA   | A216         |
| 16.0                                                                                      | 16.0 | 16.0 | 16.0 | 15.7 | 14.7 | 14.2 | 13.8 | 11.8 | 9.6  | WCB   |              |
| 16.0                                                                                      | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 15.8 | 14.6 | 11.8 | 9.6  | WCC   |              |
| Bars and Shapes                                                                           |      |      |      |      |      |      |      |      |      |       |              |
| 16.6                                                                                      | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 15.6 | 13.0 | 10.8 | ...   | A36          |
| 18.6                                                                                      | 18.6 | 18.6 | 18.6 | 18.6 | 18.6 | 18.6 | 16.9 | 13.9 | 11.4 | ...   | A992         |

(12)

Table A-2 Low and Intermediate Alloy Steel

| Spec. No.                     | Grade | Type or Class | Nominal Composition                                             | P-No. | Notes | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|-------------------------------|-------|---------------|-----------------------------------------------------------------|-------|-------|--------------------------------|------------------------------|--------|
| <b>Seamless Pipe and Tube</b> |       |               |                                                                 |       |       |                                |                              |        |
| A213                          | T2    | ...           | $\frac{1}{2}\text{Cr}-\frac{1}{2}\text{Mo}$                     | 3     | ...   | 60                             | 30                           | 1.00   |
|                               | T5    | ...           | $5\text{Cr}-\frac{1}{2}\text{Mo}$                               | 5B    | ...   | 60                             | 30                           | 1.00   |
|                               | T5b   | ...           | $5\text{Cr}-\frac{1}{2}\text{Mo}-1\frac{1}{2}\text{Si}$         | 5B    | ...   | 60                             | 30                           | 1.00   |
| A213                          | T5c   | ...           | $5\text{Cr}-\frac{1}{2}\text{Mo}-\text{Ti}$                     | 5B    | ...   | 60                             | 30                           | 1.00   |
|                               | T9    | ...           | $9\text{Cr}-1\text{Mo}$                                         | 5B    | ...   | 60                             | 30                           | 1.00   |
|                               | T11   | ...           | $1\frac{1}{4}\text{Cr}-\frac{1}{2}\text{Mo}$                    | 4     | ...   | 60                             | 30                           | 1.00   |
| A213                          | T12   | ...           | $1\text{Cr}-\frac{1}{2}\text{Mo}$                               | 4     | ...   | 60                             | 30                           | 1.00   |
|                               | T21   | ...           | $3\text{Cr}-1\text{Mo}$                                         | 5A    | ...   | 60                             | 30                           | 1.00   |
|                               | T22   | ...           | $2\frac{1}{4}\text{Cr}-1\text{Mo}$                              | 5A    | (5)   | 60                             | 30                           | 1.00   |
|                               | T91   | ...           | $9\text{Cr}-1\text{Mo}-\text{V}$                                | 15E   | (10)  | 85                             | 60                           | 1.00   |
|                               | T91   | ...           | $9\text{Cr}-1\text{Mo}-\text{V}$                                | 15E   | (11)  | 85                             | 60                           | 1.00   |
|                               |       |               |                                                                 |       |       |                                |                              |        |
| A333                          | 3     | ...           | $3\frac{1}{2}\text{Ni}$                                         | 9B    | (1)   | 65                             | 35                           | 1.00   |
|                               | 4     | ...           | $\frac{3}{4}\text{Cr}-\frac{3}{4}\text{Ni}-\text{Cu}-\text{Al}$ | 4     | (1)   | 60                             | 35                           | 1.00   |
|                               | 7     | ...           | $2\frac{1}{2}\text{Ni}$                                         | 9A    | (1)   | 65                             | 35                           | 1.00   |
|                               | 9     | ...           | $2\text{Ni}-1\text{Cu}$                                         | 9A    | (1)   | 63                             | 46                           | 1.00   |
| A335                          | P1    | ...           | $\text{C}-\frac{1}{2}\text{Mo}$                                 | 3     | (2)   | 55                             | 30                           | 1.00   |
|                               | P2    | ...           | $\frac{1}{2}\text{Cr}-\frac{1}{2}\text{Mo}$                     | 3     | ...   | 55                             | 30                           | 1.00   |
|                               | P5    | ...           | $5\text{Cr}-\frac{1}{2}\text{Mo}$                               | 5B    | ...   | 60                             | 30                           | 1.00   |
|                               | P5b   | ...           | $5\text{Cr}-\frac{1}{2}\text{Mo}-1\frac{1}{2}\text{Si}$         | 5B    | ...   | 60                             | 30                           | 1.00   |
| A335                          | P5c   | ...           | $5\text{Cr}-\frac{1}{2}\text{Mo}-\text{Ti}$                     | 5B    | ...   | 60                             | 30                           | 1.00   |
|                               | P9    | ...           | $9\text{Cr}-1\text{Mo}$                                         | 5B    | ...   | 60                             | 30                           | 1.00   |
|                               | P11   | ...           | $1\frac{1}{4}\text{Cr}-\frac{1}{2}\text{Mo}-\text{Si}$          | 4     | ...   | 60                             | 30                           | 1.00   |
| A335                          | P12   | ...           | $1\text{Cr}-\frac{1}{2}\text{Mo}$                               | 4     | ...   | 60                             | 32                           | 1.00   |
|                               | P21   | ...           | $3\text{Cr}-1\text{Mo}$                                         | 5A    | ...   | 60                             | 30                           | 1.00   |
|                               | P22   | ...           | $2\frac{1}{4}\text{Cr}-1\text{Mo}$                              | 5A    | (5)   | 60                             | 30                           | 1.00   |
|                               | P91   | ...           | $9\text{Cr}-1\text{Mo}-\text{V}$                                | 15E   | (10)  | 85                             | 60                           | 1.00   |
|                               | P91   | ...           | $9\text{Cr}-1\text{Mo}-\text{V}$                                | 15E   | (11)  | 85                             | 60                           | 1.00   |
|                               |       |               |                                                                 |       |       |                                |                              |        |
| A369                          | FP1   | ...           | $\text{C}-\frac{1}{2}\text{Mo}$                                 | 3     | (2)   | 55                             | 30                           | 1.00   |
|                               | FP2   | ...           | $\frac{1}{2}\text{Cr}-\frac{1}{2}\text{Mo}$                     | 3     | ...   | 55                             | 30                           | 1.00   |
|                               | FP5   | ...           | $5\text{Cr}-\frac{1}{2}\text{Mo}$                               | 5B    | ...   | 60                             | 30                           | 1.00   |
| A369                          | FP9   | ...           | $9\text{Cr}-1\text{Mo}$                                         | 5B    | ...   | 60                             | 30                           | 1.00   |
|                               | FP11  | ...           | $1\frac{1}{4}\text{Cr}-\frac{1}{2}\text{Mo}-\text{Si}$          | 4     | ...   | 60                             | 30                           | 1.00   |

Table A-2 Low and Intermediate Alloy Steel

(12)

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |       | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|-------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 | Grade |              |
| Seamless Pipe and Tube                                                                    |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |       |              |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 16.9 | 16.4 | 16.1 | 15.7 | 15.4 | 14.9 | 14.5 | 13.9 | 9.2  | 5.9   | ...   | ...   | ...   | ...   | T2    | A213         |
| 17.1                                                                                      | 17.1 | 16.6 | 16.5 | 16.4 | 16.2 | 15.9 | 15.6 | 15.1 | 14.5 | 13.8 | 10.9 | 8.0  | 5.8   | 4.2   | 2.9   | 1.8   | 1.0   | T5    |              |
| 17.1                                                                                      | 17.1 | 16.6 | 16.5 | 16.4 | 16.2 | 15.9 | 15.6 | 15.1 | 14.5 | 13.8 | 10.9 | 8.0  | 5.8   | 4.2   | 2.9   | 1.8   | 1.0   | T5b   |              |
| 17.1                                                                                      | 17.1 | 16.6 | 16.5 | 16.4 | 16.2 | 15.9 | 15.6 | 15.1 | 14.5 | 13.8 | 10.9 | 8.0  | 5.8   | 4.2   | 2.9   | 1.8   | 1.0   | T5c   | A213         |
| 17.1                                                                                      | 17.1 | 16.6 | 16.5 | 16.4 | 16.2 | 15.9 | 15.6 | 15.1 | 14.5 | 13.8 | 13.0 | 10.6 | 7.4   | 5.0   | 3.3   | 2.2   | 1.5   | T9    |              |
| 17.1                                                                                      | 17.1 | 17.1 | 16.8 | 16.2 | 15.7 | 15.4 | 15.1 | 14.8 | 14.4 | 14.0 | 13.6 | 9.3  | 6.3   | 4.2   | 2.8   | ...   | ...   | T11   |              |
| 17.1                                                                                      | 16.8 | 16.5 | 16.5 | 16.5 | 16.3 | 16.0 | 15.8 | 15.5 | 15.3 | 14.9 | 14.5 | 11.3 | 7.2   | 4.5   | 2.8   | ...   | ...   | T12   | A213         |
| 17.1                                                                                      | 17.1 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.0 | 12.0 | 9.0  | 7.0   | 5.5   | 4.0   | ...   | ...   | T21   |              |
| 17.1                                                                                      | 17.1 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 13.6 | 10.8 | 8.0   | 5.7   | 3.8   | ...   | ...   | T22   |              |
| 24.3                                                                                      | 24.3 | 24.3 | 24.2 | 24.1 | 23.7 | 23.4 | 22.9 | 22.2 | 21.3 | 20.3 | 19.1 | 17.8 | 16.3  | 14.0  | 10.3  | 7.0   | 4.3   | T91   |              |
| 24.3                                                                                      | 24.3 | 24.3 | 24.2 | 24.1 | 23.7 | 23.4 | 22.9 | 22.2 | 21.3 | 20.3 | 19.1 | 17.8 | 16.3  | 12.9  | 9.6   | 7.0   | 4.3   | T91   |              |
| 18.6                                                                                      | 18.6 | 18.6 | 18.6 | 18.6 | 17.5 | 16.7 | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | 3     | A333         |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | 4     |              |
| 18.6                                                                                      | 18.6 | 18.6 | 18.6 | 18.6 | 17.5 | 16.7 | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | 7     |              |
| 18.0                                                                                      | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | 9     |              |
| 15.7                                                                                      | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.4 | 14.9 | 14.5 | ...  | ...  | ...   | ...   | ...   | ...   | ...   | P1    | A335         |
| 15.7                                                                                      | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.4 | 14.9 | 14.5 | 13.9 | 9.2  | 5.9   | ...   | ...   | ...   | ...   | P2    |              |
| 17.1                                                                                      | 17.1 | 16.6 | 16.5 | 16.4 | 16.2 | 15.9 | 15.6 | 15.1 | 14.5 | 13.8 | 10.9 | 8.0  | 5.8   | 4.2   | 2.9   | 1.8   | 1.0   | P5    |              |
| 17.1                                                                                      | 17.1 | 16.6 | 16.5 | 16.4 | 16.2 | 15.9 | 15.6 | 15.1 | 14.5 | 13.8 | 10.9 | 8.0  | 5.8   | 4.2   | 2.9   | 1.8   | 1.0   | P5b   |              |
| 17.1                                                                                      | 17.1 | 16.6 | 16.5 | 16.4 | 16.2 | 15.9 | 15.6 | 15.1 | 14.5 | 13.8 | 10.9 | 8.0  | 5.8   | 4.2   | 2.9   | 1.8   | 1.0   | P5c   | A335         |
| 17.1                                                                                      | 17.1 | 16.6 | 16.5 | 16.4 | 16.2 | 15.9 | 15.6 | 15.1 | 14.5 | 13.8 | 13.0 | 10.6 | 7.4   | 5.0   | 3.3   | 2.2   | 1.5   | P9    |              |
| 17.1                                                                                      | 17.1 | 17.1 | 16.8 | 16.2 | 15.7 | 15.4 | 15.1 | 14.8 | 14.4 | 14.0 | 13.6 | 9.3  | 6.3   | 4.2   | 2.8   | ...   | ...   | P11   |              |
| 17.1                                                                                      | 16.8 | 16.5 | 16.5 | 16.5 | 16.3 | 16.0 | 15.8 | 15.5 | 15.3 | 14.9 | 14.5 | 11.3 | 7.2   | 4.5   | 2.8   | ...   | ...   | P12   | A335         |
| 17.1                                                                                      | 17.1 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.0 | 12.0 | 9.0  | 7.0   | 5.5   | 4.0   | ...   | ...   | P21   |              |
| 17.1                                                                                      | 17.1 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 13.6 | 10.8 | 8.0   | 5.7   | 3.8   | ...   | ...   | P22   |              |
| 24.3                                                                                      | 24.3 | 24.3 | 24.2 | 24.1 | 23.7 | 23.4 | 22.9 | 22.2 | 21.3 | 20.3 | 19.1 | 17.8 | 16.3  | 14.0  | 10.3  | 7.0   | 4.3   | P91   |              |
| 24.3                                                                                      | 24.3 | 24.3 | 24.2 | 24.1 | 23.7 | 23.4 | 22.9 | 22.2 | 21.3 | 20.3 | 19.1 | 17.8 | 16.3  | 12.9  | 9.6   | 7.0   | 4.3   | P91   |              |
| 15.7                                                                                      | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.4 | 14.9 | 14.5 | ...  | ...  | ...   | ...   | ...   | ...   | ...   | FP1   | A369         |
| 15.7                                                                                      | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.4 | 14.9 | 14.5 | 13.9 | 9.2  | 5.9   | ...   | ...   | ...   | ...   | FP2   |              |
| 17.1                                                                                      | 17.1 | 16.6 | 16.5 | 16.4 | 16.2 | 15.9 | 15.6 | 15.1 | 14.5 | 13.8 | 10.9 | 8.0  | 5.8   | 4.2   | 2.9   | 1.8   | 1.0   | FP5   |              |
| 17.1                                                                                      | 17.1 | 16.6 | 16.5 | 16.4 | 16.2 | 15.9 | 15.6 | 15.1 | 14.5 | 13.8 | 13.0 | 10.6 | 7.4   | 5.0   | 3.3   | 2.2   | 1.5   | FP9   | A369         |
| 17.1                                                                                      | 17.1 | 17.1 | 16.8 | 16.2 | 15.7 | 15.4 | 15.1 | 14.8 | 14.4 | 14.0 | 13.6 | 9.3  | 6.3   | 4.2   | 2.8   | ...   | ...   | FP11  |              |

Table A-2 Low and Intermediate Alloy Steel (Cont'd)

| Spec. No.                                               | Grade            | Type or Class     | Nominal Composition                  | P-No. | Notes           | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|---------------------------------------------------------|------------------|-------------------|--------------------------------------|-------|-----------------|--------------------------------|------------------------------|--------|
| <b>Seamless Pipe and Tube (Cont'd)</b>                  |                  |                   |                                      |       |                 |                                |                              |        |
| A369                                                    | FP12             | ...               | 1Cr- $\frac{1}{2}$ Mo                | 4     | ...             | 60                             | 32                           | 1.00   |
|                                                         | FP21             | ...               | 3Cr-1Mo                              | 5A    | ...             | 60                             | 30                           | 1.00   |
|                                                         | FP22             | ...               | 2 $\frac{1}{4}$ Cr-1Mo               | 5A    | (5)             | 60                             | 30                           | 1.00   |
| A714                                                    | V                | ...               | 2Ni-1Cu                              | 9A    | (1)             | 65                             | 46                           | 1.00   |
| <b>Centrifugally Cast Pipe</b>                          |                  |                   |                                      |       |                 |                                |                              |        |
| A426                                                    | CP1              | ...               | C- $\frac{1}{2}$ Mo                  | 3     | (1)(2)(3)(4)(7) | 65                             | 35                           | 0.85   |
|                                                         | CP2              | ...               | $\frac{1}{2}$ Cr- $\frac{1}{2}$ Mo   | 3     | (1)(3)(4)(7)    | 60                             | 30                           | 0.85   |
|                                                         | CP5              | ...               | 5Cr- $\frac{1}{2}$ Mo                | 5B    | (1)(3)(4)(7)    | 90                             | 60                           | 0.85   |
|                                                         | CP5b             | ...               | 5Cr- $\frac{1}{2}$ Mo-Si             | 5B    | (1)(3)(4)(7)    | 60                             | 30                           | 0.85   |
| A426                                                    | CP9              | ...               | 9Cr-1Mo                              | 5B    | (1)(3)(4)(7)    | 90                             | 60                           | 0.85   |
|                                                         | CP11             | ...               | 1 $\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo | 4     | (1)(3)(4)(7)    | 70                             | 40                           | 0.85   |
| A426                                                    | CP12             | ...               | 1Cr- $\frac{1}{2}$ Mo                | 4     | (1)(3)(4)(7)    | 60                             | 30                           | 0.85   |
|                                                         | CP21             | ...               | 3Cr-1Mo                              | 5A    | (1)(3)(4)(7)    | 60                             | 30                           | 0.85   |
|                                                         | CP22             | ...               | 2 $\frac{1}{4}$ Cr-1Mo               | 5A    | (1)(3)(4)(5)(7) | 70                             | 40                           | 0.85   |
| <b>Electric Resistance Welded Pipe</b>                  |                  |                   |                                      |       |                 |                                |                              |        |
| A333                                                    | 3                | ...               | 3 $\frac{1}{2}$ Ni                   | 9B    | (1)             | 65                             | 35                           | 0.85   |
|                                                         | 7                | ...               | 2 $\frac{1}{2}$ Ni                   | 9A    | (1)             | 65                             | 35                           | 0.85   |
|                                                         | 9                | ...               | 2Ni-1Cu                              | 9A    | (1)             | 63                             | 46                           | 0.85   |
| A714                                                    | V                | E                 | 2Ni-Cu                               | 9A    | (1)             | 65                             | 46                           | 0.85   |
| <b>Electric Fusion Welded Pipe — Filler Metal Added</b> |                  |                   |                                      |       |                 |                                |                              |        |
| A672                                                    | L65              | 20,23,30,33       | C- $\frac{1}{2}$ Mo                  | 3     | (1)             | 65                             | 37                           | 0.90   |
|                                                         | L65              | 21,22,31,32       | C- $\frac{1}{2}$ Mo                  | 3     | (1)             | 65                             | 37                           | 1.00   |
| A672                                                    | L70              | 20,23,30,33       | C- $\frac{1}{2}$ Mo                  | 3     | (1)             | 70                             | 40                           | 0.90   |
|                                                         | L70              | 21,22,31,32       | C- $\frac{1}{2}$ Mo                  | 3     | (1)             | 70                             | 40                           | 1.00   |
| A672                                                    | L75              | 20,23,30,33       | C- $\frac{1}{2}$ Mo                  | 3     | (1)             | 75                             | 43                           | 0.90   |
|                                                         | L75              | 21,22,31,32       | C- $\frac{1}{2}$ Mo                  | 3     | (1)             | 75                             | 43                           | 1.00   |
| A691                                                    | CM-65            | 20,23,30,33       | C- $\frac{1}{2}$ Mo                  | 3     | (1)             | 65                             | 37                           | 0.90   |
|                                                         | CM-65            | 21,22,31,32       | C- $\frac{1}{2}$ Mo                  | 3     | (1)             | 65                             | 37                           | 1.00   |
| A691                                                    | CM-70            | 20,23,30,33       | C- $\frac{1}{2}$ Mo                  | 3     | (1)             | 70                             | 40                           | 0.90   |
|                                                         | CM-70            | 21,22,31,32       | C- $\frac{1}{2}$ Mo                  | 3     | (1)             | 70                             | 40                           | 1.00   |
| A691                                                    | CM-75            | 20,23,30,33       | C- $\frac{1}{2}$ Mo                  | 3     | (1)             | 75                             | 43                           | 0.90   |
|                                                         | CM-75            | 21,22,31,32       | C- $\frac{1}{2}$ Mo                  | 3     | (1)             | 75                             | 43                           | 1.00   |
| A691                                                    | $\frac{1}{2}$ CR | 20,23             | $\frac{1}{2}$ Cr- $\frac{1}{2}$ Mo   | 3     | (1)(8)          | 55                             | 33                           | 0.90   |
|                                                         | $\frac{1}{2}$ CR | 21,22             | $\frac{1}{2}$ Cr- $\frac{1}{2}$ Mo   | 3     | (1)(8)          | 55                             | 33                           | 1.00   |
|                                                         | $\frac{1}{2}$ CR | 20,23,30,33,40,43 | $\frac{1}{2}$ Cr- $\frac{1}{2}$ Mo   | 3     | (1)(9)          | 70                             | 45                           | 0.90   |
|                                                         | $\frac{1}{2}$ CR | 21,22,31,32,41,42 | $\frac{1}{2}$ Cr- $\frac{1}{2}$ Mo   | 3     | (1)(9)          | 70                             | 45                           | 1.00   |

**Table A-2 Low and Intermediate Alloy Steel (Cont'd)**

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |       |              |  |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|-------|--------------|--|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 | Grade | Spec.<br>No. |  |
| Seamless Pipe and Tube (Cont'd)                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |       |              |  |
| 17.1                                                                                      | 16.8 | 16.5 | 16.5 | 16.5 | 16.3 | 16.0 | 15.8 | 15.5 | 15.3 | 14.9 | 14.5 | 11.3 | 7.2   | 4.5   | 2.8   | ...   | ...   | FP12  | A369         |  |
| 17.1                                                                                      | 17.1 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.0 | 12.0 | 9.0  | 7.0   | 5.5   | 4.0   | ...   | ...   | FP21  |              |  |
| 17.1                                                                                      | 17.1 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 13.6 | 10.8 | 8.0   | 5.7   | 3.8   | ...   | ...   | FP22  |              |  |
| 18.6                                                                                      | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | V     | A714         |  |
| Centrifugally Cast Pipe                                                                   |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |       |              |  |
| 15.8                                                                                      | 15.8 | 15.8 | 15.8 | 15.8 | 15.8 | 15.8 | 15.6 | 15.2 | 14.8 | 14.4 | ...  | ...  | ...   | ...   | ...   | ...   | ...   | CP1   | A426         |  |
| 14.5                                                                                      | 14.5 | 14.5 | 14.5 | 14.4 | 13.9 | 13.7 | 13.3 | 13.1 | 12.7 | 12.3 | 11.8 | 7.8  | 5.0   | ...   | ...   | ...   | ...   | CP2   |              |  |
| 21.9                                                                                      | 21.8 | 21.2 | 21.0 | 20.9 | 20.6 | 20.3 | 19.9 | 19.3 | 18.5 | 12.2 | 9.3  | 6.8  | 4.9   | 3.6   | 2.5   | 1.5   | 0.85  | CP5   |              |  |
| 14.6                                                                                      | 14.5 | 14.1 | 14.0 | 14.0 | 13.8 | 13.5 | 13.3 | 12.9 | 12.4 | 11.8 | 9.3  | 6.8  | 4.9   | 3.6   | 2.5   | 1.5   | 0.85  | CP5b  |              |  |
| 21.9                                                                                      | 21.8 | 21.2 | 21.0 | 20.9 | 20.7 | 20.3 | 19.9 | 19.3 | 18.5 | 17.7 | 14.0 | 9.4  | 6.3   | 4.3   | 2.8   | 1.9   | 1.3   | CP9   | A426         |  |
| 17.0                                                                                      | 17.0 | 17.0 | 17.0 | 17.0 | 17.0 | 17.0 | 17.0 | 16.7 | 16.3 | 15.9 | 11.6 | 7.9  | 5.4   | 3.6   | 2.4   | ...   | ...   | CP11  |              |  |
| 14.5                                                                                      | 14.3 | 14.0 | 13.8 | 13.3 | 12.9 | 12.8 | 12.6 | 12.4 | 12.2 | 11.9 | 11.6 | 9.6  | 6.1   | 3.8   | 2.4   | ...   | ...   | CP12  | A426         |  |
| 14.5                                                                                      | 14.5 | 14.1 | 14.1 | 14.1 | 14.1 | 14.1 | 14.1 | 14.1 | 14.1 | 13.6 | 10.2 | 7.7  | 6.0   | 4.7   | 3.4   | ...   | ...   | CP21  |              |  |
| 17.0                                                                                      | 17.0 | 16.7 | 16.5 | 16.4 | 16.3 | 16.2 | 16.0 | 15.7 | 15.2 | 14.6 | 13.4 | 9.7  | 6.6   | 4.3   | 2.7   | ...   | ...   | CP22  |              |  |
| Electric Resistance Welded Pipe                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |       |              |  |
| 15.8                                                                                      | 15.8 | 15.8 | 15.8 | 15.8 | 14.9 | 14.2 | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | 3     | A333         |  |
| 15.8                                                                                      | 15.8 | 15.8 | 15.8 | 15.8 | 14.9 | 14.2 | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | 7     |              |  |
| 15.3                                                                                      | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | 9     |              |  |
| 15.8                                                                                      | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | V     | A714         |  |
| Electric Fusion Welded Pipe — Filler Metal Added                                          |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |       |              |  |
| 16.7                                                                                      | 16.7 | 16.7 | 16.7 | 16.7 | 16.7 | 16.7 | 16.7 | 16.7 | 16.6 | 16.1 | ...  | ...  | ...   | ...   | ...   | ...   | ...   | L65   | A672         |  |
| 18.6                                                                                      | 18.6 | 18.6 | 18.6 | 18.6 | 18.6 | 18.6 | 18.6 | 18.6 | 18.4 | 17.9 | ...  | ...  | ...   | ...   | ...   | ...   | ...   | L65   |              |  |
| 18.0                                                                                      | 18.0 | 18.0 | 18.0 | 18.0 | 18.0 | 18.0 | 18.0 | 18.0 | 17.9 | 17.4 | ...  | ...  | ...   | ...   | ...   | ...   | ...   | L70   | A672         |  |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 19.9 | 19.3 | ...  | ...   | ...   | ...   | ...   | ...   | L70   |              |  |
| 19.3                                                                                      | 19.3 | 19.3 | 19.3 | 19.3 | 19.3 | 19.3 | 19.3 | 19.3 | 19.3 | 18.7 | ...  | ...  | ...   | ...   | ...   | ...   | ...   | L75   | A672         |  |
| 21.4                                                                                      | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 20.7 | ...  | ...  | ...   | ...   | ...   | ...   | ...   | L75   |              |  |
| 16.7                                                                                      | 16.7 | 16.7 | 16.7 | 16.7 | 16.7 | 16.7 | 16.7 | 16.7 | 16.6 | 16.1 | ...  | ...  | ...   | ...   | ...   | ...   | ...   | CM-65 | A691         |  |
| 18.6                                                                                      | 18.6 | 18.6 | 18.6 | 18.6 | 18.6 | 18.6 | 18.6 | 18.6 | 18.4 | 17.9 | ...  | ...  | ...   | ...   | ...   | ...   | ...   | CM-65 |              |  |
| 18.0                                                                                      | 18.0 | 18.0 | 18.0 | 18.0 | 18.0 | 18.0 | 18.0 | 18.0 | 17.9 | 17.4 | ...  | ...  | ...   | ...   | ...   | ...   | ...   | CM-70 | A691         |  |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 19.9 | 19.3 | ...  | ...   | ...   | ...   | ...   | ...   | CM-70 |              |  |
| 19.3                                                                                      | 19.3 | 19.3 | 19.3 | 19.3 | 19.3 | 19.3 | 19.3 | 19.3 | 19.3 | 18.7 | ...  | ...  | ...   | ...   | ...   | ...   | ...   | CM-75 | A691         |  |
| 21.4                                                                                      | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 20.7 | ...  | ...  | ...   | ...   | ...   | ...   | ...   | CM-75 |              |  |
| 14.1                                                                                      | 14.1 | 14.1 | 14.1 | 14.1 | 14.1 | 14.1 | 14.1 | 14.1 | 14.1 | 13.8 | 12.9 | 8.3  | 5.3   | ...   | ...   | ...   | ...   | 1/2CR | A691         |  |
| 15.7                                                                                      | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.3 | 14.3 | 9.2  | 5.9   | ...   | ...   | ...   | ...   | 1/2CR |              |  |
| 18.0                                                                                      | 18.0 | 18.0 | 18.0 | 18.0 | 18.0 | 18.0 | 18.0 | 18.0 | 18.0 | 17.6 | 16.7 | 8.3  | 5.3   | ...   | ...   | ...   | ...   | 1/2CR |              |  |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 19.5 | 18.6 | 9.2  | 5.9   | ...   | ...   | ...   | ...   | 1/2CR |              |  |

Table A-2 Low and Intermediate Alloy Steel (Cont'd)

| Spec. No.                                                        | Grade             | Type or Class     | Nominal Composition                    | P-No. | Notes     | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|------------------------------------------------------------------|-------------------|-------------------|----------------------------------------|-------|-----------|--------------------------------|------------------------------|--------|
| <b>Electric Fusion Welded Pipe — Filler Metal Added (Cont'd)</b> |                   |                   |                                        |       |           |                                |                              |        |
| A691                                                             | 1CR               | 20,23             | 1Cr- $\frac{1}{2}$ Mo                  | 4     | (1)(8)    | 55                             | 33                           | 0.90   |
|                                                                  | 1CR               | 21,22             | 1Cr- $\frac{1}{2}$ Mo                  | 4     | (1)(8)    | 55                             | 33                           | 1.00   |
|                                                                  | 1CR               | 20,23,30,33,40,43 | 1Cr- $\frac{1}{2}$ Mo                  | 4     | (1)(9)    | 65                             | 40                           | 0.90   |
|                                                                  | 1CR               | 21,22,31,32,41,42 | 1Cr- $\frac{1}{2}$ Mo                  | 4     | (1)(9)    | 65                             | 40                           | 1.00   |
| A691                                                             | $1\frac{1}{4}$ CR | 20,23             | $1\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo-Si | 4     | (1)(8)    | 60                             | 35                           | 0.90   |
|                                                                  | $1\frac{1}{4}$ CR | 21,22             | $1\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo-Si | 4     | (1)(8)    | 60                             | 35                           | 1.00   |
|                                                                  | $1\frac{1}{4}$ CR | 20,23,30,33,40,43 | $1\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo-Si | 4     | (1)(9)    | 75                             | 45                           | 0.90   |
|                                                                  | $1\frac{1}{4}$ CR | 21,22,31,32,41,42 | $1\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo-Si | 4     | (1)(9)    | 75                             | 45                           | 1.00   |
| A691                                                             | $2\frac{1}{4}$ CR | 20,23             | $2\frac{1}{4}$ Cr-1Mo                  | 5A    | (1)(5)(8) | 60                             | 30                           | 0.90   |
|                                                                  | $2\frac{1}{4}$ CR | 21,22             | $2\frac{1}{4}$ Cr-1Mo                  | 5A    | (1)(5)(8) | 60                             | 30                           | 1.00   |
|                                                                  | $2\frac{1}{4}$ CR | 20,23,30,33,40,43 | $2\frac{1}{4}$ Cr-1Mo                  | 5A    | (1)(5)(9) | 75                             | 45                           | 0.90   |
|                                                                  | $2\frac{1}{4}$ CR | 21,22,31,32,41,42 | $2\frac{1}{4}$ Cr-1Mo                  | 5A    | (1)(5)(9) | 75                             | 45                           | 1.00   |
| A691                                                             | 3CR               | 20,23             | 3Cr-1Mo                                | 5A    | (1)(8)    | 60                             | 30                           | 0.90   |
|                                                                  | 3CR               | 21,22             | 3Cr-1Mo                                | 5A    | (1)(8)    | 60                             | 30                           | 1.00   |
|                                                                  | 3CR               | 20,23,30,33,40,43 | 3Cr-1Mo                                | 5A    | (1)(9)    | 75                             | 45                           | 0.90   |
|                                                                  | 3CR               | 21,22,31,32,41,42 | 3Cr-1Mo                                | 5A    | (1)(9)    | 75                             | 45                           | 1.00   |
| A691                                                             | 5CR               | 20,23             | 5Cr- $\frac{1}{2}$ Mo                  | 5B    | (1)(8)    | 60                             | 30                           | 0.90   |
|                                                                  | 5CR               | 21,22             | 5Cr- $\frac{1}{2}$ Mo                  | 5B    | (1)(8)    | 60                             | 30                           | 1.00   |
|                                                                  | 5CR               | 20,23,30,33,40,43 | 5Cr- $\frac{1}{2}$ Mo                  | 5B    | (1)(9)    | 75                             | 45                           | 0.90   |
|                                                                  | 5CR               | 21,22,31,32,41,42 | 5Cr- $\frac{1}{2}$ Mo                  | 5B    | (1)(9)    | 75                             | 45                           | 1.00   |
| A691                                                             | 91                | 40,43,50,53       | 9Cr-1Mo-V                              | 15E   | (1)(9)    | 85                             | 60                           | 0.90   |
|                                                                  | 91                | 41,42,51,52       | 9Cr-1Mo-V                              | 15E   | (1)(9)    | 85                             | 60                           | 1.00   |
| <b>Plate</b>                                                     |                   |                   |                                        |       |           |                                |                              |        |
| A387                                                             | 2                 | 1                 | $\frac{1}{2}$ Cr- $\frac{1}{2}$ Mo     | 3     | ...       | 55                             | 33                           | 1.00   |
|                                                                  | 2                 | 2                 | $\frac{1}{2}$ Cr- $\frac{1}{2}$ Mo     | 3     | (1)       | 70                             | 45                           | 1.00   |
|                                                                  | 5                 | 1                 | 5Cr- $\frac{1}{2}$ Mo                  | 5B    | ...       | 60                             | 30                           | 1.00   |
|                                                                  | 5                 | 2                 | 5Cr- $\frac{1}{2}$ Mo                  | 5B    | (1)       | 75                             | 45                           | 1.00   |
| A387                                                             | 11                | 1                 | $1\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo-Si | 4     | ...       | 60                             | 35                           | 1.00   |
|                                                                  | 11                | 2                 | $1\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo-Si | 4     | ...       | 75                             | 45                           | 1.00   |
|                                                                  | 12                | 1                 | 1Cr- $\frac{1}{2}$ Mo                  | 4     | ...       | 55                             | 33                           | 1.00   |
|                                                                  | 12                | 2                 | 1Cr- $\frac{1}{2}$ Mo                  | 4     | ...       | 65                             | 40                           | 1.00   |
| A387                                                             | 21                | 1                 | 3Cr-1Mo                                | 5A    | ...       | 60                             | 30                           | 1.00   |
|                                                                  | 21                | 2                 | 3Cr-1Mo                                | 5A    | ...       | 75                             | 45                           | 1.00   |
|                                                                  | 22                | 1                 | $2\frac{1}{4}$ Cr-1Mo                  | 5A    | (5)       | 60                             | 30                           | 1.00   |
|                                                                  | 22                | 2                 | $2\frac{1}{4}$ Cr-1Mo                  | 5A    | (5)       | 75                             | 45                           | 1.00   |
| A387                                                             | 91                | 2                 | 9Cr-1Mo-V                              | 15E   | (10)      | 85                             | 60                           | 1.00   |
|                                                                  | 91                | 2                 | 9Cr-1Mo-V                              | 15E   | (11)      | 85                             | 60                           | 1.00   |

**Table A-2 Low and Intermediate Alloy Steel (Cont'd)**

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |       | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|-------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 | Grade |              |
| Electric Fusion Welded Pipe — Filler Metal Added (Cont'd)                                 |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |       |              |
| 14.1                                                                                      | 13.9 | 13.6 | 13.6 | 13.6 | 13.6 | 13.6 | 13.6 | 13.6 | 13.6 | 13.6 | 13.2 | 10.2 | 6.5   | 4.1   | 2.5   | ...   | ...   | 1CR   | A691         |
| 15.7                                                                                      | 15.4 | 15.1 | 15.1 | 15.1 | 15.1 | 15.1 | 15.1 | 15.1 | 15.1 | 15.1 | 14.7 | 11.3 | 7.2   | 4.5   | 2.8   | ...   | ...   | 1CR   |              |
| 16.7                                                                                      | 16.4 | 16.1 | 16.1 | 16.1 | 16.1 | 16.1 | 16.1 | 16.1 | 16.1 | 16.1 | 15.6 | 10.2 | 6.5   | 4.1   | 2.5   | ...   | ...   | 1CR   |              |
| 18.6                                                                                      | 18.2 | 17.9 | 17.9 | 17.9 | 17.9 | 17.9 | 17.9 | 17.9 | 17.9 | 17.9 | 17.4 | 11.3 | 7.2   | 4.5   | 2.8   | ...   | ...   | 1CR   |              |
| 15.4                                                                                      | 15.4 | 15.4 | 15.4 | 15.4 | 15.4 | 15.4 | 15.4 | 15.4 | 15.1 | 14.7 | 12.3 | 8.4  | 5.7   | 3.8   | 2.5   | ...   | ...   | 1¼CR  | A691         |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 16.8 | 16.4 | 13.7 | 9.3  | 6.3   | 4.2   | 2.8   | ...   | ...   | 1¼CR  |              |
| 19.3                                                                                      | 19.3 | 19.3 | 19.3 | 19.3 | 19.3 | 19.3 | 19.3 | 19.3 | 19.3 | 18.2 | 12.3 | 8.4  | 5.7   | 3.8   | 2.5   | ...   | ...   | 1¼CR  |              |
| 21.4                                                                                      | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 20.2 | 13.7 | 9.3  | 6.3   | 4.2   | 2.8   | ...   | ...   | 1¼CR  |              |
| 15.4                                                                                      | 15.4 | 15.0 | 14.9 | 14.8 | 14.6 | 14.4 | 14.2 | 14.0 | 13.7 | 13.4 | 13.0 | 10.3 | 7.0   | 4.6   | 2.9   | ...   | ...   | 2¼CR  | A691         |
| 17.1                                                                                      | 17.1 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 13.6 | 10.8 | 8.0   | 5.7   | 3.8   | ...   | ...   | 2¼CR  |              |
| 19.3                                                                                      | 19.3 | 18.8 | 18.6 | 18.5 | 18.3 | 18.2 | 18.0 | 17.7 | 17.4 | 16.8 | 14.2 | 10.3 | 7.0   | 4.6   | 2.9   | ...   | ...   | 2¼CR  |              |
| 21.4                                                                                      | 21.4 | 20.9 | 20.6 | 20.5 | 20.4 | 20.2 | 20.0 | 19.7 | 19.3 | 18.7 | 15.8 | 11.4 | 7.8   | 5.1   | 3.2   | ...   | ...   | 2¼CR  |              |
| 15.4                                                                                      | 15.4 | 15.0 | 15.0 | 15.0 | 15.0 | 15.0 | 15.0 | 15.0 | 15.0 | 14.4 | 10.8 | 8.1  | 6.3   | 5.0   | 3.6   | ...   | ...   | 3CR   | A691         |
| 17.1                                                                                      | 17.1 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.0 | 12.0 | 9.0  | 7.0   | 5.5   | 4.0   | ...   | ...   | 3CR   |              |
| 19.3                                                                                      | 19.3 | 18.8 | 18.6 | 18.5 | 18.3 | 18.2 | 18.0 | 17.7 | 17.4 | 16.3 | 11.8 | 8.6  | 6.1   | 4.4   | 2.9   | ...   | ...   | 3CR   |              |
| 21.4                                                                                      | 21.4 | 20.9 | 20.6 | 20.5 | 20.4 | 20.2 | 20.0 | 19.7 | 19.3 | 18.1 | 13.1 | 9.5  | 6.8   | 4.9   | 3.2   | ...   | ...   | 3CR   |              |
| 15.4                                                                                      | 15.4 | 14.9 | 14.8 | 14.8 | 14.6 | 14.3 | 14.0 | 13.6 | 13.1 | 12.5 | 9.8  | 7.2  | 5.2   | 3.8   | 2.6   | 1.6   | 0.9   | 5CR   | A691         |
| 17.1                                                                                      | 17.1 | 16.6 | 16.5 | 16.4 | 16.2 | 15.9 | 15.6 | 15.1 | 14.5 | 13.8 | 10.9 | 8.0  | 5.8   | 4.2   | 2.9   | 1.8   | 1.0   | 5CR   |              |
| 19.3                                                                                      | 19.2 | 18.7 | 18.5 | 18.5 | 18.2 | 17.9 | 17.5 | 17.0 | 16.4 | 12.9 | 9.8  | 7.2  | 5.2   | 3.8   | 2.6   | 1.6   | 0.9   | 5CR   |              |
| 21.4                                                                                      | 21.4 | 20.8 | 20.6 | 20.5 | 20.2 | 19.9 | 19.5 | 18.9 | 18.2 | 14.3 | 10.9 | 8.0  | 5.8   | 4.2   | 2.9   | 1.8   | 1.0   | 5CR   |              |
| 21.9                                                                                      | 21.9 | 21.9 | 21.8 | 21.7 | 21.4 | 21.0 | 20.6 | 20.0 | 19.2 | 18.3 | 17.2 | 16.0 | 14.7  | 12.6  | 9.3   | 6.3   | 3.8   | 91    | A691         |
| 24.3                                                                                      | 24.3 | 24.3 | 24.2 | 24.1 | 23.7 | 23.4 | 22.9 | 22.2 | 21.3 | 20.3 | 19.1 | 17.8 | 16.3  | 14.0  | 10.3  | 7.0   | 4.3   | 91    |              |
| Plate                                                                                     |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |       |              |
| 15.7                                                                                      | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.3 | 14.3 | 9.2  | 5.9   | ...   | ...   | ...   | ...   | 2     | A387         |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 19.5 | 18.6 | 9.2  | 5.9   | ...   | ...   | ...   | ...   | 2     |              |
| 17.1                                                                                      | 17.1 | 16.6 | 16.5 | 16.4 | 16.2 | 15.9 | 15.6 | 15.1 | 14.5 | 13.8 | 10.9 | 8.0  | 5.8   | 4.2   | 2.9   | 1.8   | 1.0   | 5     |              |
| 21.4                                                                                      | 21.4 | 20.8 | 20.6 | 20.5 | 20.2 | 19.9 | 19.5 | 18.9 | 18.2 | 14.3 | 10.9 | 8.0  | 5.8   | 4.2   | 2.9   | 1.8   | 1.0   | 5     |              |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 16.8 | 16.4 | 13.7 | 9.3  | 6.3   | 4.2   | 2.8   | ...   | ...   | 11    | A387         |
| 21.4                                                                                      | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 20.2 | 13.7 | 9.3  | 6.3   | 4.2   | 2.8   | ...   | ...   | 11    |              |
| 15.7                                                                                      | 15.4 | 15.1 | 15.1 | 15.1 | 15.1 | 15.1 | 15.1 | 15.1 | 15.1 | 15.1 | 14.7 | 11.3 | 7.2   | 4.5   | 2.8   | ...   | ...   | 12    |              |
| 18.6                                                                                      | 18.2 | 17.9 | 17.9 | 17.9 | 17.9 | 17.9 | 17.9 | 17.9 | 17.9 | 17.9 | 17.4 | 11.3 | 7.2   | 4.5   | 2.8   | ...   | ...   | 12    |              |
| 17.1                                                                                      | 17.1 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.0 | 12.0 | 9.0  | 7.0   | 5.5   | 4.0   | ...   | ...   | 21    | A387         |
| 21.4                                                                                      | 21.4 | 20.9 | 20.6 | 20.5 | 20.4 | 20.2 | 20.0 | 19.7 | 19.3 | 18.1 | 13.1 | 9.5  | 6.8   | 4.9   | 3.2   | ...   | ...   | 21    |              |
| 17.1                                                                                      | 17.1 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 13.6 | 10.8 | 8.0   | 5.7   | 3.8   | ...   | ...   | 22    |              |
| 21.4                                                                                      | 21.4 | 20.9 | 20.6 | 20.5 | 20.4 | 20.2 | 20.0 | 19.7 | 19.3 | 18.7 | 15.8 | 11.4 | 7.8   | 5.1   | 3.2   | ...   | ...   | 22    |              |
| 24.3                                                                                      | 24.3 | 24.3 | 24.2 | 24.1 | 23.7 | 23.4 | 22.9 | 22.2 | 21.3 | 20.3 | 19.1 | 17.8 | 16.3  | 14.0  | 10.3  | 7.0   | 4.3   | 91    | A387         |
| 24.3                                                                                      | 24.3 | 24.3 | 24.2 | 24.1 | 23.7 | 23.4 | 22.9 | 22.2 | 21.3 | 20.3 | 19.1 | 17.8 | 16.3  | 12.9  | 9.6   | 7.0   | 4.3   | 91    |              |

Table A-2 Low and Intermediate Alloy Steel (Cont'd)

| Spec. No.                                     | Grade | Type or Class | Nominal Composition                      | P-No. | Notes | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|-----------------------------------------------|-------|---------------|------------------------------------------|-------|-------|--------------------------------|------------------------------|--------|
| <b>Forgings</b>                               |       |               |                                          |       |       |                                |                              |        |
| A182                                          | F1    | ...           | C- $\frac{1}{2}$ Mo                      | 3     | (2)   | 70                             | 40                           | 1.00   |
|                                               | F2    | ...           | $\frac{1}{2}$ Cr- $\frac{1}{2}$ Mo       | 3     | ...   | 70                             | 40                           | 1.00   |
|                                               | F5    | ...           | 5Cr- $\frac{1}{2}$ Mo                    | 5B    | ...   | 70                             | 40                           | 1.00   |
|                                               | F5a   | ...           | 5Cr- $\frac{1}{2}$ Mo                    | 5B    | ...   | 90                             | 65                           | 1.00   |
| A182                                          | F9    | ...           | 9Cr-1Mo                                  | 5B    | ...   | 85                             | 55                           | 1.00   |
|                                               | F91   | ...           | 9Cr-1Mo-V                                | 15E   | ...   | 85                             | 60                           | 1.00   |
|                                               | F11   | Class 1       | $1\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo-Si   | 4     | ...   | 60                             | 30                           | 1.00   |
|                                               | F11   | Class 2       | $1\frac{1}{4}$ Cr- $\frac{1}{4}$ Mo-Si   | 4     | ...   | 70                             | 40                           | 1.00   |
|                                               | F11   | Class 3       | $1\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo-Si   | 4     | ...   | 75                             | 45                           | 1.00   |
|                                               | F12   | Class 1       | 1Cr- $\frac{1}{2}$ Mo                    | 4     | ...   | 60                             | 30                           | 1.00   |
|                                               | F12   | Class 2       | 1Cr- $\frac{1}{2}$ Mo                    | 4     | ...   | 70                             | 40                           | 1.00   |
|                                               | F21   | ...           | 3Cr-1Mo                                  | 5A    | ...   | 75                             | 45                           | 1.00   |
|                                               | F22   | Class 1       | $2\frac{1}{4}$ Cr-1Mo                    | 5A    | (5)   | 60                             | 30                           | 1.00   |
|                                               | F22   | Class 3       | $2\frac{1}{4}$ Cr-1Mo                    | 5A    | (5)   | 75                             | 45                           | 1.00   |
| A336                                          | F1    | ...           | C- $\frac{1}{2}$ Mo                      | 3     | (2)   | 70                             | 40                           | 1.00   |
|                                               | F5    | ...           | 5Cr- $\frac{1}{2}$ Mo                    | 5B    | ...   | 60                             | 36                           | 1.00   |
|                                               | F5A   | ...           | 5Cr- $\frac{1}{2}$ Mo                    | 5B    | ...   | 80                             | 50                           | 1.00   |
|                                               | F11   | Class 1       | $1\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo-Si   | 4     | ...   | 60                             | 30                           | 1.00   |
|                                               | F11   | Class 2       | $1\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo-Si   | 4     | ...   | 70                             | 40                           | 1.00   |
|                                               | F11   | Class 3       | $1\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo-Si   | 4     | ...   | 75                             | 45                           | 1.00   |
|                                               | F12   | ...           | 1Cr- $\frac{1}{2}$ Mo                    | 4     | ...   | 70                             | 40                           | 1.00   |
|                                               | F21   | Class 1       | 3Cr-1Mo                                  | 5A    | ...   | 60                             | 30                           | 1.00   |
|                                               | F21   | Class 3       | 3Cr-1Mo                                  | 5A    | ...   | 75                             | 45                           | 1.00   |
|                                               | F22   | Class 1       | $2\frac{1}{4}$ Cr-1Mo                    | 5A    | (5)   | 60                             | 30                           | 1.00   |
|                                               | F22   | Class 3       | $2\frac{1}{4}$ Cr-1Mo                    | 5A    | (5)   | 75                             | 45                           | 1.00   |
|                                               | F91   | ...           | 9Cr-1Mo-V                                | 15E   | (10)  | 85                             | 60                           | 1.00   |
|                                               | F91   | ...           | 9Cr-1Mo-V                                | 15E   | (11)  | 85                             | 60                           | 1.00   |
| A350                                          | LF3   | ...           | $3\frac{1}{2}$ Ni                        | 9B    | (1)   | 70                             | 40                           | 1.00   |
|                                               | LF4   | ...           | $\frac{3}{4}$ Cr- $\frac{3}{4}$ Ni-Cu-Al | 4     | (1)   | 60                             | ...                          | 1.00   |
|                                               | LF5   | Class 1       | $1\frac{1}{2}$ Ni                        | 9A    | (1)   | 60                             | 30                           | 1.00   |
|                                               | LF5   | Class 2       | $1\frac{1}{2}$ Ni                        | 9A    | (1)   | 70                             | 37                           | 1.00   |
|                                               | LF9   | ...           | 2Ni-1Cu                                  | 9A    | (1)   | 63                             | 46                           | 1.00   |
| <b>Wrought Fittings (Seamless and Welded)</b> |       |               |                                          |       |       |                                |                              |        |
| A234                                          | WP1   | ...           | C- $\frac{1}{2}$ Mo                      | 3     | (2)   | 55                             | 30                           | 1.00   |
|                                               | WP5   | Class 1       | 5Cr- $\frac{1}{2}$ Mo                    | 5B    | ...   | 60                             | 30                           | 1.00   |
|                                               | WP5   | Class 3       | 5Cr- $\frac{1}{2}$ Mo                    | 5B    | ...   | 75                             | 45                           | 1.00   |
|                                               | WP9   | Class 1       | 9Cr-1Mo                                  | 5B    | ...   | 60                             | 30                           | 1.00   |
|                                               | WP11  | Class 1       | $1\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo      | 4     | ...   | 60                             | 30                           | 1.00   |
|                                               | WP11  | Class 3       | $1\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo      | 4     | ...   | 75                             | 45                           | 1.00   |
|                                               | WP12  | Class 1       | 1Cr- $\frac{1}{2}$ Mo                    | 4     | (6)   | 60                             | 32                           | 1.00   |
|                                               | WP12  | Class 2       | 1Cr- $\frac{1}{2}$ Mo                    | 4     | ...   | 70                             | 40                           | 1.00   |
| A234                                          | WP22  | Class 1       | $2\frac{1}{4}$ Cr-1Mo                    | 5A    | (5)   | 60                             | 30                           | 1.00   |
|                                               | WP22  | Class 3       | $2\frac{1}{4}$ Cr-1Mo                    | 5A    | (5)   | 75                             | 45                           | 1.00   |
|                                               | WP91  | ...           | 9Cr-1Mo-V                                | 15E   | (10)  | 85                             | 60                           | 1.00   |
|                                               | WP91  | ...           | 9Cr-1Mo-V                                | 15E   | (11)  | 85                             | 60                           | 1.00   |

**Table A-2 Low and Intermediate Alloy Steel (Cont'd)**

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |       | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|-------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 | Grade |              |
| <b>Forgings</b>                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |       |              |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 19.9 | 19.3 | ...  | ...  | ...   | ...   | ...   | ...   | ...   | F1    | A182         |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 19.9 | 19.3 | 18.6 | 9.2  | 5.9   | ...   | ...   | ...   | ...   | F2    |              |
| 20.0                                                                                      | 20.0 | 19.4 | 19.2 | 19.2 | 18.9 | 18.6 | 18.2 | 17.6 | 17.0 | 14.3 | 10.9 | 8.0  | 5.8   | 4.2   | 2.9   | 1.8   | 1.0   | F5    |              |
| 25.7                                                                                      | 25.7 | 24.9 | 24.7 | 24.6 | 24.3 | 23.9 | 23.4 | 22.7 | 19.1 | 14.3 | 10.9 | 8.0  | 5.8   | 4.2   | 2.9   | 1.8   | 1.0   | F5a   |              |
| 24.3                                                                                      | 24.2 | 23.5 | 23.4 | 23.3 | 22.9 | 22.6 | 22.1 | 21.4 | 20.6 | 19.6 | 16.4 | 11.0 | 7.4   | 5.0   | 3.3   | 2.2   | 1.5   | F9    | A182         |
| 24.3                                                                                      | 24.3 | 24.3 | 24.2 | 24.1 | 23.7 | 23.4 | 22.9 | 22.2 | 21.3 | 20.3 | 19.1 | 17.8 | 16.3  | 14.0  | 10.3  | 7.0   | 4.3   | F91   |              |
| 17.1                                                                                      | 17.1 | 17.1 | 16.8 | 16.2 | 15.7 | 15.4 | 15.1 | 14.8 | 14.4 | 14.0 | 13.6 | 9.3  | 6.3   | 4.2   | 2.8   | ...   | ...   | F11   |              |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 19.7 | 19.2 | 18.7 | 13.7 | 9.3  | 6.3   | 4.2   | 2.8   | ...   | ...   | F11   |              |
| 21.4                                                                                      | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 20.2 | 13.7 | 9.3  | 6.3   | 4.2   | 2.8   | ...   | ...   | F11   |              |
| 17.1                                                                                      | 16.8 | 16.5 | 16.5 | 16.5 | 16.3 | 16.0 | 15.8 | 15.5 | 15.3 | 14.9 | 14.5 | 11.3 | 7.2   | 4.5   | 2.8   | ...   | ...   | F12   |              |
| 20.0                                                                                      | 19.6 | 19.2 | 19.2 | 19.2 | 19.2 | 19.2 | 19.2 | 19.2 | 19.1 | 18.6 | 18.0 | 11.3 | 7.2   | 4.5   | 2.8   | ...   | ...   | F12   |              |
| 21.4                                                                                      | 21.4 | 20.9 | 20.6 | 20.5 | 20.4 | 20.2 | 20.0 | 19.7 | 19.3 | 18.1 | 13.1 | 9.5  | 6.8   | 4.9   | 3.2   | ...   | ...   | F21   |              |
| 17.1                                                                                      | 17.1 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 13.6 | 10.8 | 8.0  | 5.7   | 3.8   | ...   | ...   | ...   | F22   |              |
| 21.4                                                                                      | 21.4 | 20.9 | 20.6 | 20.5 | 20.4 | 20.2 | 20.0 | 19.7 | 19.3 | 18.7 | 15.8 | 11.4 | 7.8   | 5.1   | 3.2   | ...   | ...   | F22   |              |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 19.9 | 19.3 | 13.7 | 8.2  | 4.8   | ...   | ...   | ...   | ...   | F1    | A336         |
| 17.1                                                                                      | 17.1 | 16.6 | 16.5 | 16.4 | 16.2 | 15.9 | 15.6 | 15.1 | 14.5 | 13.8 | 10.9 | 8.0  | 5.8   | 4.2   | 2.9   | 1.8   | 1.0   | F5    |              |
| 22.9                                                                                      | 22.8 | 22.1 | 22.0 | 21.9 | 21.6 | 21.3 | 20.8 | 20.2 | 19.1 | 14.3 | 10.9 | 8.0  | 5.8   | 4.2   | 2.9   | 1.8   | 1.0   | F5A   |              |
| 17.1                                                                                      | 17.1 | 17.1 | 16.8 | 16.2 | 15.7 | 15.4 | 15.1 | 14.8 | 14.4 | 14.0 | 13.6 | 9.3  | 6.3   | 4.2   | 2.8   | ...   | ...   | F11   |              |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 19.7 | 19.2 | 18.7 | 13.7 | 9.3  | 6.3   | 4.2   | 2.8   | ...   | ...   | F11   |              |
| 21.4                                                                                      | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 20.2 | 13.7 | 9.3  | 6.3   | 4.2   | 2.8   | ...   | ...   | F11   |              |
| 20.0                                                                                      | 19.6 | 19.2 | 19.2 | 19.2 | 19.2 | 19.2 | 19.2 | 19.2 | 19.1 | 18.6 | 18.0 | 11.3 | 7.2   | 4.5   | 2.8   | ...   | ...   | F12   |              |
| 17.1                                                                                      | 17.1 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.0 | 12.0 | 9.0  | 7.0   | 5.5   | 4.0   | 2.7   | 1.5   | F21   |              |
| 21.4                                                                                      | 21.4 | 20.9 | 20.6 | 20.5 | 20.4 | 20.2 | 20.0 | 19.7 | 19.3 | 18.1 | 13.1 | 9.5  | 6.8   | 4.9   | 3.2   | 2.4   | 1.3   | F21   |              |
| 17.1                                                                                      | 17.1 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 13.6 | 10.8 | 8.0  | 5.7   | 3.8   | ...   | ...   | ...   | F22   |              |
| 21.4                                                                                      | 21.4 | 20.9 | 20.6 | 20.5 | 20.4 | 20.2 | 20.0 | 19.7 | 19.3 | 18.7 | 15.8 | 11.4 | 7.8   | 5.1   | 3.2   | ...   | ...   | F22   |              |
| 24.3                                                                                      | 24.3 | 24.3 | 24.2 | 24.1 | 23.7 | 23.4 | 22.9 | 22.2 | 21.3 | 20.3 | 19.1 | 17.8 | 16.3  | 14.0  | 10.3  | 7.0   | 4.3   | F91   |              |
| 24.3                                                                                      | 24.3 | 24.3 | 24.2 | 24.1 | 23.7 | 23.4 | 22.9 | 22.2 | 21.3 | 20.3 | 19.1 | 17.8 | 16.3  | 12.9  | 9.6   | 7.0   | 4.3   | F91   |              |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 18.8 | 17.9 | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | LF3   | A350         |
| 17.1                                                                                      | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | 17.1 | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | LF4   |              |
| 17.1                                                                                      | 16.5 | 15.7 | 15.3 | 15.3 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | LF5   |              |
| 20.0                                                                                      | 19.2 | 18.3 | 17.8 | 17.8 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | LF5   |              |
| 18.0                                                                                      | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | LF9   |              |
| <b>Wrought Fittings (Seamless and Welded)</b>                                             |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |       |              |
| 15.7                                                                                      | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.4 | 14.9 | 14.5 | ...  | ...  | ...   | ...   | ...   | ...   | ...   | WP1   | A234         |
| 17.1                                                                                      | 17.1 | 16.6 | 16.5 | 16.4 | 16.2 | 15.9 | 15.6 | 15.1 | 14.5 | 13.8 | 10.9 | 8.0  | 5.8   | 4.2   | 2.9   | 1.8   | 1.0   | WP5   |              |
| 21.4                                                                                      | 21.4 | 20.8 | 20.6 | 20.5 | 20.2 | 19.9 | 19.5 | 18.9 | 18.2 | 14.3 | 10.9 | 8.0  | 5.8   | 4.2   | 2.9   | 1.8   | 1.0   | WP5   |              |
| 17.1                                                                                      | 17.1 | 16.6 | 16.5 | 16.4 | 16.2 | 15.9 | 15.6 | 15.1 | 14.5 | 13.8 | 13.0 | 10.6 | 7.4   | 5.0   | 3.3   | 2.2   | 1.5   | WP9   |              |
| 17.1                                                                                      | 17.1 | 17.1 | 16.8 | 16.2 | 15.7 | 15.4 | 15.1 | 14.8 | 14.4 | 14.0 | 13.6 | 9.3  | 6.3   | 4.2   | 2.8   | ...   | ...   | WP11  |              |
| 21.4                                                                                      | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 21.4 | 20.2 | 13.7 | 9.3  | 6.3   | 4.2   | 2.8   | ...   | ...   | WP11  |              |
| 17.1                                                                                      | 16.8 | 16.5 | 16.5 | 16.5 | 16.3 | 16.0 | 15.8 | 15.5 | 15.3 | 14.9 | 14.5 | 11.3 | 7.2   | 4.5   | 2.8   | ...   | ...   | WP12  |              |
| 20.0                                                                                      | 19.6 | 19.2 | 19.2 | 19.2 | 19.2 | 19.2 | 19.2 | 19.2 | 19.1 | 18.6 | 18.0 | 11.3 | 7.2   | 4.5   | 2.8   | ...   | ...   | WP12  |              |
| 17.1                                                                                      | 17.1 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 16.6 | 13.6 | 10.8 | 8.0   | 5.7   | 3.8   | ...   | ...   | WP22  | A234         |
| 21.4                                                                                      | 21.4 | 20.9 | 20.6 | 20.5 | 20.4 | 20.2 | 20.0 | 19.7 | 19.3 | 18.7 | 15.8 | 11.4 | 7.8   | 5.1   | 3.2   | ...   | ...   | WP22  |              |
| 24.3                                                                                      | 24.3 | 24.3 | 24.2 | 24.1 | 23.7 | 23.4 | 22.9 | 22.2 | 21.3 | 20.3 | 19.1 | 17.8 | 16.3  | 14.0  | 10.3  | 7.0   | 4.3   | WP91  |              |
| 24.3                                                                                      | 24.3 | 24.3 | 24.2 | 24.1 | 23.7 | 23.4 | 22.9 | 22.2 | 21.3 | 20.3 | 19.1 | 17.8 | 16.3  | 12.9  | 9.6   | 7.0   | 4.3   | WP91  |              |

**Table A-2 Low and Intermediate Alloy Steel (Cont'd)**

| Spec. No.       | Grade | Type or Class | Nominal Composition                     | P-No. | Notes     | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|-----------------|-------|---------------|-----------------------------------------|-------|-----------|--------------------------------|------------------------------|--------|
| <b>Castings</b> |       |               |                                         |       |           |                                |                              |        |
| A217            | WC1   | ...           | C- $\frac{1}{2}$ Mo                     | 3     | (2)(3)(4) | 65                             | 35                           | 0.80   |
|                 | WC4   | ...           | 1Ni- $\frac{1}{2}$ Cr- $\frac{1}{2}$ Mo | 4     | (3)(4)    | 70                             | 40                           | 0.80   |
|                 | WC5   | ...           | $\frac{3}{4}$ Ni-1Mo- $\frac{3}{4}$ Cr  | 4     | (3)(4)    | 70                             | 40                           | 0.80   |
|                 | WC6   | ...           | 1 $\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo    | 4     | (3)(4)    | 70                             | 40                           | 0.80   |
| A217            | WC9   | ...           | 2 $\frac{1}{4}$ Cr-1Mo                  | 5A    | (3)(4)    | 70                             | 40                           | 0.80   |
|                 | C5    | ...           | 5Cr- $\frac{1}{2}$ Mo                   | 5B    | (3)(4)    | 90                             | 60                           | 0.80   |
|                 | C12   | ...           | 9Cr-1Mo                                 | 5B    | (3)(4)    | 90                             | 60                           | 0.80   |
|                 | C12A  | ...           | 9Cr-1Mo-V                               | 15E   | (3)(4)    | 85                             | 60                           | 0.80   |

**GENERAL NOTES:**

- The tabulated specifications are ANSI/ASTM or ASTM. For ASME Boiler and Pressure Vessel Code applications, see related specifications in Section II of the ASME Code.
- The stress values in this Table may be interpolated to determine values for intermediate temperatures.
- The P-Numbers indicated in this Table are identical to those adopted by the ASME Boiler and Pressure Vessel Code, Section IX, except as modified by para. 127.5.
- Tensile strengths and allowable stresses shown in "ksi" are "thousands of pounds per square inch."
- The materials listed in this Table shall not be used at design temperatures above those for which allowable stress values are given.
- The tabulated stress values are  $S \times E$  (weld joint efficiency factor) or  $S \times F$  (material quality factor), as applicable. Weld joint efficiency factors are shown in Table 102.4.3.
- Pressure-temperature ratings of piping components, as published in standards referenced in this Code, may be used for components meeting the requirements of those standards. The allowable stress values given in this Table are for use in designing piping components which are not manufactured in accordance with referenced standards.
- All the materials listed are classified as ferritic [see Table 104.1.2(A)].
- The tabulated stress values that are shown in italics are at temperatures in the range where creep and stress rupture strength govern the selection of stresses.

**(12) NOTES:**

- THIS MATERIAL IS NOT ACCEPTABLE FOR USE ON BOILER EXTERNAL PIPING — SEE FIGS. 100.1.2(A) AND (B).
- Upon prolonged exposure to temperature above 875°F, the carbide phase of carbon-molybdenum steel may be converted to graphite.
- These allowable stress values apply to normalized and tempered material only.
- The material quality factors and allowable stress values for these materials may be increased in accordance with para. 102.4.6.
- For use at temperatures above 850°F, the carbon content of the base material and, where applicable, weld filler metal shall be 0.05% or higher. See para. 124.2(D).
- If A234 Grade WP-12 fittings are made from A387 Grade 12 Class 1 plate, the allowable stress values shall be reduced by the ratio of 55 divided by 60 in the temperature range -20°F through 850°F. At 900°F through 1,100°F, the values shown may be used.
- The material quality factor for centrifugally cast pipe (0.85) is based on all surfaces being machined, after heat treatment, to a surface finish of 250  $\mu$ in. arithmetic average deviation or better.
- These allowable stress values are for pipe fabricated from ASTM A387 Class 1 plate in the annealed condition.
- These allowable stress values are for pipe fabricated from ASTM A387 Class 2 plate.
- These allowable stress values apply to thickness less than 3 in.
- These allowable stress values apply to thickness 3 in. or greater.

**Table A-2 Low and Intermediate Alloy Steel (Cont'd)**

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |      | Grade    | Spec. No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|------|----------|-----------|
| –20 to 100                                                                                | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 |      |          |           |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |      | Castings |           |
| 14.9                                                                                      | 14.9 | 14.9 | 14.9 | 14.9 | 14.9 | 14.9 | 14.7 | 14.3 | 13.9 | 13.5 | ...  | ...  | ...   | ...   | ...   | ...   | ...   | WC1  | A217     |           |
| 16.0                                                                                      | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 15.4 | 12.0 | 7.4  | 4.7   | ...   | ...   | ...   | ...   | WC4  |          |           |
| 16.0                                                                                      | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 15.4 | 13.0 | 8.8  | 5.5   | 3.7   | 2.2   | ...   | ...   | WC5  |          |           |
| 16.0                                                                                      | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 15.8 | 15.4 | 15.0 | 11.0 | 7.4  | 5.0   | 3.4   | 2.2   | ...   | ...   | WC6  |          |           |
| 16.0                                                                                      | 16.0 | 15.8 | 15.5 | 15.4 | 15.4 | 15.3 | 15.0 | 14.8 | 14.3 | 13.8 | 12.6 | 9.1  | 6.2   | 4.1   | 2.6   | ...   | ...   | WC9  | A217     |           |
| 20.6                                                                                      | 20.6 | 19.9 | 19.8 | 19.7 | 19.4 | 19.1 | 18.7 | 18.2 | 15.3 | 11.4 | 8.7  | 6.4  | 4.6   | 3.4   | 2.3   | 1.4   | 0.8   | C5   |          |           |
| 20.6                                                                                      | 20.6 | 19.9 | 19.8 | 19.7 | 19.4 | 19.1 | 18.7 | 18.2 | 17.4 | 16.6 | 13.1 | 8.8  | 5.9   | 4.0   | 2.6   | 1.8   | 1.2   | C12  |          |           |
| 19.4                                                                                      | 19.4 | 19.4 | 19.4 | 19.3 | 19.0 | 18.7 | 18.3 | 17.7 | 17.1 | 16.2 | 15.3 | 14.2 | 13.0  | 11.2  | 8.2   | 5.6   | 3.4   | C12A |          |           |

ASME B31.1-2012

Click to view the full PDF of ASME B31.1-2012

Table A-3 Stainless Steels

| Spec. No.                         | Type or Grade | Class  | UNS Alloy No. | Nominal Composition | P-No.           | Notes   | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |      |
|-----------------------------------|---------------|--------|---------------|---------------------|-----------------|---------|--------------------------------|------------------------------|--------|------|
| Seamless Pipe and Tube Austenitic |               |        |               |                     |                 |         |                                |                              |        |      |
| A213                              | TP304         | ...    | S30400        | 18Cr-8Ni            | 8               | (10)    | 75                             | 30                           | 1.00   |      |
|                                   | TP304         | ...    | S30400        | 18Cr-8Ni            | 8               | (9)(10) | 75                             | 30                           | 1.00   |      |
|                                   | TP304H        | ...    | S30409        | 18Cr-8Ni            | 8               | ...     | 75                             | 30                           | 1.00   |      |
|                                   | TP304H        | ...    | S30409        | 18Cr-8Ni            | 8               | (9)     | 75                             | 30                           | 1.00   |      |
| A213                              | TP304L        | ...    | S30403        | 18Cr-8Ni            | 8               | (1)     | 70                             | 25                           | 1.00   |      |
|                                   | TP304L        | ...    | S30403        | 18Cr-8Ni            | 8               | (1)(9)  | 70                             | 25                           | 1.00   |      |
|                                   | TP304N        | ...    | S30451        | 18Cr-8Ni-N          | 8               | (10)    | 80                             | 35                           | 1.00   |      |
|                                   | TP304N        | ...    | S30451        | 18Cr-8Ni-N          | 8               | (9)(10) | 80                             | 35                           | 1.00   |      |
| A213                              | ...           | ...    | S30815        | 21Cr-11Ni-N         | 8               | (1)     | 87                             | 45                           | 1.00   |      |
|                                   | ...           | ...    | S30815        | 21Cr-11Ni-N         | 8               | (1)(9)  | 87                             | 45                           | 1.00   |      |
| A213                              | TP309H        |        | S30909        | 23Cr-12Ni           | 8               | (9)     | 75                             | 30                           | 1.00   |      |
|                                   | TP309H        |        | S30909        | 23Cr-12Ni           | 8               | ...     | 75                             | 30                           | 1.00   |      |
|                                   | TP310H        |        | S31009        | 25Cr-20Ni           | 8               | (9)     | 75                             | 30                           | 1.00   |      |
|                                   | TP310H        |        | S31009        | 25Cr-20Ni           | 8               | ...     | 75                             | 30                           | 1.00   |      |
| A213                              | TP316         | ...    | S31600        | 16Cr-12Ni-2Mo       | 8               | (10)    | 75                             | 30                           | 1.00   |      |
|                                   | TP316         | ...    | S31600        | 16Cr-12Ni-2Mo       | 8               | (9)(10) | 75                             | 30                           | 1.00   |      |
|                                   | TP316H        | ...    | S31609        | 16Cr-12Ni-2Mo       | 8               | ...     | 75                             | 30                           | 1.00   |      |
|                                   | TP316H        | ...    | S31609        | 16Cr-12Ni-2Mo       | 8               | (9)     | 75                             | 30                           | 1.00   |      |
| (12)                              | A213          | TP316L | ...           | S31603              | 16Cr-12Ni-2Mo   | 8       | (1)(29)                        | 70                           | 25     | 1.00 |
| (12)                              |               | TP316L | ...           | S31603              | 16Cr-12Ni-2Mo   | 8       | (1)(9)(29)                     | 70                           | 25     | 1.00 |
|                                   |               | TP316N | ...           | S31651              | 16Cr-12Ni-2Mo-N | 8       | (10)                           | 80                           | 35     | 1.00 |
|                                   |               | TP316N | ...           | S31651              | 16Cr-12Ni-2Mo-N | 8       | (9)(10)                        | 80                           | 35     | 1.00 |
| A213                              | TP321         | ...    | S32100        | 18Cr-10Ni-Ti        | 8               | (10)    | 75                             | 30                           | 1.00   |      |
|                                   | TP321         | ...    | S32100        | 18Cr-10Ni-Ti        | 8               | (9)(10) | 75                             | 30                           | 1.00   |      |
|                                   | TP321H        | ...    | S32109        | 18Cr-10Ni-Ti        | 8               | ...     | 75                             | 30                           | 1.00   |      |
|                                   | TP321H        | ...    | S32109        | 18Cr-10Ni-Ti        | 8               | (9)     | 75                             | 30                           | 1.00   |      |
| A213                              | TP347         | ...    | S34700        | 18Cr-10Ni-Cb        | 8               | (10)    | 75                             | 30                           | 1.00   |      |
|                                   | TP347         | ...    | S34700        | 18Cr-10Ni-Cb        | 8               | (9)(10) | 75                             | 30                           | 1.00   |      |
|                                   | TP347H        | ...    | S34709        | 18Cr-10Ni-Cb        | 8               | ...     | 75                             | 30                           | 1.00   |      |
|                                   | TP347H        | ...    | S34709        | 18Cr-10Ni-Cb        | 8               | (9)     | 75                             | 30                           | 1.00   |      |
| A213                              | TP348         | ...    | S34800        | 18Cr-10Ni-Cb        | 8               | (10)    | 75                             | 30                           | 1.00   |      |
|                                   | TP348         | ...    | S34800        | 18Cr-10Ni-Cb        | 8               | (9)(10) | 75                             | 30                           | 1.00   |      |
|                                   | TP348H        | ...    | S34809        | 18Cr-10Ni-Cb        | 8               | ...     | 75                             | 30                           | 1.00   |      |
|                                   | TP348H        | ...    | S34809        | 18Cr-10Ni-Cb        | 8               | (9)     | 75                             | 30                           | 1.00   |      |
| A312                              | TP304         | ...    | S30400        | 18Cr-8Ni            | 8               | (10)    | 75                             | 30                           | 1.00   |      |
|                                   | TP304         | ...    | S30400        | 18Cr-8Ni            | 8               | (9)(10) | 75                             | 30                           | 1.00   |      |
|                                   | TP304H        | ...    | S30409        | 18Cr-8Ni            | 8               | ...     | 75                             | 30                           | 1.00   |      |
|                                   | TP304H        | ...    | S30409        | 18Cr-8Ni            | 8               | (9)     | 75                             | 30                           | 1.00   |      |

Table A-3 Stainless Steels

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        | Type<br>or<br>Grade                  | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|--------|--------------------------------------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 |        |                                      |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        | Seamless Pipe and Tube<br>Austenitic |              |
| 20.0                                                                                      | 16.7 | 15.0 | 13.8 | 12.9 | 12.3 | 12.0 | 11.7 | 11.5 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4  | 10.1  | 9.8   | 7.7   | 6.1   | TP304  | A213                                 |              |
| 20.0                                                                                      | 20.0 | 18.9 | 18.3 | 17.5 | 16.6 | 16.2 | 15.8 | 15.5 | 15.2 | 14.9 | 14.6 | 14.3 | 14.0  | 12.4  | 9.8   | 7.7   | 6.1   | TP304  |                                      |              |
| 20.0                                                                                      | 16.7 | 15.0 | 13.8 | 12.9 | 12.3 | 12.0 | 11.7 | 11.5 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4  | 10.1  | 9.8   | 7.7   | 6.1   | TP304H |                                      |              |
| 20.0                                                                                      | 20.0 | 18.9 | 18.3 | 17.5 | 16.6 | 16.2 | 15.8 | 15.5 | 15.2 | 14.9 | 14.6 | 14.3 | 14.0  | 12.4  | 9.8   | 7.7   | 6.1   | TP304H |                                      |              |
| 16.7                                                                                      | 14.3 | 12.8 | 11.7 | 10.9 | 10.4 | 10.2 | 10.0 | 9.8  | 9.7  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP304L | A213                                 |              |
| 16.7                                                                                      | 16.7 | 16.7 | 15.8 | 14.7 | 14.0 | 13.7 | 13.5 | 13.3 | 13.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP304L |                                      |              |
| 22.9                                                                                      | 19.1 | 16.7 | 15.1 | 14.0 | 13.3 | 13.0 | 12.8 | 12.5 | 12.3 | 12.1 | 11.8 | 11.6 | 11.3  | 11.0  | 9.8   | 7.7   | 6.1   | TP304N |                                      |              |
| 22.9                                                                                      | 22.9 | 21.7 | 20.3 | 18.9 | 17.9 | 17.5 | 17.2 | 16.9 | 16.6 | 16.3 | 16.0 | 15.6 | 15.2  | 12.4  | 9.8   | 7.7   | 6.1   | TP304N |                                      |              |
| 24.9                                                                                      | 24.7 | 22.0 | 19.9 | 18.5 | 17.7 | 17.4 | 17.2 | 17.0 | 16.8 | 16.6 | 16.4 | 16.2 | 14.9  | 11.6  | 9.0   | 6.9   | 5.2   | ...    | A213                                 |              |
| 24.9                                                                                      | 24.7 | 23.3 | 22.4 | 21.8 | 21.4 | 21.2 | 21.0 | 20.8 | 20.6 | 20.3 | 20.0 | 19.1 | 14.9  | 11.6  | 9.0   | 6.9   | 5.2   | ...    |                                      |              |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 19.4 | 18.8 | 18.5 | 18.2 | 18.0 | 17.7 | 17.5 | 17.2 | 16.9 | 13.8  | 10.3  | 7.6   | 5.5   | 4.0   | TP309H | A213                                 |              |
| 20.0                                                                                      | 17.5 | 16.1 | 15.1 | 14.4 | 13.9 | 13.7 | 13.5 | 13.3 | 13.1 | 12.9 | 12.7 | 12.5 | 12.3  | 10.3  | 7.6   | 5.5   | 4.0   | TP309H |                                      |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.9 | 19.3 | 18.5 | 18.2 | 17.9 | 17.7 | 17.4 | 17.2 | 16.9 | 16.7 | 13.8  | 10.3  | 7.6   | 5.5   | 4.0   | TP310H |                                      |              |
| 20.0                                                                                      | 17.6 | 16.1 | 15.1 | 14.3 | 13.7 | 13.5 | 13.3 | 13.1 | 12.9 | 12.7 | 12.5 | 12.3 | 12.1  | 10.3  | 7.6   | 5.5   | 4.0   | TP310H |                                      |              |
| 20.0                                                                                      | 17.3 | 15.6 | 14.3 | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.8 | 11.6 | 11.5 | 11.4 | 11.3  | 11.2  | 11.1  | 9.8   | 7.4   | TP316  | A213                                 |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.3 | 18.0 | 17.0 | 16.6 | 16.3 | 16.1 | 15.9 | 15.7 | 15.6 | 15.4 | 15.3  | 15.1  | 12.4  | 9.8   | 7.4   | TP316  |                                      |              |
| 20.0                                                                                      | 17.3 | 15.6 | 14.3 | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.8 | 11.6 | 11.5 | 11.4 | 11.3  | 11.2  | 11.1  | 9.8   | 7.4   | TP316H |                                      |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.3 | 18.0 | 17.0 | 16.6 | 16.3 | 16.1 | 15.9 | 15.7 | 15.6 | 15.4 | 15.3  | 15.1  | 12.4  | 9.8   | 7.4   | TP316H |                                      |              |
| 16.7                                                                                      | 14.1 | 12.7 | 11.7 | 10.9 | 10.4 | 10.2 | 10.0 | 9.8  | 9.6  | 9.4  | 9.2  | 9.0  | 8.8   | 8.6   | 8.4   | 8.3   | 6.4   | TP316L | A213                                 |              |
| 16.7                                                                                      | 16.7 | 16.0 | 15.6 | 14.8 | 14.0 | 13.8 | 13.5 | 13.2 | 13.0 | 12.7 | 12.4 | 12.1 | 11.9  | 11.6  | 11.4  | 8.8   | 6.4   | TP316L | (12)                                 |              |
| 22.9                                                                                      | 20.7 | 19.0 | 17.6 | 16.5 | 15.6 | 15.2 | 14.9 | 14.5 | 14.2 | 13.9 | 13.7 | 13.4 | 13.2  | 12.9  | 12.3  | 9.8   | 7.4   | TP316N |                                      |              |
| 22.9                                                                                      | 22.9 | 22.0 | 21.5 | 21.2 | 21.0 | 20.5 | 20.0 | 19.6 | 19.2 | 18.8 | 18.5 | 18.1 | 17.8  | 15.8  | 12.3  | 9.8   | 7.4   | TP316N |                                      |              |
| 20.0                                                                                      | 18.0 | 16.5 | 15.3 | 14.3 | 13.5 | 13.2 | 13.0 | 12.7 | 12.6 | 12.4 | 12.3 | 12.1 | 12.0  | 9.6   | 6.9   | 5.0   | 3.6   | TP321  | A213                                 |              |
| 20.0                                                                                      | 20.0 | 19.1 | 18.7 | 18.7 | 18.3 | 17.9 | 17.5 | 17.2 | 16.9 | 16.7 | 16.5 | 16.4 | 16.2  | 9.6   | 6.9   | 5.0   | 3.6   | TP321  |                                      |              |
| 20.0                                                                                      | 18.0 | 16.5 | 15.3 | 14.3 | 13.5 | 13.2 | 13.0 | 12.7 | 12.6 | 12.4 | 12.3 | 12.1 | 12.0  | 11.9  | 9.1   | 6.9   | 5.4   | TP321H |                                      |              |
| 20.0                                                                                      | 20.0 | 19.1 | 18.7 | 18.7 | 18.3 | 17.9 | 17.5 | 17.2 | 16.9 | 16.7 | 16.5 | 16.4 | 16.2  | 12.3  | 9.1   | 6.9   | 5.4   | TP321H |                                      |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 12.1  | 9.1   | 6.1   | 4.4   | TP347  | A213                                 |              |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.2 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.0  | 12.1  | 9.1   | 6.1   | 4.4   | TP347  |                                      |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 13.4  | 13.3  | 10.5  | 7.9   | TP347H |                                      |              |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.1 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.4  | 16.2  | 14.1  | 10.5  | 7.9   | TP347H |                                      |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 12.1  | 9.1   | 6.1   | 4.4   | TP348  | A213                                 |              |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.2 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.0  | 12.1  | 9.1   | 6.1   | 4.4   | TP348  |                                      |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 13.4  | 13.3  | 10.5  | 7.9   | TP348H |                                      |              |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.1 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.4  | 16.2  | 14.1  | 10.5  | 7.9   | TP348H |                                      |              |
| 20.0                                                                                      | 16.7 | 15.0 | 13.8 | 12.9 | 12.3 | 12.0 | 11.7 | 11.5 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4  | 10.1  | 9.8   | 7.7   | 6.1   | TP304  | A312                                 |              |
| 20.0                                                                                      | 20.0 | 18.9 | 18.3 | 17.5 | 16.6 | 16.2 | 15.8 | 15.5 | 15.2 | 14.9 | 14.6 | 14.3 | 14.0  | 12.4  | 9.8   | 7.7   | 6.1   | TP304  |                                      |              |
| 20.0                                                                                      | 16.7 | 15.0 | 13.8 | 12.9 | 12.3 | 12.0 | 11.7 | 11.5 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4  | 10.1  | 9.8   | 7.7   | 6.1   | TP304H |                                      |              |
| 20.0                                                                                      | 20.0 | 18.9 | 18.3 | 17.5 | 16.6 | 16.2 | 15.8 | 15.5 | 15.2 | 14.9 | 14.6 | 14.3 | 14.0  | 12.4  | 9.8   | 7.7   | 6.1   | TP304H |                                      |              |

Table A-3 Stainless Steels (Cont'd)

| Spec. No.                              | Type or Grade | Class  | UNS Alloy No. | Nominal Composition | P- No. | Notes      | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|----------------------------------------|---------------|--------|---------------|---------------------|--------|------------|--------------------------------|------------------------------|--------|
| <b>Seamless Pipe and Tube (Cont'd)</b> |               |        |               |                     |        |            |                                |                              |        |
| <b>Austenitic (Cont'd)</b>             |               |        |               |                     |        |            |                                |                              |        |
| A312                                   | TP304L        | ...    | S30403        | 18Cr-8Ni            | 8      | (1)        | 70                             | 25                           | 1.00   |
|                                        | TP304L        | ...    | S30403        | 18Cr-8Ni            | 8      | (1)(9)     | 70                             | 25                           | 1.00   |
|                                        | TP304N        | ...    | S30451        | 18Cr-8Ni-N          | 8      | (10)       | 80                             | 35                           | 1.00   |
|                                        | TP304N        | ...    | S30451        | 18Cr-8Ni-N          | 8      | (9)(10)    | 80                             | 35                           | 1.00   |
| A312                                   | ...           | ...    | S30815        | 21Cr-11Ni-N         | 8      | (1)        | 87                             | 45                           | 1.00   |
|                                        | ...           | ...    | S30815        | 21Cr-11Ni-N         | 8      | (1)(9)     | 87                             | 45                           | 1.00   |
| A312                                   | TP309H        | ...    | S30909        | 23Cr-12Ni           | 8      | (9)        | 75                             | 30                           | 1.00   |
|                                        | TP309H        | ...    | S30909        | 23Cr-12Ni           | 8      | ...        | 75                             | 30                           | 1.00   |
|                                        | TP310H        | ...    | S31009        | 25Cr-20Ni           | 8      | (9)        | 75                             | 30                           | 1.00   |
|                                        | TP310H        | ...    | S31009        | 25Cr-20Ni           | 8      | ...        | 75                             | 30                           | 1.00   |
| A312                                   | TP316         | ...    | S31600        | 16Cr-12Ni-2Mo       | 8      | (10)       | 75                             | 30                           | 1.00   |
|                                        | TP316         | ...    | S31600        | 16Cr-12Ni-2Mo       | 8      | (9)(10)    | 75                             | 30                           | 1.00   |
|                                        | TP316H        | ...    | S31609        | 16Cr-12Ni-2Mo       | 8      | ...        | 75                             | 30                           | 1.00   |
|                                        | TP316H        | ...    | S31609        | 16Cr-12Ni-2Mo       | 8      | (9)        | 75                             | 30                           | 1.00   |
| (12)                                   | A312          | TP316L | S31603        | 16Cr-12Ni-2Mo       | 8      | (1)(29)    | 70                             | 25                           | 1.00   |
| (12)                                   |               | TP316L | S31603        | 16Cr-12Ni-2Mo       | 8      | (1)(9)(29) | 70                             | 25                           | 1.00   |
|                                        |               | TP316N | S31651        | 16Cr-12Ni-2Mo-N     | 8      | (10)       | 80                             | 35                           | 1.00   |
|                                        |               | TP316N | S31651        | 16Cr-12Ni-2Mo-N     | 8      | (9)(10)    | 80                             | 35                           | 1.00   |
| A312                                   | TP317         | ...    | S31700        | 18Cr-13Ni-3Mo       | 8      | (1)(10)    | 75                             | 30                           | 1.00   |
|                                        | TP317         | ...    | S31700        | 18Cr-13Ni-3Mo       | 8      | (1)(9)(10) | 75                             | 30                           | 1.00   |
|                                        | TP321         | ...    | S32100        | 18Cr-10Ni-Ti        | 8      | (10)       | 75                             | 30                           | 1.00   |
|                                        | TP321         | ...    | S32100        | 18Cr-10Ni-Ti        | 8      | (9)(10)    | 75                             | 30                           | 1.00   |
|                                        | TP321H        | ...    | S32109        | 18Cr-10Ni-Ti        | 8      | ...        | 75                             | 30                           | 1.00   |
|                                        | TP321H        | ...    | S32109        | 18Cr-10Ni-Ti        | 8      | (9)        | 75                             | 30                           | 1.00   |
| A312                                   | TP347         | ...    | S34700        | 18Cr-10Ni-Cb        | 8      | (10)       | 75                             | 30                           | 1.00   |
|                                        | TP347         | ...    | S34700        | 18Cr-10Ni-Cb        | 8      | (9)(10)    | 75                             | 30                           | 1.00   |
|                                        | TP347H        | ...    | S34709        | 18Cr-10Ni-Cb        | 8      | ...        | 75                             | 30                           | 1.00   |
|                                        | TP347H        | ...    | S34709        | 18Cr-10Ni-Cb        | 8      | (9)        | 75                             | 30                           | 1.00   |
| A312                                   | TP348         | ...    | S34800        | 18Cr-10Ni-Cb        | 8      | (10)       | 75                             | 30                           | 1.00   |
|                                        | TP348         | ...    | S34800        | 18Cr-10Ni-Cb        | 8      | (9)(10)    | 75                             | 30                           | 1.00   |
|                                        | TP348H        | ...    | S34809        | 18Cr-10Ni-Cb        | 8      | ...        | 75                             | 30                           | 1.00   |
|                                        | TP348H        | ...    | S34809        | 18Cr-10Ni-Cb        | 8      | (9)        | 75                             | 30                           | 1.00   |
| A312                                   | TPXM-15       | ...    | S38100        | 18Cr-18Ni-2Si       | 8      | (1)        | 75                             | 30                           | 1.00   |
|                                        | TPXM-15       | ...    | S38100        | 18Cr-18Ni-2Si       | 8      | (1)(9)     | 75                             | 30                           | 1.00   |
|                                        | TPXM-19       | ...    | S20910        | 22Cr-13Ni-5Mn       | 8      | (1)        | 100                            | 55                           | 1.00   |
|                                        | TPXM-19       | ...    | S20910        | 22Cr-13Ni-5Mn       | 8      | (1)(9)     | 100                            | 55                           | 1.00   |
|                                        | ...           | ...    | S31254        | 20Cr-18Ni-6Mo       | 8      | (1)        | 95                             | 45                           | 1.00   |
|                                        | ...           | ...    | S31254        | 20Cr-18Ni-6Mo       | 8      | (1)(9)     | 95                             | 45                           | 1.00   |

Table A-3 Stainless Steels (Cont'd)

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       | Type<br>or<br>Grade | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|---------------------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 |                     |              |
| Seamless Pipe and Tube (Cont'd)<br>Austenitic (Cont'd)                                    |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |                     |              |
| 16.7                                                                                      | 14.3 | 12.8 | 11.7 | 10.9 | 10.4 | 10.2 | 10.0 | 9.8  | 9.7  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP304L              | A312         |
| 16.7                                                                                      | 16.7 | 16.7 | 15.8 | 14.7 | 14.0 | 13.7 | 13.5 | 13.3 | 13.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP304L              |              |
| 22.9                                                                                      | 19.1 | 16.7 | 15.1 | 14.0 | 13.3 | 13.0 | 12.8 | 12.5 | 12.3 | 12.1 | 11.8 | 11.6 | 11.3  | 11.0  | 9.8   | 7.7   | 6.1   | TP304N              |              |
| 22.9                                                                                      | 22.9 | 21.7 | 20.3 | 18.9 | 17.9 | 17.5 | 17.2 | 16.9 | 16.6 | 16.3 | 16.0 | 15.6 | 15.2  | 12.4  | 9.8   | 7.7   | 6.1   | TP304N              |              |
| 24.9                                                                                      | 24.7 | 22.0 | 19.9 | 18.5 | 17.7 | 17.4 | 17.2 | 17.0 | 16.8 | 16.6 | 16.4 | 16.2 | 14.9  | 11.6  | 9.0   | 6.9   | 5.2   | ...                 | A312         |
| 24.9                                                                                      | 24.7 | 23.3 | 22.4 | 21.8 | 21.4 | 21.2 | 21.0 | 20.8 | 20.6 | 20.3 | 20.0 | 19.1 | 14.9  | 11.6  | 9.0   | 6.9   | 5.2   | ...                 |              |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 19.4 | 18.8 | 18.5 | 18.2 | 18.0 | 17.7 | 17.5 | 17.2 | 16.9 | 13.8  | 10.3  | 7.6   | 5.5   | 4.0   | TP309H              | A312         |
| 20.0                                                                                      | 17.5 | 16.1 | 15.1 | 14.4 | 13.9 | 13.7 | 13.5 | 13.3 | 13.1 | 12.9 | 12.7 | 12.5 | 12.3  | 10.3  | 7.6   | 5.5   | 4.0   | TP309H              |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.9 | 19.3 | 18.5 | 18.2 | 17.9 | 17.7 | 17.4 | 17.2 | 16.9 | 16.7 | 13.8  | 10.3  | 7.6   | 5.5   | 4.0   | TP310H              |              |
| 20.0                                                                                      | 17.6 | 16.1 | 15.1 | 14.3 | 13.7 | 13.5 | 13.3 | 13.1 | 12.9 | 12.7 | 12.5 | 12.3 | 12.1  | 10.3  | 7.6   | 5.5   | 4.0   | TP310H              |              |
| 20.0                                                                                      | 17.3 | 15.6 | 14.3 | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.8 | 11.6 | 11.5 | 11.4 | 11.3  | 11.2  | 11.1  | 9.8   | 7.4   | TP316               | A312         |
| 20.0                                                                                      | 20.0 | 20.0 | 19.3 | 18.0 | 17.0 | 16.6 | 16.3 | 16.1 | 15.9 | 15.7 | 15.6 | 15.4 | 15.3  | 15.1  | 12.4  | 9.8   | 7.4   | TP316               |              |
| 20.0                                                                                      | 17.3 | 15.6 | 14.3 | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.8 | 11.6 | 11.5 | 11.4 | 11.3  | 11.2  | 11.1  | 9.8   | 7.4   | TP316H              |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.3 | 18.0 | 17.0 | 16.6 | 16.3 | 16.1 | 15.9 | 15.7 | 15.6 | 15.4 | 15.3  | 15.1  | 12.4  | 9.8   | 7.4   | TP316H              |              |
| 16.7                                                                                      | 14.2 | 12.7 | 11.7 | 10.9 | 10.4 | 10.2 | 10.0 | 9.8  | 9.6  | 9.4  | 9.2  | 9.0  | 8.8   | 8.6   | 8.4   | 8.3   | 6.4   | TP316L              | A312         |
| 16.7                                                                                      | 16.7 | 16.7 | 15.7 | 14.8 | 14.0 | 13.7 | 13.5 | 13.2 | 12.9 | 12.7 | 12.4 | 12.1 | 11.9  | 11.6  | 11.4  | 8.8   | 6.4   | TP316L              | (12)         |
| 22.9                                                                                      | 20.7 | 19.0 | 17.6 | 16.5 | 15.6 | 15.2 | 14.9 | 14.5 | 14.2 | 13.9 | 13.7 | 13.4 | 13.2  | 12.9  | 12.3  | 9.8   | 7.4   | TP316N              |              |
| 22.9                                                                                      | 22.9 | 22.0 | 21.5 | 21.2 | 21.0 | 20.5 | 20.0 | 19.6 | 19.2 | 18.8 | 18.5 | 18.1 | 17.8  | 15.8  | 12.3  | 9.8   | 7.4   | TP316N              |              |
| 20.0                                                                                      | 17.3 | 15.6 | 14.3 | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.8 | 11.6 | 11.5 | 11.4 | 11.3  | 11.2  | 11.1  | 9.8   | 7.4   | TP317               | A312         |
| 20.0                                                                                      | 20.0 | 20.0 | 19.3 | 18.0 | 17.0 | 16.6 | 16.3 | 16.1 | 15.9 | 15.7 | 15.6 | 15.4 | 15.3  | 15.1  | 12.4  | 9.8   | 7.4   | TP317               |              |
| 20.0                                                                                      | 18.0 | 16.5 | 15.3 | 14.3 | 13.5 | 13.2 | 13.0 | 12.7 | 12.6 | 12.4 | 12.3 | 12.1 | 12.0  | 9.6   | 6.9   | 5.0   | 3.6   | TP321               |              |
| 20.0                                                                                      | 20.0 | 19.1 | 18.7 | 18.7 | 18.3 | 17.9 | 17.5 | 17.2 | 16.9 | 16.7 | 16.5 | 16.4 | 16.2  | 9.6   | 6.9   | 5.0   | 3.6   | TP321               |              |
| 20.0                                                                                      | 18.0 | 16.5 | 15.3 | 14.3 | 13.5 | 13.2 | 13.0 | 12.7 | 12.6 | 12.4 | 12.3 | 12.1 | 12.0  | 11.9  | 9.1   | 6.9   | 5.4   | TP321H              |              |
| 20.0                                                                                      | 20.0 | 19.1 | 18.7 | 18.7 | 18.3 | 17.9 | 17.5 | 17.2 | 16.9 | 16.7 | 16.5 | 16.4 | 16.2  | 12.3  | 9.1   | 6.9   | 5.4   | TP321H              |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 12.1  | 9.1   | 6.1   | 4.4   | TP347               | A312         |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.2 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.0  | 12.1  | 9.1   | 6.1   | 4.4   | TP347               |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 13.4  | 13.3  | 10.5  | 7.9   | TP347H              |              |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.1 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.4  | 16.2  | 14.1  | 10.5  | 7.9   | TP347H              |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 12.1  | 9.1   | 6.1   | 4.4   | TP348               | A312         |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.2 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.0  | 12.1  | 9.1   | 6.1   | 4.4   | TP348               |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 13.4  | 13.3  | 10.5  | 7.9   | TP348H              |              |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.1 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.4  | 16.2  | 14.1  | 10.5  | 7.9   | TP348H              |              |
| 20.0                                                                                      | 16.7 | 15.0 | 13.8 | 12.9 | 12.3 | 12.0 | 11.7 | 11.5 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4  | ...   | ...   | ...   | ...   | TPXM-15             | A312         |
| 20.0                                                                                      | 20.0 | 18.9 | 18.3 | 17.5 | 16.6 | 16.2 | 15.8 | 15.5 | 15.2 | 14.9 | 14.6 | 10.6 | 10.4  | ...   | ...   | ...   | ...   | TPXM-15             |              |
| 28.6                                                                                      | 28.4 | 26.9 | 26.0 | 25.5 | 25.0 | 24.6 | 24.2 | 23.9 | 23.5 | 23.3 | 23.0 | 22.7 | 22.5  | 22.2  | ...   | ...   | ...   | TPXM-19             |              |
| 28.6                                                                                      | 28.4 | 26.9 | 26.0 | 25.5 | 25.1 | 24.9 | 24.7 | 24.5 | 24.2 | 23.9 | 23.6 | 23.2 | 22.8  | 22.3  | ...   | ...   | ...   | TPXM-19             |              |
| 27.1                                                                                      | 27.1 | 25.8 | 24.6 | 23.7 | 23.2 | 23.1 | 23.0 | 22.9 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...                 |              |
| 27.1                                                                                      | 24.5 | 21.9 | 20.2 | 19.1 | 18.3 | 18.0 | 17.8 | 17.7 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...                 |              |

(12)

Table A-3 Stainless Steels (Cont'd)

| Spec. No.                              | Type or Grade | Class | UNS Alloy No. | Nominal Composition    | P-No. | Notes       | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|----------------------------------------|---------------|-------|---------------|------------------------|-------|-------------|--------------------------------|------------------------------|--------|
| <b>Seamless Pipe and Tube (Cont'd)</b> |               |       |               |                        |       |             |                                |                              |        |
| <b>Austenitic (Cont'd)</b>             |               |       |               |                        |       |             |                                |                              |        |
| A376                                   | TP304         | ...   | S30400        | 18Cr-8Ni               | 8     | (10)        | 75                             | 30                           | 1.00   |
|                                        | TP304         | ...   | S30400        | 18Cr-8Ni               | 8     | (9)(10)     | 75                             | 30                           | 1.00   |
|                                        | TP304H        | ...   | S30409        | 18Cr-8Ni               | 8     | ...         | 75                             | 30                           | 1.00   |
|                                        | TP304H        | ...   | S30409        | 18Cr-8Ni               | 8     | (9)         | 75                             | 30                           | 1.00   |
|                                        | TP304N        | ...   | S30451        | 18Cr-8Ni-N             | 8     | (10)        | 80                             | 35                           | 1.00   |
|                                        | TP304N        | ...   | S30451        | 18Cr-8Ni-N             | 8     | (9)(10)     | 80                             | 35                           | 1.00   |
| A376                                   | TP316         | ...   | S31600        | 16Cr-12Ni-2Mo          | 8     | (10)        | 75                             | 30                           | 1.00   |
|                                        | TP316         | ...   | S31600        | 16Cr-12Ni-2Mo          | 8     | (9)(10)     | 75                             | 30                           | 1.00   |
|                                        | TP316H        | ...   | S31609        | 16Cr-12Ni-2Mo          | 8     | ...         | 75                             | 30                           | 1.00   |
|                                        | TP316H        | ...   | S31609        | 16Cr-12Ni-2Mo          | 8     | (9)         | 75                             | 30                           | 1.00   |
|                                        | TP316N        | ...   | S31651        | 16Cr-12Ni-2Mo-N        | 8     | (10)        | 80                             | 35                           | 1.00   |
|                                        | TP316N        | ...   | S31651        | 16Cr-12Ni-2Mo-N        | 8     | (9)(10)     | 80                             | 35                           | 1.00   |
| A376                                   | TP321         | ...   | S32100        | 18Cr-10Ni-Ti           | 8     | (10)        | 75                             | 30                           | 1.00   |
|                                        | TP321         | ...   | S32100        | 18Cr-10Ni-Ti           | 8     | (9)(10)     | 75                             | 30                           | 1.00   |
|                                        | TP321H        | ...   | S32109        | 18Cr-10Ni-Ti           | 8     | ...         | 75                             | 30                           | 1.00   |
|                                        | TP321H        | ...   | S32109        | 18Cr-10Ni-Ti           | 8     | (9)         | 75                             | 30                           | 1.00   |
| A376                                   | TP347         | ...   | S34700        | 18Cr-10Ni-Cb           | 8     | (10)        | 75                             | 30                           | 1.00   |
|                                        | TP347         | ...   | S34700        | 18Cr-10Ni-Cb           | 8     | (9)(10)     | 75                             | 30                           | 1.00   |
|                                        | TP347H        | ...   | S34709        | 18Cr-10Ni-Cb           | 8     | ...         | 75                             | 30                           | 1.00   |
|                                        | TP347H        | ...   | S34709        | 18Cr-10Ni-Cb           | 8     | (9)         | 75                             | 30                           | 1.00   |
| A376                                   | TP348         | ...   | S34800        | 18Cr-10Ni-Cb           | 8     | (10)        | 75                             | 30                           | 1.00   |
|                                        | TP348         | ...   | S34800        | 18Cr-10Ni-Cb           | 8     | (9)(10)     | 75                             | 30                           | 1.00   |
| A789                                   | ...           | ...   | S32550        | 25.5Cr-5.5Ni-3.5Mo-2Cu | 10H   | (1)(25)(26) | 110                            | 80                           | 1.00   |
| A790                                   | ...           | ...   | S32550        | 25.5Cr-5.5Ni-3.5Mo-2Cu | 10H   | (1)(25)(26) | 110                            | 80                           | 1.00   |
| <b>Ferritic/Martensitic</b>            |               |       |               |                        |       |             |                                |                              |        |
| A268                                   | TP405         | ...   | S40500        | 12Cr-Al                | 7     | (3)         | 60                             | 30                           | 1.00   |
|                                        | TP410         | ...   | S41000        | 13Cr                   | 6     | ...         | 60                             | 30                           | 1.00   |
|                                        | TP429         | ...   | S42900        | 15Cr                   | 6     | (3)         | 60                             | 35                           | 1.00   |
|                                        | TP430         | ...   | S43000        | 17Cr                   | 7     | (3)         | 60                             | 35                           | 1.00   |
|                                        | TPXM-27       | ...   | S44627        | 26Cr-1Mo               | 10I   | (1)(2)      | 65                             | 40                           | 1.00   |
|                                        | TP446-1       | ...   | S44600        | 27Cr                   | 10I   | ...         | 70                             | 40                           | 1.00   |
|                                        | TPXM-33       | ...   | S44626        | 27Cr-1Mo-Ti            | 10I   | (2)         | 68                             | 45                           | 1.00   |
| <b>Ferritic/Austenitic</b>             |               |       |               |                        |       |             |                                |                              |        |
| A789                                   | S31803        | ...   | S31803        | 22Cr-5.5Ni-3Mo-N       | 10H   | (1)(23)(24) | 90                             | 65                           | 1.00   |
|                                        | S32205        | ...   | S32205        | 22Cr-5.5Ni-3Mo-N       | 10H   | (1)(23)(24) | 95                             | 70                           | 1.00   |
|                                        | S32750        | ...   | S32750        | 25Cr-7Ni-4Mo-N         | 10H   | (1)(22)(23) | 116                            | 80                           | 1.00   |
| A790                                   | S31803        | ...   | S31803        | 22Cr-5.5Ni-3Mo-N       | 10H   | (1)(23)(24) | 90                             | 65                           | 1.00   |
|                                        | S32205        | ...   | S32205        | 22Cr-5.5Ni-3Mo-N       | 10H   | (1)(23)(24) | 90                             | 65                           | 1.00   |
|                                        | S32750        | ...   | S32750        | 25Cr-7Ni-4Mo-N         | 10H   | (1)(22)(23) | 116                            | 80                           | 1.00   |

Table A-3 Stainless Steels (Cont'd)

(12)

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |         | Type<br>or<br>Grade | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|---------|---------------------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 |         |                     |              |
| Seamless Pipe and Tube (Cont'd)<br>Austenitic (Cont'd)                                    |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |         |                     |              |
| 20.0                                                                                      | 16.7 | 15.0 | 13.8 | 12.9 | 12.3 | 12.0 | 11.7 | 11.5 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4  | 10.1  | 9.8   | 7.7   | 6.1   | TP304   | A376                |              |
| 20.0                                                                                      | 20.0 | 18.9 | 18.3 | 17.5 | 16.6 | 16.2 | 15.8 | 15.5 | 15.2 | 14.9 | 14.6 | 14.3 | 14.0  | 12.4  | 9.8   | 7.7   | 6.1   | TP304   |                     |              |
| 20.0                                                                                      | 16.7 | 15.0 | 13.8 | 12.9 | 12.3 | 12.0 | 11.7 | 11.5 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4  | 10.1  | 9.8   | 7.7   | 6.1   | TP304H  |                     |              |
| 20.0                                                                                      | 20.0 | 18.9 | 18.3 | 17.5 | 16.6 | 16.2 | 15.8 | 15.5 | 15.2 | 14.9 | 14.6 | 14.3 | 14.0  | 12.4  | 9.8   | 7.7   | 6.1   | TP304H  |                     |              |
| 22.9                                                                                      | 19.1 | 16.7 | 15.1 | 14.0 | 13.3 | 13.0 | 12.8 | 12.5 | 12.3 | 12.1 | 11.8 | 11.6 | 11.3  | 11.0  | 9.8   | 7.7   | 6.1   | TP304N  |                     |              |
| 22.9                                                                                      | 22.9 | 21.7 | 20.3 | 18.9 | 17.9 | 17.5 | 17.2 | 16.9 | 16.6 | 16.3 | 16.0 | 15.6 | 15.2  | 12.4  | 9.8   | 7.7   | 6.1   | TP304N  |                     |              |
| 20.0                                                                                      | 17.3 | 15.6 | 14.3 | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.8 | 11.6 | 11.5 | 11.4 | 11.3  | 11.2  | 11.1  | 9.8   | 7.4   | TP316   | A376                |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.3 | 18.0 | 17.0 | 16.6 | 16.3 | 16.1 | 15.9 | 15.7 | 15.6 | 15.4 | 15.3  | 15.1  | 12.4  | 9.8   | 7.4   | TP316   |                     |              |
| 20.0                                                                                      | 17.3 | 15.6 | 14.3 | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.8 | 11.6 | 11.5 | 11.4 | 11.3  | 11.2  | 11.1  | 9.8   | 7.4   | TP316H  |                     |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.3 | 18.0 | 17.0 | 16.6 | 16.3 | 16.1 | 15.9 | 15.7 | 15.6 | 15.4 | 15.3  | 15.1  | 12.4  | 9.8   | 7.4   | TP316H  |                     |              |
| 22.9                                                                                      | 20.7 | 19.0 | 17.6 | 16.5 | 15.6 | 15.2 | 14.9 | 14.5 | 14.2 | 13.9 | 13.7 | 13.4 | 13.2  | 12.9  | 12.3  | 9.8   | 7.4   | TP316N  |                     |              |
| 22.9                                                                                      | 22.9 | 22.0 | 21.5 | 21.2 | 21.0 | 20.5 | 20.0 | 19.6 | 19.2 | 18.8 | 18.5 | 18.1 | 17.8  | 15.8  | 12.3  | 9.8   | 7.4   | TP316N  |                     |              |
| 20.0                                                                                      | 18.0 | 16.5 | 15.3 | 14.3 | 13.5 | 13.2 | 13.0 | 12.7 | 12.6 | 12.4 | 12.3 | 12.1 | 12.0  | 9.6   | 6.9   | 5.0   | 3.6   | TP321   | A376                |              |
| 20.0                                                                                      | 20.0 | 19.1 | 18.7 | 18.7 | 18.3 | 17.9 | 17.5 | 17.2 | 16.9 | 16.7 | 16.5 | 16.4 | 16.2  | 9.6   | 6.9   | 5.0   | 3.6   | TP321   |                     |              |
| 20.0                                                                                      | 18.0 | 16.5 | 15.3 | 14.3 | 13.5 | 13.2 | 13.0 | 12.7 | 12.6 | 12.4 | 12.3 | 12.1 | 12.0  | 11.9  | 9.1   | 6.9   | 5.4   | TP321H  |                     |              |
| 20.0                                                                                      | 20.0 | 19.1 | 18.7 | 18.7 | 18.3 | 17.9 | 17.5 | 17.2 | 16.9 | 16.7 | 16.5 | 16.4 | 16.2  | 12.3  | 9.1   | 6.9   | 5.4   | TP321H  |                     |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 12.1  | 9.1   | 6.1   | 4.4   | TP347   | A376                |              |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.2 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.0  | 12.1  | 9.1   | 6.1   | 4.4   | TP347   |                     |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 13.4  | 13.3  | 10.5  | 7.9   | TP347H  |                     |              |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.1 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.4  | 16.2  | 14.1  | 10.5  | 7.9   | TP347H  |                     |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 12.1  | 9.1   | 6.1   | 4.4   | TP348   | A376                |              |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.2 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.0  | 12.1  | 9.1   | 6.1   | 4.4   | TP348   |                     |              |
| 31.4                                                                                      | 31.3 | 29.5 | 28.6 | 28.2 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...     | A789                |              |
| 31.4                                                                                      | 31.3 | 29.5 | 28.6 | 28.2 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...     | A790                |              |
| Ferritic/Martensitic                                                                      |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |         |                     |              |
| 17.1                                                                                      | 17.1 | 16.8 | 16.5 | 16.3 | 15.9 | 15.6 | 15.2 | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP405   | A268                |              |
| 17.1                                                                                      | 17.1 | 16.8 | 16.5 | 16.3 | 15.9 | 15.6 | 15.2 | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP410   |                     |              |
| 17.1                                                                                      | 17.1 | 16.8 | 16.5 | 16.3 | 15.9 | 15.6 | 15.2 | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP429   |                     |              |
| 17.1                                                                                      | 17.1 | 16.8 | 16.5 | 16.3 | 15.9 | 15.6 | 15.2 | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP430   |                     |              |
| 18.6                                                                                      | 18.6 | 18.3 | 18.1 | 18.1 | 18.1 | 18.1 | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TPXM-27 |                     |              |
| 20.0                                                                                      | 20.0 | 19.3 | 18.8 | 18.4 | 17.9 | 17.7 | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP446-1 |                     |              |
| 19.4                                                                                      | 19.4 | 19.3 | 19.0 | 18.8 | 18.4 | 18.1 | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TPXM-33 |                     |              |
| Ferritic/Austenitic                                                                       |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |         |                     |              |
| 25.7                                                                                      | 25.7 | 24.8 | 23.9 | 23.3 | 23.1 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | S31803  | A789                |              |
| 27.1                                                                                      | 27.1 | 26.2 | 25.2 | 24.6 | 24.3 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | S32205  |                     |              |
| 33.1                                                                                      | 33.0 | 31.2 | 30.1 | 29.6 | 29.4 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | S32750  |                     |              |
| 25.7                                                                                      | 25.7 | 24.8 | 23.9 | 23.3 | 23.1 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | S31803  | A790                |              |
| 25.7                                                                                      | 25.7 | 24.8 | 23.9 | 23.3 | 23.1 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | S32205  |                     |              |
| 33.1                                                                                      | 33.0 | 31.2 | 30.1 | 29.6 | 29.4 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | S32750  |                     |              |

Table A-3 Stainless Steels (Cont'd)

| Spec. No.                                   | Type or Grade | Class  | UNS Alloy No. | Nominal Composition | P-No.           | Notes                | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |      |
|---------------------------------------------|---------------|--------|---------------|---------------------|-----------------|----------------------|--------------------------------|------------------------------|--------|------|
| Centrifugally Cast Pipe                     |               |        |               |                     |                 |                      |                                |                              |        |      |
| Austenitic                                  |               |        |               |                     |                 |                      |                                |                              |        |      |
| A451                                        | CPF8          | ...    | J92600        | 18Cr-8Ni            | 8               | (1)(8)(10)(17)       | 70                             | 30                           | 0.85   |      |
|                                             | CPF8          | ...    | J92600        | 18Cr-8Ni            | 8               | (1)(8)(9)(10)(17)    | 70                             | 30                           | 0.85   |      |
|                                             | CPF8C         | ...    | J92710        | 18Cr-10Ni-Cb        | 8               | (1)(8)(10)(17)       | 70                             | 30                           | 0.85   |      |
|                                             | CPF8C         | ...    | J92710        | 18Cr-10Ni-Cb        | 8               | (1)(8)(9)(10)(17)    | 70                             | 30                           | 0.85   |      |
|                                             | CPF8M         | ...    | J92900        | 18Cr-9Ni-2Mo        | 8               | (1)(8)(13)(17)       | 70                             | 30                           | 0.85   |      |
|                                             | CPF8M         | ...    | J92900        | 18Cr-9Ni-2Mo        | 8               | (1)(8)(9)(13)(17)    | 70                             | 30                           | 0.85   |      |
| A451                                        | CPH8          | ...    | J93400        | 25Cr-12Ni           | 8               | (1)(8)(10)(17)       | 65                             | 28                           | 0.85   |      |
|                                             | CPH8          | ...    | J93400        | 25Cr-12Ni           | 8               | (1)(8)(9)(10)(17)    | 65                             | 28                           | 0.85   |      |
|                                             | CPH10         | ...    | J93410        | 25Cr-12Ni           | 8               | (1)(6)(8)(10)(17)    | (70)                           | 30                           | 0.85   |      |
|                                             | CPH10         | ...    | J93410        | 25Cr-12Ni           | 8               | (1)(6)(8)(9)(10)(17) | (70)                           | 30                           | 0.85   |      |
| A451                                        | CPH20         | ...    | J93402        | 25Cr-12Ni           | 8               | (1)(6)(8)(10)(17)    | (70)                           | 30                           | 0.85   |      |
|                                             | CPH20         | ...    | J93402        | 25Cr-12Ni           | 8               | (1)(6)(8)(9)(10)(17) | (70)                           | 30                           | 0.85   |      |
|                                             | CPK20         | ...    | J94202        | 25Cr-20Ni           | 8               | (1)(8)(10)(17)       | 65                             | 28                           | 0.85   |      |
|                                             | CPK20         | ...    | J94202        | 25Cr-20Ni           | 8               | (1)(8)(9)(10)(17)    | 65                             | 28                           | 0.85   |      |
| Welded Pipe and Tube — Without Filler Metal |               |        |               |                     |                 |                      |                                |                              |        |      |
| Austenitic                                  |               |        |               |                     |                 |                      |                                |                              |        |      |
| A249                                        | TP304         | ...    | S30400        | 18Cr-8Ni            | 8               | (10)                 | 75                             | 30                           | 0.85   |      |
|                                             | TP304         | ...    | S30400        | 18Cr-8Ni            | 8               | (9)(10)              | 75                             | 30                           | 0.85   |      |
|                                             | TP304H        | ...    | S30409        | 18Cr-8Ni            | 8               | ...                  | 75                             | 30                           | 0.85   |      |
|                                             | TP304H        | ...    | S30409        | 18Cr-8Ni            | 8               | (9)                  | 75                             | 30                           | 0.85   |      |
| A249                                        | TP304L        | ...    | S30403        | 18Cr-8Ni            | 8               | (1)                  | 70                             | 25                           | 0.85   |      |
|                                             | TP304L        | ...    | S30403        | 18Cr-8Ni            | 8               | (1)(9)               | 70                             | 25                           | 0.85   |      |
|                                             | TP304N        | ...    | S30451        | 18Cr-8Ni-N          | 8               | (10)                 | 80                             | 35                           | 0.85   |      |
|                                             | TP304N        | ...    | S30451        | 18Cr-8Ni-N          | 8               | (9)(10)              | 80                             | 35                           | 0.85   |      |
| A249                                        | ...           | ...    | S30815        | 21Cr-11Ni-N         | 8               | (1)                  | 87                             | 45                           | 0.85   |      |
|                                             | ...           | ...    | S30815        | 21Cr-11Ni-N         | 8               | (1)(9)               | 87                             | 45                           | 0.85   |      |
| A249                                        | TP309H        | ...    | S30909        | 23Cr-12Ni           | 8               | (9)                  | 75                             | 30                           | 0.85   |      |
|                                             | TP309H        | ...    | S30909        | 23Cr-12Ni           | 8               | ...                  | 75                             | 30                           | 0.85   |      |
| A249                                        | TP316         | ...    | S31600        | 16Cr-12Ni-2Mo       | 8               | (10)                 | 75                             | 30                           | 0.85   |      |
|                                             | TP316         | ...    | S31600        | 16Cr-12Ni-2Mo       | 8               | (9)(10)              | 75                             | 30                           | 0.85   |      |
|                                             | TP316H        | ...    | S31609        | 16Cr-12Ni-2Mo       | 8               | ...                  | 75                             | 30                           | 0.85   |      |
|                                             | TP316H        | ...    | S31609        | 16Cr-12Ni-2Mo       | 8               | (9)                  | 75                             | 30                           | 0.85   |      |
| (12)                                        | A249          | TP316L | ...           | S31603              | 16Cr-12Ni-2Mo   | 8                    | (1)(29)                        | 70                           | 25     | 0.85 |
| (12)                                        |               | TP316L | ...           | S31603              | 16Cr-12Ni-2Mo   | 8                    | (1)(9)(29)                     | 70                           | 25     | 0.85 |
|                                             |               | TP316N | ...           | S31651              | 16Cr-12Ni-2Mo-N | 8                    | (10)                           | 80                           | 35     | 0.85 |
|                                             |               | TP316N | ...           | S31651              | 16Cr-12Ni-2Mo-N | 8                    | (9)(10)                        | 80                           | 35     | 0.85 |
| A249                                        | TP317         | ...    | S31700        | 18Cr-13Ni-3Mo       | 8               | (1)(10)              | 75                             | 30                           | 0.85   |      |
|                                             | TP317         | ...    | S31700        | 18Cr-13Ni-3Mo       | 8               | (1)(9)(10)           | 75                             | 30                           | 0.85   |      |
|                                             | TP321         | ...    | S32100        | 18Cr-10Ni-Ti        | 8               | (10)                 | 75                             | 30                           | 0.85   |      |
|                                             | TP321         | ...    | S32100        | 18Cr-10Ni-Ti        | 8               | (9)(10)              | 75                             | 30                           | 0.85   |      |
|                                             | TP321H        | ...    | S32109        | 18Cr-10Ni-Ti        | 8               | ...                  | 75                             | 30                           | 0.85   |      |
|                                             | TP321H        | ...    | S32109        | 18Cr-10Ni-Ti        | 8               | (9)                  | 75                             | 30                           | 0.85   |      |

Table A-3 Stainless Steels (Cont'd)

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       | Type<br>or<br>Grade                                       | Spec.<br>No. |  |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|-----------------------------------------------------------|--------------|--|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 |                                                           |              |  |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       | Centrifugally Cast Pipe<br>Austenitic                     |              |  |
| 17.0                                                                                      | 14.2 | 12.7 | 11.7 | 11.0 | 10.5 | 10.2 | 9.9  | 9.8  | 9.5  | 9.4  | 9.2  | 9.0  | 8.8   | 8.1   | 6.4   | 5.1   | 4.1   | CPF8                                                      | A451         |  |
| 17.0                                                                                      | 16.1 | 15.0 | 14.5 | 14.4 | 14.1 | 13.8 | 13.4 | 13.2 | 12.9 | 12.7 | 12.4 | 12.2 | 10.4  | 8.1   | 6.4   | 5.1   | 4.1   | CPF8                                                      |              |  |
| 17.0                                                                                      | 14.2 | 12.7 | 11.7 | 11.0 | 10.4 | 10.2 | 10.0 | 9.8  | 9.5  | 9.4  | 9.2  | 9.0  | 8.8   | 8.6   | 7.8   | 5.2   | 3.8   | CPF8C                                                     |              |  |
| 17.0                                                                                      | 16.1 | 15.0 | 14.5 | 14.4 | 14.1 | 13.8 | 13.5 | 13.2 | 12.9 | 12.6 | 12.4 | 12.1 | 11.9  | 10.3  | 7.8   | 5.2   | 3.8   | CPF8C                                                     |              |  |
| 17.0                                                                                      | 14.6 | 13.2 | 12.1 | 11.3 | 10.7 | 10.4 | 10.3 | 10.1 | 10.0 | 9.9  | 9.8  | 9.7  | 9.6   | 9.5   | 7.6   | 5.9   | 4.6   | CPF8M                                                     |              |  |
| 17.0                                                                                      | 17.0 | 16.5 | 16.3 | 15.2 | 14.4 | 14.1 | 13.8 | 13.6 | 13.5 | 13.3 | 13.2 | 13.1 | 12.6  | 9.8   | 7.6   | 5.9   | 4.6   | CPF8M                                                     |              |  |
| 15.8                                                                                      | 13.0 | 12.0 | 11.5 | 11.1 | 10.8 | 10.5 | 10.3 | 10.0 | 9.7  | 9.4  | 9.1  | 8.7  | 8.4   | 7.2   | 5.5   | 4.3   | 3.2   | CPH8                                                      | A451         |  |
| 15.8                                                                                      | 14.4 | 13.4 | 13.1 | 13.1 | 13.1 | 13.0 | 12.9 | 12.8 | 12.5 | 12.2 | 11.8 | 11.3 | 9.4   | 7.2   | 5.5   | 4.3   | 3.2   | CPH8                                                      |              |  |
| 17.0                                                                                      | 13.9 | 12.8 | 12.3 | 11.9 | 11.5 | 11.3 | 11.0 | 10.7 | 10.4 | 10.0 | 9.7  | 7.8  | 5.0   | 3.2   | 2.1   | 1.3   | 0.85  | CPH10                                                     |              |  |
| 17.0                                                                                      | 15.6 | 14.5 | 14.1 | 14.1 | 14.1 | 14.0 | 13.9 | 13.8 | 13.5 | 13.1 | 12.7 | 7.8  | 5.0   | 3.2   | 2.1   | 1.3   | 0.85  | CPH10                                                     |              |  |
| 17.0                                                                                      | 13.9 | 12.8 | 12.3 | 11.9 | 11.5 | 11.3 | 11.0 | 10.7 | 10.4 | 10.0 | 9.7  | 9.4  | 9.0   | 7.2   | 5.5   | 4.3   | 3.2   | CPH20                                                     | A451         |  |
| 17.0                                                                                      | 15.6 | 14.5 | 14.1 | 14.1 | 14.1 | 14.0 | 13.9 | 13.8 | 13.5 | 13.1 | 12.7 | 12.1 | 9.4   | 7.2   | 5.5   | 4.3   | 3.2   | CPH20                                                     |              |  |
| 15.8                                                                                      | 13.0 | 12.0 | 11.5 | 11.1 | 10.8 | 10.5 | 10.3 | 10.0 | 9.7  | 9.4  | 9.1  | 8.7  | 8.4   | 8.1   | 7.2   | 6.2   | 5.1   | CPK20                                                     |              |  |
| 15.8                                                                                      | 14.4 | 13.4 | 13.1 | 13.1 | 13.1 | 13.0 | 12.9 | 12.8 | 12.5 | 12.2 | 11.8 | 11.3 | 9.6   | 8.3   | 7.2   | 6.2   | 5.1   | CPK20                                                     |              |  |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       | Welded Pipe and Tube – Without Filler Metal<br>Austenitic |              |  |
| 17.0                                                                                      | 14.2 | 12.7 | 11.7 | 11.0 | 10.4 | 10.2 | 10.0 | 9.8  | 9.6  | 9.4  | 9.2  | 9.0  | 8.8   | 8.6   | 8.3   | 6.6   | 5.2   | TP304                                                     | A249         |  |
| 17.0                                                                                      | 17.0 | 16.1 | 15.5 | 14.8 | 14.1 | 13.8 | 13.5 | 13.2 | 12.9 | 12.6 | 12.4 | 12.1 | 11.9  | 10.5  | 8.3   | 6.6   | 5.2   | TP304                                                     |              |  |
| 17.0                                                                                      | 14.2 | 12.7 | 11.7 | 11.0 | 10.4 | 10.2 | 10.0 | 9.8  | 9.6  | 9.4  | 9.2  | 9.0  | 8.8   | 8.6   | 8.3   | 6.6   | 5.2   | TP304H                                                    |              |  |
| 17.0                                                                                      | 17.0 | 16.1 | 15.5 | 14.8 | 14.1 | 13.8 | 13.5 | 13.2 | 12.9 | 12.6 | 12.4 | 12.1 | 11.9  | 10.5  | 8.3   | 6.6   | 5.2   | TP304H                                                    |              |  |
| 14.2                                                                                      | 12.1 | 10.9 | 9.9  | 9.3  | 8.8  | 8.6  | 8.5  | 8.3  | 8.2  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP304L                                                    | A249         |  |
| 14.2                                                                                      | 14.2 | 14.2 | 13.4 | 12.5 | 11.9 | 11.7 | 11.4 | 11.3 | 11.1 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP304L                                                    |              |  |
| 19.4                                                                                      | 16.2 | 14.2 | 12.8 | 11.9 | 11.3 | 11.0 | 10.8 | 10.6 | 10.5 | 10.3 | 10.0 | 9.8  | 9.6   | 9.4   | 8.3   | 6.6   | 5.2   | TP304N                                                    |              |  |
| 19.4                                                                                      | 19.4 | 18.5 | 17.3 | 16.0 | 15.2 | 14.9 | 14.6 | 14.4 | 14.1 | 13.8 | 13.6 | 13.3 | 13.0  | 10.5  | 8.3   | 6.6   | 5.2   | TP304N                                                    |              |  |
| 21.2                                                                                      | 21.0 | 18.7 | 16.9 | 15.7 | 15.0 | 14.8 | 14.6 | 14.5 | 14.3 | 14.1 | 13.9 | 13.8 | 12.7  | 9.9   | 7.7   | 5.9   | 4.4   | ...                                                       | A249         |  |
| 21.2                                                                                      | 21.0 | 19.8 | 19.0 | 18.5 | 18.2 | 18.0 | 17.9 | 17.7 | 17.5 | 17.3 | 17.0 | 16.2 | 12.7  | 9.9   | 7.7   | 5.9   | 4.4   | ...                                                       |              |  |
| 17.0                                                                                      | 17.0 | 17.0 | 17.0 | 16.5 | 15.9 | 15.7 | 15.5 | 15.3 | 15.1 | 14.8 | 14.6 | 14.4 | 11.7  | 8.8   | 6.5   | 4.7   | 3.4   | TP309H                                                    | A249         |  |
| 17.0                                                                                      | 14.9 | 13.7 | 12.8 | 12.2 | 11.8 | 11.6 | 11.5 | 11.3 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4  | 8.8   | 6.5   | 4.7   | 3.4   | TP309H                                                    |              |  |
| 17.0                                                                                      | 14.7 | 13.2 | 12.1 | 11.3 | 10.7 | 10.5 | 10.3 | 10.1 | 10.0 | 9.9  | 9.8  | 9.7  | 9.6   | 9.5   | 9.4   | 8.3   | 6.3   | TP316                                                     | A249         |  |
| 17.0                                                                                      | 17.0 | 17.0 | 16.4 | 15.3 | 14.5 | 14.1 | 13.9 | 13.7 | 13.5 | 13.4 | 13.2 | 13.1 | 13.0  | 12.9  | 10.5  | 8.3   | 6.3   | TP316                                                     |              |  |
| 17.0                                                                                      | 14.7 | 13.2 | 12.1 | 11.3 | 10.7 | 10.5 | 10.3 | 10.1 | 10.0 | 9.9  | 9.8  | 9.7  | 9.6   | 9.5   | 9.4   | 8.3   | 6.3   | TP316H                                                    |              |  |
| 17.0                                                                                      | 17.0 | 17.0 | 16.4 | 15.3 | 14.5 | 14.1 | 13.9 | 13.7 | 13.5 | 13.4 | 13.2 | 13.1 | 13.0  | 12.9  | 10.5  | 8.3   | 6.3   | TP316H                                                    |              |  |
| 14.2                                                                                      | 12.1 | 10.8 | 9.9  | 9.3  | 8.8  | 8.7  | 8.5  | 8.3  | 8.1  | 8.0  | 7.8  | 7.7  | 7.5   | 7.3   | 7.2   | 7.1   | 5.4   | TP316L                                                    | A249         |  |
| 14.2                                                                                      | 14.2 | 14.2 | 13.4 | 12.5 | 11.9 | 11.7 | 11.4 | 11.2 | 11.0 | 10.8 | 10.5 | 10.3 | 10.1  | 9.9   | 9.7   | 7.5   | 5.4   | TP316L                                                    |              |  |
| 19.4                                                                                      | 17.6 | 16.1 | 15.0 | 14.0 | 13.3 | 12.9 | 12.6 | 12.3 | 12.1 | 11.9 | 11.6 | 11.4 | 11.2  | 11.0  | 10.5  | 8.3   | 6.3   | TP316N                                                    |              |  |
| 19.4                                                                                      | 19.4 | 18.7 | 18.2 | 18.1 | 17.9 | 17.4 | 17.0 | 16.7 | 16.3 | 16.0 | 15.7 | 15.4 | 15.1  | 13.4  | 10.5  | 8.3   | 6.3   | TP316N                                                    |              |  |
| 17.0                                                                                      | 14.7 | 13.2 | 12.1 | 11.3 | 10.7 | 10.5 | 10.3 | 10.1 | 10.0 | 9.9  | 9.8  | 9.7  | 9.6   | 9.5   | 9.4   | 8.3   | 6.3   | TP317                                                     | A249         |  |
| 17.0                                                                                      | 17.0 | 17.0 | 16.4 | 15.3 | 14.5 | 14.1 | 13.9 | 13.7 | 13.5 | 13.4 | 13.2 | 13.1 | 13.0  | 12.9  | 10.5  | 8.3   | 6.3   | TP317                                                     |              |  |
| 17.0                                                                                      | 15.3 | 14.1 | 13.0 | 12.2 | 11.5 | 11.2 | 11.0 | 10.8 | 10.7 | 10.5 | 10.4 | 10.3 | 10.2  | 8.2   | 5.9   | 4.3   | 3.1   | TP321                                                     |              |  |
| 17.0                                                                                      | 17.0 | 16.2 | 15.9 | 15.9 | 15.5 | 15.2 | 14.9 | 14.6 | 14.4 | 14.2 | 14.1 | 13.9 | 13.8  | 8.2   | 5.9   | 4.3   | 3.1   | TP321                                                     |              |  |
| 17.0                                                                                      | 15.3 | 14.1 | 13.0 | 12.2 | 11.5 | 11.2 | 11.0 | 10.8 | 10.7 | 10.5 | 10.4 | 10.3 | 10.2  | 10.1  | 7.7   | 5.9   | 4.6   | TP321H                                                    |              |  |
| 17.0                                                                                      | 17.0 | 16.2 | 15.9 | 15.9 | 15.5 | 15.2 | 14.9 | 14.6 | 14.4 | 14.2 | 14.1 | 13.9 | 13.8  | 10.5  | 7.7   | 5.9   | 4.6   | TP321H                                                    |              |  |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |                                                           |              |  |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |                                                           |              |  |

Table A-3 Stainless Steels (Cont'd)

| Spec. No.                                                   | Type or Grade | Class  | UNS Alloy No. | Nominal Composition | P-No. | Notes      | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|-------------------------------------------------------------|---------------|--------|---------------|---------------------|-------|------------|--------------------------------|------------------------------|--------|
| <b>Welded Pipe and Tube — Without Filler Metal (Cont'd)</b> |               |        |               |                     |       |            |                                |                              |        |
| <b>Austenitic (Cont'd)</b>                                  |               |        |               |                     |       |            |                                |                              |        |
| A249                                                        | TP347         | ...    | S34700        | 18Cr-10Ni-Cb        | 8     | (10)       | 75                             | 30                           | 0.85   |
|                                                             | TP347         | ...    | S34700        | 18Cr-10Ni-Cb        | 8     | (9)(10)    | 75                             | 30                           | 0.85   |
|                                                             | TP347H        | ...    | S34709        | 18Cr-10Ni-Cb        | 8     | ...        | 75                             | 30                           | 0.85   |
|                                                             | TP347H        | ...    | S34709        | 18Cr-10Ni-Cb        | 8     | (9)        | 75                             | 30                           | 0.85   |
| A249                                                        | TP348         | ...    | S34800        | 18Cr-10Ni-Cb        | 8     | (10)       | 75                             | 30                           | 0.85   |
|                                                             | TP348         | ...    | S34800        | 18Cr-10Ni-Cb        | 8     | (9)(10)    | 75                             | 30                           | 0.85   |
|                                                             | TP348H        | ...    | S34809        | 18Cr-10Ni-Cb        | 8     | ...        | 75                             | 30                           | 0.85   |
|                                                             | TP348H        | ...    | S34809        | 18Cr-10Ni-Cb        | 8     | (9)        | 75                             | 30                           | 0.85   |
| A249                                                        | ...           | ...    | S31254        | 20Cr-18Ni-6Mo       | 8     | (1)        | 94                             | 44                           | 0.85   |
|                                                             | ...           | ...    | S31254        | 20Cr-18Ni-6Mo       | 8     | (1)(9)     | 94                             | 44                           | 0.85   |
| A312                                                        | TP304         | ...    | S30400        | 18Cr-8Ni            | 8     | (10)       | 75                             | 30                           | 0.85   |
|                                                             | TP304         | ...    | S30400        | 18Cr-8Ni            | 8     | (9)(10)    | 75                             | 30                           | 0.85   |
|                                                             | TP304H        | ...    | S30409        | 18Cr-8Ni            | 8     | ...        | 75                             | 30                           | 0.85   |
|                                                             | TP304H        | ...    | S30409        | 18Cr-8Ni            | 8     | (9)        | 75                             | 30                           | 0.85   |
| A312                                                        | TP304L        | ...    | S30403        | 18Cr-8Ni            | 8     | (1)        | 70                             | 25                           | 0.85   |
|                                                             | TP304L        | ...    | S30403        | 18Cr-8Ni            | 8     | (1)(9)     | 70                             | 25                           | 0.85   |
|                                                             | TP304N        | ...    | S30451        | 18Cr-8Ni-N          | 8     | (10)       | 80                             | 35                           | 0.85   |
|                                                             | TP304N        | ...    | S30451        | 18Cr-8Ni-N          | 8     | (9)(10)    | 80                             | 35                           | 0.85   |
| A312                                                        | ...           | ...    | S30815        | 21Cr-11Ni-N         | 8     | (1)        | 87                             | 45                           | 0.85   |
|                                                             | ...           | ...    | S30815        | 21Cr-11Ni-N         | 8     | (1)(9)     | 87                             | 45                           | 0.85   |
| A312                                                        | TP309H        | ...    | S30909        | 23Cr-12Ni           | 8     | (9)        | 75                             | 30                           | 0.85   |
|                                                             | TP309H        | ...    | S30909        | 23Cr-12Ni           | 8     | ...        | 75                             | 30                           | 0.85   |
|                                                             | TP310H        | ...    | S31009        | 23Cr-20Ni           | 8     | (9)        | 75                             | 30                           | 0.85   |
|                                                             | TP310H        | ...    | S31009        | 23Cr-20Ni           | 8     | ...        | 75                             | 30                           | 0.85   |
| A312                                                        | TP316         | ...    | S31600        | 16Cr-12Ni-2Mo       | 8     | (10)       | 75                             | 30                           | 0.85   |
|                                                             | TP316         | ...    | S31600        | 16Cr-12Ni-2Mo       | 8     | (9)(10)    | 75                             | 30                           | 0.85   |
|                                                             | TP316H        | ...    | S31609        | 16Cr-12Ni-2Mo       | 8     | ...        | 75                             | 30                           | 0.85   |
|                                                             | TP316H        | ...    | S31609        | 16Cr-12Ni-2Mo       | 8     | (9)        | 75                             | 30                           | 0.85   |
| (12)                                                        | A312          | TP316L | S31603        | 16Cr-12Ni-2Mo       | 8     | (1)(29)    | 70                             | 25                           | 0.85   |
| (12)                                                        |               | TP316L | S31603        | 16Cr-12Ni-2Mo       | 8     | (1)(9)(29) | 70                             | 25                           | 0.85   |
|                                                             |               | TP316N | S31651        | 16Cr-12Ni-2Mo-N     | 8     | (10)       | 80                             | 35                           | 0.85   |
|                                                             |               | TP316N | S31651        | 16Cr-12Ni-2Mo-N     | 8     | (9)(10)    | 80                             | 35                           | 0.85   |
| A312                                                        | TP317         | ...    | S31700        | 18Cr-13Ni-3Mo       | 8     | (1)(10)    | 75                             | 30                           | 0.85   |
|                                                             | TP317         | ...    | S31700        | 18Cr-13Ni-3Mo       | 8     | (1)(9)(10) | 75                             | 30                           | 0.85   |
|                                                             | TP321         | ...    | S32100        | 18Cr-10Ni-Ti        | 8     | (10)       | 75                             | 30                           | 0.85   |
|                                                             | TP321         | ...    | S32100        | 18Cr-10Ni-Ti        | 8     | (9)(10)    | 75                             | 30                           | 0.85   |
|                                                             | TP321H        | ...    | S32109        | 18Cr-10Ni-Ti        | 8     | ...        | 75                             | 30                           | 0.85   |
|                                                             | TP321H        | ...    | S32109        | 18Cr-10Ni-Ti        | 8     | (9)        | 75                             | 30                           | 0.85   |
| A312                                                        | TP347         | ...    | S34700        | 18Cr-10Ni-Cb        | 8     | (10)       | 75                             | 30                           | 0.85   |
|                                                             | TP347         | ...    | S34700        | 18Cr-10Ni-Cb        | 8     | (9)(10)    | 75                             | 30                           | 0.85   |
|                                                             | TP347H        | ...    | S34709        | 18Cr-10Ni-Cb        | 8     | ...        | 75                             | 30                           | 0.85   |
|                                                             | TP347H        | ...    | S34709        | 18Cr-10Ni-Cb        | 8     | (9)        | 75                             | 30                           | 0.85   |

Table A-3 Stainless Steels (Cont'd)

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        | Type<br>or<br>Grade | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|--------|---------------------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 |        |                     |              |
| Welded Pipe and Tube – Without Filler Metal (Cont'd)                                      |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        |                     |              |
| Austenitic (Cont'd)                                                                       |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        |                     |              |
| 17.0                                                                                      | 15.6 | 14.6 | 13.6 | 12.8 | 12.2 | 11.9 | 11.8 | 11.6 | 11.5 | 11.5 | 11.4 | 11.4 | 11.4  | 10.3  | 7.8   | 5.2   | 3.8   | TP347  | A249                |              |
| 17.0                                                                                      | 17.0 | 16.0 | 15.1 | 14.6 | 14.3 | 14.3 | 14.3 | 14.3 | 14.3 | 14.3 | 14.2 | 14.1 | 13.6  | 10.3  | 7.8   | 5.2   | 3.8   | TP347  |                     |              |
| 17.0                                                                                      | 15.6 | 14.6 | 13.6 | 12.8 | 12.2 | 11.9 | 11.8 | 11.6 | 11.5 | 11.5 | 11.4 | 11.4 | 11.4  | 11.4  | 11.3  | 8.9   | 6.7   | TP347H |                     |              |
| 17.0                                                                                      | 17.0 | 16.0 | 15.1 | 14.6 | 14.3 | 14.3 | 14.3 | 14.3 | 14.3 | 14.3 | 14.2 | 14.1 | 14.0  | 13.7  | 12.0  | 8.9   | 6.7   | TP347H |                     |              |
| 17.0                                                                                      | 15.6 | 14.6 | 13.6 | 12.8 | 12.2 | 11.9 | 11.8 | 11.6 | 11.5 | 11.5 | 11.4 | 11.4 | 11.4  | 10.3  | 7.8   | 5.2   | 3.8   | TP348  | A249                |              |
| 17.0                                                                                      | 17.0 | 16.0 | 15.1 | 14.6 | 14.3 | 14.3 | 14.3 | 14.3 | 14.3 | 14.3 | 14.2 | 14.1 | 13.6  | 10.3  | 7.8   | 5.2   | 3.8   | TP348  |                     |              |
| 17.0                                                                                      | 15.6 | 14.6 | 13.6 | 12.8 | 12.2 | 11.9 | 11.8 | 11.6 | 11.5 | 11.5 | 11.4 | 11.4 | 11.4  | 11.4  | 11.3  | 8.9   | 6.7   | TP348H |                     |              |
| 17.0                                                                                      | 17.0 | 16.0 | 15.1 | 14.6 | 14.3 | 14.3 | 14.3 | 14.3 | 14.3 | 14.3 | 14.2 | 14.1 | 14.0  | 13.7  | 12.0  | 8.9   | 6.7   | TP348H |                     |              |
| 22.8                                                                                      | 20.3 | 18.2 | 16.8 | 15.8 | 15.2 | 15.0 | 14.8 | 14.7 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...    | A249                |              |
| 22.8                                                                                      | 22.8 | 21.7 | 20.7 | 20.0 | 19.5 | 19.4 | 19.3 | 19.2 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...    |                     |              |
| 17.0                                                                                      | 14.2 | 12.7 | 11.7 | 11.0 | 10.4 | 10.2 | 10.0 | 9.8  | 9.6  | 9.4  | 9.2  | 9.0  | 8.8   | 8.6   | 8.3   | 6.6   | 5.2   | TP304  | A312                |              |
| 17.0                                                                                      | 17.0 | 16.1 | 15.5 | 14.8 | 14.1 | 13.8 | 13.5 | 13.2 | 12.9 | 12.6 | 12.4 | 12.1 | 11.9  | 10.5  | 8.3   | 6.6   | 5.2   | TP304  |                     |              |
| 17.0                                                                                      | 14.2 | 12.7 | 11.7 | 11.0 | 10.4 | 10.2 | 10.0 | 9.8  | 9.6  | 9.4  | 9.2  | 9.0  | 8.8   | 8.6   | 8.3   | 6.6   | 5.2   | TP304H |                     |              |
| 17.0                                                                                      | 17.0 | 16.1 | 15.5 | 14.8 | 14.1 | 13.8 | 13.5 | 13.2 | 12.9 | 12.6 | 12.4 | 12.1 | 11.9  | 10.5  | 8.3   | 6.6   | 5.2   | TP304H |                     |              |
| 14.2                                                                                      | 12.1 | 10.9 | 9.9  | 9.3  | 8.8  | 8.6  | 8.5  | 8.3  | 8.2  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP304L | A312                |              |
| 14.2                                                                                      | 14.2 | 14.2 | 13.4 | 12.5 | 11.9 | 11.7 | 11.4 | 11.3 | 11.1 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP304L |                     |              |
| 19.4                                                                                      | 16.2 | 14.2 | 12.8 | 11.9 | 11.3 | 11.0 | 10.8 | 10.6 | 10.5 | 10.3 | 10.0 | 9.8  | 9.6   | 9.4   | 8.3   | 6.6   | 5.2   | TP304N |                     |              |
| 19.4                                                                                      | 19.4 | 18.5 | 17.3 | 16.0 | 15.2 | 14.9 | 14.6 | 14.4 | 14.1 | 13.8 | 13.6 | 13.3 | 13.0  | 10.5  | 8.3   | 6.6   | 5.2   | TP304N |                     |              |
| 21.2                                                                                      | 21.0 | 18.7 | 16.9 | 15.7 | 15.0 | 14.8 | 14.6 | 14.5 | 14.3 | 14.1 | 13.9 | 13.8 | 12.7  | 9.9   | 7.7   | 5.9   | 4.4   | ...    | A312                |              |
| 21.2                                                                                      | 21.0 | 19.8 | 19.0 | 18.5 | 18.2 | 18.0 | 17.9 | 17.7 | 17.5 | 17.3 | 17.0 | 16.2 | 12.7  | 9.9   | 7.7   | 5.9   | 4.4   | ...    |                     |              |
| 17.0                                                                                      | 17.0 | 17.0 | 17.0 | 16.5 | 15.9 | 15.7 | 15.5 | 15.3 | 15.1 | 14.8 | 14.6 | 14.4 | 11.7  | 8.8   | 6.5   | 4.7   | 3.4   | TP309H | A312                |              |
| 17.0                                                                                      | 14.9 | 13.7 | 12.8 | 12.2 | 11.8 | 11.6 | 11.5 | 11.3 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4  | 8.8   | 6.5   | 4.7   | 3.4   | TP309H |                     |              |
| 17.0                                                                                      | 17.0 | 17.0 | 16.9 | 16.4 | 15.7 | 15.5 | 15.2 | 15.0 | 14.8 | 14.6 | 14.4 | 14.2 | 11.7  | 8.8   | 6.5   | 4.7   | 3.4   | TP310H |                     |              |
| 17.0                                                                                      | 15.0 | 13.7 | 12.8 | 12.1 | 11.7 | 11.5 | 11.3 | 11.1 | 11.0 | 10.8 | 10.7 | 10.5 | 10.3  | 8.8   | 6.5   | 4.7   | 3.4   | TP310H |                     |              |
| 17.0                                                                                      | 14.7 | 13.2 | 12.1 | 11.3 | 10.7 | 10.5 | 10.3 | 10.1 | 10.0 | 9.9  | 9.8  | 9.7  | 9.6   | 9.5   | 9.4   | 8.3   | 6.3   | TP316  | A312                |              |
| 17.0                                                                                      | 17.0 | 17.0 | 16.4 | 15.3 | 14.5 | 14.1 | 13.9 | 13.7 | 13.5 | 13.4 | 13.2 | 13.1 | 13.0  | 12.9  | 10.5  | 8.3   | 6.3   | TP316  |                     |              |
| 17.0                                                                                      | 14.7 | 13.2 | 12.1 | 11.3 | 10.7 | 10.5 | 10.3 | 10.1 | 10.0 | 9.9  | 9.8  | 9.7  | 9.6   | 9.5   | 9.4   | 8.3   | 6.3   | TP316H |                     |              |
| 17.0                                                                                      | 17.0 | 17.0 | 16.4 | 15.3 | 14.5 | 14.1 | 13.9 | 13.7 | 13.5 | 13.4 | 13.2 | 13.1 | 13.0  | 12.9  | 10.5  | 8.3   | 6.3   | TP316H |                     |              |
| 14.2                                                                                      | 12.1 | 10.8 | 9.9  | 9.3  | 8.8  | 8.7  | 8.5  | 8.3  | 8.1  | 8.0  | 7.8  | 7.7  | 7.5   | 7.3   | 7.2   | 7.1   | 5.4   | TP316L | A312                |              |
| 14.2                                                                                      | 14.2 | 14.2 | 13.4 | 12.5 | 11.9 | 11.7 | 11.4 | 11.2 | 11.0 | 10.8 | 10.5 | 10.3 | 10.1  | 9.9   | 9.7   | 7.5   | 5.4   | TP316L | (12)                |              |
| 19.4                                                                                      | 17.6 | 16.1 | 15.0 | 14.0 | 13.3 | 12.9 | 12.6 | 12.3 | 12.1 | 11.9 | 11.6 | 11.4 | 11.2  | 11.0  | 10.5  | 8.3   | 6.3   | TP316N |                     |              |
| 19.4                                                                                      | 19.4 | 18.7 | 18.2 | 18.1 | 17.9 | 17.4 | 17.0 | 16.7 | 16.3 | 16.0 | 15.7 | 15.4 | 15.1  | 13.4  | 10.5  | 8.3   | 6.3   | TP316N |                     |              |
| 17.0                                                                                      | 14.7 | 13.2 | 12.1 | 11.3 | 10.7 | 10.5 | 10.3 | 10.1 | 10.0 | 9.9  | 9.8  | 9.7  | 9.6   | 9.5   | 9.4   | 8.3   | 6.3   | TP317  | A312                |              |
| 17.0                                                                                      | 17.0 | 17.0 | 16.4 | 15.3 | 14.5 | 14.1 | 13.9 | 13.7 | 13.5 | 13.4 | 13.2 | 13.1 | 13.0  | 12.9  | 10.5  | 8.3   | 6.3   | TP317  |                     |              |
| 17.0                                                                                      | 15.3 | 14.1 | 13.0 | 12.2 | 11.5 | 11.2 | 11.0 | 10.8 | 10.7 | 10.5 | 10.4 | 10.3 | 10.2  | 8.2   | 5.9   | 4.3   | 3.1   | TP321  |                     |              |
| 17.0                                                                                      | 17.0 | 16.2 | 15.9 | 15.9 | 15.5 | 15.2 | 14.9 | 14.6 | 14.4 | 14.2 | 14.1 | 13.9 | 13.8  | 8.2   | 5.9   | 4.3   | 3.1   | TP321  |                     |              |
| 17.0                                                                                      | 15.3 | 14.1 | 13.0 | 12.2 | 11.5 | 11.2 | 11.0 | 10.8 | 10.7 | 10.5 | 10.4 | 10.3 | 10.2  | 10.1  | 7.7   | 5.9   | 4.6   | TP321H |                     |              |
| 17.0                                                                                      | 17.0 | 16.2 | 15.9 | 15.9 | 15.5 | 15.2 | 14.9 | 14.6 | 14.4 | 14.2 | 14.1 | 13.9 | 13.8  | 10.5  | 7.7   | 5.9   | 4.6   | TP321H |                     |              |
| 17.0                                                                                      | 15.6 | 14.6 | 13.6 | 12.8 | 12.2 | 11.9 | 11.8 | 11.6 | 11.5 | 11.5 | 11.4 | 11.4 | 11.4  | 10.3  | 7.8   | 5.2   | 3.8   | TP347  | A312                |              |
| 17.0                                                                                      | 17.0 | 16.0 | 15.1 | 14.6 | 14.3 | 14.3 | 14.3 | 14.3 | 14.3 | 14.3 | 14.2 | 14.1 | 13.6  | 10.3  | 7.8   | 5.2   | 3.8   | TP347  |                     |              |
| 17.0                                                                                      | 15.6 | 14.6 | 13.6 | 12.8 | 12.2 | 11.9 | 11.8 | 11.6 | 11.5 | 11.5 | 11.4 | 11.4 | 11.4  | 11.4  | 11.3  | 8.9   | 6.7   | TP347H |                     |              |
| 17.0                                                                                      | 17.0 | 16.0 | 15.1 | 14.6 | 14.3 | 14.3 | 14.3 | 14.3 | 14.3 | 14.3 | 14.2 | 14.1 | 14.0  | 13.7  | 12.0  | 8.9   | 6.7   | TP347H |                     |              |

(12)

Table A-3 Stainless Steels (Cont'd)

| Spec. No.                                                   | Type or Grade | Class | UNS Alloy No. | Nominal Composition    | P-No. | Notes          | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|-------------------------------------------------------------|---------------|-------|---------------|------------------------|-------|----------------|--------------------------------|------------------------------|--------|
| <b>Welded Pipe and Tube — Without Filler Metal (Cont'd)</b> |               |       |               |                        |       |                |                                |                              |        |
| <b>Austenitic (Cont'd)</b>                                  |               |       |               |                        |       |                |                                |                              |        |
| A312                                                        | TP348         | ...   | S34800        | 18Cr-10Ni-Cb           | 8     | (1)(10)        | 75                             | 30                           | 0.85   |
|                                                             | TP348         | ...   | S34800        | 18Cr-10Ni-Cb           | 8     | (1)(9)(10)     | 75                             | 30                           | 0.85   |
|                                                             | TP348H        | ...   | S34809        | 18Cr-10Ni-Cb           | 8     | (1)            | 75                             | 30                           | 0.85   |
|                                                             | TP348H        | ...   | S34809        | 18Cr-10Ni-Cb           | 8     | (1)(9)         | 75                             | 30                           | 0.85   |
| A312                                                        | TPXM-15       | ...   | S38100        | 18Cr-18Ni-2Si          | 8     | (1)            | 75                             | 30                           | 0.85   |
|                                                             | TPXM-15       | ...   | S38100        | 18Cr-18Ni-2Si          | 8     | (1)(9)         | 75                             | 30                           | 0.85   |
|                                                             | ...           | ...   | S31254        | 20Cr-18Ni-6Mo          | 8     | (1)            | 95                             | 45                           | 0.85   |
|                                                             | ...           | ...   | S31254        | 20Cr-18Ni-6Mo          | 8     | (1)(9)         | 95                             | 45                           | 0.85   |
| A409                                                        | ...           | ...   | S30815        | 21Cr-11Ni-N            | 8     | (1)            | 87                             | 45                           | 0.85   |
|                                                             | ...           | ...   | S30815        | 21Cr-11Ni-N            | 8     | (1)(9)         | 87                             | 45                           | 0.85   |
| (12)                                                        | A789          | ...   | S32550        | 25.5Cr-5.5Ni-3.5Mo-2Cu | 10H   | (1)(25)(26)    | 110                            | 80                           | 0.85   |
| (12)                                                        | A790          | ...   | S32550        | 25.5Cr-5.5Ni-3.5Mo-2Cu | 10H   | (1)(25)(26)    | 110                            | 80                           | 0.85   |
| <b>Ferritic/Martensitic</b>                                 |               |       |               |                        |       |                |                                |                              |        |
| A268                                                        | TP405         | ...   | S40500        | 12Cr-Al                | 7     | ...            | 60                             | 30                           | 0.85   |
|                                                             | TP410         | ...   | S41000        | 13Cr                   | 6     | ...            | 60                             | 30                           | 0.85   |
|                                                             | TP429         | ...   | S42900        | 15Cr                   | 6     | ...            | 60                             | 35                           | 0.85   |
|                                                             | TP430         | ...   | S43000        | 17Cr                   | 7     | ...            | 60                             | 35                           | 0.85   |
|                                                             | TP446-1       | ...   | S44600        | 27Cr                   | 10I   | (1)            | 70                             | 40                           | 0.85   |
|                                                             | TPXM-27       | ...   | S44627        | 26Cr-1Mo               | 10I   | (1)(2)         | 65                             | 40                           | 0.85   |
|                                                             | TPXM-33       | ...   | S44626        | 27Cr-1Mo-Ti            | 10I   | (2)            | 68                             | 45                           | 0.85   |
| <b>Ferritic/Austenitic</b>                                  |               |       |               |                        |       |                |                                |                              |        |
| A789                                                        | S31803        | ...   | S31803        | 22Cr-5.5Ni-3Mo-N       | 10H   | (1)(23)(24)    | 90                             | 65                           | 0.85   |
|                                                             | S32205        | ...   | S32205        | 22Cr-5.5Ni-3Mo-N       | 10H   | (1)(23)(24)    | 95                             | 70                           | 0.85   |
|                                                             | S32750        | ...   | S32750        | 25Cr-7Ni-4Mo-N         | 10H   | (1)(22)(23)    | 116                            | 80                           | 0.85   |
| A790                                                        | S31803        | ...   | S31803        | 22Cr-5.5Ni-3Mo-N       | 10H   | (1)(23)(24)    | 90                             | 65                           | 0.85   |
|                                                             | S32205        | ...   | S32205        | 22Cr-5.5Ni-3Mo-N       | 10H   | (1)(23)(24)    | 90                             | 65                           | 0.85   |
|                                                             | S32750        | ...   | S32750        | 25Cr-7Ni-4Mo-N         | 10H   | (1)(22)(23)    | 116                            | 80                           | 0.85   |
| <b>Welded Pipe — Filler Metal Added</b>                     |               |       |               |                        |       |                |                                |                              |        |
| <b>Austenitic</b>                                           |               |       |               |                        |       |                |                                |                              |        |
| A358                                                        | 304           | 1 & 3 | S30400        | 18Cr-8Ni               | 8     | (1)(10)(11)    | 75                             | 30                           | 1.00   |
|                                                             | 304           | 2     | S30400        | 18Cr-8Ni               | 8     | (1)(10)(11)    | 75                             | 30                           | 0.90   |
|                                                             | 304           | 1 & 3 | S30400        | 18Cr-8Ni               | 8     | (1)(9)(10)(11) | 75                             | 30                           | 1.00   |
|                                                             | 304           | 2     | S30400        | 18Cr-8Ni               | 8     | (1)(9)(10)(11) | 75                             | 30                           | 0.90   |
| A358                                                        | 304L          | 1 & 3 | S30403        | 18Cr-8Ni               | 8     | (1)            | 70                             | 25                           | 1.00   |
|                                                             | 304L          | 2     | S30403        | 18Cr-8Ni               | 8     | (1)            | 70                             | 25                           | 0.90   |
|                                                             | 304L          | 1 & 3 | S30403        | 18Cr-8Ni               | 8     | (1)(9)         | 70                             | 25                           | 1.00   |
|                                                             | 304L          | 2     | S30403        | 18Cr-8Ni               | 8     | (1)(9)         | 70                             | 25                           | 0.90   |
| A358                                                        | 304N          | 1 & 3 | S30451        | 18Cr-8Ni-N             | 8     | (1)(10)        | 80                             | 35                           | 1.00   |
|                                                             | 304N          | 2     | S30451        | 18Cr-8Ni-N             | 8     | (1)(10)        | 80                             | 35                           | 0.90   |
|                                                             | 304N          | 1 & 3 | S30451        | 18Cr-8Ni-N             | 8     | (1)(9)(10)     | 80                             | 35                           | 1.00   |
|                                                             | 304N          | 2     | S30451        | 18Cr-8Ni-N             | 8     | (1)(9)(10)     | 80                             | 35                           | 0.90   |

Table A-3 Stainless Steels (Cont'd)

(12)

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |         | Type<br>or<br>Grade | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|---------|---------------------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 |         |                     |              |
| Welded Pipe and Tube – Without Filler Metal (Cont'd)                                      |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |         |                     |              |
| Austenitic (Cont'd)                                                                       |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |         |                     |              |
| 17.0                                                                                      | 15.6 | 14.6 | 13.6 | 12.8 | 12.2 | 11.9 | 11.8 | 11.6 | 11.5 | 11.5 | 11.4 | 11.4 | 11.4  | 10.3  | 7.8   | 5.2   | 3.8   | TP348   | A312                |              |
| 17.0                                                                                      | 17.0 | 16.0 | 15.1 | 14.6 | 14.3 | 14.3 | 14.3 | 14.3 | 14.3 | 14.3 | 14.2 | 14.1 | 13.6  | 10.3  | 7.8   | 5.2   | 3.8   | TP348   |                     |              |
| 17.0                                                                                      | 15.6 | 14.6 | 13.6 | 12.8 | 12.2 | 11.9 | 11.8 | 11.6 | 11.5 | 11.5 | 11.4 | 11.4 | 11.4  | 11.4  | 11.3  | 8.9   | 6.7   | TP348H  |                     |              |
| 17.0                                                                                      | 17.0 | 16.0 | 15.1 | 14.6 | 14.3 | 14.3 | 14.3 | 14.3 | 14.3 | 14.3 | 14.2 | 14.1 | 14.0  | 13.7  | 12.0  | 8.9   | 6.7   | TP348H  |                     |              |
| 17.0                                                                                      | 14.2 | 12.7 | 11.7 | 11.0 | 10.4 | 10.2 | 10.0 | 9.8  | 9.6  | 9.4  | 9.2  | 9.0  | 8.8   | ...   | ...   | ...   | ...   | TPXM-15 | A312                |              |
| 17.0                                                                                      | 17.0 | 16.1 | 15.5 | 14.8 | 14.1 | 13.8 | 13.5 | 13.2 | 12.9 | 12.6 | 12.4 | 12.1 | 11.9  | ...   | ...   | ...   | ...   | TPXM-15 |                     |              |
| 23.0                                                                                      | 20.8 | 18.6 | 17.2 | 16.2 | 15.6 | 15.3 | 15.1 | 15.0 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...     |                     |              |
| 23.0                                                                                      | 23.0 | 21.9 | 20.9 | 20.1 | 19.7 | 19.6 | 19.6 | 19.5 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...     |                     |              |
| 21.2                                                                                      | 21.0 | 18.7 | 16.9 | 15.7 | 15.0 | 14.8 | 14.6 | 14.5 | 14.3 | 14.1 | 13.9 | 13.8 | 12.7  | 9.9   | 7.7   | 5.9   | 4.4   | ...     | A409                |              |
| 21.2                                                                                      | 21.0 | 19.8 | 19.0 | 18.5 | 18.2 | 18.0 | 17.9 | 17.7 | 17.5 | 17.3 | 17.0 | 16.2 | 12.7  | 9.9   | 7.7   | 5.9   | 4.4   | ...     |                     |              |
| 26.7                                                                                      | 26.6 | 25.1 | 24.3 | 24.0 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...     | A789                |              |
| 26.7                                                                                      | 26.6 | 25.1 | 24.3 | 24.0 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...     | A790                |              |
| Ferritic/Martensitic                                                                      |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |         |                     |              |
| 14.6                                                                                      | 14.6 | 14.3 | 14.0 | 13.8 | 13.5 | 13.2 | 12.9 | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP405   | A268                |              |
| 14.6                                                                                      | 14.6 | 14.3 | 14.0 | 13.8 | 13.5 | 13.2 | 12.9 | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP410   |                     |              |
| 14.6                                                                                      | 14.6 | 14.3 | 14.0 | 13.8 | 13.5 | 13.2 | 12.9 | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP429   |                     |              |
| 14.6                                                                                      | 14.6 | 14.3 | 14.0 | 13.8 | 13.5 | 13.2 | 12.9 | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP430   |                     |              |
| 17.0                                                                                      | 17.0 | 16.4 | 16.0 | 15.6 | 15.2 | 15.0 | 14.7 | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP446-1 |                     |              |
| 15.8                                                                                      | 15.8 | 15.5 | 15.4 | 15.4 | 15.4 | 15.4 | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TPXM-27 |                     |              |
| 16.5                                                                                      | 16.5 | 16.4 | 16.2 | 16.0 | 15.7 | 15.4 | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TPXM-33 |                     |              |
| Ferritic/Austenitic                                                                       |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |         |                     |              |
| 21.9                                                                                      | 21.9 | 21.1 | 20.3 | 19.8 | 19.6 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | S31803  | A789                |              |
| 23.1                                                                                      | 23.1 | 22.3 | 21.4 | 20.9 | 20.7 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | S32205  |                     |              |
| 28.2                                                                                      | 28.0 | 26.5 | 25.6 | 25.2 | 25.0 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | S32750  |                     |              |
| 21.9                                                                                      | 21.9 | 21.1 | 20.3 | 19.8 | 19.6 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | S31803  | A790                |              |
| 21.9                                                                                      | 21.9 | 21.1 | 20.3 | 19.8 | 19.6 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | S32205  |                     |              |
| 28.2                                                                                      | 28.0 | 26.5 | 25.6 | 25.2 | 25.0 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | S32750  |                     |              |
| Welded Pipe – Filler Metal Added                                                          |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |         |                     |              |
| Austenitic                                                                                |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |         |                     |              |
| 20.0                                                                                      | 16.7 | 15.0 | 13.8 | 12.9 | 12.3 | 12.0 | 11.7 | 11.5 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4  | 10.1  | 9.8   | 7.7   | 6.1   | 304     | A358                |              |
| 18.0                                                                                      | 15.0 | 13.5 | 12.4 | 11.6 | 11.1 | 10.8 | 10.6 | 10.3 | 10.1 | 9.9  | 9.7  | 9.5  | 9.3   | 9.1   | 8.8   | 7.0   | 5.5   | 304     |                     |              |
| 20.0                                                                                      | 20.0 | 18.9 | 18.3 | 17.5 | 16.6 | 16.2 | 15.8 | 15.5 | 15.2 | 14.9 | 14.6 | 14.3 | 14.0  | 12.4  | 9.8   | 7.7   | 6.1   | 304     |                     |              |
| 16.2                                                                                      | 16.2 | 15.3 | 14.8 | 14.1 | 13.4 | 13.1 | 12.8 | 12.6 | 12.3 | 12.0 | 11.8 | 11.6 | 11.3  | 10.0  | 7.9   | 6.3   | 4.9   | 304     |                     |              |
| 16.7                                                                                      | 14.3 | 12.8 | 11.7 | 10.9 | 10.4 | 10.2 | 10.0 | 9.8  | 9.7  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | 304L    | A358                |              |
| 15.0                                                                                      | 12.8 | 11.5 | 10.5 | 9.8  | 9.3  | 9.1  | 9.0  | 8.8  | 8.7  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | 304L    |                     |              |
| 16.7                                                                                      | 16.7 | 16.7 | 15.8 | 14.7 | 14.0 | 13.7 | 13.5 | 13.3 | 13.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | 304L    |                     |              |
| 15.0                                                                                      | 15.0 | 15.0 | 14.2 | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.7 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | 304L    |                     |              |
| 22.9                                                                                      | 19.1 | 16.7 | 15.1 | 14.0 | 13.3 | 13.0 | 12.8 | 12.5 | 12.3 | 12.1 | 11.8 | 11.6 | 11.3  | 11.0  | 9.8   | 7.7   | 6.1   | 304N    | A358                |              |
| 20.6                                                                                      | 17.2 | 15.0 | 13.5 | 12.6 | 11.9 | 11.7 | 11.5 | 11.3 | 11.1 | 10.9 | 10.6 | 10.4 | 10.2  | 9.9   | 8.8   | 7.0   | 5.5   | 304N    |                     |              |
| 22.9                                                                                      | 22.9 | 21.7 | 20.3 | 18.9 | 17.9 | 17.5 | 17.2 | 16.9 | 16.6 | 16.3 | 16.0 | 15.6 | 15.2  | 12.4  | 9.8   | 7.7   | 6.1   | 304N    |                     |              |
| 20.6                                                                                      | 20.6 | 19.6 | 18.3 | 17.0 | 16.1 | 15.8 | 15.5 | 15.2 | 14.9 | 14.7 | 14.4 | 14.0 | 13.7  | 11.2  | 8.8   | 7.0   | 5.5   | 304N    |                     |              |

Table A-3 Stainless Steels (Cont'd)

| Spec. No.                                 | Type or Grade | Class | UNS Alloy No. | Nominal Composition | P- No.        | Notes          | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |      |
|-------------------------------------------|---------------|-------|---------------|---------------------|---------------|----------------|--------------------------------|------------------------------|--------|------|
| Welded Pipe — Filler Metal Added (Cont'd) |               |       |               |                     |               |                |                                |                              |        |      |
| Austenitic (Cont'd)                       |               |       |               |                     |               |                |                                |                              |        |      |
| A358                                      | ...           | 1 & 3 | S30815        | 21Cr–11Ni–N         | 8             | (1)            | 87                             | 45                           | 1.00   |      |
|                                           | ...           | 2     | S30815        | 21Cr–11Ni–N         | 8             | (1)            | 87                             | 45                           | 0.90   |      |
|                                           | ...           | 1 & 3 | S30815        | 21Cr–11Ni–N         | 8             | (1)(9)         | 87                             | 45                           | 1.00   |      |
|                                           | ...           | 2     | S30815        | 21Cr–11Ni–N         | 8             | (1)(9)         | 87                             | 45                           | 0.90   |      |
| A358                                      | 309           | 1 & 3 | S30900        | 23Cr–12Ni           | 8             | (1)(10)        | 75                             | 30                           | 1.00   |      |
|                                           | 309           | 2     | S30900        | 23Cr–12Ni           | 8             | (1)(10)        | 75                             | 30                           | 0.90   |      |
|                                           | 309           | 1 & 3 | S30900        | 23Cr–12Ni           | 8             | (1)(9)(10)     | 75                             | 30                           | 1.00   |      |
|                                           | 309           | 2     | S30900        | 23Cr–12Ni           | 8             | (1)(9)(10)     | 75                             | 30                           | 0.90   |      |
| A358                                      | 310           | 1 & 3 | S31000        | 25Cr–20Ni           | 8             | (1)(10)(14)    | 75                             | 30                           | 1.00   |      |
|                                           | 310           | 2     | S31000        | 25Cr–20Ni           | 8             | (1)(10)(14)    | 75                             | 30                           | 0.90   |      |
|                                           | 310           | 1 & 3 | S31000        | 25Cr–20Ni           | 8             | (1)(9)(10)(14) | 75                             | 30                           | 1.00   |      |
|                                           | 310           | 2     | S31000        | 25Cr–20Ni           | 8             | (1)(9)(10)(14) | 75                             | 30                           | 0.90   |      |
| A358                                      | 310           | 1 & 3 | S31000        | 25Cr–20Ni           | 8             | (1)(10)(15)    | 75                             | 30                           | 1.00   |      |
|                                           | 310           | 2     | S31000        | 25Cr–20Ni           | 8             | (1)(10)(15)    | 75                             | 30                           | 0.90   |      |
|                                           | 310           | 1 & 3 | S31000        | 25Cr–20Ni           | 8             | (1)(9)(10)(15) | 75                             | 30                           | 1.00   |      |
|                                           | 310           | 2     | S31000        | 25Cr–20Ni           | 8             | (1)(9)(10)(15) | 75                             | 30                           | 0.90   |      |
| A358                                      | 316           | 1 & 3 | S31600        | 16Cr–12Ni–2Mo       | 8             | (1)(10)(11)    | 75                             | 30                           | 1.00   |      |
|                                           | 316           | 2     | S31600        | 16Cr–12Ni–2Mo       | 8             | (1)(10)(11)    | 75                             | 30                           | 0.90   |      |
|                                           | 316           | 1 & 3 | S31600        | 16Cr–12Ni–2Mo       | 8             | (1)(9)(10)(11) | 75                             | 30                           | 1.00   |      |
|                                           | 316           | 2     | S31600        | 16Cr–12Ni–2Mo       | 8             | (1)(9)(10)(11) | 75                             | 30                           | 0.90   |      |
| (12)                                      | A358          | 316L  | 1 & 3         | S31603              | 16Cr–12Ni–2Mo | 8              | (1)(29)                        | 70                           | 25     | 1.00 |
| (12)                                      |               | 316L  | 2             | S31603              | 16Cr–12Ni–2Mo | 8              | (1)(29)                        | 70                           | 25     | 0.90 |
| (12)                                      |               | 316L  | 1 & 3         | S31603              | 16Cr–12Ni–2Mo | 8              | (1)(9)(29)                     | 70                           | 25     | 1.00 |
| (12)                                      |               | 316L  | 2             | S31603              | 16Cr–12Ni–2Mo | 8              | (1)(9)(29)                     | 70                           | 25     | 0.90 |
| A358                                      | 316N          | 1 & 3 | S31651        | 16Cr–12Ni–2Mo–N     | 8             | (1)(10)        | 80                             | 35                           | 1.00   |      |
|                                           | 316N          | 2     | S31651        | 16Cr–12Ni–2Mo–N     | 8             | (1)(10)        | 80                             | 35                           | 0.90   |      |
|                                           | 316N          | 1 & 3 | S31651        | 16Cr–12Ni–2Mo–N     | 8             | (1)(9)(10)     | 80                             | 35                           | 1.00   |      |
|                                           | 316N          | 2     | S31651        | 16Cr–12Ni–2Mo–N     | 8             | (1)(9)(10)     | 80                             | 35                           | 0.90   |      |
| A358                                      | 321           | 1 & 3 | S32100        | 18Cr–10Ni–Ti        | 8             | (1)(10)(11)    | 75                             | 30                           | 1.00   |      |
|                                           | 321           | 2     | S32100        | 18Cr–10Ni–Ti        | 8             | (1)(10)(11)    | 75                             | 30                           | 0.90   |      |
|                                           | 321           | 1 & 3 | S32100        | 18Cr–10Ni–Ti        | 8             | (1)(9)(10)(11) | 75                             | 30                           | 1.00   |      |
|                                           | 321           | 2     | S32100        | 18Cr–10Ni–Ti        | 8             | (1)(9)(10)(11) | 75                             | 30                           | 0.90   |      |
| A358                                      | 347           | 1 & 3 | S34700        | 18Cr–10Ni–Cb        | 8             | (1)(10)(11)    | 75                             | 30                           | 1.00   |      |
|                                           | 347           | 2     | S34700        | 18Cr–10Ni–Cb        | 8             | (1)(10)(11)    | 75                             | 30                           | 0.90   |      |
|                                           | 347           | 1 & 3 | S34700        | 18Cr–10Ni–Cb        | 8             | (1)(9)(10)(11) | 75                             | 30                           | 1.00   |      |
|                                           | 347           | 2     | S34700        | 18Cr–10Ni–Cb        | 8             | (1)(9)(10)(11) | 75                             | 30                           | 0.90   |      |

Table A-3 Stainless Steels (Cont'd)

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |      | Type<br>or<br>Grade | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|------|---------------------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 |      |                     |              |
| Welded Pipe – Filler Metal Added (Cont'd)<br>Austenitic (Cont'd)                          |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |      |                     |              |
| 24.9                                                                                      | 24.7 | 22.0 | 19.9 | 18.5 | 17.7 | 17.4 | 17.2 | 17.0 | 16.8 | 16.6 | 16.4 | 16.2 | 14.9  | 11.6  | 9.0   | 6.9   | 5.2   | ...  | A358                |              |
| 22.4                                                                                      | 22.2 | 21.0 | 20.2 | 19.6 | 19.3 | 19.1 | 18.9 | 18.7 | 18.5 | 18.3 | 18.0 | 17.2 | 13.4  | 10.4  | 8.1   | 6.2   | 4.7   | ...  |                     |              |
| 24.9                                                                                      | 24.7 | 22.0 | 19.9 | 18.5 | 17.7 | 17.4 | 17.2 | 17.0 | 16.8 | 16.6 | 16.4 | 16.2 | 14.9  | 11.6  | 9.0   | 6.9   | 5.2   | ...  |                     |              |
| 22.4                                                                                      | 22.2 | 21.0 | 20.2 | 19.6 | 19.3 | 19.1 | 18.9 | 18.7 | 18.5 | 18.3 | 18.0 | 17.2 | 13.4  | 10.4  | 8.1   | 6.2   | 4.7   | ...  |                     |              |
| 20.0                                                                                      | 17.5 | 16.1 | 15.1 | 14.4 | 13.9 | 13.7 | 13.5 | 13.3 | 13.1 | 12.9 | 12.7 | 12.5 | 9.9   | 7.1   | 5.0   | 3.6   | 2.5   | 309  | A358                |              |
| 18.0                                                                                      | 15.8 | 14.5 | 13.6 | 13.0 | 12.5 | 12.3 | 12.1 | 12.0 | 11.8 | 11.6 | 11.5 | 11.3 | 8.9   | 6.4   | 4.5   | 3.2   | 2.3   | 309  |                     |              |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 19.4 | 18.8 | 18.5 | 18.2 | 18.0 | 17.7 | 17.5 | 17.2 | 15.9 | 9.9   | 7.1   | 5.0   | 3.6   | 2.5   | 309  |                     |              |
| 18.0                                                                                      | 18.0 | 18.0 | 18.0 | 17.5 | 16.9 | 16.6 | 16.4 | 16.2 | 15.9 | 15.7 | 15.5 | 14.3 | 8.9   | 6.4   | 4.5   | 3.2   | 2.3   | 309  |                     |              |
| 20.0                                                                                      | 17.6 | 16.1 | 15.1 | 14.3 | 13.7 | 13.5 | 13.3 | 13.1 | 12.9 | 12.7 | 12.5 | 12.3 | 9.9   | 7.1   | 5.0   | 3.6   | 2.5   | 310  | A358                |              |
| 18.0                                                                                      | 15.9 | 14.5 | 13.6 | 12.9 | 12.4 | 12.1 | 12.0 | 11.8 | 11.6 | 11.5 | 11.3 | 11.1 | 8.9   | 6.4   | 4.5   | 3.2   | 2.3   | 310  |                     |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.9 | 19.3 | 18.5 | 18.2 | 17.9 | 17.7 | 17.4 | 17.2 | 16.9 | 15.9 | 9.9   | 7.1   | 5.0   | 3.6   | 2.5   | 310  |                     |              |
| 18.0                                                                                      | 18.0 | 18.0 | 17.9 | 17.4 | 16.7 | 16.4 | 16.1 | 15.9 | 15.7 | 15.5 | 15.2 | 14.3 | 8.9   | 6.4   | 4.5   | 3.2   | 2.3   | 310  |                     |              |
| 20.0                                                                                      | 17.6 | 16.1 | 15.1 | 14.3 | 13.7 | 13.5 | 13.3 | 13.1 | 12.9 | 12.7 | 12.5 | 12.3 | 9.9   | 7.1   | 5.0   | 3.6   | 2.5   | 310  | A358                |              |
| 18.0                                                                                      | 15.9 | 14.5 | 13.6 | 12.9 | 12.4 | 12.1 | 12.0 | 11.8 | 11.6 | 11.5 | 11.3 | 11.1 | 8.9   | 6.4   | 4.5   | 3.2   | 2.3   | 310  |                     |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.9 | 19.3 | 18.5 | 18.2 | 17.9 | 17.7 | 17.4 | 17.2 | 16.9 | 15.9 | 9.9   | 7.1   | 5.0   | 3.6   | 2.5   | 310  |                     |              |
| 18.0                                                                                      | 18.0 | 18.0 | 17.9 | 17.4 | 16.7 | 16.4 | 16.1 | 15.9 | 15.7 | 15.5 | 15.2 | 14.3 | 8.9   | 6.4   | 4.5   | 3.2   | 2.3   | 310  |                     |              |
| 20.0                                                                                      | 17.3 | 15.6 | 14.3 | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.8 | 11.6 | 11.5 | 11.4 | 11.3  | 11.2  | 11.1  | 9.8   | 7.4   | 316  | A358                |              |
| 18.0                                                                                      | 15.5 | 14.0 | 12.9 | 12.0 | 11.3 | 11.1 | 10.9 | 10.7 | 10.6 | 10.5 | 10.4 | 10.3 | 10.2  | 10.1  | 9.9   | 8.8   | 6.7   | 316  |                     |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.3 | 18.0 | 17.0 | 16.6 | 16.3 | 16.1 | 15.9 | 15.7 | 15.6 | 15.4 | 15.3  | 15.1  | 12.4  | 9.8   | 7.4   | 316  |                     |              |
| 18.0                                                                                      | 18.0 | 18.0 | 17.4 | 16.2 | 15.3 | 15.0 | 14.7 | 14.5 | 14.3 | 14.1 | 14.0 | 13.9 | 13.8  | 13.6  | 11.2  | 8.8   | 6.7   | 316  |                     |              |
| 16.7                                                                                      | 14.2 | 12.7 | 11.7 | 10.9 | 10.4 | 10.2 | 10.0 | 9.8  | 9.6  | 9.4  | 9.2  | 9.0  | 8.8   | 8.6   | 8.4   | 8.3   | 6.4   | 316L | A358                |              |
| 15.0                                                                                      | 12.8 | 11.4 | 10.5 | 9.8  | 9.4  | 9.2  | 9.0  | 8.8  | 8.6  | 8.4  | 8.3  | 8.1  | 7.9   | 7.7   | 7.6   | 7.5   | 5.8   | 316L |                     |              |
| 16.7                                                                                      | 16.7 | 16.7 | 15.7 | 14.8 | 14.0 | 13.7 | 13.5 | 13.2 | 12.9 | 12.7 | 12.4 | 12.1 | 11.9  | 11.6  | 11.4  | 8.8   | 6.4   | 316L |                     |              |
| 15.0                                                                                      | 15.0 | 15.0 | 14.2 | 13.3 | 12.6 | 12.4 | 12.1 | 11.9 | 11.6 | 11.4 | 11.2 | 10.9 | 10.7  | 10.4  | 10.3  | 7.9   | 5.8   | 316L |                     |              |
| 22.9                                                                                      | 20.7 | 19.0 | 17.6 | 16.5 | 15.6 | 15.2 | 14.9 | 14.5 | 14.2 | 13.9 | 13.7 | 13.4 | 13.2  | 12.9  | 12.3  | 9.8   | 7.4   | 316N | A358                |              |
| 20.6                                                                                      | 18.6 | 17.1 | 15.8 | 14.8 | 14.0 | 13.7 | 13.4 | 13.1 | 12.8 | 12.6 | 12.3 | 12.1 | 11.9  | 11.6  | 11.1  | 8.8   | 6.7   | 316N |                     |              |
| 22.9                                                                                      | 22.9 | 22.0 | 21.5 | 21.2 | 21.0 | 20.5 | 20.0 | 19.6 | 19.2 | 18.8 | 18.5 | 18.1 | 17.8  | 15.8  | 12.3  | 9.8   | 7.4   | 316N |                     |              |
| 20.6                                                                                      | 20.6 | 19.8 | 19.3 | 19.1 | 18.9 | 18.5 | 18.0 | 17.7 | 17.3 | 16.9 | 16.6 | 16.3 | 16.0  | 14.2  | 11.1  | 8.8   | 6.7   | 316N |                     |              |
| 20.0                                                                                      | 18.0 | 16.5 | 15.3 | 14.3 | 13.5 | 13.2 | 13.0 | 12.7 | 12.6 | 12.4 | 12.3 | 12.1 | 12.0  | 9.6   | 6.9   | 5.0   | 3.6   | 321  | A358                |              |
| 18.0                                                                                      | 16.2 | 14.9 | 13.8 | 12.9 | 12.2 | 11.9 | 11.7 | 11.5 | 11.3 | 11.2 | 11.0 | 10.9 | 10.8  | 8.6   | 6.2   | 4.5   | 3.2   | 321  |                     |              |
| 20.0                                                                                      | 20.0 | 19.1 | 18.7 | 18.7 | 18.3 | 17.9 | 17.5 | 17.2 | 16.9 | 16.7 | 16.5 | 16.4 | 16.2  | 9.6   | 6.9   | 5.0   | 3.6   | 321  |                     |              |
| 18.0                                                                                      | 18.0 | 17.2 | 16.8 | 16.8 | 16.5 | 16.1 | 15.8 | 15.5 | 15.3 | 15.1 | 14.9 | 14.7 | 14.6  | 8.6   | 6.2   | 4.5   | 3.2   | 321  |                     |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 12.1  | 9.1   | 6.1   | 4.4   | 347  | A358                |              |
| 18.0                                                                                      | 16.6 | 15.4 | 14.4 | 13.5 | 12.9 | 12.6 | 12.4 | 12.3 | 12.2 | 12.1 | 12.1 | 12.1 | 12.1  | 10.9  | 8.2   | 5.5   | 4.0   | 347  |                     |              |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.2 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.0  | 12.1  | 9.1   | 6.1   | 4.4   | 347  |                     |              |
| 18.0                                                                                      | 18.0 | 16.9 | 16.0 | 15.4 | 15.2 | 15.1 | 15.1 | 15.1 | 15.1 | 15.1 | 15.0 | 14.9 | 14.4  | 10.9  | 8.2   | 5.5   | 4.0   | 347  |                     |              |

Table A-3 Stainless Steels (Cont'd)

| Spec. No.                                        | Type or Grade | Class | UNS Alloy No. | Nominal Composition | P- No. | Notes          | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|--------------------------------------------------|---------------|-------|---------------|---------------------|--------|----------------|--------------------------------|------------------------------|--------|
| <b>Welded Pipe — Filler Metal Added (Cont'd)</b> |               |       |               |                     |        |                |                                |                              |        |
| <b>Austenitic (Cont'd)</b>                       |               |       |               |                     |        |                |                                |                              |        |
| A358                                             | 348           | 1 & 3 | S34800        | 18Cr-10Ni-Cb        | 8      | (1)(10)(11)    | 75                             | 30                           | 1.00   |
|                                                  | 348           | 2     | S34800        | 18Cr-10Ni-Cb        | 8      | (1)(10)(11)    | 75                             | 30                           | 0.90   |
|                                                  | 348           | 1 & 3 | S34800        | 18Cr-10Ni-Cb        | 8      | (1)(9)(10)(11) | 75                             | 30                           | 1.00   |
|                                                  | 348           | 2     | S34800        | 18Cr-10Ni-Cb        | 8      | (1)(9)(10)(11) | 75                             | 30                           | 0.90   |
| A358                                             | ...           | 1 & 3 | S31254        | 20Cr-18Ni-6Mo       | 8      | (1)            | 95                             | 45                           | 1.00   |
|                                                  | ...           | 2     | S31254        | 20Cr-18Ni-6Mo       | 8      | (1)            | 95                             | 45                           | 0.90   |
|                                                  | ...           | 1 & 3 | S31254        | 20Cr-18Ni-6Mo       | 8      | (1)(9)         | 95                             | 45                           | 1.00   |
|                                                  | ...           | 2     | S31254        | 20Cr-18Ni-6Mo       | 8      | (1)(9)         | 95                             | 45                           | 0.90   |
| A358                                             | ...           | 1 & 3 | S31254        | 20Cr-18Ni-6Mo       | 8      | (1)            | 100                            | 45                           | 1.00   |
|                                                  | ...           | 2     | S31254        | 20Cr-18Ni-6Mo       | 8      | (1)            | 100                            | 45                           | 0.90   |
|                                                  | ...           | 1 & 3 | S31254        | 20Cr-18Ni-6Mo       | 8      | (1)(9)         | 100                            | 45                           | 1.00   |
|                                                  | ...           | 2     | S31254        | 20Cr-18Ni-6Mo       | 8      | (1)(9)         | 100                            | 45                           | 0.90   |
| A409                                             | TP304         | ...   | S30400        | 18Cr-8Ni            | 8      | (1)(10)(19)    | 75                             | 30                           | 1.00   |
|                                                  | TP304         | ...   | S30400        | 18Cr-8Ni            | 8      | (1)(10)(20)    | 75                             | 30                           | 0.90   |
|                                                  | TP304         | ...   | S30400        | 18Cr-8Ni            | 8      | (1)(10)(21)    | 75                             | 30                           | 0.80   |
|                                                  | TP304         | ...   | S30400        | 18Cr-8Ni            | 8      | (1)(9)(10)(19) | 75                             | 30                           | 1.00   |
|                                                  | TP304         | ...   | S30400        | 18Cr-8Ni            | 8      | (1)(9)(10)(20) | 75                             | 30                           | 0.90   |
|                                                  | TP304         | ...   | S30400        | 18Cr-8Ni            | 8      | (1)(9)(10)(21) | 75                             | 30                           | 0.80   |
| A409                                             | TP304L        | ...   | S30403        | 18Cr-8Ni            | 8      | (1)(19)        | 70                             | 25                           | 1.00   |
|                                                  | TP304L        | ...   | S30403        | 18Cr-8Ni            | 8      | (1)(20)        | 70                             | 25                           | 0.90   |
|                                                  | TP304L        | ...   | S30403        | 18Cr-8Ni            | 8      | (1)(21)        | 70                             | 25                           | 0.80   |
|                                                  | TP304L        | ...   | S30403        | 18Cr-8Ni            | 8      | (1)(9)(19)     | 70                             | 25                           | 1.00   |
|                                                  | TP304L        | ...   | S30403        | 18Cr-8Ni            | 8      | (1)(9)(20)     | 70                             | 25                           | 0.90   |
|                                                  | TP304L        | ...   | S30403        | 18Cr-8Ni            | 8      | (1)(9)(21)     | 70                             | 25                           | 0.80   |
| A409                                             | ...           | ...   | S30815        | 21Cr-11Ni-N         | 8      | (1)(19)        | 87                             | 45                           | 1.00   |
|                                                  | ...           | ...   | S30815        | 21Cr-11Ni-N         | 8      | (1)(20)        | 87                             | 45                           | 0.90   |
|                                                  | ...           | ...   | S30815        | 21Cr-11Ni-N         | 8      | (1)(21)        | 87                             | 45                           | 0.80   |
|                                                  | ...           | ...   | S30815        | 21Cr-11Ni-N         | 8      | (1)(9)(19)     | 87                             | 45                           | 1.00   |
|                                                  | ...           | ...   | S30815        | 21Cr-11Ni-N         | 8      | (1)(9)(20)     | 87                             | 45                           | 0.90   |
|                                                  | ...           | ...   | S30815        | 21Cr-11Ni-N         | 8      | (1)(9)(21)     | 87                             | 45                           | 0.80   |
| A409                                             | TP316         | ...   | S31600        | 16Cr-12Ni-2Mo       | 8      | (1)(10)(19)    | 75                             | 30                           | 1.00   |
|                                                  | TP316         | ...   | S31600        | 16Cr-12Ni-2Mo       | 8      | (1)(10)(20)    | 75                             | 30                           | 0.90   |
|                                                  | TP316         | ...   | S31600        | 16Cr-12Ni-2Mo       | 8      | (1)(10)(21)    | 75                             | 30                           | 0.80   |
|                                                  | TP316         | ...   | S31600        | 16Cr-12Ni-2Mo       | 8      | (1)(9)(10)(19) | 75                             | 30                           | 1.00   |
|                                                  | TP316         | ...   | S31600        | 16Cr-12Ni-2Mo       | 8      | (1)(9)(10)(20) | 75                             | 30                           | 0.90   |
|                                                  | TP316         | ...   | S31600        | 16Cr-12Ni-2Mo       | 8      | (1)(9)(10)(21) | 75                             | 30                           | 0.80   |

Table A-3 Stainless Steels (Cont'd)

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        | Type<br>or<br>Grade | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|--------|---------------------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 |        |                     |              |
| Welded Pipe – Filler Metal Added (Cont'd)<br>Austenitic (Cont'd)                          |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        |                     |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 12.1  | 9.1   | 6.1   | 4.4   | 348    | A358                |              |
| 18.0                                                                                      | 16.6 | 15.4 | 14.4 | 13.5 | 12.9 | 12.6 | 12.4 | 12.3 | 12.2 | 12.1 | 12.1 | 12.1 | 12.1  | 10.9  | 8.2   | 5.5   | 4.0   | 348    |                     |              |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.2 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.0  | 12.1  | 9.1   | 6.1   | 4.4   | 348    |                     |              |
| 18.0                                                                                      | 18.0 | 16.9 | 16.0 | 15.4 | 15.2 | 15.1 | 15.1 | 15.1 | 15.1 | 15.1 | 15.0 | 14.9 | 14.4  | 10.9  | 8.2   | 5.5   | 4.0   | 348    |                     |              |
| 27.1                                                                                      | 24.5 | 21.9 | 20.2 | 19.1 | 18.3 | 18.0 | 17.8 | 17.7 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...    | A358                |              |
| 24.4                                                                                      | 22.1 | 19.7 | 18.2 | 17.2 | 16.5 | 16.2 | 16.0 | 15.9 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...    |                     |              |
| 27.1                                                                                      | 27.1 | 25.8 | 24.6 | 23.7 | 23.2 | 23.1 | 23.0 | 22.9 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...    |                     |              |
| 24.4                                                                                      | 24.4 | 23.2 | 22.1 | 21.3 | 20.9 | 20.8 | 20.7 | 20.6 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...    |                     |              |
| 28.6                                                                                      | 24.5 | 21.9 | 20.2 | 19.1 | 18.3 | 18.0 | 17.8 | 17.7 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...    | A358                |              |
| 25.7                                                                                      | 22.1 | 19.7 | 18.2 | 17.2 | 16.5 | 16.2 | 16.0 | 15.9 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...    |                     |              |
| 28.6                                                                                      | 28.6 | 27.2 | 25.9 | 25.0 | 24.4 | 24.3 | 24.1 | 23.9 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...    |                     |              |
| 25.7                                                                                      | 25.7 | 24.5 | 23.3 | 22.5 | 22.0 | 21.9 | 21.7 | 21.5 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...    |                     |              |
| 20.0                                                                                      | 16.7 | 15.0 | 13.8 | 12.9 | 12.3 | 12.0 | 11.7 | 11.5 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4  | 10.1  | 9.8   | 7.7   | 6.1   | TP304  | A409                |              |
| 18.0                                                                                      | 15.0 | 13.5 | 12.4 | 11.6 | 11.1 | 10.8 | 10.6 | 10.3 | 10.1 | 9.9  | 9.7  | 9.5  | 9.3   | 9.1   | 8.8   | 7.0   | 5.5   | TP304  |                     |              |
| 16.0                                                                                      | 13.3 | 12.0 | 11.0 | 10.4 | 9.8  | 9.6  | 9.4  | 9.2  | 9.0  | 8.8  | 8.6  | 8.5  | 8.3   | 8.1   | 7.8   | 6.2   | 4.9   | TP304  |                     |              |
| 20.0                                                                                      | 20.0 | 18.9 | 18.3 | 17.5 | 16.6 | 16.2 | 15.8 | 15.5 | 15.2 | 14.9 | 14.6 | 14.3 | 14.0  | 12.4  | 9.8   | 7.7   | 6.1   | TP304  |                     |              |
| 18.0                                                                                      | 18.0 | 17.0 | 16.5 | 15.7 | 14.9 | 14.6 | 14.3 | 13.9 | 13.7 | 13.4 | 13.1 | 12.8 | 12.6  | 11.2  | 8.8   | 7.0   | 5.5   | TP304  |                     |              |
| 16.0                                                                                      | 16.0 | 15.1 | 14.6 | 14.0 | 13.3 | 13.0 | 12.7 | 12.4 | 12.1 | 11.9 | 11.7 | 11.4 | 11.2  | 9.9   | 7.8   | 6.2   | 4.9   | TP304  |                     |              |
| 16.7                                                                                      | 14.3 | 12.8 | 11.7 | 10.9 | 10.4 | 10.2 | 10.0 | 9.8  | 9.7  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP304L | A409                |              |
| 15.0                                                                                      | 12.8 | 11.5 | 10.5 | 9.8  | 9.3  | 9.1  | 9.0  | 8.8  | 8.7  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP304L |                     |              |
| 13.3                                                                                      | 11.4 | 10.2 | 9.4  | 8.7  | 8.3  | 8.1  | 8.0  | 7.9  | 7.7  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP304L |                     |              |
| 16.7                                                                                      | 16.7 | 16.7 | 15.8 | 14.7 | 14.0 | 13.7 | 13.5 | 13.3 | 13.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP304L |                     |              |
| 15.0                                                                                      | 15.0 | 15.0 | 14.2 | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.7 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP304L |                     |              |
| 13.3                                                                                      | 13.3 | 13.3 | 12.6 | 11.8 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TP304L |                     |              |
| 24.9                                                                                      | 24.7 | 22.0 | 19.9 | 18.5 | 17.7 | 17.4 | 17.2 | 17.0 | 16.8 | 16.6 | 16.4 | 16.2 | 14.9  | 11.6  | 9.0   | 6.9   | 5.2   | ...    | A409                |              |
| 22.4                                                                                      | 22.2 | 19.8 | 17.9 | 16.7 | 15.9 | 15.7 | 15.5 | 15.3 | 15.1 | 14.9 | 14.8 | 14.6 | 13.4  | 10.4  | 8.1   | 6.2   | 4.7   | ...    |                     |              |
| 19.9                                                                                      | 19.8 | 17.6 | 15.9 | 14.8 | 14.2 | 13.9 | 13.8 | 13.6 | 13.4 | 13.3 | 13.1 | 13.0 | 11.9  | 9.3   | 7.2   | 5.5   | 4.2   | ...    |                     |              |
| 24.9                                                                                      | 24.7 | 23.3 | 22.4 | 21.8 | 21.4 | 21.2 | 21.0 | 20.8 | 20.6 | 20.3 | 20.0 | 19.1 | 14.9  | 11.6  | 9.0   | 6.9   | 5.2   | ...    |                     |              |
| 22.4                                                                                      | 22.2 | 21.0 | 20.2 | 19.6 | 19.3 | 19.1 | 18.9 | 18.7 | 18.5 | 18.3 | 18.0 | 17.2 | 13.4  | 10.4  | 8.1   | 6.2   | 4.7   | ...    |                     |              |
| 19.9                                                                                      | 19.8 | 18.6 | 17.9 | 17.4 | 17.1 | 17.0 | 16.8 | 16.6 | 16.5 | 16.2 | 16.0 | 15.3 | 11.9  | 9.3   | 7.2   | 5.5   | 4.2   | ...    |                     |              |
| 20.0                                                                                      | 17.3 | 15.6 | 14.3 | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.8 | 11.6 | 11.5 | 11.4 | 11.3  | 11.2  | 11.1  | 9.8   | 7.4   | TP316  | A409                |              |
| 18.0                                                                                      | 15.5 | 14.0 | 12.9 | 12.0 | 11.3 | 11.1 | 10.9 | 10.7 | 10.6 | 10.5 | 10.4 | 10.3 | 10.2  | 10.1  | 9.9   | 8.8   | 6.7   | TP316  |                     |              |
| 16.0                                                                                      | 13.8 | 12.5 | 11.4 | 10.6 | 10.1 | 9.9  | 9.7  | 9.5  | 9.4  | 9.3  | 9.2  | 9.1  | 9.1   | 9.0   | 8.8   | 7.8   | 5.9   | TP316  |                     |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.3 | 18.0 | 17.0 | 16.6 | 16.3 | 16.1 | 15.9 | 15.7 | 15.6 | 15.4 | 15.3  | 15.1  | 12.4  | 9.8   | 7.4   | TP316  |                     |              |
| 18.0                                                                                      | 18.0 | 18.0 | 17.4 | 16.2 | 15.3 | 15.0 | 14.7 | 14.5 | 14.3 | 14.1 | 14.0 | 13.9 | 13.8  | 13.6  | 11.2  | 8.8   | 6.7   | TP316  |                     |              |
| 16.0                                                                                      | 16.0 | 16.0 | 15.4 | 14.4 | 13.6 | 13.3 | 13.1 | 12.9 | 12.7 | 12.6 | 12.5 | 12.3 | 12.2  | 12.1  | 9.9   | 7.8   | 5.9   | TP316  |                     |              |

(12)

Table A-3 Stainless Steels (Cont'd)

|                                           | Spec.<br>No. | Type or<br>Grade | Class | UNS<br>Alloy<br>No. | Nominal<br>Composition | P-<br>No. | Notes           | Specified<br>Minimum<br>Tensile,<br>ksi | Specified<br>Minimum<br>Yield,<br>ksi | E<br>or<br>F |
|-------------------------------------------|--------------|------------------|-------|---------------------|------------------------|-----------|-----------------|-----------------------------------------|---------------------------------------|--------------|
| Welded Pipe — Filler Metal Added (Cont'd) |              |                  |       |                     |                        |           |                 |                                         |                                       |              |
| Austenitic (Cont'd)                       |              |                  |       |                     |                        |           |                 |                                         |                                       |              |
| (12)                                      | A409         | TP316L           | ...   | S31603              | 16Cr–12Ni–2Mo          | 8         | (1)(19)(29)     | 70                                      | 25                                    | 1.00         |
| (12)                                      |              | TP316L           | ...   | S31603              | 16Cr–12Ni–2Mo          | 8         | (1)(20)(29)     | 70                                      | 25                                    | 0.90         |
| (12)                                      |              | TP316L           | ...   | S31603              | 16Cr–12Ni–2Mo          | 8         | (1)(21)(29)     | 70                                      | 25                                    | 0.80         |
| (12)                                      |              | TP316L           | ...   | S31603              | 16Cr–12Ni–2Mo          | 8         | (1)(9)(19)(29)  | 70                                      | 25                                    | 1.00         |
| (12)                                      |              | TP316L           | ...   | S31603              | 16Cr–12Ni–2Mo          | 8         | (1)(9)(20)(29)  | 70                                      | 25                                    | 0.90         |
| (12)                                      |              | TP316L           | ...   | S31603              | 16Cr–12Ni–2Mo          | 8         | (1)(9)(21)(29)  | 70                                      | 25                                    | 0.80         |
| Ferritic/Austenitic                       |              |                  |       |                     |                        |           |                 |                                         |                                       |              |
|                                           | A928         | S31803           | 1 & 3 | S31803              | 22Cr–5.5Ni–3Mo–N       | 10H       | (1)(23)(24)     | 90                                      | 65                                    | 1.00         |
|                                           |              | S31803           | 2     | S31803              | 22Cr–5.5Ni–3Mo–N       | 10H       | (1)(23)(24)     | 90                                      | 65                                    | 0.90         |
| Plate, Sheet, and Strip                   |              |                  |       |                     |                        |           |                 |                                         |                                       |              |
| Austenitic                                |              |                  |       |                     |                        |           |                 |                                         |                                       |              |
|                                           | A240         | 304              | ...   | S30400              | 18Cr–8Ni               | 8         | (10)(11)        | 75                                      | 30                                    | 1.00         |
|                                           |              | 304              | ...   | S30400              | 18Cr–8Ni               | 8         | (9)(10)(11)     | 75                                      | 30                                    | 1.00         |
|                                           |              | 304L             | ...   | S30403              | 18Cr–8Ni               | 8         | (1)             | 70                                      | 25                                    | 1.00         |
|                                           |              | 304L             | ...   | S30403              | 18Cr–8Ni               | 8         | (1)(9)          | 70                                      | 25                                    | 1.00         |
|                                           |              | 304N             | ...   | S30451              | 18Cr–8Ni–N             | 8         | (1)(10)         | 80                                      | 35                                    | 1.00         |
|                                           |              | 304N             | ...   | S30451              | 18Cr–8Ni–N             | 8         | (1)(9)(10)      | 80                                      | 35                                    | 1.00         |
|                                           | A240         | ...              | ...   | S30815              | 21Cr–11Ni–N            | 8         | (1)             | 87                                      | 45                                    | 1.00         |
|                                           |              | ...              | ...   | S30815              | 21Cr–11Ni–N            | 8         | (1)(9)          | 87                                      | 45                                    | 1.00         |
|                                           | A240         | 309H             | ...   | S30909              | 23Cr–12Ni              | 8         | (9)(11)(18)     | 75                                      | 30                                    | 1.00         |
|                                           |              | 309H             | ...   | S30909              | 23Cr–12Ni              | 8         | (11)(18)        | 75                                      | 30                                    | 1.00         |
|                                           |              | 309S             | ...   | S30908              | 23Cr–12Ni              | 8         | (1)(10)         | 75                                      | 30                                    | 1.00         |
|                                           |              | 309S             | ...   | S30908              | 23Cr–12Ni              | 8         | (1)(9)(10)      | 75                                      | 30                                    | 1.00         |
|                                           | A240         | 310H             | ...   | S31009              | 25Cr–20Ni              | 8         | (9)             | 75                                      | 30                                    | 1.00         |
|                                           |              | 310H             | ...   | S31009              | 25Cr–20Ni              | 8         | ...             | 75                                      | 30                                    | 1.00         |
|                                           |              | 310S             | ...   | S31008              | 25Cr–20Ni              | 8         | (10)(11)(14)    | 75                                      | 30                                    | 1.00         |
|                                           |              | 310S             | ...   | S31008              | 25Cr–20Ni              | 8         | (9)(10)(11)(14) | 75                                      | 30                                    | 1.00         |
|                                           |              | 310S             | ...   | S31008              | 25Cr–20Ni              | 8         | (10)(11)(15)    | 75                                      | 30                                    | 1.00         |
|                                           |              | 310S             | ...   | S31008              | 25Cr–20Ni              | 8         | (9)(10)(11)(15) | 75                                      | 30                                    | 1.00         |
|                                           | A240         | 316              | ...   | S31600              | 16Cr–12Ni–2Mo          | 8         | (10)(11)        | 75                                      | 30                                    | 1.00         |
|                                           |              | 316              | ...   | S31600              | 16Cr–12Ni–2Mo          | 8         | (9)(10)(11)     | 75                                      | 30                                    | 1.00         |
| (12)                                      |              | 316L             | ...   | S31603              | 16Cr–12Ni–2Mo          | 8         | (1)(29)         | 70                                      | 25                                    | 1.00         |
| (12)                                      |              | 316L             | ...   | S31603              | 16Cr–12Ni–2Mo          | 8         | (1)(9)(29)      | 70                                      | 25                                    | 1.00         |
|                                           |              | 316N             | ...   | S31651              | 16Cr–12Ni–2Mo–N        | 8         | (10)            | 80                                      | 35                                    | 1.00         |
|                                           |              | 316N             | ...   | S31651              | 16Cr–12Ni–2Mo–N        | 8         | (9)(10)         | 80                                      | 35                                    | 1.00         |

Table A-3 Stainless Steels (Cont'd)

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        | Type<br>or<br>Grade | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|--------|---------------------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 |        |                     |              |
| Welded Pipe – Filler Metal Added (Cont'd)                                                 |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        | Austenitic (Cont'd) |              |
| 16.7                                                                                      | 14.2 | 12.7 | 11.7 | 10.9 | 10.4 | 10.2 | 10.0 | 9.8  | 9.6  | 9.4  | 9.2  | 9.0  | 8.8   | 8.6   | 8.4   | 8.3   | 6.4   | TP316L | A409                | (12)         |
| 15.0                                                                                      | 12.8 | 11.4 | 10.5 | 9.8  | 9.4  | 9.2  | 9.0  | 8.8  | 8.6  | 8.4  | 8.3  | 8.1  | 7.9   | 7.7   | 7.6   | 7.5   | 5.8   | TP316L |                     | (12)         |
| 13.3                                                                                      | 11.4 | 10.2 | 9.3  | 8.7  | 8.3  | 8.1  | 8.0  | 7.8  | 7.7  | 7.5  | 7.4  | 7.2  | 7.0   | 6.9   | 6.7   | 6.6   | 5.1   | TP316L |                     | (12)         |
| 16.7                                                                                      | 16.7 | 16.7 | 15.7 | 14.8 | 14.0 | 13.7 | 13.5 | 13.2 | 12.9 | 12.7 | 12.4 | 12.1 | 11.9  | 11.6  | 11.4  | 8.8   | 6.4   | TP316L |                     | (12)         |
| 15.0                                                                                      | 15.0 | 15.0 | 14.2 | 13.3 | 12.6 | 12.4 | 12.1 | 11.9 | 11.6 | 11.4 | 11.2 | 10.9 | 10.7  | 10.4  | 10.3  | 7.9   | 5.8   | TP316L |                     | (12)         |
| 13.3                                                                                      | 13.3 | 13.3 | 12.6 | 11.8 | 11.2 | 11.0 | 10.8 | 10.6 | 10.3 | 10.1 | 9.9  | 9.7  | 9.5   | 9.3   | 9.1   | 7.0   | 5.1   | TP316L |                     | (12)         |
| Ferritic/Austenitic                                                                       |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        |                     |              |
| 25.7                                                                                      | 25.7 | 24.8 | 23.9 | 23.3 | 23.1 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | S31803 | A928                |              |
| 23.1                                                                                      | 23.1 | 22.3 | 21.5 | 21.0 | 20.8 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | S31803 |                     |              |
| Plate, Sheet, and Strip                                                                   |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        | Austenitic          |              |
| 20.0                                                                                      | 16.7 | 15.0 | 13.8 | 12.9 | 12.3 | 12.0 | 11.7 | 11.5 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4  | 10.1  | 9.8   | 7.7   | 6.1   | 304    | A240                |              |
| 20.0                                                                                      | 20.0 | 18.9 | 18.3 | 17.5 | 16.6 | 16.2 | 15.8 | 15.5 | 15.2 | 14.9 | 14.6 | 14.3 | 14.0  | 12.4  | 9.8   | 7.7   | 6.1   | 304    |                     |              |
| 16.7                                                                                      | 14.3 | 12.8 | 11.7 | 10.9 | 10.4 | 10.2 | 10.0 | 9.8  | 9.7  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | 304L   |                     |              |
| 16.7                                                                                      | 16.7 | 16.7 | 15.8 | 14.7 | 14.0 | 13.7 | 13.5 | 13.3 | 13.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | 304L   |                     |              |
| 22.9                                                                                      | 19.1 | 16.7 | 15.1 | 14.0 | 13.3 | 13.0 | 12.8 | 12.5 | 12.3 | 12.1 | 11.8 | 11.6 | 11.3  | 11.0  | 9.8   | 7.7   | 6.1   | 304N   |                     |              |
| 22.9                                                                                      | 22.9 | 21.7 | 20.3 | 18.9 | 17.9 | 17.5 | 17.2 | 16.9 | 16.6 | 16.3 | 16.0 | 15.6 | 15.2  | 12.4  | 9.8   | 7.7   | 6.1   | 304N   |                     |              |
| 24.9                                                                                      | 24.7 | 22.0 | 19.9 | 18.5 | 17.7 | 17.4 | 17.2 | 17.0 | 16.8 | 16.6 | 16.4 | 16.2 | 14.9  | 11.6  | 9.0   | 6.9   | 5.2   | ...    | A240                |              |
| 24.9                                                                                      | 24.7 | 23.3 | 22.4 | 21.8 | 21.4 | 21.2 | 21.0 | 20.8 | 20.6 | 20.3 | 20.0 | 19.1 | 14.9  | 11.6  | 9.0   | 6.9   | 5.2   | ...    |                     |              |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 19.4 | 18.8 | 18.5 | 18.2 | 18.0 | 17.7 | 17.5 | 17.2 | 16.9 | 13.8  | 10.3  | 7.6   | 5.5   | 4.0   | 309H   | A240                |              |
| 20.0                                                                                      | 17.5 | 16.1 | 15.1 | 14.4 | 13.9 | 13.7 | 13.5 | 13.3 | 13.1 | 12.9 | 12.7 | 12.5 | 12.3  | 10.3  | 7.6   | 5.5   | 4.0   | 309H   |                     |              |
| 20.0                                                                                      | 17.5 | 16.1 | 15.1 | 14.4 | 13.9 | 13.7 | 13.5 | 13.3 | 13.1 | 12.9 | 12.7 | 12.5 | 9.9   | 7.1   | 5.0   | 3.6   | 2.5   | 309S   |                     |              |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 19.4 | 18.8 | 18.5 | 18.2 | 18.0 | 17.7 | 17.5 | 17.2 | 15.9 | 9.9   | 7.1   | 5.0   | 3.6   | 2.5   | 309S   |                     |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.9 | 19.3 | 18.5 | 18.2 | 17.9 | 17.7 | 17.4 | 17.2 | 16.9 | 16.7 | 13.8  | 10.3  | 7.6   | 5.5   | 4.0   | 310H   | A240                |              |
| 20.0                                                                                      | 17.6 | 16.1 | 15.1 | 14.3 | 13.7 | 13.5 | 13.3 | 13.1 | 12.9 | 12.7 | 12.5 | 12.3 | 12.1  | 10.3  | 7.6   | 5.5   | 4.0   | 310H   |                     |              |
| 20.0                                                                                      | 17.6 | 16.1 | 15.1 | 14.3 | 13.7 | 13.5 | 13.3 | 13.1 | 12.9 | 12.7 | 12.5 | 12.3 | 9.9   | 7.1   | 5.0   | 3.6   | 2.5   | 310S   |                     |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.9 | 19.3 | 18.5 | 18.2 | 17.9 | 17.7 | 17.4 | 17.2 | 16.9 | 15.9 | 9.9   | 7.1   | 5.0   | 3.6   | 2.5   | 310S   |                     |              |
| 20.0                                                                                      | 17.6 | 16.1 | 15.1 | 14.3 | 13.7 | 13.5 | 13.3 | 13.1 | 12.9 | 12.7 | 12.5 | 12.3 | 9.9   | 7.1   | 5.0   | 3.6   | 2.5   | 310S   |                     |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.9 | 19.3 | 18.5 | 18.2 | 17.9 | 17.7 | 17.4 | 17.2 | 16.9 | 15.9 | 9.9   | 7.1   | 5.0   | 3.6   | 2.5   | 310S   |                     |              |
| 20.0                                                                                      | 17.3 | 15.6 | 14.3 | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.8 | 11.6 | 11.5 | 11.4 | 11.3  | 11.2  | 11.1  | 9.8   | 7.4   | 316    | A240                |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.3 | 18.0 | 17.0 | 16.6 | 16.3 | 16.1 | 15.9 | 15.7 | 15.6 | 15.4 | 15.3  | 15.1  | 12.4  | 9.8   | 7.4   | 316    |                     |              |
| 16.7                                                                                      | 14.2 | 12.7 | 11.7 | 10.9 | 10.4 | 10.2 | 10.0 | 9.8  | 9.6  | 9.4  | 9.2  | 9.0  | 8.8   | 8.6   | 8.4   | 8.3   | 6.4   | 316L   |                     | (12)         |
| 16.7                                                                                      | 16.7 | 16.7 | 15.7 | 14.8 | 14.0 | 13.7 | 13.5 | 13.2 | 12.9 | 12.7 | 12.4 | 12.1 | 11.9  | 11.6  | 11.4  | 8.8   | 6.4   | 316L   |                     | (12)         |
| 22.9                                                                                      | 20.7 | 19.0 | 17.6 | 16.5 | 15.6 | 15.2 | 14.9 | 14.5 | 14.2 | 13.9 | 13.7 | 13.4 | 13.2  | 12.9  | 12.3  | 9.8   | 7.4   | 316N   |                     |              |
| 22.9                                                                                      | 22.9 | 22.0 | 21.5 | 21.2 | 21.0 | 20.5 | 20.0 | 19.6 | 19.2 | 18.8 | 18.5 | 18.1 | 17.8  | 15.8  | 12.3  | 9.8   | 7.4   | 316N   |                     |              |

Table A-3 Stainless Steels (Cont'd)

| Spec. No.                               | Type or Grade | Class | UNS Alloy No. | Nominal Composition    | P-No. | Notes          | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|-----------------------------------------|---------------|-------|---------------|------------------------|-------|----------------|--------------------------------|------------------------------|--------|
| <b>Plate, Sheet, and Strip (Cont'd)</b> |               |       |               |                        |       |                |                                |                              |        |
| <b>Austenitic (Cont'd)</b>              |               |       |               |                        |       |                |                                |                              |        |
| A240                                    | 317           | ...   | S31700        | 18Cr-13Ni-3Mo          | 8     | (1)(10)(11)    | 75                             | 30                           | 1.00   |
|                                         | 317           | ...   | S31700        | 18Cr-13Ni-3Mo          | 8     | (1)(9)(10)(11) | 75                             | 30                           | 1.00   |
|                                         | 317L          | ...   | S31703        | 18Cr-13Ni-3Mo          | 8     | (1)            | 75                             | 30                           | 1.00   |
|                                         | 317L          | ...   | S31703        | 18Cr-13Ni-3Mo          | 8     | (1)(9)         | 75                             | 30                           | 1.00   |
|                                         | 321           | ...   | S32100        | 18Cr-10Ni-Ti           | 8     | (10)(11)       | 75                             | 30                           | 1.00   |
|                                         | 321           | ...   | S32100        | 18Cr-10Ni-Ti           | 8     | (9)(10)(11)    | 75                             | 30                           | 1.00   |
| A240                                    | 347           | ...   | S34700        | 18Cr-10Ni-Cb           | 8     | (10)(11)       | 75                             | 30                           | 1.00   |
|                                         | 347           | ...   | S34700        | 18Cr-10Ni-Cb           | 8     | (9)(10)(11)    | 75                             | 30                           | 1.00   |
|                                         | 348           | ...   | S34800        | 18Cr-10Ni-Cb           | 8     | (1)(10)(11)    | 75                             | 30                           | 1.00   |
|                                         | 348           | ...   | S34800        | 18Cr-10Ni-Cb           | 8     | (1)(9)(10)(11) | 75                             | 30                           | 1.00   |
|                                         | XM-15         | ...   | S38100        | 18Cr-8Ni-2Si           | 8     | (1)            | 75                             | 30                           | 1.00   |
|                                         | XM-15         | ...   | S38100        | 18Cr-8Ni-2Si           | 8     | (1)(9)         | 75                             | 30                           | 1.00   |
| A240                                    | ...           | ...   | S31254        | 20Cr-18Ni-6Mo          | 8     | (1)            | 95                             | 45                           | 1.00   |
|                                         | ...           | ...   | S31254        | 20Cr-18Ni-6Mo          | 8     | (1)(9)         | 95                             | 45                           | 1.00   |
|                                         | ...           | ...   | S31254        | 20Cr-18Ni-6Mo          | 8     | (1)            | 100                            | 45                           | 1.00   |
|                                         | ...           | ...   | S31254        | 20Cr-18Ni-6Mo          | 8     | (1)(9)         | 100                            | 45                           | 1.00   |
|                                         | ...           | ...   | S32550        | 25.5Cr-5.5Ni-3.5Mo-2Cu | 10H   | (1)(25)(26)    | 110                            | 80                           | 1.00   |
| <b>Ferritic/Martensitic</b>             |               |       |               |                        |       |                |                                |                              |        |
| A240                                    | 405           | ...   | S40500        | 12Cr-1Al               | 7     | (3)            | 60                             | 25                           | 1.00   |
|                                         | 410           | ...   | S41000        | 13Cr                   | 6     | (1)            | 65                             | 30                           | 1.00   |
|                                         | 410S          | ...   | S41008        | 13Cr                   | 7     | (1)            | 60                             | 30                           | 1.00   |
|                                         | 429           | ...   | S42900        | 15Cr                   | 6     | (1)(3)         | 65                             | 30                           | 1.00   |
| A240                                    | 430           | ...   | S43000        | 17Cr                   | 7     | (1)(3)         | 65                             | 30                           | 1.00   |
|                                         | XM-27         | ...   | S44627        | 26Cr-1Mo               | 10I   | (1)(3)         | 65                             | 40                           | 1.00   |
|                                         | XM-33         | ...   | S44626        | 27Cr-1Mo-Ti            | 10I   | (2)            | 68                             | 45                           | 1.00   |
| <b>Ferritic/Austenitic</b>              |               |       |               |                        |       |                |                                |                              |        |
| A240                                    | S31803        | ...   | S31803        | 22Cr-5.5Ni-3Mo-N       | 10H   | (1)(23)(24)    | 90                             | 65                           | 1.00   |
|                                         | S32205        | ...   | S32205        | 22Cr-5.5Ni-3Mo-N       | 10H   | (1)(23)(24)    | 90                             | 65                           | 1.00   |
|                                         | S32750        | ...   | S32750        | 25Cr-7Ni-4Mo-N         | 10H   | (1)(22)(23)    | 116                            | 80                           | 1.00   |
| <b>Forgings</b>                         |               |       |               |                        |       |                |                                |                              |        |
| <b>Austenitic</b>                       |               |       |               |                        |       |                |                                |                              |        |
| A182                                    | F44           | ...   | S31254        | 20Cr-18Ni-6Mo          | 8     | (1)            | 94                             | 44                           | 1.00   |
|                                         | F44           | ...   | S31254        | 20Cr-18Ni-6Mo          | 8     | (1)(9)         | 94                             | 44                           | 1.00   |
| A182                                    | F304          | ...   | S30400        | 18Cr-8Ni               | 8     | (10)(12)       | 70                             | 30                           | 1.00   |
|                                         | F304          | ...   | S30400        | 18Cr-8Ni               | 8     | (9)(10)(12)    | 70                             | 30                           | 1.00   |
|                                         | F304          | ...   | S30400        | 18Cr-8Ni               | 8     | (10)           | 75                             | 30                           | 1.00   |
|                                         | F304          | ...   | S30400        | 18Cr-8Ni               | 8     | (9)(10)        | 75                             | 30                           | 1.00   |
| A182                                    | F304H         | ...   | S30409        | 18Cr-8Ni               | 8     | (12)           | 70                             | 30                           | 1.00   |
|                                         | F304H         | ...   | S30409        | 18Cr-8Ni               | 8     | (9)(12)        | 70                             | 30                           | 1.00   |
|                                         | F304H         | ...   | S30409        | 18Cr-8Ni               | 8     | ...            | 75                             | 30                           | 1.00   |
|                                         | F304H         | ...   | S30409        | 18Cr-8Ni               | 8     | (9)            | 75                             | 30                           | 1.00   |
| A182                                    | F304L         | ...   | S30403        | 18Cr-8Ni               | 8     | (1)            | 65                             | 25                           | 1.00   |
|                                         | F304L         | ...   | S30403        | 18Cr-8Ni               | 8     | (1)(9)         | 65                             | 25                           | 1.00   |
|                                         | F304N         | ...   | S30451        | 18Cr-8Ni-N             | 8     | (10)           | 80                             | 35                           | 1.00   |
|                                         | F304N         | ...   | S30451        | 18Cr-8Ni-N             | 8     | (9)(10)        | 80                             | 35                           | 1.00   |

Table A-3 Stainless Steels (Cont'd)

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        | Type<br>or<br>Grade              | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|--------|----------------------------------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 |        |                                  |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        | Plate, Sheet, and Strip (Cont'd) |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        | Austenitic (Cont'd)              |              |
| 20.0                                                                                      | 17.3 | 15.6 | 14.3 | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.8 | 11.6 | 11.5 | 11.4 | 11.3  | 11.2  | 11.1  | 9.8   | 7.4   | 317    | A240                             |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.3 | 18.0 | 17.0 | 16.6 | 16.3 | 16.1 | 15.9 | 15.7 | 15.6 | 15.4 | 15.3  | 15.1  | 12.4  | 9.8   | 7.4   | 317    |                                  |              |
| 20.0                                                                                      | 17.0 | 15.2 | 14.0 | 13.1 | 12.5 | 12.2 | 12.0 | 11.7 | 11.5 | 11.3 | ...  | ...  | ...   | ...   | ...   | ...   | ...   | 317L   |                                  |              |
| 20.0                                                                                      | 20.0 | 19.6 | 18.9 | 17.7 | 16.9 | 16.5 | 16.2 | 15.8 | 15.5 | 15.2 | ...  | ...  | ...   | ...   | ...   | ...   | ...   | 317L   |                                  |              |
| 20.0                                                                                      | 18.0 | 16.5 | 15.3 | 14.3 | 13.5 | 13.2 | 13.0 | 12.7 | 12.6 | 12.4 | 12.3 | 12.1 | 12.0  | 9.6   | 6.9   | 5.0   | 3.6   | 321    |                                  |              |
| 20.0                                                                                      | 20.0 | 19.1 | 18.7 | 18.7 | 18.3 | 17.9 | 17.5 | 17.2 | 16.9 | 16.7 | 16.5 | 16.4 | 16.2  | 9.6   | 6.9   | 5.0   | 3.6   | 321    |                                  |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 12.1  | 9.1   | 6.1   | 4.4   | 347    | A240                             |              |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.2 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.0  | 12.1  | 9.1   | 6.1   | 4.4   | 347    |                                  |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 12.1  | 9.1   | 6.1   | 4.4   | 348    |                                  |              |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.2 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.0  | 12.1  | 9.1   | 6.1   | 4.4   | 348    |                                  |              |
| 20.0                                                                                      | 16.7 | 15.0 | 13.8 | 12.9 | 12.3 | 12.0 | 11.7 | 11.5 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4  | ...   | ...   | ...   | ...   | XM-15  |                                  |              |
| 20.0                                                                                      | 20.0 | 18.9 | 18.3 | 17.5 | 16.6 | 16.2 | 15.8 | 15.5 | 15.2 | 14.9 | 14.6 | 14.3 | 14.0  | ...   | ...   | ...   | ...   | XM-15  |                                  |              |
| 27.1                                                                                      | 24.5 | 21.9 | 20.2 | 19.1 | 18.3 | 18.0 | 17.8 | 17.7 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...    | A240                             |              |
| 27.1                                                                                      | 27.1 | 25.8 | 24.6 | 23.7 | 23.2 | 23.1 | 23.0 | 22.9 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...    |                                  |              |
| 28.6                                                                                      | 24.5 | 21.9 | 20.2 | 19.1 | 18.3 | 18.0 | 17.8 | 17.7 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...    |                                  |              |
| 28.6                                                                                      | 28.6 | 27.2 | 25.9 | 25.0 | 24.4 | 24.3 | 24.1 | 23.9 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...    |                                  |              |
| 31.4                                                                                      | 31.3 | 29.5 | 28.6 | 28.2 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...    |                                  |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        | Ferritic/Martensitic             |              |
| 16.7                                                                                      | 15.3 | 14.8 | 14.5 | 14.3 | 14.0 | 13.8 | 13.5 | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | 405    | A240                             |              |
| 18.6                                                                                      | 18.4 | 17.8 | 17.4 | 17.2 | 16.8 | 16.6 | 16.2 | 15.7 | 15.1 | 14.4 | 12.3 | 8.8  | 6.4   | 4.4   | 2.9   | 1.8   | 1.0   | 410    |                                  |              |
| 17.1                                                                                      | 17.1 | 16.8 | 16.5 | 16.3 | 15.9 | 15.6 | 15.2 | 14.7 | 14.1 | 13.4 | 12.3 | 8.8  | 6.4   | 4.4   | 2.9   | 1.8   | 1.0   | 410S   |                                  |              |
| 18.6                                                                                      | 18.4 | 17.8 | 17.4 | 17.2 | 16.8 | 16.6 | 16.2 | 15.7 | 15.1 | 14.4 | 12.0 | 9.2  | 6.5   | 4.5   | 3.2   | 2.4   | 1.8   | 429    |                                  |              |
| 18.6                                                                                      | 18.4 | 17.8 | 17.4 | 17.2 | 16.8 | 16.6 | 16.2 | 15.7 | 15.1 | 14.4 | 12.0 | 9.2  | 6.5   | 4.5   | 3.2   | 2.4   | 1.8   | 430    | A240                             |              |
| 18.6                                                                                      | 18.6 | 18.3 | 18.1 | 18.1 | 18.1 | 18.1 | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | XM-27  |                                  |              |
| 19.4                                                                                      | 19.4 | 19.3 | 19.0 | 18.8 | 18.4 | 18.1 | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | XM-33  |                                  |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        | Ferritic/Austenitic              |              |
| 25.7                                                                                      | 25.7 | 24.8 | 23.9 | 23.3 | 23.1 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | S31803 | A240                             |              |
| 25.7                                                                                      | 25.7 | 24.8 | 23.9 | 23.3 | 23.1 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | S32205 |                                  |              |
| 33.1                                                                                      | 33.0 | 31.2 | 30.1 | 29.6 | 29.4 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | S32750 |                                  |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        | Forgings                         |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        | Austenitic                       |              |
| 26.9                                                                                      | 23.9 | 21.4 | 19.8 | 18.6 | 17.9 | 17.6 | 17.4 | 17.3 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | F44    | A182                             |              |
| 26.9                                                                                      | 26.9 | 25.5 | 24.3 | 23.5 | 23.0 | 22.8 | 22.7 | 22.6 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | F44    |                                  |              |
| 20.0                                                                                      | 16.7 | 15.0 | 13.8 | 12.9 | 12.3 | 12.0 | 11.7 | 11.5 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4  | 10.1  | 9.8   | 7.7   | 6.1   | F304   | A182                             |              |
| 20.0                                                                                      | 20.0 | 18.9 | 18.3 | 17.5 | 16.6 | 16.2 | 15.8 | 15.5 | 15.2 | 14.9 | 14.6 | 14.3 | 14.0  | 12.4  | 9.8   | 7.7   | 6.1   | F304   |                                  |              |
| 20.0                                                                                      | 16.7 | 15.0 | 13.8 | 12.9 | 12.3 | 12.0 | 11.7 | 11.5 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4  | 10.1  | 9.8   | 7.7   | 6.1   | F304   |                                  |              |
| 20.0                                                                                      | 20.0 | 18.9 | 18.3 | 17.5 | 16.6 | 16.2 | 15.8 | 15.5 | 15.2 | 14.9 | 14.6 | 14.3 | 14.0  | 12.4  | 9.8   | 7.7   | 6.1   | F304   |                                  |              |
| 20.0                                                                                      | 16.7 | 15.0 | 13.8 | 12.9 | 12.3 | 12.0 | 11.7 | 11.5 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4  | 10.1  | 9.8   | 7.7   | 6.1   | F304H  | A182                             |              |
| 20.0                                                                                      | 18.9 | 17.7 | 17.1 | 16.9 | 16.6 | 16.2 | 15.8 | 15.5 | 15.2 | 14.9 | 14.6 | 14.3 | 14.0  | 12.4  | 9.8   | 7.7   | 6.1   | F304H  |                                  |              |
| 20.0                                                                                      | 16.7 | 15.0 | 13.8 | 12.9 | 12.3 | 12.0 | 11.7 | 11.5 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4  | 10.1  | 9.8   | 7.7   | 6.1   | F304H  |                                  |              |
| 20.0                                                                                      | 20.0 | 18.9 | 18.3 | 17.5 | 16.6 | 16.2 | 15.8 | 15.5 | 15.2 | 14.9 | 14.6 | 14.3 | 14.0  | 12.4  | 9.8   | 7.7   | 6.1   | F304H  |                                  |              |
| 16.7                                                                                      | 14.3 | 12.8 | 11.7 | 10.9 | 10.4 | 10.2 | 10.0 | 9.8  | 9.7  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | F304L  | A182                             |              |
| 16.7                                                                                      | 16.7 | 16.2 | 15.6 | 14.7 | 14.0 | 13.7 | 13.5 | 13.3 | 13.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | F304L  |                                  |              |
| 22.9                                                                                      | 19.1 | 16.7 | 15.1 | 14.0 | 13.3 | 13.0 | 12.8 | 12.5 | 12.3 | 12.1 | 11.8 | 11.6 | 11.3  | 11.0  | 9.8   | 7.7   | 6.1   | F304N  |                                  |              |
| 22.9                                                                                      | 22.9 | 21.7 | 20.3 | 18.9 | 17.9 | 17.5 | 17.2 | 16.9 | 16.6 | 16.3 | 16.0 | 15.6 | 15.2  | 12.4  | 9.8   | 7.7   | 6.1   | F304N  |                                  |              |

Table A-3 Stainless Steels (Cont'd)

| Spec. No.                  | Type or Grade | Class | UNS Alloy No. | Nominal Composition | P- No. | Notes          | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|----------------------------|---------------|-------|---------------|---------------------|--------|----------------|--------------------------------|------------------------------|--------|
| <b>Forgings (Cont'd)</b>   |               |       |               |                     |        |                |                                |                              |        |
| <b>Austenitic (Cont'd)</b> |               |       |               |                     |        |                |                                |                              |        |
| A182                       | ...           | ...   | S30815        | 21Cr-11Ni-N         | 8      | (1)            | 87                             | 45                           | 1.00   |
|                            | ...           | ...   | S30815        | 21Cr-11Ni-N         | 8      | (1)(9)         | 87                             | 45                           | 1.00   |
| A182                       | F310          | ...   | S31000        | 25Cr-20Ni           | 8      | (1)(10)(14)    | 75                             | 30                           | 1.00   |
|                            | F310          | ...   | S31000        | 25Cr-20Ni           | 8      | (1)(9)(10)(14) | 75                             | 30                           | 1.00   |
|                            | F310          | ...   | S31000        | 25Cr-20Ni           | 8      | (1)(10)(15)    | 75                             | 30                           | 1.00   |
|                            | F310          | ...   | S31000        | 25Cr-20Ni           | 8      | (1)(9)(10)(15) | 75                             | 30                           | 1.00   |
| A182                       | F316          | ...   | S31600        | 16Cr-12Ni-2Mo       | 8      | (10)(12)       | 70                             | 30                           | 1.00   |
|                            | F316          | ...   | S31600        | 16Cr-12Ni-2Mo       | 8      | (9)(10)(12)    | 70                             | 30                           | 1.00   |
|                            | F316          | ...   | S31600        | 16Cr-12Ni-2Mo       | 8      | (10)           | 75                             | 30                           | 1.00   |
|                            | F316          | ...   | S31600        | 16Cr-12Ni-2Mo       | 8      | (9)(10)        | 75                             | 30                           | 1.00   |
| A182                       | F316H         | ...   | S31609        | 16Cr-12Ni-2Mo       | 8      | (12)           | 70                             | 30                           | 1.00   |
|                            | F316H         | ...   | S31609        | 16Cr-12Ni-2Mo       | 8      | (9)(12)        | 70                             | 30                           | 1.00   |
|                            | F316H         | ...   | S31609        | 16Cr-12Ni-2Mo       | 8      | ...            | 75                             | 30                           | 1.00   |
|                            | F316H         | ...   | S31609        | 16Cr-12Ni-2Mo       | 8      | (9)            | 75                             | 30                           | 1.00   |
| (12)                       | A182          | F316L | S31603        | 16Cr-12Ni-2Mo       | 8      | (1)(27)(29)    | 70                             | 25                           | 1.00   |
| (12)                       |               | F316L | S31603        | 16Cr-12Ni-2Mo       | 8      | (1)(9)(27)(29) | 70                             | 25                           | 1.00   |
|                            |               | F316N | S31651        | 16Cr-12Ni-2Mo-N     | 8      | (10)           | 80                             | 35                           | 1.00   |
|                            |               | F316N | S31651        | 16Cr-12Ni-2Mo-N     | 8      | (9)(10)        | 80                             | 35                           | 1.00   |
| A182                       | F321          | ...   | S32100        | 18Cr-10Ni-Ti        | 8      | (12)           | 70                             | 30                           | 1.00   |
|                            | F321          | ...   | S32100        | 18Cr-10Ni-Ti        | 8      | (9)(12)        | 70                             | 30                           | 1.00   |
|                            | F321          | ...   | S32100        | 18Cr-10Ni-Ti        | 8      | (10)           | 75                             | 30                           | 1.00   |
|                            | F321          | ...   | S32100        | 18Cr-10Ni-Ti        | 8      | (9)(10)        | 75                             | 30                           | 1.00   |
| A182                       | F321H         | ...   | S32109        | 18Cr-10Ni-Ti        | 8      | (12)           | 70                             | 30                           | 1.00   |
|                            | F321H         | ...   | S32109        | 18Cr-10Ni-Ti        | 8      | (9)(12)        | 70                             | 30                           | 1.00   |
|                            | F321H         | ...   | S32109        | 18Cr-10Ni-Ti        | 8      | ...            | 75                             | 30                           | 1.00   |
|                            | F321H         | ...   | S32109        | 18Cr-10Ni-Ti        | 8      | (9)            | 75                             | 30                           | 1.00   |
| A182                       | F347          | ...   | S34700        | 18Cr-10Ni-Cb        | 8      | (12)           | 70                             | 30                           | 1.00   |
|                            | F347          | ...   | S34700        | 18Cr-10Ni-Cb        | 8      | (9)(12)        | 70                             | 30                           | 1.00   |
|                            | F347          | ...   | S34700        | 18Cr-10Ni-Cb        | 8      | (10)           | 75                             | 30                           | 1.00   |
|                            | F347          | ...   | S34700        | 18Cr-10Ni-Cb        | 8      | (9)(10)        | 75                             | 30                           | 1.00   |
| A182                       | F347H         | ...   | S34709        | 18Cr-10Ni-Cb        | 8      | (12)           | 70                             | 30                           | 1.00   |
|                            | F347H         | ...   | S34709        | 18Cr-10Ni-Cb        | 8      | (9)(12)        | 70                             | 30                           | 1.00   |
|                            | F347H         | ...   | S34709        | 18Cr-10Ni-Cb        | 8      | ...            | 75                             | 30                           | 1.00   |
|                            | F347H         | ...   | S34709        | 18Cr-10Ni-Cb        | 8      | (9)            | 75                             | 30                           | 1.00   |
| A182                       | F348          | ...   | S34800        | 18Cr-10Ni-Cb        | 8      | (12)           | 70                             | 30                           | 1.00   |
|                            | F348          | ...   | S34800        | 18Cr-10Ni-Cb        | 8      | (9)(12)        | 70                             | 30                           | 1.00   |
|                            | F348          | ...   | S34800        | 18Cr-10Ni-Cb        | 8      | (10)           | 75                             | 30                           | 1.00   |
|                            | F348          | ...   | S34800        | 18Cr-10Ni-Cb        | 8      | (9)(10)        | 75                             | 30                           | 1.00   |

Table A-3 Stainless Steels (Cont'd)

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       | Type<br>or<br>Grade                      | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|------------------------------------------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 |                                          |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       | Forgings (Cont'd)<br>Austenitic (Cont'd) |              |
| 24.9                                                                                      | 24.7 | 22.0 | 19.9 | 18.5 | 17.7 | 17.4 | 17.2 | 17.0 | 16.8 | 16.6 | 16.4 | 16.2 | 14.9  | 11.6  | 9.0   | 6.9   | 5.2   | ...                                      | A182         |
| 24.9                                                                                      | 24.7 | 23.3 | 22.4 | 21.8 | 21.4 | 21.2 | 21.0 | 20.8 | 20.6 | 20.3 | 20.0 | 19.1 | 14.9  | 11.6  | 9.0   | 6.9   | 5.2   | ...                                      | A182         |
| 20.0                                                                                      | 17.6 | 16.1 | 15.1 | 14.3 | 13.7 | 13.5 | 13.3 | 13.1 | 12.9 | 12.7 | 12.5 | 12.3 | 9.9   | 7.1   | 5.0   | 3.6   | 2.5   | F310                                     | A182         |
| 20.0                                                                                      | 20.0 | 20.0 | 19.9 | 19.3 | 18.5 | 18.2 | 17.9 | 17.7 | 17.4 | 17.2 | 16.9 | 15.9 | 9.9   | 7.1   | 5.0   | 3.6   | 2.5   | F310                                     | A182         |
| 20.0                                                                                      | 17.6 | 16.1 | 15.1 | 14.3 | 13.7 | 13.5 | 13.3 | 13.1 | 12.9 | 12.7 | 12.5 | 12.3 | 9.9   | 7.1   | 5.0   | 3.6   | 2.5   | F310                                     | A182         |
| 20.0                                                                                      | 20.0 | 20.0 | 19.9 | 19.3 | 18.5 | 18.2 | 17.9 | 17.7 | 17.4 | 17.2 | 16.9 | 15.9 | 9.9   | 7.1   | 5.0   | 3.6   | 2.5   | F310                                     | A182         |
| 20.0                                                                                      | 17.3 | 15.6 | 14.3 | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.8 | 11.6 | 11.5 | 11.4 | 11.3  | 11.2  | 11.1  | 9.8   | 7.4   | F316                                     | A182         |
| 20.0                                                                                      | 20.0 | 19.4 | 19.2 | 18.0 | 17.0 | 16.6 | 16.3 | 16.1 | 15.9 | 15.7 | 15.6 | 15.4 | 15.3  | 15.1  | 12.4  | 9.8   | 7.4   | F316                                     | A182         |
| 20.0                                                                                      | 17.3 | 15.6 | 14.3 | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.8 | 11.6 | 11.5 | 11.4 | 11.3  | 11.2  | 11.1  | 9.8   | 7.4   | F316                                     | A182         |
| 20.0                                                                                      | 20.0 | 20.0 | 19.3 | 18.0 | 17.0 | 16.6 | 16.3 | 16.1 | 15.9 | 15.7 | 15.6 | 15.4 | 15.3  | 15.1  | 12.4  | 9.8   | 7.4   | F316                                     | A182         |
| 20.0                                                                                      | 17.3 | 15.6 | 14.3 | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.8 | 11.6 | 11.5 | 11.4 | 11.3  | 11.2  | 11.1  | 9.8   | 7.4   | F316H                                    | A182         |
| 20.0                                                                                      | 20.0 | 19.4 | 19.2 | 18.0 | 17.0 | 16.6 | 16.3 | 16.1 | 15.9 | 15.7 | 15.6 | 15.4 | 15.3  | 15.1  | 12.4  | 9.8   | 7.4   | F316H                                    | A182         |
| 20.0                                                                                      | 17.3 | 15.6 | 14.3 | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.8 | 11.6 | 11.5 | 11.4 | 11.3  | 11.2  | 11.1  | 9.8   | 7.4   | F316H                                    | A182         |
| 20.0                                                                                      | 20.0 | 20.0 | 19.3 | 18.0 | 17.0 | 16.6 | 16.3 | 16.1 | 15.9 | 15.7 | 15.6 | 15.4 | 15.3  | 15.1  | 12.4  | 9.8   | 7.4   | F316H                                    | A182         |
| 16.7                                                                                      | 14.1 | 12.7 | 11.7 | 10.9 | 10.4 | 10.2 | 10.0 | 9.8  | 9.6  | 9.4  | 9.2  | 9.0  | 8.8   | 8.6   | 8.4   | 8.3   | 6.4   | F316L                                    | A182         |
| 16.7                                                                                      | 16.7 | 16.7 | 15.6 | 14.8 | 14.0 | 13.8 | 13.5 | 13.2 | 13.0 | 12.7 | 12.4 | 12.1 | 11.9  | 11.6  | 11.4  | 8.8   | 6.4   | F316L                                    | (12)         |
| 22.9                                                                                      | 20.7 | 19.0 | 17.6 | 16.5 | 15.6 | 15.2 | 14.9 | 14.5 | 14.2 | 13.9 | 13.7 | 13.4 | 13.2  | 12.9  | 12.3  | 9.8   | 7.4   | F316N                                    | (12)         |
| 22.9                                                                                      | 22.9 | 22.0 | 21.5 | 21.2 | 21.0 | 20.5 | 20.0 | 19.6 | 19.2 | 18.8 | 18.5 | 18.1 | 17.8  | 15.8  | 12.3  | 9.8   | 7.4   | F316N                                    | (12)         |
| 20.0                                                                                      | 18.0 | 16.5 | 15.3 | 14.3 | 13.5 | 13.2 | 13.0 | 12.7 | 12.6 | 12.4 | 12.3 | 12.1 | 12.0  | 9.6   | 6.9   | 5.0   | 3.6   | F321                                     | A182         |
| 20.0                                                                                      | 19.0 | 17.8 | 17.5 | 17.5 | 17.5 | 17.5 | 17.5 | 17.2 | 16.9 | 16.7 | 16.5 | 16.4 | 16.2  | 9.6   | 6.9   | 5.0   | 3.6   | F321                                     | A182         |
| 20.0                                                                                      | 18.0 | 16.5 | 15.3 | 14.3 | 13.5 | 13.2 | 13.0 | 12.7 | 12.6 | 12.4 | 12.3 | 12.1 | 12.0  | 9.6   | 6.9   | 5.0   | 3.6   | F321                                     | A182         |
| 20.0                                                                                      | 20.0 | 19.1 | 18.7 | 18.7 | 18.3 | 17.9 | 17.5 | 17.2 | 16.9 | 16.7 | 16.5 | 16.4 | 16.2  | 9.6   | 6.9   | 5.0   | 3.6   | F321                                     | A182         |
| 20.0                                                                                      | 18.0 | 16.5 | 15.3 | 14.3 | 13.5 | 13.2 | 13.0 | 12.7 | 12.6 | 12.4 | 12.3 | 12.1 | 12.0  | 11.9  | 9.1   | 6.9   | 5.4   | F321H                                    | A182         |
| 20.0                                                                                      | 19.0 | 17.8 | 17.5 | 17.5 | 17.5 | 17.5 | 17.5 | 17.2 | 16.9 | 16.7 | 16.5 | 16.4 | 16.2  | 12.3  | 9.1   | 6.9   | 5.4   | F321H                                    | A182         |
| 20.0                                                                                      | 18.0 | 16.5 | 15.3 | 14.3 | 13.5 | 13.2 | 13.0 | 12.7 | 12.6 | 12.4 | 12.3 | 12.1 | 12.0  | 11.9  | 9.1   | 6.9   | 5.4   | F321H                                    | A182         |
| 20.0                                                                                      | 20.0 | 19.1 | 18.7 | 18.7 | 18.3 | 17.9 | 17.5 | 17.2 | 16.9 | 16.7 | 16.5 | 16.4 | 16.2  | 12.3  | 9.1   | 6.9   | 5.4   | F321H                                    | A182         |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 12.1  | 9.1   | 6.1   | 4.4   | F347                                     | A182         |
| 20.0                                                                                      | 19.1 | 17.6 | 16.6 | 16.0 | 15.8 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.6 | 15.5 | 15.3  | 12.1  | 9.1   | 6.1   | 4.4   | F347                                     | A182         |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 12.1  | 9.1   | 6.1   | 4.4   | F347                                     | A182         |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.2 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.0  | 12.1  | 9.1   | 6.1   | 4.4   | F347                                     | A182         |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 13.4  | 13.3  | 10.5  | 7.9   | F347H                                    | A182         |
| 20.0                                                                                      | 19.1 | 17.6 | 16.6 | 16.0 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.6 | 15.5 | 15.3  | 15.1  | 14.1  | 10.5  | 7.9   | F347H                                    | A182         |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 13.4  | 13.3  | 10.5  | 7.9   | F347H                                    | A182         |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.1 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.4  | 16.2  | 14.1  | 10.5  | 7.9   | F347H                                    | A182         |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 12.1  | 9.1   | 6.1   | 4.4   | F348                                     | A182         |
| 20.0                                                                                      | 19.1 | 17.6 | 16.6 | 16.0 | 15.8 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.6 | 15.5 | 15.3  | 12.1  | 9.1   | 6.1   | 4.4   | F348                                     | A182         |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 12.1  | 9.1   | 6.1   | 4.4   | F348                                     | A182         |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.2 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.0  | 12.1  | 9.1   | 6.1   | 4.4   | F348                                     | A182         |

Table A-3 Stainless Steels (Cont'd)

| Spec. No.                             | Type or Grade | Class  | UNS Alloy No. | Nominal Composition | P- No. | Notes                 | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|---------------------------------------|---------------|--------|---------------|---------------------|--------|-----------------------|--------------------------------|------------------------------|--------|
| <b>Forgings (Cont'd)</b>              |               |        |               |                     |        |                       |                                |                              |        |
| <b>Austenitic (Cont'd)</b>            |               |        |               |                     |        |                       |                                |                              |        |
| A182                                  | F348H         | ...    | S34809        | 18Cr-10Ni-Cb        | 8      | (12)                  | 70                             | 30                           | 1.00   |
|                                       | F348H         | ...    | S34809        | 18Cr-10Ni-Cb        | 8      | (9)(12)               | 70                             | 30                           | 1.00   |
|                                       | F348H         | ...    | S34809        | 18Cr-10Ni-Cb        | 8      | ...                   | 75                             | 30                           | 1.00   |
|                                       | F348H         | ...    | S34809        | 18Cr-10Ni-Cb        | 8      | (9)                   | 75                             | 30                           | 1.00   |
| <b>Ferritic/Martensitic</b>           |               |        |               |                     |        |                       |                                |                              |        |
| A182                                  | FXM-27Cb      | ...    | S44627        | 27Cr-1Mo            | 10I    | (2)                   | 60                             | 35                           | 1.00   |
| A336                                  | FXM-27Cb      | ...    | S44627        | 27Cr-1Mo            | 10I    | (2)                   | 60                             | 35                           | 1.00   |
| <b>Ferritic/Austenitic</b>            |               |        |               |                     |        |                       |                                |                              |        |
| A182                                  | F51           | ...    | S31803        | 22Cr-5.5Ni-3Mo-N    | 10H    | (1)(23)(24)           | 90                             | 65                           | 1.00   |
|                                       | F60           | ...    | S32205        | 22Cr-5.5Ni-3Mo-N    | 10H    | (1)(23)(24)           | 95                             | 70                           | 1.00   |
|                                       | F53           | ...    | S32750        | 25Cr-7Ni-4Mo-N      | 10H    | (1)(22)(23)           | 116                            | 80                           | 1.00   |
| <b>Fittings (Seamless and Welded)</b> |               |        |               |                     |        |                       |                                |                              |        |
| <b>Austenitic</b>                     |               |        |               |                     |        |                       |                                |                              |        |
| A403                                  | WP304         | ...    | S30400        | 18Cr-8Ni            | 8      | (1)(4)(7)(10)(11)     | 75                             | 30                           | 1.00   |
|                                       | WP304         | ...    | S30400        | 18Cr-8Ni            | 8      | (1)(4)(7)(9)(10)(11)  | 75                             | 30                           | 1.00   |
|                                       | WP304H        | ...    | S30409        | 18Cr-8Ni            | 8      | (1)(4)(7)(11)         | 75                             | 30                           | 1.00   |
|                                       | WP304H        | ...    | S30409        | 18Cr-8Ni            | 8      | (1)(4)(7)(9)(11)      | 75                             | 30                           | 1.00   |
| A403                                  | WP304L        | ...    | S30403        | 18Cr-8Ni            | 8      | (1)(7)(11)            | 70                             | 25                           | 1.00   |
|                                       | WP304L        | ...    | S30403        | 18Cr-8Ni            | 8      | (1)(7)(9)(11)         | 70                             | 25                           | 1.00   |
|                                       | WP304N        | ...    | S30451        | 18Cr-8Ni-N          | 8      | (1)(4)(7)(10)         | 80                             | 35                           | 1.00   |
|                                       | WP304N        | ...    | S30451        | 18Cr-8Ni-N          | 8      | (1)(4)(7)(9)(10)      | 80                             | 35                           | 1.00   |
| A403                                  | WP309         | ...    | S30900        | 23Cr-12Ni           | 8      | (1)(7)(10)(11)        | 75                             | 30                           | 1.00   |
|                                       | WP309         | ...    | S30900        | 23Cr-12Ni           | 8      | (1)(7)(9)(10)(11)     | 75                             | 30                           | 1.00   |
|                                       | WP310         | ...    | S31000        | 23Cr-20Ni           | 8      | (1)(7)(10)(11)(14)    | 75                             | 30                           | 1.00   |
|                                       | WP310         | ...    | S31000        | 23Cr-20Ni           | 8      | (1)(7)(9)(10)(11)(14) | 75                             | 30                           | 1.00   |
|                                       | WP310         | ...    | S31000        | 23Cr-20Ni           | 8      | (1)(7)(10)(11)(15)    | 75                             | 30                           | 1.00   |
|                                       | WP310         | ...    | S31000        | 23Cr-20Ni           | 8      | (1)(7)(9)(10)(11)(15) | 75                             | 30                           | 1.00   |
| A403                                  | WPS31254      | ...    | S31254        | 20Cr-18Ni-6Mo       | 8      | (1)(7)                | 94                             | 44                           | 1.00   |
|                                       | WPS31254      | ...    | S31254        | 20Cr-18Ni-6Mo       | 8      | (1)(7)(9)             | 94                             | 44                           | 1.00   |
| A403                                  | WP316         | ...    | S31600        | 16Cr-12Ni-2Mo       | 8      | (4)(7)(10)(11)        | 75                             | 30                           | 1.00   |
|                                       | WP316         | ...    | S31600        | 16Cr-12Ni-2Mo       | 8      | (4)(7)(9)(10)(11)     | 75                             | 30                           | 1.00   |
|                                       | WP316H        | ...    | S31609        | 16Cr-12Ni-2Mo       | 8      | (4)(7)(11)            | 75                             | 30                           | 1.00   |
|                                       | WP316H        | ...    | S31609        | 16Cr-12Ni-2Mo       | 8      | (4)(7)(9)(11)         | 75                             | 30                           | 1.00   |
| (12)                                  | A403          | WP316L | S31603        | 16Cr-12Ni-2Mo       | 8      | (1)(7)(11)(29)        | 70                             | 25                           | 1.00   |
| (12)                                  |               | WP316L | S31603        | 16Cr-12Ni-2Mo       | 8      | (1)(7)(9)(11)(29)     | 70                             | 25                           | 1.00   |
|                                       |               | WP316N | S31651        | 16Cr-12Ni-2Mo-N     | 8      | (1)(7)(10)            | 80                             | 35                           | 1.00   |
|                                       |               | WP316N | S31651        | 16Cr-12Ni-2Mo-N     | 8      | (1)(7)(9)(10)         | 80                             | 35                           | 1.00   |
| A403                                  | WP317         | ...    | S31700        | 18Cr-13Ni-3Mo       | 8      | (1)(7)(10)(11)        | 75                             | 30                           | 1.00   |
|                                       | WP317         | ...    | S31700        | 18Cr-13Ni-3Mo       | 8      | (1)(7)(9)(10)(11)     | 75                             | 30                           | 1.00   |
|                                       | WP321         | ...    | S32100        | 18Cr-10Ni-Ti        | 8      | (4)(7)(10)(11)        | 75                             | 30                           | 1.00   |
|                                       | WP321         | ...    | S32100        | 18Cr-10Ni-Ti        | 8      | (4)(7)(9)(10)(11)     | 75                             | 30                           | 1.00   |
|                                       | WP321H        | ...    | S32109        | 18Cr-10Ni-Ti        | 8      | (4)(7)(11)            | 75                             | 30                           | 1.00   |
|                                       | WP321H        | ...    | S32109        | 18Cr-10Ni-Ti        | 8      | (4)(7)(9)(11)         | 75                             | 30                           | 1.00   |

Table A-3 Stainless Steels (Cont'd)

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |          | Type<br>or<br>Grade            | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|----------|--------------------------------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 |          |                                |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |          | Forgings (Cont'd)              |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |          | Austenitic (Cont'd)            |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 13.4  | 13.3  | 10.5  | 7.9   | F348H    | A182                           |              |
| 20.0                                                                                      | 19.1 | 17.6 | 16.6 | 16.0 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.7 | 15.6 | 15.5 | 15.3  | 15.1  | 14.1  | 10.5  | 7.9   | F348H    |                                |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 13.4  | 13.3  | 10.5  | 7.9   | F348H    |                                |              |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.1 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.4  | 16.2  | 14.1  | 10.5  | 7.9   | F348H    |                                |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |          | Ferritic/Martensitic           |              |
| 17.1                                                                                      | 17.1 | 16.6 | 16.1 | 16.1 | 16.1 | 16.1 | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | FXM-27Cb | A182                           |              |
| 17.1                                                                                      | 17.1 | 16.6 | 16.1 | 16.1 | 16.1 | 16.1 | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | FXM-27Cb | A336                           |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |          | Ferritic/Austenitic            |              |
| 25.7                                                                                      | 25.7 | 24.8 | 23.9 | 23.3 | 23.1 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | F51      | A182                           |              |
| 27.1                                                                                      | 27.1 | 26.2 | 25.2 | 24.6 | 24.3 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | F60      |                                |              |
| 33.1                                                                                      | 33.0 | 31.2 | 30.1 | 29.6 | 29.4 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | F53      |                                |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |          | Fittings (Seamless and Welded) |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |          | Austenitic                     |              |
| 20.0                                                                                      | 16.7 | 15.0 | 13.8 | 12.9 | 12.3 | 12.0 | 11.7 | 11.5 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4  | 10.1  | 9.8   | 7.7   | 6.1   | WP304    | A403                           |              |
| 20.0                                                                                      | 20.0 | 18.9 | 18.3 | 17.5 | 16.6 | 16.2 | 15.8 | 15.5 | 15.2 | 14.9 | 14.6 | 14.3 | 14.0  | 12.4  | 9.8   | 7.7   | 6.1   | WP304    |                                |              |
| 20.0                                                                                      | 16.7 | 15.0 | 13.8 | 12.9 | 12.3 | 12.0 | 11.7 | 11.5 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4  | 10.1  | 9.8   | 7.7   | 6.1   | WP304H   |                                |              |
| 20.0                                                                                      | 20.0 | 18.9 | 18.3 | 17.5 | 16.6 | 16.2 | 15.8 | 15.5 | 15.2 | 14.9 | 14.6 | 14.3 | 14.0  | 12.4  | 9.8   | 7.7   | 6.1   | WP304H   |                                |              |
| 16.7                                                                                      | 14.3 | 12.8 | 11.7 | 10.9 | 10.4 | 10.2 | 10.0 | 9.8  | 9.7  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | WP304L   | A403                           |              |
| 16.7                                                                                      | 16.7 | 16.7 | 15.8 | 14.7 | 14.0 | 13.7 | 13.5 | 13.3 | 13.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | WP304L   |                                |              |
| 22.9                                                                                      | 19.1 | 16.7 | 15.1 | 14.0 | 13.3 | 13.0 | 12.8 | 12.5 | 12.3 | 12.1 | 11.8 | 11.6 | 11.3  | 11.0  | 9.8   | 7.7   | 6.1   | WP304N   |                                |              |
| 22.9                                                                                      | 22.9 | 21.7 | 20.3 | 18.9 | 17.9 | 17.5 | 17.2 | 16.9 | 16.6 | 16.3 | 16.0 | 15.6 | 15.2  | 12.4  | 9.8   | 7.7   | 6.1   | WP304N   |                                |              |
| 20.0                                                                                      | 17.5 | 16.1 | 15.1 | 14.4 | 13.9 | 13.7 | 13.5 | 13.3 | 13.1 | 12.9 | 12.7 | 12.5 | 9.9   | 7.1   | 5.0   | 3.6   | 2.5   | WP309    | A403                           |              |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 19.4 | 18.8 | 18.5 | 18.2 | 18.0 | 17.7 | 17.5 | 17.2 | 15.9 | 9.9   | 7.1   | 5.0   | 3.6   | 2.5   | WP309    |                                |              |
| 20.0                                                                                      | 17.6 | 16.1 | 15.1 | 14.3 | 13.7 | 13.5 | 13.3 | 13.1 | 12.9 | 12.7 | 12.5 | 12.3 | 9.9   | 7.1   | 5.0   | 3.6   | 2.5   | WP310    |                                |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.9 | 19.3 | 18.5 | 18.2 | 17.9 | 17.7 | 17.4 | 17.2 | 16.9 | 15.9 | 9.9   | 7.1   | 5.0   | 3.6   | 2.5   | WP310    |                                |              |
| 20.0                                                                                      | 17.6 | 16.1 | 15.1 | 14.3 | 13.7 | 13.5 | 13.3 | 13.1 | 12.9 | 12.7 | 12.5 | 12.3 | 9.9   | 7.1   | 5.0   | 3.6   | 2.5   | WP310    |                                |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.9 | 19.3 | 18.5 | 18.2 | 17.9 | 17.7 | 17.4 | 17.2 | 16.9 | 15.9 | 9.9   | 7.1   | 5.0   | 3.6   | 2.5   | WP310    |                                |              |
| 26.9                                                                                      | 23.9 | 21.4 | 19.8 | 18.6 | 17.9 | 17.6 | 17.4 | 17.3 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | WPS31254 | A403                           |              |
| 26.9                                                                                      | 26.9 | 25.5 | 24.3 | 23.5 | 23.0 | 22.8 | 22.7 | 22.6 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | WPS31254 |                                |              |
| 20.0                                                                                      | 17.3 | 15.6 | 14.3 | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.8 | 11.6 | 11.5 | 11.4 | 11.3  | 11.2  | 11.1  | 9.8   | 7.4   | WP316    | A403                           |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.3 | 18.0 | 17.0 | 16.6 | 16.3 | 16.1 | 15.9 | 15.7 | 15.6 | 15.4 | 15.3  | 15.1  | 12.4  | 9.8   | 7.4   | WP316    |                                |              |
| 20.0                                                                                      | 17.3 | 15.6 | 14.3 | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.8 | 11.6 | 11.5 | 11.4 | 11.3  | 11.2  | 11.1  | 9.8   | 7.4   | WP316H   |                                |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.3 | 18.0 | 17.0 | 16.6 | 16.3 | 16.1 | 15.9 | 15.7 | 15.6 | 15.4 | 15.3  | 15.1  | 12.4  | 9.8   | 7.4   | WP316H   |                                |              |
| 16.7                                                                                      | 14.1 | 12.7 | 11.7 | 10.9 | 10.4 | 10.2 | 10.0 | 9.8  | 9.6  | 9.4  | 9.2  | 9.0  | 8.8   | 8.6   | 8.4   | 8.3   | 6.4   | WP316L   | A403                           |              |
| 16.7                                                                                      | 16.7 | 16.0 | 15.6 | 14.8 | 14.0 | 13.8 | 13.5 | 13.2 | 13.0 | 12.7 | 12.4 | 12.1 | 11.9  | 11.6  | 11.4  | 8.8   | 6.4   | WP316L   |                                |              |
| 22.9                                                                                      | 20.7 | 19.0 | 17.6 | 16.5 | 15.6 | 15.2 | 14.9 | 14.5 | 14.2 | 13.9 | 13.7 | 13.4 | 13.2  | 12.9  | 12.3  | 9.8   | 7.4   | WP316N   |                                |              |
| 22.9                                                                                      | 22.9 | 22.0 | 21.5 | 21.2 | 21.0 | 20.5 | 20.0 | 19.6 | 19.2 | 18.8 | 18.5 | 18.1 | 17.8  | 15.8  | 12.3  | 9.8   | 7.4   | WP316N   |                                |              |
| 20.0                                                                                      | 17.3 | 15.6 | 14.3 | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.8 | 11.6 | 11.5 | 11.4 | 11.3  | 11.2  | 11.1  | 9.8   | 7.4   | WP317    | A403                           |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.3 | 18.0 | 17.0 | 16.6 | 16.3 | 16.1 | 15.9 | 15.7 | 15.6 | 15.4 | 15.3  | 15.1  | 12.4  | 9.8   | 7.4   | WP317    |                                |              |
| 20.0                                                                                      | 18.0 | 16.5 | 15.3 | 14.3 | 13.5 | 13.2 | 13.0 | 12.7 | 12.6 | 12.4 | 12.3 | 12.1 | 12.0  | 9.6   | 6.9   | 5.0   | 3.6   | WP321    |                                |              |
| 20.0                                                                                      | 20.0 | 19.1 | 18.7 | 18.7 | 18.3 | 17.9 | 17.5 | 17.2 | 16.9 | 16.7 | 16.5 | 16.4 | 16.2  | 9.6   | 6.9   | 5.0   | 3.6   | WP321    |                                |              |
| 20.0                                                                                      | 18.0 | 16.5 | 15.3 | 14.3 | 13.5 | 13.2 | 13.0 | 12.7 | 12.6 | 12.4 | 12.3 | 12.1 | 12.0  | 11.9  | 9.1   | 6.9   | 5.4   | WP321H   |                                |              |
| 20.0                                                                                      | 20.0 | 19.1 | 18.7 | 18.7 | 18.3 | 17.9 | 17.5 | 17.2 | 16.9 | 16.7 | 16.5 | 16.4 | 16.2  | 12.3  | 9.1   | 6.9   | 5.4   | WP321H   |                                |              |

Table A-3 Stainless Steels (Cont'd)

| Spec. No.                                      | Type or Grade | Class | UNS Alloy No. | Nominal Composition    | P-No. | Notes             | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|------------------------------------------------|---------------|-------|---------------|------------------------|-------|-------------------|--------------------------------|------------------------------|--------|
| <b>Fittings (Seamless and Welded) (Cont'd)</b> |               |       |               |                        |       |                   |                                |                              |        |
| <b>Austenitic (Cont'd)</b>                     |               |       |               |                        |       |                   |                                |                              |        |
| A403                                           | WP347         | ...   | S34700        | 18Cr-10Ni-Cb           | 8     | (4)(7)(10)(11)    | 75                             | 30                           | 1.00   |
|                                                | WP347         | ...   | S34700        | 18Cr-10Ni-Cb           | 8     | (4)(7)(9)(10)(11) | 75                             | 30                           | 1.00   |
|                                                | WP347H        | ...   | S34709        | 18Cr-10Ni-Cb           | 8     | (4)(7)(11)        | 75                             | 30                           | 1.00   |
|                                                | WP347H        | ...   | S34709        | 18Cr-10Ni-Cb           | 8     | (4)(7)(9)(11)     | 75                             | 30                           | 1.00   |
| A403                                           | WP348         | ...   | S34800        | 18Cr-10Ni-Cb           | 8     | (4)(7)(10)(11)    | 75                             | 30                           | 1.00   |
|                                                | WP348         | ...   | S34800        | 18Cr-10Ni-Cb           | 8     | (4)(7)(9)(10)(11) | 75                             | 30                           | 1.00   |
|                                                | WP348H        | ...   | S34809        | 18Cr-10Ni-Cb           | 8     | (4)(7)(11)        | 75                             | 30                           | 1.00   |
|                                                | WP348H        | ...   | S34809        | 18Cr-10Ni-Cb           | 8     | (4)(7)(9)(11)     | 75                             | 30                           | 1.00   |
| <b>Ferritic/Austenitic</b>                     |               |       |               |                        |       |                   |                                |                              |        |
| A815                                           | S31803        | ...   | S31803        | 22Cr-5.5Ni-3Mo-N       | 10H   | (1)(23)(24)       | 90                             | 65                           | 1.00   |
|                                                | S32205        | ...   | S32205        | 22Cr-5.5Ni-3Mo-N       | 10H   | (1)(23)(24)       | 95                             | 70                           | 1.00   |
| <b>Castings</b>                                |               |       |               |                        |       |                   |                                |                              |        |
| <b>Austenitic</b>                              |               |       |               |                        |       |                   |                                |                              |        |
| A351                                           | CF3           | ...   | J92500        | 18Cr-8Ni               | 8     | (1)(5)(17)        | 70                             | 30                           | 0.80   |
|                                                | CF3           | ...   | J92500        | 18Cr-8Ni               | 8     | (1)(5)(9)(17)     | 70                             | 30                           | 0.80   |
|                                                | CF3A          | ...   | J92500        | 18Cr-8Ni               | 8     | (1)(5)(17)        | 77.5                           | 35                           | 0.80   |
|                                                | CF3A          | ...   | J92500        | 18Cr-8Ni               | 8     | (1)(5)(9)(17)     | 77.5                           | 35                           | 0.80   |
|                                                | CF3M          | ...   | J92800        | 18Cr-12Ni-2Mo          | 8     | (1)(5)(13)(17)    | 70                             | 30                           | 0.80   |
|                                                | CF3M          | ...   | J92800        | 18Cr-12Ni-2Mo          | 8     | (1)(5)(9)(13)(17) | 70                             | 30                           | 0.80   |
| A351                                           | CF8           | ...   | J92600        | 18Cr-8Ni               | 8     | (5)(10)(17)       | 70                             | 30                           | 0.80   |
|                                                | CF8           | ...   | J92600        | 18Cr-8Ni               | 8     | (5)(9)(10)(17)    | 70                             | 30                           | 0.80   |
|                                                | CF8C          | ...   | J92710        | 18Cr-10Ni-Cb           | 8     | (1)(5)(10)(17)    | 70                             | 30                           | 0.80   |
|                                                | CF8C          | ...   | J92710        | 18Cr-10Ni-Cb           | 8     | (1)(5)(9)(10)(17) | 70                             | 30                           | 0.80   |
|                                                | CF8M          | ...   | J92900        | 16Cr-12Ni-2Mo          | 8     | (5)(13)(17)       | 70                             | 30                           | 0.80   |
|                                                | CF8M          | ...   | J92900        | 16Cr-12Ni-2Mo          | 8     | (5)(9)(13)(17)    | 70                             | 30                           | 0.80   |
| A351                                           | CH8           | ...   | J93400        | 25Cr-12Ni              | 8     | (1)(5)(10)(17)    | 65                             | 28                           | 0.80   |
|                                                | CH8           | ...   | J93400        | 25Cr-12Ni              | 8     | (1)(5)(9)(10)(17) | 65                             | 28                           | 0.80   |
|                                                | CH20          | ...   | J93402        | 25Cr-12Ni              | 8     | (1)(5)(10)(17)    | 70                             | 30                           | 0.80   |
|                                                | CH20          | ...   | J93402        | 25Cr-12Ni              | 8     | (1)(5)(9)(10)(17) | 70                             | 30                           | 0.80   |
|                                                | CK20          | ...   | J94202        | 25Cr-20Ni              | 8     | (1)(5)(10)(17)    | 65                             | 28                           | 0.80   |
|                                                | CK20          | ...   | J94202        | 25Cr-20Ni              | 8     | (1)(5)(9)(10)(17) | 65                             | 28                           | 0.80   |
| <b>Ferritic/Martensitic</b>                    |               |       |               |                        |       |                   |                                |                              |        |
| A217                                           | CA15          | ...   | J91150        | 13Cr- $\frac{1}{2}$ Mo | 6     | (1)(3)(5)         | 90                             | 65                           | 0.80   |

Table A-3 Stainless Steels (Cont'd)

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        | Type<br>or<br>Grade                     | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|--------|-----------------------------------------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 |        |                                         |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        | Fittings (Seamless and Welded) (Cont'd) |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        | Austenitic (Cont'd)                     |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 12.1  | 9.1   | 6.1   | 4.4   | WP347  | A403                                    |              |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.2 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.0  | 12.1  | 9.1   | 6.1   | 4.4   | WP347  |                                         |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 13.4  | 13.3  | 10.5  | 7.9   | WP347H |                                         |              |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.1 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.4  | 16.2  | 14.1  | 10.5  | 7.9   | WP347H |                                         |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 12.1  | 9.1   | 6.1   | 4.4   | WP348  | A403                                    |              |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.2 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.0  | 12.1  | 9.1   | 6.1   | 4.4   | WP348  |                                         |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 13.4  | 13.3  | 10.5  | 7.9   | WP348H |                                         |              |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.1 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.4  | 16.2  | 14.1  | 10.5  | 7.9   | WP348H |                                         |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        | Ferritic/Austenitic                     |              |
| 25.7                                                                                      | 25.7 | 24.8 | 23.9 | 23.3 | 23.1 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | S31803 | A815                                    |              |
| 27.1                                                                                      | 27.1 | 26.2 | 25.2 | 24.6 | 24.3 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | S32205 |                                         |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        | Castings                                |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        | Austenitic                              |              |
| 16.0                                                                                      | 13.3 | 12.0 | 11.0 | 10.4 | 9.8  | 9.6  | 9.4  | 9.2  | 9.0  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | CF3    | A351                                    |              |
| 16.0                                                                                      | 15.2 | 14.1 | 13.7 | 13.5 | 13.3 | 13.0 | 12.7 | 12.4 | 12.1 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | CF3    |                                         |              |
| 17.7                                                                                      | 15.6 | 14.0 | 12.9 | 12.1 | 11.5 | 11.2 | 10.9 | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | CF3A   |                                         |              |
| 17.7                                                                                      | 16.8 | 15.6 | 15.1 | 15.0 | 15.0 | 14.8 | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | CF3A   |                                         |              |
| 16.0                                                                                      | 13.8 | 12.4 | 11.4 | 10.6 | 10.1 | 9.8  | 9.7  | 9.5  | 9.4  | 9.3  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | CF3M   |                                         |              |
| 16.0                                                                                      | 16.0 | 15.5 | 15.4 | 14.3 | 13.6 | 13.3 | 13.0 | 12.8 | 12.7 | 12.5 | ...  | ...  | ...   | ...   | ...   | ...   | ...   | CF3M   |                                         |              |
| 16.0                                                                                      | 13.3 | 12.0 | 11.0 | 10.4 | 9.8  | 9.6  | 9.4  | 9.2  | 9.0  | 8.8  | 8.6  | 8.5  | 8.3   | 7.6   | 6.0   | 4.8   | 3.8   | CF8    | A351                                    |              |
| 16.0                                                                                      | 15.2 | 14.1 | 13.7 | 13.5 | 13.3 | 13.0 | 12.7 | 12.4 | 12.1 | 11.9 | 11.7 | 11.4 | 9.8   | 7.6   | 6.0   | 4.8   | 3.8   | CF8    |                                         |              |
| 16.0                                                                                      | 13.3 | 12.0 | 11.0 | 10.4 | 9.8  | 9.6  | 9.4  | 9.2  | 9.0  | 8.8  | 8.6  | 8.5  | 8.3   | 8.1   | 7.3   | 4.9   | 3.6   | CF8C   |                                         |              |
| 16.0                                                                                      | 15.2 | 14.1 | 13.7 | 13.5 | 13.3 | 13.0 | 12.7 | 12.4 | 12.1 | 11.9 | 11.7 | 11.4 | 11.2  | 9.7   | 7.3   | 4.9   | 3.6   | CF8C   |                                         |              |
| 16.0                                                                                      | 13.8 | 12.4 | 11.4 | 10.6 | 10.1 | 9.8  | 9.7  | 9.5  | 9.4  | 9.3  | 9.2  | 9.1  | 9.1   | 9.0   | 7.1   | 5.5   | 4.3   | CF8M   |                                         |              |
| 16.0                                                                                      | 16.0 | 15.5 | 15.4 | 14.3 | 13.6 | 13.3 | 13.0 | 12.8 | 12.7 | 12.5 | 12.4 | 12.3 | 11.9  | 9.2   | 7.1   | 5.5   | 4.3   | CF8M   |                                         |              |
| 14.9                                                                                      | 12.2 | 11.3 | 10.8 | 10.5 | 10.1 | 9.9  | 9.7  | 9.4  | 9.1  | 8.8  | 8.5  | 8.2  | 7.9   | 6.8   | 5.2   | 4.0   | 3.0   | CH8    | A351                                    |              |
| 14.9                                                                                      | 13.6 | 12.7 | 12.3 | 12.3 | 12.3 | 12.3 | 12.2 | 12.0 | 11.8 | 11.5 | 11.1 | 10.6 | 8.9   | 6.8   | 5.2   | 4.0   | 3.0   | CH8    |                                         |              |
| 16.0                                                                                      | 13.1 | 12.1 | 11.6 | 11.2 | 10.8 | 10.6 | 10.4 | 10.1 | 9.8  | 9.5  | 9.1  | 8.8  | 8.5   | 6.8   | 5.2   | 4.0   | 3.0   | CH20   |                                         |              |
| 16.0                                                                                      | 14.6 | 13.6 | 13.3 | 13.2 | 13.2 | 13.2 | 13.1 | 13.0 | 12.7 | 12.4 | 11.9 | 11.4 | 8.9   | 6.8   | 5.2   | 4.0   | 3.0   | CH20   |                                         |              |
| 14.9                                                                                      | 12.2 | 11.3 | 10.8 | 10.5 | 10.1 | 9.9  | 9.7  | 9.4  | 9.1  | 8.8  | 8.5  | 8.2  | 7.9   | 7.6   | 6.8   | 5.8   | 4.8   | CK20   |                                         |              |
| 14.9                                                                                      | 13.6 | 12.7 | 12.3 | 12.3 | 12.3 | 12.3 | 12.2 | 12.0 | 11.8 | 11.5 | 11.1 | 10.6 | 9.0   | 7.8   | 6.8   | 5.8   | 4.8   | CK20   |                                         |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        | Ferritic/Martensitic                    |              |
| 20.6                                                                                      | 20.6 | 20.6 | 20.6 | 20.6 | 20.6 | 20.6 | 20.6 | 20.6 | 20.6 | 20.1 | 12.0 | 7.4  | 4.7   | 3.0   | 1.9   | 1.2   | 0.8   | CA15   | A217                                    |              |

Table A-3 Stainless Steels (Cont'd)

| Spec. No.                   | Type or Grade | Class  | UNS Alloy No. | Nominal Composition    | P- No. | Notes              | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|-----------------------------|---------------|--------|---------------|------------------------|--------|--------------------|--------------------------------|------------------------------|--------|
| <b>Bar</b>                  |               |        |               |                        |        |                    |                                |                              |        |
| <b>Austenitic</b>           |               |        |               |                        |        |                    |                                |                              |        |
| A479                        | 304           | ...    | S30400        | 18Cr-8Ni               | 8      | (10)               | 75                             | 30                           | 1.00   |
|                             | 304           | ...    | S30400        | 18Cr-8Ni               | 8      | (9)(10)            | 75                             | 30                           | 1.00   |
|                             | 304H          | ...    | S30409        | 18Cr-8Ni               | 8      | ...                | 75                             | 30                           | 1.00   |
|                             | 304H          | ...    | S30409        | 18Cr-8Ni               | 8      | (9)                | 75                             | 30                           | 1.00   |
| A479                        | 304L          | ...    | S30403        | 18Cr-8Ni               | 8      | (16)               | 70                             | 25                           | 1.00   |
|                             | 304L          | ...    | S30403        | 18Cr-8Ni               | 8      | (9)(16)            | 70                             | 25                           | 1.00   |
|                             | 304N          | ...    | S30451        | 18Cr-8Ni-N             | 8      | (10)               | 80                             | 35                           | 1.00   |
|                             | 304N          | ...    | S30451        | 18Cr-8Ni-N             | 8      | (9)(10)            | 80                             | 35                           | 1.00   |
| A479                        | ...           | ...    | S30815        | 21Cr-11Ni-N            | 8      | (1)                | 87                             | 45                           | 1.00   |
|                             | ...           | ...    | S30815        | 21Cr-11Ni-N            | 8      | (1)(9)             | 87                             | 45                           | 1.00   |
| A479                        | 310S          | ...    | S31008        | 25Cr-20Ni              | 8      | (10)(11)(15)       | 75                             | 30                           | 1.00   |
|                             | 310S          | ...    | S31008        | 25Cr-20Ni              | 8      | (10)(11)(14)       | 75                             | 30                           | 1.00   |
|                             | 310S          | ...    | S31008        | 25Cr-20Ni              | 8      | (9)(10)(11)        | 75                             | 30                           | 1.00   |
|                             | ...           | ...    | S31254        | 20Cr-18Ni-6Mo          | 8      | (1)                | 95                             | 44                           | 1.00   |
|                             | ...           | ...    | S31254        | 20Cr-18Ni-6Mo          | 8      | (1)(9)             | 95                             | 44                           | 1.00   |
| A479                        | 316           | ...    | S31600        | 16Cr-12Ni-2Mo          | 8      | (10)               | 75                             | 30                           | 1.00   |
|                             | 316           | ...    | S31600        | 16Cr-12Ni-2Mo          | 8      | (9)(10)            | 75                             | 30                           | 1.00   |
|                             | 316H          | ...    | S31609        | 16Cr-12Ni-2Mo          | 8      | ...                | 75                             | 30                           | 1.00   |
|                             | 316H          | ...    | S31609        | 16Cr-12Ni-2Mo          | 8      | (9)                | 75                             | 30                           | 1.00   |
| (12)                        | A479          | 316L   | S31603        | 16Cr-12Ni-2Mo          | 8      | (1)(16)(28)(29)    | 70                             | 25                           | 1.00   |
| (12)                        |               | 316L   | S31603        | 16Cr-12Ni-2Mo          | 8      | (1)(9)(16)(28)(29) | 70                             | 25                           | 1.00   |
|                             |               | 316N   | S31651        | 16Cr-12Ni-2Mo          | 8      | (10)               | 80                             | 35                           | 1.00   |
|                             |               | 316N   | S31651        | 16Cr-12Ni-2Mo          | 8      | (9)(10)            | 80                             | 35                           | 1.00   |
| A479                        | 321           | ...    | S32100        | 18Cr-10Ni-Ti           | 8      | (10)               | 75                             | 30                           | 1.00   |
|                             | 321           | ...    | S32100        | 18Cr-10Ni-Ti           | 8      | (9)(10)            | 75                             | 30                           | 1.00   |
|                             | 321H          | ...    | S32109        | 18Cr-10Ni-Ti           | 8      | ...                | 75                             | 30                           | 1.00   |
|                             | 321H          | ...    | S32109        | 18Cr-10Ni-Ti           | 8      | (9)                | 75                             | 30                           | 1.00   |
|                             | ...           | ...    | S32550        | 25.5Cr-5.5Ni-3.5Mo-2Cu | 10H    | (1)(25)(26)        | 110                            | 80                           | 1.00   |
| A479                        | 347           | ...    | S34700        | 18Cr-10Ni-Cb           | 8      | (10)               | 75                             | 30                           | 1.00   |
|                             | 347           | ...    | S34700        | 18Cr-10Ni-Cb           | 8      | (9)(10)            | 75                             | 30                           | 1.00   |
|                             | 347H          | ...    | S34709        | 18Cr-10Ni-Cb           | 8      | ...                | 75                             | 30                           | 1.00   |
|                             | 347H          | ...    | S34709        | 18Cr-10Ni-Cb           | 8      | (9)                | 75                             | 30                           | 1.00   |
| A479                        | 348           | ...    | S34800        | 18Cr-10Ni-Cb           | 8      | (10)               | 75                             | 30                           | 1.00   |
|                             | 348           | ...    | S34800        | 18Cr-10Ni-Cb           | 8      | (9)(10)            | 75                             | 30                           | 1.00   |
|                             | 348H          | ...    | S34809        | 18Cr-10Ni-Cb           | 8      | ...                | 75                             | 30                           | 1.00   |
|                             | 348H          | ...    | S34809        | 18Cr-10Ni-Cb           | 8      | (9)                | 75                             | 30                           | 1.00   |
| <b>Ferritic/Martensitic</b> |               |        |               |                        |        |                    |                                |                              |        |
| A479                        | XM-27         | ...    | S44627        | 27Cr-1Mo               | 10I    | (2)                | 65                             | 40                           | 1.00   |
| <b>Ferritic/Austenitic</b>  |               |        |               |                        |        |                    |                                |                              |        |
| (12)                        | A479          | S31803 | S31803        | 22Cr-5.5Ni-3Mo-N       | 10H    | (1)(23)(24)        | 90                             | 65                           | 1.00   |
|                             |               | S32750 | S32750        | 25Cr-7Ni-4Mo-N         | 10H    | (1)(22)(23)        | 116                            | 80                           | 1.00   |

Table A-3 Stainless Steels (Cont'd)

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |         | Type<br>or<br>Grade  | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|---------|----------------------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 |         |                      |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |         | Bar                  |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |         | Austenitic           |              |
| 20.0                                                                                      | 16.7 | 15.0 | 13.8 | 12.9 | 12.3 | 12.0 | 11.7 | 11.5 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4  | 10.1  | 9.8   | 7.7   | 6.1   | 304     | A479                 |              |
| 20.0                                                                                      | 20.0 | 18.9 | 18.3 | 17.5 | 16.6 | 16.2 | 15.8 | 15.5 | 15.2 | 14.9 | 14.6 | 14.3 | 14.0  | 12.4  | 9.8   | 7.7   | 6.1   | 304     |                      |              |
| 20.0                                                                                      | 16.7 | 15.0 | 13.8 | 12.9 | 12.3 | 12.0 | 11.7 | 11.5 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4  | 10.1  | 9.8   | 7.7   | 6.1   | 304H    |                      |              |
| 20.0                                                                                      | 20.0 | 18.9 | 18.3 | 17.5 | 16.6 | 16.2 | 15.8 | 15.5 | 15.2 | 14.9 | 14.6 | 14.3 | 14.0  | 12.4  | 9.8   | 7.7   | 6.1   | 304H    |                      |              |
| 16.7                                                                                      | 14.3 | 12.8 | 11.7 | 10.9 | 10.4 | 10.2 | 10.0 | 9.8  | 9.7  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | 304L    | A479                 |              |
| 16.7                                                                                      | 16.7 | 16.7 | 15.8 | 14.7 | 14.0 | 13.7 | 13.5 | 13.3 | 13.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | 304L    |                      |              |
| 22.9                                                                                      | 19.1 | 16.7 | 15.1 | 14.0 | 13.3 | 13.0 | 12.8 | 12.5 | 12.3 | 12.1 | 11.8 | 11.6 | 11.3  | 11.0  | 9.8   | 7.7   | 6.1   | 304N    |                      |              |
| 22.9                                                                                      | 22.9 | 21.7 | 20.3 | 18.9 | 17.9 | 17.5 | 17.2 | 16.9 | 16.6 | 16.3 | 16.0 | 15.6 | 15.2  | 12.4  | 9.8   | 7.7   | 6.1   | 304N    |                      |              |
| 24.9                                                                                      | 24.7 | 22.0 | 19.9 | 18.5 | 17.7 | 17.4 | 17.2 | 17.0 | 16.8 | 16.6 | 16.4 | 16.2 | 14.9  | 11.6  | 9.0   | 6.9   | 5.2   | ...     | A479                 |              |
| 24.9                                                                                      | 24.7 | 23.3 | 22.4 | 21.8 | 21.4 | 21.2 | 21.0 | 20.8 | 20.6 | 20.3 | 20.0 | 19.1 | 14.9  | 11.6  | 9.0   | 6.9   | 5.2   | ...     |                      |              |
| 20.0                                                                                      | 17.6 | 16.1 | 15.1 | 14.3 | 13.7 | 13.5 | 13.3 | 13.1 | 12.9 | 12.7 | 12.5 | 12.3 | 9.9   | ...   | ...   | ...   | ...   | 310S    | A479                 |              |
| 20.0                                                                                      | 17.6 | 16.1 | 15.1 | 14.3 | 13.7 | 13.5 | 13.3 | 13.1 | 12.9 | 12.7 | 12.5 | 12.3 | 9.9   | ...   | ...   | ...   | ...   | 310S    |                      |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.9 | 19.3 | 18.5 | 18.2 | 17.9 | 17.7 | 17.4 | 17.2 | 16.9 | 15.9 | 9.9   | ...   | ...   | ...   | ...   | 310S    |                      |              |
| 26.9                                                                                      | 23.9 | 21.4 | 19.8 | 18.6 | 17.9 | 17.6 | 17.4 | 17.3 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...     |                      |              |
| 26.9                                                                                      | 26.9 | 25.5 | 24.3 | 23.5 | 23.0 | 22.8 | 22.7 | 22.6 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...     |                      |              |
| 20.0                                                                                      | 17.3 | 15.6 | 14.3 | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.8 | 11.6 | 11.5 | 11.4 | 11.3  | 11.2  | 11.1  | 9.8   | 7.4   | 316     | A479                 |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.3 | 18.0 | 17.0 | 16.6 | 16.3 | 16.1 | 15.9 | 15.7 | 15.6 | 15.4 | 15.3  | 15.1  | 12.4  | 9.8   | 7.4   | 316     |                      |              |
| 20.0                                                                                      | 17.3 | 15.6 | 14.3 | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.8 | 11.6 | 11.5 | 11.4 | 11.3  | 11.2  | 11.1  | 9.8   | 7.4   | 316H    |                      |              |
| 20.0                                                                                      | 20.0 | 20.0 | 19.3 | 18.0 | 17.0 | 16.6 | 16.3 | 16.1 | 15.9 | 15.7 | 15.6 | 15.4 | 15.3  | 15.1  | 12.4  | 9.8   | 7.4   | 316H    |                      |              |
| 16.7                                                                                      | 14.1 | 12.7 | 11.7 | 10.9 | 10.4 | 10.2 | 10.0 | 9.8  | 9.6  | 9.4  | 9.2  | 9.0  | 8.8   | 8.6   | 8.4   | 8.3   | 6.4   | 316L    | A479                 |              |
| 16.7                                                                                      | 16.7 | 16.0 | 15.6 | 14.8 | 14.0 | 13.8 | 13.5 | 13.2 | 13.0 | 12.7 | 12.4 | 12.1 | 11.9  | 11.6  | 11.4  | 8.8   | 6.4   | 316L    | (12)                 |              |
| 22.9                                                                                      | 20.7 | 19.0 | 17.6 | 16.5 | 15.6 | 15.2 | 14.9 | 14.5 | 14.2 | 13.9 | 13.7 | 13.4 | 13.2  | 12.9  | 12.3  | 9.8   | 7.4   | 316N    | (12)                 |              |
| 22.9                                                                                      | 22.9 | 22.0 | 21.5 | 21.2 | 21.0 | 20.5 | 20.0 | 19.6 | 19.2 | 18.8 | 18.5 | 18.1 | 17.8  | 15.8  | 12.3  | 9.8   | 7.4   | 316N    |                      |              |
| 20.0                                                                                      | 18.0 | 16.5 | 15.3 | 14.3 | 13.5 | 13.2 | 13.0 | 12.7 | 12.6 | 12.4 | 12.3 | 12.1 | 12.0  | 9.6   | 6.9   | 5.0   | 3.6   | 321     | A479                 |              |
| 20.0                                                                                      | 20.0 | 19.1 | 18.7 | 18.7 | 18.3 | 17.9 | 17.5 | 17.2 | 16.9 | 16.7 | 16.5 | 16.4 | 14.9  | 9.6   | 6.9   | 5.0   | 3.6   | 321     |                      |              |
| 20.0                                                                                      | 18.0 | 16.5 | 15.3 | 14.3 | 13.5 | 13.2 | 13.0 | 12.7 | 12.6 | 12.4 | 12.3 | 12.1 | 12.0  | 11.9  | 9.1   | 6.9   | 5.4   | 321H    |                      |              |
| 20.0                                                                                      | 20.0 | 19.1 | 18.7 | 18.7 | 18.3 | 17.9 | 17.5 | 17.2 | 16.9 | 16.7 | 16.5 | 16.4 | 16.2  | 12.3  | 9.1   | 6.9   | 5.4   | 321H    |                      |              |
| 31.4                                                                                      | 31.3 | 29.5 | 28.6 | 28.2 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...     |                      |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 12.1  | 9.1   | 6.1   | 4.4   | 347     | A479                 |              |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.2 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.0  | 12.1  | 9.1   | 6.1   | 4.4   | 347     |                      |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 13.4  | 13.3  | 10.5  | 7.9   | 347H    |                      |              |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.1 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.4  | 16.2  | 14.1  | 10.5  | 7.9   | 347H    |                      |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 12.1  | 9.1   | 6.1   | 4.4   | 348     | A479                 |              |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.2 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.0  | 12.1  | 9.1   | 6.1   | 4.4   | 348     |                      |              |
| 20.0                                                                                      | 18.4 | 17.1 | 16.0 | 15.0 | 14.3 | 14.0 | 13.8 | 13.7 | 13.6 | 13.5 | 13.4 | 13.4 | 13.4  | 13.4  | 13.3  | 10.5  | 7.9   | 348H    |                      |              |
| 20.0                                                                                      | 20.0 | 18.8 | 17.8 | 17.1 | 16.9 | 16.8 | 16.8 | 16.8 | 16.8 | 16.8 | 16.7 | 16.6 | 16.4  | 16.2  | 14.1  | 10.5  | 7.9   | 348H    |                      |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |         | Ferritic/Martensitic |              |
| 18.6                                                                                      | 18.6 | 18.3 | 18.1 | 18.1 | 18.1 | 18.1 | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | TPXM-27 | A479                 |              |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |         | Ferritic/Austenitic  |              |
| 25.7                                                                                      | 25.7 | 24.8 | 23.9 | 23.3 | 23.1 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | S31803  | A479                 |              |
| 33.1                                                                                      | 33.0 | 31.2 | 30.1 | 29.6 | 29.4 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | S32750  | (12)                 |              |

**Table A-3 Stainless Steels (Cont'd)**

## GENERAL NOTES:

- (a) The tabulated specifications are ANSI/ASTM or ASTM. For ASME Boiler and Pressure Vessel Code applications, see related specifications in Section II of the ASME Code.
- (b) The stress values in this Table may be interpolated to determine values for intermediate temperatures.
- (c) The P-Numbers indicated in this Table are identical to those adopted by the ASME Boiler and Pressure Vessel Code. Qualification of welding procedures, welders, and welding operators is required and shall comply with the ASME Boiler and Pressure Vessel Code, Section IX, except as modified by para. 127.5.
- (d) Tensile strengths and allowable stresses shown in “ksi” are “thousands of pounds per square inch.”
- (e) The materials listed in this Table shall not be used at design temperatures above those for which allowable stress values are given herein or in Table A-8.
- (f) The tabulated stress values are  $S \times E$  (weld joint efficiency factor) or  $S \times F$  (material quality factor), as applicable. Weld joint efficiency factors are shown in Table 102.4.3.
- (g) Pressure-temperature ratings of piping components, as published in standards referenced in this Code, may be used for components meeting the requirements of those standards. The allowable stress values given in this Table are for use in designing piping components which are not manufactured in accordance with referenced standards.
- (h) The tabulated stress values that are shown in italics are at temperatures in the range where creep and stress rupture strength govern the selection of stresses.

## (12) NOTES:

- (1) THIS MATERIAL IS NOT ACCEPTABLE FOR USE ON BOILER EXTERNAL PIPING — SEE FIGS. 100.1.2(A) AND (B).
- (2) Use of this material at temperatures above 650°F is not approved because of the possibility of temper embrittlement.
- (3) This steel may be expected to develop embrittlement at room temperature after service at temperatures above 700°F. Consequently, its use at higher temperatures is not recommended unless due caution is observed.
- (4) For fittings made from A182 forgings over 5 in. in thickness, the allowable stress values tabulated shall be reduced by the ratio of 70 divided by 75.
- (5) The material quality factors and allowable stress values for these materials may be increased in accordance with para. 102.4.6.
- (6) Tensile strengths in parentheses are expected minimum values.
- (7) See MSS SP-43 for requirements for lightweight stainless steel fittings. MSS SP-43 Schedule 5S fittings shall not be used for design temperatures above 400°F. MSS SP-43 Schedule 10S fittings shall not be used for design temperatures above 750°F.
- (8) The material quality factor for centrifugally cast pipe (0.85) is based on all surfaces being machined after heat treatment. The surface finish, after machining, shall be 250  $\mu$ in. arithmetic average deviation or smoother.
- (9) Due to relatively low yield strength of these materials, these higher allowable stress values were established at temperatures where the short time tensile properties govern to permit the use of these alloys where slightly greater deformation is acceptable. These stress values exceed 67% but do not exceed 90% of the yield strength at temperature. Use of these stress values may result in dimensional changes due to permanent strain. These values should not be used for the flanges of gasketed joints or other applications where slight amounts of distortion can cause leakage or malfunction.
- (10) The allowable stress values tabulated for temperatures over 1,000°F apply only if the carbon content of the material is 0.04% or higher.
- (11) The allowable stress values tabulated for temperatures over 1,000°F apply only if the material is heat treated by heating to a minimum temperature of 1,900°F and quenching in water or rapidly cooling by other means.
- (12) These allowable stress values apply to forgings over 5 in. in thickness.
- (13) The allowable stress values tabulated for temperatures over 800°F apply only if the carbon content of the material is 0.04% or higher.
- (14) These allowable stress values shall be used only when the grain size of the material is ASTM No. 6 or coarser.
- (15) These allowable stress values shall be used when the grain size of the material is finer than ASTM No. 6 or when the grain size has not been determined.
- (16) Use of external pressure charts for material in the form of barstock is permitted for stiffening rings only.
- (17) At the ferrite levels tabulated below, these materials will have significant reductions in Charpy V-notch toughness values at room temperature and below following service exposure at the indicated temperatures. This reduction indicates the potential for brittle fracture with high rate loading in the presence of sharp notches or cracks.

| Ferrite Content | Service Temperature |
|-----------------|---------------------|
| 5% and less     | 1,100°F and above   |
| 10%             | 900°F and above     |
| 15%             | 800°F and above     |
| 20%             | 700°F and above     |
| 25%—30%         | 600°F and above     |
| 35%—40%         | 500°F and above     |

**Table A-3 Stainless Steels (Cont'd)****(12)**

## NOTES (Cont'd):

- (18) The stress values at 1,050°F and above shall be used only when the grain size is ASTM No. 6 or coarser.
- (19) These allowable stress values apply for single or double butt welded pipe with radiography per para. 136.4.5.
- (20) These allowable stress values apply for double butt welded pipe.
- (21) These allowable stress values apply for single butt welded pipe.
- (22) Any heat treatment applied to this material shall be performed at 1,880°F to 2,060°F, followed by a rapid cool.
- (23) The use of this material is limited to 600°F. This material may be expected to exhibit embrittlement at room temperature after service.
- (24) Any heat treatment applied to this material shall be performed at 1,870°F to 2,010°F, followed by a rapid cool. For A182, A240, and A479 material, this is more restrictive than the material specification and shall be met.
- (25) Openings  $\geq 4$  in. shall conform to para. 127.4.8, except that full-penetration welds shall be used and separate reinforcing pads shall not be used.
- (26) This steel may be expected to develop embrittlement after exposure to temperatures above 500°F for prolonged times. See ASME Boiler and Pressure Vessel Code, Section II, Part D, Appendix A, A-340 and A-360.
- (27) These allowable stress values apply only to forgings 5 in. in thickness and under.
- (28) The stress values at temperatures above 1,000°F apply only if Supplementary Requirement S1 has been specified.
- (29) The material shall have an ASTM grain size of 7 or coarser for use at 1,000°F (550°C) and above.

ASMENORMDOC.COM : Click to view the full PDF of ASME B31.1-2012

Table A-4 Nickel and High Nickel Alloys

| Spec. No.                     | UNS Alloy No. | Temper or Condition | Nominal Composition    | P-No. | Notes          | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|-------------------------------|---------------|---------------------|------------------------|-------|----------------|--------------------------------|------------------------------|--------|
| <b>Seamless Pipe and Tube</b> |               |                     |                        |       |                |                                |                              |        |
| B161                          | N02200        | Annealed            | Ni                     | 41    | (1)(5)         | 55                             | 15                           | 1.00   |
|                               | N02200        | Annealed            | Ni                     | 41    | (1)(6)         | 55                             | 12                           | 1.00   |
|                               | N02200        | Str. rel.           | Ni                     | 41    | (1)            | 65                             | 40                           | 1.00   |
| B161                          | N02201        | Annealed            | Ni-Low C               | 41    | (1)(5)         | 50                             | 12                           | 1.00   |
|                               | N02201        | Annealed            | Ni-Low C               | 41    | (1)(6)         | 50                             | 10                           | 1.00   |
|                               | N02201        | Str. rel.           | Ni-Low C               | 41    | (1)            | 60                             | 30                           | 1.00   |
| B163                          | N08800        | Annealed            | Ni-Cr-Fe               | 45    | (1)(7)         | 75                             | 30                           | 1.00   |
|                               | N08800        | Annealed            | Ni-Cr-Fe               | 45    | (1)(2)(7)      | 75                             | 30                           | 1.00   |
|                               | N08810        | Annealed            | Ni-Cr-Fe               | 45    | (1)            | 65                             | 25                           | 1.00   |
|                               | N08810        | Annealed            | Ni-Cr-Fe               | 45    | (1)(2)         | 65                             | 25                           | 1.00   |
| B165                          | N04400        | Annealed            | Ni-Cu                  | 42    | (1)(5)         | 70                             | 28                           | 1.00   |
|                               | N04400        | Annealed            | Ni-Cu                  | 42    | (1)(6)         | 70                             | 25                           | 1.00   |
|                               | N04400        | Str. rel.           | Ni-Cu                  | 42    | (1)(2)(3)      | 85                             | 35                           | 1.00   |
| B167                          | N06600        | H.F./ann.           | Ni-Cr-Fe               | 43    | (1)(5)         | 80                             | 30                           | 1.00   |
|                               | N06600        | H.F./ann.           | Ni-Cr-Fe               | 43    | (1)(2)(5)      | 75                             | 30                           | 1.00   |
|                               | N06600        | H.F./ann.           | Ni-Cr-Fe               | 43    | (1)(6)         | 75                             | 25                           | 1.00   |
|                               | N06600        | H.F./ann.           | Ni-Cr-Fe               | 43    | (1)(2)(6)      | 80                             | 25                           | 1.00   |
| B167                          | N06600        | C.D./ann.           | Ni-Cr-Fe               | 43    | (1)(5)         | 80                             | 35                           | 1.00   |
|                               | N06600        | C.D./ann.           | Ni-Cr-Fe               | 43    | (1)(2)(5)      | 80                             | 35                           | 1.00   |
|                               | N06600        | C.D./ann.           | Ni-Cr-Fe               | 43    | (1)(6)         | 80                             | 30                           | 1.00   |
|                               | N06600        | C.D./ann.           | Ni-Cr-Fe               | 43    | (1)(2)(6)      | 80                             | 30                           | 1.00   |
| B167                          | N06617        | Annealed            | 52Ni-22Cr-13Co-9Mo     | 43    | (1)(7)         | 95                             | 35                           | 1.00   |
|                               | N06617        | Annealed            | 52Ni-22Cr-13Co-9Mo     | 43    | (1)(2)(7)      | 95                             | 35                           | 1.00   |
| B407                          | N08800        | C.D./ann.           | Ni-Cr-Fe               | 45    | (7)            | 75                             | 30                           | 1.00   |
|                               | N08800        | C.D./ann.           | Ni-Cr-Fe               | 45    | (2)(7)         | 75                             | 30                           | 1.00   |
|                               | N08810        | Annealed            | Ni-Cr-Fe               | 45    | (7)            | 65                             | 25                           | 1.00   |
|                               | N08810        | Annealed            | Ni-Cr-Fe               | 45    | (2)(7)         | 65                             | 25                           | 1.00   |
| B423                          | N08825        | C.W./ann.           | Ni-Fe-Cr-Mo-Cu         | 45    | (1)(7)         | 85                             | 35                           | 1.00   |
|                               | N08825        | C.W./ann.           | Ni-Fe-Cr-Mo-Cu         | 45    | (1)(2)(7)      | 85                             | 35                           | 1.00   |
| B444                          | N06625        | Sol. ann.           | Ni-Cr-Mo-Cb            | 43    | (1)(14)(18)    | 100                            | 40                           | 1.00   |
|                               | N06625        | Annealed            | Ni-Cr-Mo-Cb            | 43    | (1)(2)(14)     | 120                            | 60                           | 1.00   |
| B622                          | N06022        | Sol. ann.           | Ni-Mo-Cr-Low C         | 44    | (1)(12)        | 100                            | 45                           | 1.00   |
|                               | N06022        | Sol. ann.           | Ni-Mo-Cr-Low C         | 44    | (1)(2)(12)     | 100                            | 45                           | 1.00   |
|                               | N10276        | Sol. ann.           | Low C-Ni-Mo-Cr         | 43    | (1)(12)        | 100                            | 41                           | 1.00   |
|                               | N10276        | Sol. ann.           | Low C-Ni-Mo-Cr         | 43    | (1)(2)(12)     | 100                            | 41                           | 1.00   |
|                               | R30556        | Annealed            | Ni-Fe-Cr-Co-Mo-W       | 45    | (1)            | 100                            | 45                           | 1.00   |
|                               | R30556        | Annealed            | Ni-Fe-Cr-Co-Mo-W       | 45    | (1)(2)         | 100                            | 45                           | 1.00   |
| B677                          | N08925        | Annealed            | Ni-Fe-Cr-Mo-Cu-Low C   | 45    | (1)            | 87                             | 43                           | 1.00   |
|                               | N08925        | Annealed            | Ni-Fe-Cr-Mo-Cu-Low C   | 45    | (1)(2)         | 87                             | 43                           | 1.00   |
|                               | N08926        | Annealed            | Ni-Fe-Cr-Mo-Cu-N-Low C | 45    | (1)(19)(20)    | 94                             | 43                           | 1.00   |
|                               | N08926        | Annealed            | Ni-Fe-Cr-Mo-Cu-N-Low C | 45    | (1)(2)(19)(20) | 94                             | 43                           | 1.00   |

Table A-4 Nickel and High Nickel Alloys

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        | UNS Alloy No. | Spec. No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|--------|---------------|-----------|
| -20 to 100                                                                                | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 |        |               |           |
| Seamless Pipe and Tube                                                                    |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        |               |           |
| 10.0                                                                                      | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N02200 | B161          |           |
| 8.0                                                                                       | 8.0  | 8.0  | 8.0  | 8.0  | 8.0  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N02200 |               |           |
| 18.6                                                                                      | 18.6 | 18.6 | 18.6 | 18.3 | 17.7 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N02200 |               |           |
| 8.0                                                                                       | 7.7  | 7.5  | 7.5  | 7.5  | 7.5  | 7.5  | 7.4  | 7.4  | 7.2  | 5.8  | 4.5  | 3.7  | 3.0   | 2.4   | 2.0   | 1.5   | 1.2   | N02201 | B161          |           |
| 6.7                                                                                       | 6.4  | 6.3  | 6.2  | 6.2  | 6.2  | 6.2  | 6.2  | 6.1  | 6.0  | 5.8  | 4.5  | 3.7  | 3.0   | 2.4   | 2.0   | 1.5   | 1.2   | N02201 |               |           |
| 17.1                                                                                      | 17.1 | 17.0 | 17.0 | 16.8 | 16.3 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N02201 |               |           |
| 20.0                                                                                      | 18.5 | 17.8 | 17.2 | 16.8 | 16.3 | 16.1 | 15.9 | 15.7 | 15.5 | 15.3 | 15.1 | 14.9 | 14.7  | 14.5  | 13.0  | 9.8   | 6.6   | N08800 | B163          |           |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 19.9  | 17.0  | 13.0  | 9.8   | 6.6   | N08800 |               |           |
| 16.7                                                                                      | 15.4 | 14.4 | 13.6 | 12.9 | 12.2 | 11.9 | 11.6 | 11.4 | 11.1 | 10.9 | 10.7 | 10.5 | 10.4  | 10.2  | 10.0  | 9.3   | 7.4   | N08810 |               |           |
| 16.7                                                                                      | 16.7 | 16.7 | 16.7 | 16.7 | 16.7 | 16.1 | 15.7 | 15.3 | 15.0 | 14.7 | 14.5 | 14.2 | 14.0  | 13.8  | 11.6  | 9.3   | 7.4   | N08810 |               |           |
| 18.7                                                                                      | 16.4 | 15.2 | 14.7 | 14.7 | 14.7 | 14.7 | 14.6 | 14.5 | 14.3 | 11.0 | 8.0  | ...  | ...   | ...   | ...   | ...   | ...   | N04400 | B165          |           |
| 16.7                                                                                      | 14.6 | 13.6 | 13.2 | 13.1 | 13.1 | 13.1 | 13.0 | 12.9 | 12.7 | 11.0 | 8.0  | ...  | ...   | ...   | ...   | ...   | ...   | N04400 |               |           |
| 24.3                                                                                      | 24.3 | 24.3 | 24.3 | 24.3 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N04400 |               |           |
| 20.0                                                                                      | 19.1 | 18.3 | 17.5 | 16.8 | 16.2 | 15.9 | 15.7 | 15.5 | 15.2 | 15.1 | 14.9 | 10.6 | 7.0   | 4.5   | 3.0   | 2.2   | 2.0   | N06600 | B167          |           |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 16.0 | 10.6  | 7.0   | 4.5   | 3.0   | 2.2   | 2.0    |               | N06600    |
| 16.7                                                                                      | 15.9 | 15.2 | 14.6 | 14.0 | 13.5 | 13.3 | 13.1 | 12.9 | 12.7 | 12.5 | 12.4 | 10.6 | 7.0   | 4.5   | 3.0   | 2.2   | 2.0   | N06600 |               |           |
| 16.7                                                                                      | 16.7 | 16.7 | 16.7 | 16.7 | 16.7 | 16.7 | 16.7 | 16.7 | 16.7 | 16.7 | 16.7 | 16.0 | 10.6  | 7.0   | 4.5   | 3.0   | 2.2   | 2.0    |               | N06600    |
| 22.9                                                                                      | 21.3 | 20.8 | 20.5 | 20.2 | 19.9 | 19.8 | 19.6 | 19.4 | 19.1 | 18.7 | 18.0 | 10.6 | 7.0   | 4.5   | 3.0   | 2.2   | 2.0   | N06600 |               | B167      |
| 22.9                                                                                      | 22.9 | 22.9 | 22.9 | 22.9 | 22.9 | 22.9 | 22.9 | 22.9 | 22.9 | 22.4 | 16.0 | 10.6 | 7.0   | 4.5   | 3.0   | 2.2   | 2.0   | N06600 |               |           |
| 20.0                                                                                      | 19.1 | 18.3 | 17.5 | 16.8 | 16.2 | 15.9 | 15.7 | 15.5 | 15.2 | 15.1 | 14.9 | 10.6 | 7.0   | 4.5   | 3.0   | 2.2   | 2.0   | N06600 |               |           |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 16.0 | 10.6  | 7.0   | 4.5   | 3.0   | 2.2   | 2.0    | N06600        |           |
| 23.3                                                                                      | 20.8 | 19.2 | 18.1 | 17.2 | 16.6 | 16.4 | 16.2 | 16.0 | 15.9 | 15.8 | 15.7 | 15.6 | 15.5  | 15.4  | 15.4  | 15.3  | 15.3  | N06617 | B167          |           |
| 23.3                                                                                      | 23.3 | 23.3 | 23.3 | 23.3 | 22.5 | 22.1 | 21.9 | 21.7 | 21.5 | 21.3 | 21.2 | 21.0 | 20.9  | 20.9  | 20.8  | 20.7  | 18.1  | N06617 |               |           |
| 20.0                                                                                      | 18.5 | 17.8 | 17.2 | 16.8 | 16.3 | 16.1 | 15.9 | 15.7 | 15.5 | 15.3 | 15.1 | 14.9 | 14.7  | 14.5  | 13.0  | 9.8   | 6.6   | N08800 | B407          |           |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 19.9  | 17.0  | 13.0  | 9.8   | 6.6   | N08800 |               |           |
| 16.7                                                                                      | 15.4 | 14.4 | 13.6 | 12.9 | 12.2 | 11.9 | 11.6 | 11.4 | 11.1 | 10.9 | 10.7 | 10.5 | 10.4  | 10.2  | 10.0  | 9.3   | 7.4   | N08810 |               |           |
| 16.7                                                                                      | 16.7 | 16.7 | 16.7 | 16.7 | 16.5 | 16.1 | 15.7 | 15.3 | 15.0 | 14.7 | 14.5 | 14.2 | 14.0  | 13.8  | 11.6  | 9.3   | 7.4   | N08810 |               |           |
| 23.3                                                                                      | 21.4 | 20.3 | 19.4 | 18.5 | 17.8 | 17.5 | 17.3 | 17.2 | 17.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08825 |               | B423      |
| 23.3                                                                                      | 23.3 | 23.3 | 23.3 | 23.3 | 23.3 | 23.3 | 23.3 | 23.2 | 23.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08825 |               |           |
| 26.7                                                                                      | 24.9 | 23.6 | 22.6 | 21.8 | 21.1 | 20.8 | 20.6 | 20.3 | 20.1 | 20.0 | 19.8 | 19.7 | 19.5  | 19.4  | 19.4  | 19.3  | 19.3  | N06625 | B444          |           |
| 34.3                                                                                      | 34.3 | 34.3 | 33.6 | 32.9 | 32.4 | 32.1 | 31.8 | 31.5 | 31.2 | 30.9 | 30.6 | 30.3 | 29.9  | 29.5  | 29.0  | 21.0  | 13.2  | N06625 |               |           |
| 28.6                                                                                      | 26.7 | 24.6 | 22.9 | 21.5 | 20.4 | 20.0 | 19.6 | 19.3 | 19.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N06022 | B622          |           |
| 28.6                                                                                      | 28.6 | 28.2 | 27.2 | 26.5 | 26.0 | 25.8 | 25.6 | 25.4 | 25.3 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N06022 |               |           |
| 27.3                                                                                      | 24.9 | 23.0 | 21.3 | 19.9 | 18.8 | 18.2 | 17.8 | 17.4 | 17.1 | 16.9 | 16.7 | 16.6 | 16.5  | ...   | ...   | ...   | ...   | N10276 |               |           |
| 27.3                                                                                      | 27.3 | 27.3 | 27.3 | 26.9 | 25.2 | 24.6 | 24.0 | 23.5 | 23.1 | 22.8 | 22.6 | 22.4 | 22.3  | ...   | ...   | ...   | ...   | N10276 |               |           |
| 28.6                                                                                      | 25.6 | 23.1 | 21.3 | 20.1 | 19.3 | 18.9 | 18.7 | 18.4 | 18.2 | 18.0 | 17.8 | 17.6 | 17.5  | 17.3  | 17.1  | 16.9  | 13.6  | R30556 |               |           |
| 28.6                                                                                      | 28.6 | 28.0 | 27.1 | 26.4 | 26.0 | 25.6 | 25.2 | 24.9 | 24.6 | 24.3 | 24.1 | 23.8 | 23.6  | 23.3  | 21.2  | 17.0  | 13.6  | R30556 |               |           |
| 24.9                                                                                      | 23.2 | 21.3 | 19.8 | 18.3 | 17.3 | 17.0 | 16.9 | 16.9 | 16.9 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08925 |               | B677      |
| 24.9                                                                                      | 24.9 | 23.9 | 23.0 | 22.1 | 21.4 | 21.1 | 20.8 | 20.4 | 20.1 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08925 |               |           |
| 26.9                                                                                      | 24.1 | 21.5 | 19.7 | 18.7 | 18.0 | 17.7 | 17.5 | 17.4 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08926 |               |           |
| 26.9                                                                                      | 26.9 | 26.2 | 24.8 | 23.7 | 22.8 | 22.4 | 22.0 | 21.6 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08926 |               |           |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |        |               |           |

Table A-4 Nickel and High Nickel Alloys (Cont'd)

| Spec. No.                              | UNS Alloy No. | Temper or Condition | Nominal Composition    | P-No. | Notes          | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|----------------------------------------|---------------|---------------------|------------------------|-------|----------------|--------------------------------|------------------------------|--------|
| <b>Seamless Pipe and Tube (Cont'd)</b> |               |                     |                        |       |                |                                |                              |        |
| B690                                   | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45    | (1)(8)(22)     | 95                             | 45                           | 1.00   |
|                                        | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45    | (1)(2)(8)(22)  | 95                             | 45                           | 1.00   |
|                                        | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45    | (1)(21)        | 100                            | 45                           | 1.00   |
|                                        | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45    | (1)(2)(21)     | 100                            | 45                           | 1.00   |
| B729                                   | N08020        | Annealed            | Ni-Fe-Cr-Mo-Cu-Cb      | 45    | (1)            | 80                             | 35                           | 1.00   |
|                                        | N08020        | Annealed            | Ni-Fe-Cr-Mo-Cu-Cb      | 45    | (1)(2)         | 80                             | 35                           | 1.00   |
| <b>Welded Pipe and Tube</b>            |               |                     |                        |       |                |                                |                              |        |
| B464                                   | N08020        | Annealed            | Ni-Fe-Cr-Mo-Cu-Cb      | 45    | (1)            | 80                             | 35                           | 0.85   |
|                                        | N08020        | Annealed            | Ni-Fe-Cr-Mo-Cu-Cb      | 45    | (1)(2)         | 80                             | 35                           | 0.85   |
| B468                                   | N08020        | Annealed            | Ni-Fe-Cr-Mo-Cu-Cb      | 45    | (1)            | 80                             | 35                           | 0.85   |
|                                        | N08020        | Annealed            | Ni-Fe-Cr-Mo-Cu-Cb      | 45    | (1)(2)         | 80                             | 35                           | 0.85   |
| B546                                   | N06617        | Annealed            | 52Ni-22Cr-13Co-9Mo     | 43    | (1)(7)         | 95                             | 35                           | 0.85   |
|                                        | N06617        | Annealed            | 52Ni-22Cr-13Co-9Mo     | 43    | (1)(2)(7)      | 95                             | 35                           | 0.85   |
| B619                                   | N06022        | Sol. ann.           | Ni-Mo-Cr-Low C         | 44    | (1)(12)        | 100                            | 45                           | 0.85   |
|                                        | N06022        | Sol. ann.           | Ni-Mo-Cr-Low C         | 44    | (1)(2)(12)     | 100                            | 45                           | 0.85   |
|                                        | N10276        | Sol. ann.           | Low C-Ni-Mo-Cr         | 43    | (1)(12)        | 100                            | 41                           | 0.85   |
|                                        | N10276        | Sol. ann.           | Low C-Ni-Mo-Cr         | 43    | (1)(2)(12)     | 100                            | 41                           | 0.85   |
|                                        | R30556        | Annealed            | Ni-Fe-Cr-Co-Mo-W       | 45    | (1)            | 100                            | 45                           | 0.85   |
|                                        | R30556        | Annealed            | Ni-Fe-Cr-Co-Mo-W       | 45    | (1)(2)         | 100                            | 45                           | 0.85   |
| B626                                   | N06022        | Sol. ann.           | Ni-Mo-Cr-Low C         | 44    | (1)(12)        | 100                            | 45                           | 0.85   |
|                                        | N06022        | Sol. ann.           | Ni-Mo-Cr-Low C         | 44    | (1)(2)(12)     | 100                            | 45                           | 0.85   |
|                                        | N10276        | Sol. ann.           | Low C-Ni-Mo-Cr         | 43    | (1)(12)        | 100                            | 41                           | 0.85   |
|                                        | N10276        | Sol. ann.           | Low C-Ni-Mo-Cr         | 43    | (1)(2)(12)     | 100                            | 41                           | 0.85   |
|                                        | R30556        | Annealed            | Ni-Fe-Cr-Co-Mo-W       | 45    | (1)            | 100                            | 45                           | 0.85   |
|                                        | R30556        | Annealed            | Ni-Fe-Cr-Co-Mo-W       | 45    | (1)(2)         | 100                            | 45                           | 0.85   |
| B673                                   | N08925        | Annealed            | Ni-Fe-Cr-Mo-Cu-Low C   | 45    | (1)            | 87                             | 43                           | 0.85   |
|                                        | N08925        | Annealed            | Ni-Fe-Cr-Mo-Cu-Low C   | 45    | (1)(2)         | 87                             | 43                           | 0.85   |
|                                        | N08926        | Annealed            | Ni-Fe-Cr-Mo-Cu-N-Low C | 45    | (1)(19)(20)    | 94                             | 43                           | 0.85   |
|                                        | N08926        | Annealed            | Ni-Fe-Cr-Mo-Cu-N-Low C | 45    | (1)(2)(19)(20) | 94                             | 43                           | 0.85   |
| B674                                   | N08925        | Annealed            | Ni-Fe-Cr-Mo-Cu-Low C   | 45    | (1)            | 87                             | 43                           | 0.85   |
|                                        | N08925        | Annealed            | Ni-Fe-Cr-Mo-Cu-Low C   | 45    | (1)(2)         | 87                             | 43                           | 0.85   |
|                                        | N08926        | Annealed            | Ni-Fe-Cr-Mo-Cu-N-Low C | 45    | (1)(19)(20)    | 94                             | 43                           | 0.85   |
|                                        | N08926        | Annealed            | Ni-Fe-Cr-Mo-Cu-N-Low C | 45    | (1)(2)(19)(20) | 94                             | 43                           | 0.85   |
| B675                                   | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45    | (1)(8)(22)     | 95                             | 45                           | 0.85   |
|                                        | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45    | (1)(2)(8)(22)  | 95                             | 45                           | 0.85   |
|                                        | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45    | (1)(8)(21)     | 100                            | 45                           | 0.85   |
|                                        | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45    | (1)(2)(8)(21)  | 100                            | 45                           | 0.85   |
| B676                                   | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45    | (1)(8)(22)     | 95                             | 45                           | 0.85   |
|                                        | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45    | (1)(2)(8)(22)  | 95                             | 45                           | 0.85   |
|                                        | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45    | (1)(8)(21)     | 100                            | 45                           | 0.85   |
|                                        | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45    | (1)(2)(8)(21)  | 100                            | 45                           | 0.85   |

**Table A-4 Nickel and High Nickel Alloys (Cont'd)**

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       | UNS<br>Alloy<br>No. | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|---------------------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 |                     |              |
| Seamless Pipe and Tube (Cont'd)                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |                     |              |
| 27.1                                                                                      | 26.2 | 23.8 | 21.9 | 20.5 | 19.4 | 19.0 | 18.6 | 18.3 | 18.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367              | B690         |
| 27.1                                                                                      | 27.1 | 25.7 | 24.6 | 23.8 | 23.3 | 23.1 | 22.9 | 22.8 | 22.6 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367              |              |
| 28.6                                                                                      | 26.2 | 23.8 | 21.9 | 20.5 | 19.4 | 19.0 | 18.6 | 18.3 | 18.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367              |              |
| 28.6                                                                                      | 28.6 | 27.0 | 25.8 | 25.0 | 24.5 | 24.3 | 24.1 | 24.0 | 23.8 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367              |              |
| 22.9                                                                                      | 20.6 | 19.7 | 18.9 | 18.2 | 17.7 | 17.5 | 17.4 | 17.2 | 16.8 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08020              | B729         |
| 22.9                                                                                      | 22.9 | 22.6 | 22.2 | 22.1 | 22.1 | 22.0 | 21.9 | 21.8 | 21.8 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08020              |              |
| Welded Pipe and Tube                                                                      |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |                     |              |
| 19.4                                                                                      | 17.5 | 16.7 | 16.1 | 15.5 | 15.0 | 14.9 | 14.8 | 14.6 | 14.3 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08020              | B464         |
| 19.4                                                                                      | 19.4 | 19.2 | 18.8 | 18.8 | 18.8 | 18.7 | 18.6 | 18.5 | 18.5 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08020              |              |
| 19.4                                                                                      | 17.5 | 16.7 | 16.1 | 15.5 | 15.0 | 14.9 | 14.8 | 14.6 | 14.3 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08020              | B468         |
| 19.4                                                                                      | 19.4 | 19.2 | 18.8 | 18.8 | 18.8 | 18.7 | 18.6 | 18.5 | 18.5 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08020              |              |
| 19.8                                                                                      | 17.7 | 16.3 | 15.4 | 14.6 | 14.1 | 13.9 | 13.8 | 13.6 | 13.5 | 13.4 | 13.3 | 13.3 | 13.2  | 13.1  | 13.1  | 13.0  | 13.0  | N06617              | B546         |
| 19.8                                                                                      | 19.8 | 19.8 | 19.8 | 19.8 | 19.1 | 18.8 | 18.6 | 18.4 | 18.3 | 18.1 | 18.0 | 17.9 | 17.8  | 17.8  | 17.7  | 17.6  | 15.4  | N06617              |              |
| 24.3                                                                                      | 22.7 | 20.9 | 19.4 | 18.3 | 17.4 | 17.0 | 16.7 | 16.4 | 16.2 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N06022              | B619         |
| 24.3                                                                                      | 22.7 | 20.9 | 19.4 | 18.3 | 17.4 | 17.0 | 16.7 | 16.4 | 16.2 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N06022              |              |
| 23.2                                                                                      | 21.2 | 19.6 | 18.1 | 16.9 | 16.0 | 15.5 | 15.1 | 14.8 | 14.5 | 14.4 | 14.2 | 14.1 | 14.0  | ...   | ...   | ...   | ...   | N10276              |              |
| 23.2                                                                                      | 23.2 | 23.2 | 23.2 | 22.9 | 21.4 | 20.9 | 20.4 | 20.0 | 19.6 | 19.4 | 19.2 | 19.0 | 19.0  | ...   | ...   | ...   | ...   | N10276              |              |
| 24.3                                                                                      | 21.8 | 19.6 | 18.1 | 17.1 | 16.4 | 16.1 | 15.9 | 15.7 | 15.5 | 15.3 | 15.2 | 15.0 | 14.8  | 14.7  | 14.5  | 14.4  | 11.6  | R30556              |              |
| 24.3                                                                                      | 24.3 | 23.8 | 23.0 | 22.5 | 22.1 | 21.7 | 21.4 | 21.1 | 20.9 | 20.7 | 20.5 | 20.2 | 20.0  | 19.8  | 18.0  | 14.4  | 11.6  | R30556              |              |
| 24.3                                                                                      | 24.3 | 23.9 | 23.1 | 22.6 | 22.1 | 21.9 | 21.8 | 21.6 | 21.5 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N06022              | B626         |
| 24.3                                                                                      | 24.3 | 23.9 | 23.1 | 22.6 | 22.1 | 21.9 | 21.8 | 21.6 | 21.5 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N06022              |              |
| 23.2                                                                                      | 21.2 | 19.6 | 18.1 | 16.9 | 16.0 | 15.5 | 15.1 | 14.8 | 14.5 | 14.4 | 14.2 | 14.1 | 14.0  | ...   | ...   | ...   | ...   | N10276              |              |
| 23.2                                                                                      | 23.2 | 23.2 | 23.2 | 22.9 | 21.4 | 20.9 | 20.4 | 20.0 | 19.6 | 19.4 | 19.2 | 19.0 | 19.0  | ...   | ...   | ...   | ...   | N10276              |              |
| 24.3                                                                                      | 21.8 | 19.6 | 18.1 | 17.1 | 16.4 | 16.1 | 15.9 | 15.7 | 15.5 | 15.3 | 15.2 | 15.0 | 14.8  | 14.7  | 14.5  | 14.4  | 11.6  | R30556              |              |
| 24.3                                                                                      | 24.3 | 23.8 | 23.0 | 22.5 | 22.1 | 21.7 | 21.4 | 21.1 | 20.9 | 20.7 | 20.5 | 20.2 | 20.0  | 19.8  | 18.0  | 14.4  | 11.6  | R30556              |              |
| 21.1                                                                                      | 19.7 | 18.1 | 16.8 | 15.6 | 14.7 | 14.4 | 14.4 | 14.4 | 14.4 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08925              | B673         |
| 21.1                                                                                      | 21.1 | 20.4 | 19.5 | 18.8 | 18.2 | 17.9 | 17.7 | 17.4 | 17.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08925              |              |
| 22.9                                                                                      | 20.5 | 18.3 | 16.7 | 15.9 | 15.3 | 15.0 | 14.9 | 14.8 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08926              |              |
| 22.9                                                                                      | 22.9 | 22.3 | 21.1 | 20.1 | 19.4 | 19.0 | 18.7 | 18.4 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08926              |              |
| 21.1                                                                                      | 19.7 | 18.1 | 16.8 | 15.6 | 14.7 | 14.4 | 14.4 | 14.4 | 14.4 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08925              | B674         |
| 21.1                                                                                      | 21.1 | 20.4 | 19.5 | 18.8 | 18.2 | 17.9 | 17.7 | 17.4 | 17.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08925              |              |
| 22.9                                                                                      | 20.5 | 18.3 | 16.7 | 15.9 | 15.3 | 15.0 | 14.9 | 14.8 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08926              |              |
| 22.9                                                                                      | 22.9 | 22.3 | 21.1 | 20.1 | 19.4 | 19.0 | 18.7 | 18.4 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08926              |              |
| 23.1                                                                                      | 22.2 | 20.2 | 18.7 | 17.4 | 16.5 | 16.1 | 15.8 | 15.5 | 15.3 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367              | B675         |
| 23.1                                                                                      | 23.1 | 21.8 | 20.9 | 20.2 | 19.8 | 19.6 | 19.5 | 19.4 | 19.2 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367              |              |
| 24.3                                                                                      | 22.2 | 20.2 | 18.7 | 17.4 | 16.5 | 16.1 | 15.8 | 15.5 | 15.3 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367              |              |
| 24.3                                                                                      | 24.3 | 23.0 | 22.0 | 21.3 | 20.8 | 20.7 | 20.5 | 20.4 | 20.2 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367              |              |
| 23.1                                                                                      | 22.2 | 20.2 | 18.7 | 17.4 | 16.5 | 16.1 | 15.8 | 15.5 | 15.3 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367              | B676         |
| 23.1                                                                                      | 23.1 | 21.8 | 20.9 | 20.2 | 19.8 | 19.6 | 19.5 | 19.4 | 19.2 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367              |              |
| 24.3                                                                                      | 22.2 | 20.2 | 18.7 | 17.4 | 16.5 | 16.1 | 15.8 | 15.5 | 15.3 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367              |              |
| 24.3                                                                                      | 24.3 | 23.0 | 22.0 | 21.3 | 20.8 | 20.7 | 20.5 | 20.4 | 20.2 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367              |              |

Table A-4 Nickel and High Nickel Alloys (Cont'd)

| Spec. No.                            | UNS Alloy No. | Temper or Condition | Nominal Composition    | P- No. | Notes             | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|--------------------------------------|---------------|---------------------|------------------------|--------|-------------------|--------------------------------|------------------------------|--------|
| <b>Welded Pipe and Tube (Cont'd)</b> |               |                     |                        |        |                   |                                |                              |        |
| B704                                 | N06625        | Annealed            | Ni-Cr-Mo-Cb            | 43     | (1)(14)           | 120                            | 60                           | 0.85   |
| B705                                 | N06625        | Annealed            | Ni-Cr-Mo-Cb            | 43     | (1)(14)           | 120                            | 60                           | 0.85   |
| B804                                 | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45     | (1)(8)            | 95                             | 45                           | 0.85   |
|                                      | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45     | (1)(2)(8)         | 95                             | 45                           | 0.85   |
|                                      | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45     | (1)(8)(21)        | 100                            | 45                           | 0.85   |
|                                      | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45     | (1)(2)(8)(21)     | 100                            | 45                           | 0.85   |
| <b>Plate, Sheet, and Strip</b>       |               |                     |                        |        |                   |                                |                              |        |
| B168                                 | N06600        | Annealed            | Ni-Cr-Fe               | 43     | (1)               | 80                             | 35                           | 1.00   |
|                                      | N06600        | Annealed            | Ni-Cr-Fe               | 43     | (1)(2)            | 80                             | 35                           | 1.00   |
|                                      | N06600        | Hot rolled          | Ni-Cr-Fe               | 43     | (1)(4)            | 85                             | 35                           | 1.00   |
|                                      | N06600        | Hot rolled          | Ni-Cr-Fe               | 43     | (1)(2)(4)         | 85                             | 35                           | 1.00   |
| B168                                 | N06617        | Annealed            | 52Ni-22Cr-13Co-9Mo     | 43     | (1)(7)            | 95                             | 35                           | 1.00   |
|                                      | N06617        | Annealed            | 52Ni-22Cr-13Co-9Mo     | 43     | (1)(2)(7)         | 95                             | 35                           | 1.00   |
| B409                                 | N08800        | Annealed            | Ni-Cr-Fe               | 45     | (4)(7)            | 75                             | 30                           | 1.00   |
|                                      | N08800        | Annealed            | Ni-Cr-Fe               | 45     | (2)(4)(7)         | 75                             | 30                           | 1.00   |
|                                      | N08810        | Annealed            | Ni-Cr-Fe               | 45     | (4)(7)            | 65                             | 25                           | 1.00   |
|                                      | N08810        | Annealed            | Ni-Cr-Fe               | 45     | (2)(4)(7)         | 65                             | 25                           | 1.00   |
| B424                                 | N08825        | Annealed            | Ni-Fe-Cr-Mo-Cu         | 45     | (1)(7)            | 85                             | 35                           | 1.00   |
|                                      | N08825        | Annealed            | Ni-Fe-Cr-Mo-Cu         | 45     | (1)(2)(7)         | 85                             | 35                           | 1.00   |
| B435                                 | R30556        | Annealed            | Ni-Fe-Cr-Co-Mo-W       | 45     | (1)               | 100                            | 45                           | 1.00   |
|                                      | R30556        | Annealed            | Ni-Fe-Cr-Co-Mo-W       | 45     | (1)(2)            | 100                            | 45                           | 1.00   |
| B443                                 | N06625        | Sol. ann.           | Ni-Cr-Mo-Cb            | 43     | (1)(14)(18)       | 100                            | 40                           | 1.00   |
|                                      | N06625        | Annealed            | Ni-Cr-Mo-Cb            | 43     | (1)(14)           | 110                            | 55                           | 1.00   |
|                                      | N06625        | Annealed            | Ni-Cr-Mo-Cb            | 43     | (1)(14)(15)       | 120                            | 60                           | 1.00   |
| B463                                 | N08020        | Annealed            | Ni-Fe-Cr-Mo-Cu-Cb      | 45     | (1)               | 80                             | 35                           | 1.00   |
|                                      | N08020        | Annealed            | Ni-Fe-Cr-Mo-Cu-Cb      | 45     | (1)(12)           | 80                             | 35                           | 1.00   |
| B575                                 | N06022        | Sol. ann.           | Ni-Mo-Cr-Low C         | 44     | (1)(12)           | 100                            | 45                           | 1.00   |
|                                      | N06022        | Sol. ann.           | Ni-Mo-Cr-Low C         | 44     | (1)(2)(12)        | 100                            | 45                           | 1.00   |
|                                      | N10276        | Sol. ann.           | Low C-Ni-Mo-Cr         | 43     | (1)(12)           | 100                            | 41                           | 1.00   |
|                                      | N10276        | Sol. ann.           | Low C-Ni-Mo-Cr         | 43     | (1)(2)(12)        | 100                            | 41                           | 1.00   |
| B625                                 | N08925        | Annealed            | Ni-Fe-Cr-Mo-Cu-Low C   | 45     | (1)               | 87                             | 43                           | 1.00   |
|                                      | N08925        | Annealed            | Ni-Fe-Cr-Mo-Cu-Low C   | 45     | (1)(2)            | 87                             | 43                           | 1.00   |
|                                      | N08926        | Annealed            | Ni-Fe-Cr-Mo-Cu-N-Low C | 45     | (1)(19)(20)       | 94                             | 43                           | 1.00   |
|                                      | N08926        | Annealed            | Ni-Fe-Cr-Mo-Cu-N-Low C | 45     | (1)(2)(19)(20)    | 94                             | 43                           | 1.00   |
| B688                                 | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45     | (1)(7)(11)(22)    | 95                             | 45                           | 1.00   |
|                                      | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45     | (1)(2)(7)(11)(22) | 95                             | 45                           | 1.00   |
|                                      | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45     | (1)(7)(10)(21)    | 100                            | 45                           | 1.00   |
|                                      | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45     | (1)(2)(7)(10)(21) | 100                            | 45                           | 1.00   |

**Table A-4 Nickel and High Nickel Alloys (Cont'd)**

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       | UNS<br>Alloy<br>No. | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|---------------------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 |                     |              |
| Welded Pipe and Tube (Cont'd)                                                             |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |                     |              |
| 29.1                                                                                      | 29.1 | 29.1 | 28.5 | 28.0 | 27.5 | 27.3 | 27.0 | 26.8 | 26.5 | 26.3 | 26.0 | 25.7 | 25.4  | 25.1  | 24.7  | 17.9  | 11.2  | N06625              | B704         |
| 29.1                                                                                      | 29.1 | 29.1 | 28.5 | 28.0 | 27.5 | 27.3 | 27.0 | 26.8 | 26.5 | 26.3 | 26.0 | 25.7 | 25.4  | 25.1  | 24.7  | 17.9  | 11.2  | N06625              | B705         |
| 23.1                                                                                      | 22.2 | 20.2 | 18.7 | 17.4 | 16.5 | 16.1 | 15.8 | 15.5 | 15.3 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367              | B804         |
| 23.1                                                                                      | 23.1 | 21.8 | 20.9 | 20.2 | 19.8 | 19.6 | 19.5 | 19.4 | 19.2 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367              |              |
| 24.3                                                                                      | 22.2 | 20.2 | 18.7 | 17.4 | 16.5 | 16.1 | 15.8 | 15.5 | 15.3 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367              |              |
| 24.3                                                                                      | 24.3 | 23.0 | 22.0 | 21.3 | 20.8 | 20.7 | 20.5 | 20.4 | 20.2 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367              |              |
| Plate, Sheet, and Strip                                                                   |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |                     |              |
| 22.9                                                                                      | 21.3 | 20.8 | 20.5 | 20.2 | 19.9 | 19.8 | 19.6 | 19.4 | 19.1 | 18.7 | 16.0 | 10.6 | 7.0   | 4.5   | 3.0   | 2.2   | 2.0   | N06600              | B168         |
| 22.9                                                                                      | 22.9 | 22.9 | 22.9 | 22.9 | 22.9 | 22.9 | 22.9 | 22.9 | 22.9 | 22.4 | 16.0 | 10.6 | 7.0   | 4.5   | 3.0   | 2.2   | 2.0   | N06600              |              |
| 23.3                                                                                      | 22.1 | 21.5 | 21.3 | 21.3 | 21.2 | 21.1 | 21.0 | 20.8 | 20.5 | 20.1 | 19.7 | 19.3 | 14.5  | 10.3  | 7.2   | 5.8   | 5.5   | N06600              |              |
| 23.3                                                                                      | 23.3 | 23.3 | 23.3 | 23.3 | 23.3 | 23.3 | 23.3 | 23.3 | 23.3 | 23.3 | 23.3 | 23.3 | 14.5  | 10.3  | 7.2   | 5.8   | 5.5   | N06600              |              |
| 23.3                                                                                      | 20.8 | 19.2 | 18.1 | 17.2 | 16.6 | 16.4 | 16.2 | 16.0 | 15.9 | 15.8 | 15.7 | 15.6 | 15.5  | 15.4  | 15.4  | 15.3  | 15.3  | N06617              | B168         |
| 23.3                                                                                      | 23.3 | 23.3 | 23.3 | 23.3 | 22.5 | 22.1 | 21.9 | 21.7 | 21.5 | 21.3 | 21.2 | 21.0 | 20.9  | 20.9  | 20.8  | 20.7  | 18.1  | N06617              |              |
| 20.0                                                                                      | 18.5 | 17.8 | 17.2 | 16.8 | 16.3 | 16.1 | 15.9 | 15.7 | 15.5 | 15.3 | 15.1 | 14.9 | 14.7  | 14.5  | 13.0  | 9.8   | 6.6   | N08800              | B409         |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 19.9  | 17.0  | 13.0  | 9.8   | 6.6   | N08800              |              |
| 16.7                                                                                      | 15.4 | 14.4 | 13.6 | 12.9 | 12.2 | 11.9 | 11.6 | 11.4 | 11.1 | 10.9 | 10.7 | 10.5 | 10.4  | 10.2  | 10.0  | 9.3   | 7.4   | N08810              |              |
| 16.7                                                                                      | 16.7 | 16.7 | 16.7 | 16.7 | 16.5 | 16.1 | 15.7 | 15.3 | 15.0 | 14.7 | 14.5 | 14.2 | 14.0  | 13.8  | 11.6  | 9.3   | 7.4   | N08810              |              |
| 23.3                                                                                      | 21.4 | 20.3 | 19.4 | 18.5 | 17.8 | 17.5 | 17.3 | 17.2 | 17.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08825              | B424         |
| 23.3                                                                                      | 23.3 | 23.3 | 23.3 | 23.3 | 23.3 | 23.3 | 23.3 | 23.2 | 23.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08825              |              |
| 28.6                                                                                      | 25.6 | 23.1 | 21.3 | 20.1 | 19.3 | 18.9 | 18.7 | 18.4 | 18.2 | 18.0 | 17.8 | 17.6 | 17.5  | 17.3  | 17.1  | 16.9  | 13.6  | R30556              | B435         |
| 28.6                                                                                      | 28.6 | 28.0 | 27.1 | 26.4 | 26.0 | 25.6 | 25.2 | 24.9 | 24.6 | 24.3 | 24.1 | 23.8 | 23.6  | 23.3  | 21.2  | 17.0  | 13.6  | R30556              |              |
| 26.7                                                                                      | 24.9 | 23.6 | 22.6 | 21.8 | 21.1 | 20.8 | 20.6 | 20.3 | 20.1 | 20.0 | 19.8 | 19.7 | 19.5  | 19.4  | 19.4  | 19.3  | 19.3  | N06625              | B443         |
| 31.4                                                                                      | 31.4 | 31.4 | 30.8 | 30.2 | 29.7 | 29.4 | 29.1 | 28.9 | 28.6 | 28.3 | 28.0 | 27.7 | 27.4  | 27.0  | 26.6  | 21.0  | 13.2  | N06625              |              |
| 34.3                                                                                      | 34.3 | 34.3 | 33.6 | 32.9 | 32.4 | 32.1 | 31.8 | 31.5 | 31.2 | 30.9 | 30.6 | 30.3 | 29.9  | 29.5  | 29.0  | 21.0  | 13.2  | N06625              |              |
| 22.9                                                                                      | 20.6 | 19.7 | 18.9 | 18.2 | 17.7 | 17.5 | 17.4 | 17.2 | 16.8 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08020              | B463         |
| 22.9                                                                                      | 22.9 | 22.9 | 22.6 | 22.2 | 22.1 | 22.1 | 22.0 | 21.9 | 21.8 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08020              |              |
| 28.6                                                                                      | 28.6 | 28.2 | 27.2 | 26.5 | 26.0 | 25.8 | 25.6 | 25.4 | 25.3 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N06022              | B575         |
| 28.6                                                                                      | 28.6 | 28.2 | 27.2 | 26.5 | 26.0 | 25.8 | 25.6 | 25.4 | 25.3 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N06022              |              |
| 27.3                                                                                      | 24.9 | 23.0 | 21.3 | 19.9 | 18.8 | 18.2 | 17.8 | 17.4 | 17.1 | 16.8 | 16.7 | 16.5 | 16.5  | ...   | ...   | ...   | ...   | N10276              |              |
| 27.3                                                                                      | 27.3 | 27.3 | 26.9 | 25.2 | 24.6 | 24.0 | 23.5 | 23.1 | 22.8 | 22.6 | 22.4 | 22.3 | ...   | ...   | ...   | ...   | ...   | N10276              |              |
| 24.9                                                                                      | 23.2 | 21.3 | 19.8 | 18.3 | 17.3 | 17.0 | 16.9 | 16.9 | 16.9 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08925              | B625         |
| 24.9                                                                                      | 24.9 | 23.9 | 23.0 | 22.1 | 21.4 | 21.1 | 20.8 | 20.4 | 20.1 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08925              |              |
| 26.9                                                                                      | 24.1 | 21.5 | 19.7 | 18.7 | 18.0 | 17.7 | 17.5 | 17.4 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08926              |              |
| 26.9                                                                                      | 26.9 | 26.2 | 24.8 | 23.7 | 22.8 | 22.4 | 22.0 | 21.6 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08926              |              |
| 27.1                                                                                      | 26.2 | 23.8 | 21.9 | 20.5 | 19.4 | 19.0 | 18.6 | 18.3 | 18.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367              | B688         |
| 27.1                                                                                      | 27.1 | 25.7 | 24.6 | 23.8 | 23.3 | 23.1 | 22.9 | 22.8 | 22.6 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367              |              |
| 28.6                                                                                      | 26.2 | 23.8 | 21.9 | 20.5 | 19.4 | 19.0 | 18.6 | 18.3 | 18.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367              |              |
| 28.6                                                                                      | 28.6 | 27.0 | 25.8 | 25.0 | 24.5 | 24.3 | 24.1 | 24.0 | 23.8 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367              |              |

Table A-4 Nickel and High Nickel Alloys (Cont'd)

| Spec. No.                               | UNS Alloy No. | Temper or Condition | Nominal Composition    | P- No. | Notes              | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|-----------------------------------------|---------------|---------------------|------------------------|--------|--------------------|--------------------------------|------------------------------|--------|
| <b>Bars, Rods, Shapes, and Forgings</b> |               |                     |                        |        |                    |                                |                              |        |
| B166                                    | N06617        | Annealed            | 52Ni-22Cr-13Co-9Mo     | 43     | (1)(7)             | 95                             | 35                           | 1.00   |
|                                         | N06617        | Annealed            | 52Ni-22Cr-13Co-9Mo     | 43     | (1)(2)(7)          | 95                             | 35                           | 1.00   |
| B408                                    | N08800        | Annealed            | Ni-Cr-Fe               | 45     | (7)                | 75                             | 30                           | 1.00   |
|                                         | N08800        | Annealed            | Ni-Cr-Fe               | 45     | (2)(7)             | 75                             | 30                           | 1.00   |
|                                         | N08810        | Annealed            | Ni-Cr-Fe               | 45     | (7)                | 65                             | 25                           | 1.00   |
|                                         | N08810        | Annealed            | Ni-Cr-Fe               | 45     | (2)(7)             | 65                             | 25                           | 1.00   |
| B425                                    | N08825        | Annealed            | Ni-Fe-Cr-Mo-Cu         | 45     | (1)(7)             | 85                             | 35                           | 1.00   |
|                                         | N08825        | Annealed            | Ni-Fe-Cr-Mo-Cu         | 45     | (1)(2)(7)          | 85                             | 35                           | 1.00   |
| B446                                    | N06625        | Sol. ann.           | Ni-Cr-Mo-Cb            | 43     | (1)(14)(18)        | 100                            | 40                           | 1.00   |
|                                         | N06625        | Annealed            | Ni-Cr-Mo-Cb            | 43     | (1)(2)(14)(16)     | 110                            | 50                           | 1.00   |
|                                         | N06625        | Annealed            | Ni-Cr-Mo-Cb            | 43     | (1)(2)(14)(15)(17) | 120                            | 60                           | 1.00   |
| B462                                    | N08020        | Annealed            | Ni-Fe-Cr-Mo-Cu-Cb      | 45     | (1)                | 80                             | 35                           | 1.00   |
|                                         | N08020        | Annealed            | Ni-Fe-Cr-Mo-Cu-Cb      | 45     | (1)(2)             | 80                             | 35                           | 1.00   |
| B473                                    | N08020        | Annealed            | Cr-Ni-Fe-Mo-Cu-Cb      | 45     | (1)                | 80                             | 35                           | 1.00   |
|                                         | N08020        | Annealed            | Cr-Ni-Fe-Mo-Cu-Cb      | 45     | (1)(2)             | 80                             | 35                           | 1.00   |
| B564                                    | N06617        | Annealed            | 52Ni-22Cr-13Co-9Mo     | 43     | (1)(7)             | 95                             | 35                           | 1.00   |
|                                         | N06617        | Annealed            | 52Ni-22Cr-13Co-9Mo     | 43     | (1)(2)(7)          | 95                             | 35                           | 1.00   |
|                                         | N06625        | Annealed            | Ni-Cr-Mo-Cb            | 43     | (1)(2)(14)(16)     | 110                            | 50                           | 1.00   |
|                                         | N06625        | Annealed            | Ni-Cr-Mo-Cb            | 43     | (1)(2)(14)(15)(17) | 120                            | 60                           | 1.00   |
| B564                                    | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45     | (1)(8)(22)         | 95                             | 45                           | 1.00   |
|                                         | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45     | (1)(2)(8)(22)      | 95                             | 45                           | 1.00   |
|                                         | N08800        | Annealed            | Ni-Cr-Fe               | 45     | (1)                | 75                             | 30                           | 1.00   |
|                                         | N08800        | Annealed            | Ni-Cr-Fe               | 45     | (1)(2)             | 75                             | 30                           | 1.00   |
|                                         | N08810        | Annealed            | Ni-Cr-Fe               | 45     | (1)                | 65                             | 25                           | 1.00   |
|                                         | N08810        | Annealed            | Ni-Cr-Fe               | 45     | (1)(2)             | 65                             | 25                           | 1.00   |
| B572                                    | R30556        | Annealed            | Ni-Fe-Cr-Co-Mo-W       | 45     | (1)                | 100                            | 45                           | 1.00   |
|                                         | R30556        | Annealed            | Ni-Fe-Cr-Co-Mo-W       | 45     | (1)(2)             | 100                            | 45                           | 1.00   |
| B574                                    | N06022        | Sol. ann.           | Ni-Mo-Cr-Low C         | 44     | (1)(12)            | 100                            | 45                           | 1.00   |
|                                         | N06022        | Sol. ann.           | Ni-Mo-Cr-Low C         | 44     | (1)(2)(12)         | 100                            | 45                           | 1.00   |
|                                         | N10276        | Sol. ann.           | Low C-Ni-Mo-Cr         | 43     | (1)(12)            | 100                            | 41                           | 1.00   |
|                                         | N10276        | Sol. ann.           | Low C-Ni-Mo-Cr         | 43     | (1)(2)(12)         | 100                            | 41                           | 1.00   |
| B649                                    | N08925        | Annealed            | Ni-Fe-Cr-Mo-Cu-Low C   | 45     | (1)                | 87                             | 43                           | 1.00   |
|                                         | N08925        | Annealed            | Ni-Fe-Cr-Mo-Cu-Low C   | 45     | (1)(2)             | 87                             | 43                           | 1.00   |
|                                         | N08926        | Annealed            | Ni-Fe-Cr-Mo-Cu-N-Low C | ...    | (1)                | 94                             | 43                           | 1.00   |
|                                         | N08926        | Annealed            | Ni-Fe-Cr-Mo-Cu-N-Low C | ...    | (1)(2)             | 94                             | 43                           | 1.00   |
| B691                                    | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45     | (1)(8)(22)         | 95                             | 45                           | 1.00   |
|                                         | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-Cu-N       | 45     | (1)(2)(8)(22)      | 95                             | 45                           | 1.00   |

**Table A-4 Nickel and High Nickel Alloys (Cont'd)**

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       | UNS Alloy No. | Spec. No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|---------------|-----------|
| -20 to 100                                                                                | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 |               |           |
| Bars, Rods, Shapes, and Forgings                                                          |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |               |           |
| 23.3                                                                                      | 20.8 | 19.2 | 18.1 | 17.2 | 16.6 | 16.4 | 16.2 | 16.0 | 15.9 | 15.8 | 15.7 | 15.6 | 15.5  | 15.4  | 15.4  | 15.3  | 15.3  | N06617        | B166      |
| 23.3                                                                                      | 23.3 | 23.3 | 23.3 | 23.3 | 22.5 | 22.1 | 21.9 | 21.7 | 21.5 | 21.3 | 21.2 | 21.0 | 20.9  | 20.9  | 20.8  | 20.7  | 18.1  | N06617        |           |
| 20.0                                                                                      | 18.5 | 17.8 | 17.2 | 16.8 | 16.3 | 16.1 | 15.9 | 15.7 | 15.5 | 15.3 | 15.1 | 14.9 | 14.7  | 14.5  | 13.0  | 9.8   | 6.6   | N08800        | B408      |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 19.9  | 17.0  | 13.0  | 9.8   | 6.6   | N08800        |           |
| 16.7                                                                                      | 15.4 | 14.4 | 13.6 | 12.9 | 12.2 | 11.9 | 11.6 | 11.4 | 11.1 | 10.9 | 10.7 | 10.5 | 10.4  | 10.2  | 10.0  | 9.3   | 7.4   | N08810        |           |
| 16.7                                                                                      | 16.7 | 16.7 | 16.7 | 16.7 | 16.5 | 16.1 | 15.7 | 15.3 | 15.0 | 14.7 | 14.5 | 14.2 | 14.0  | 13.8  | 11.6  | 9.3   | 7.4   | N08810        |           |
| 23.3                                                                                      | 21.4 | 20.3 | 19.4 | 18.5 | 17.8 | 17.5 | 17.3 | 17.2 | 17.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08825        | B425      |
| 23.3                                                                                      | 23.3 | 23.3 | 23.3 | 23.3 | 23.3 | 23.3 | 23.3 | 23.2 | 23.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08825        |           |
| 26.7                                                                                      | 24.9 | 23.6 | 22.6 | 21.8 | 21.1 | 20.8 | 20.6 | 20.3 | 20.1 | 20.0 | 19.8 | 19.7 | 19.5  | 19.4  | 19.4  | 19.3  | 19.3  | N06625        | B446      |
| 31.4                                                                                      | 31.4 | 31.4 | 30.8 | 30.2 | 29.7 | 29.4 | 29.1 | 28.9 | 28.6 | 28.3 | 28.0 | 27.7 | 27.4  | 27.0  | 26.6  | 21.0  | 13.2  | N06625        |           |
| 34.3                                                                                      | 34.3 | 34.3 | 33.6 | 32.9 | 32.4 | 32.1 | 31.8 | 31.5 | 31.2 | 30.9 | 30.6 | 30.3 | 29.9  | 29.5  | 29.0  | 21.0  | 13.2  | N06625        |           |
| 22.9                                                                                      | 20.6 | 19.7 | 18.9 | 18.2 | 17.7 | 17.5 | 17.4 | 17.2 | 16.8 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08020        | B462      |
| 22.9                                                                                      | 22.9 | 22.6 | 22.2 | 22.1 | 22.1 | 22.0 | 21.9 | 21.8 | 21.8 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08020        |           |
| 22.9                                                                                      | 20.6 | 19.7 | 18.9 | 18.2 | 17.7 | 17.5 | 17.4 | 17.2 | 16.8 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08020        | B473      |
| 22.9                                                                                      | 22.9 | 22.6 | 22.2 | 22.1 | 22.1 | 22.0 | 21.9 | 21.8 | 21.8 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08020        |           |
| 23.3                                                                                      | 20.8 | 19.2 | 18.1 | 17.2 | 16.6 | 16.4 | 16.2 | 16.0 | 15.9 | 15.8 | 15.7 | 15.6 | 15.5  | 15.4  | 15.4  | 15.3  | 15.3  | N06617        | B564      |
| 23.3                                                                                      | 23.3 | 23.3 | 23.3 | 23.3 | 22.5 | 22.1 | 21.9 | 21.7 | 21.5 | 21.3 | 21.2 | 21.0 | 20.9  | 20.9  | 20.8  | 20.7  | 18.1  | N06617        |           |
| 31.4                                                                                      | 31.4 | 31.4 | 30.8 | 30.2 | 29.7 | 29.4 | 29.1 | 28.9 | 28.6 | 28.3 | 28.0 | 27.7 | 27.4  | 27.0  | 26.6  | 21.0  | 13.2  | N06625        |           |
| 34.3                                                                                      | 34.3 | 34.3 | 33.6 | 32.9 | 32.4 | 32.1 | 31.8 | 31.5 | 31.2 | 30.9 | 30.6 | 30.3 | 29.9  | 29.5  | 29.0  | 21.0  | 13.2  | N06625        |           |
| 27.1                                                                                      | 26.2 | 23.8 | 21.9 | 20.5 | 19.4 | 19.0 | 18.6 | 18.3 | 18.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367        | B564      |
| 27.1                                                                                      | 27.1 | 25.7 | 24.6 | 23.8 | 23.3 | 23.1 | 22.9 | 22.8 | 22.6 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367        |           |
| 20.0                                                                                      | 18.5 | 17.8 | 17.2 | 16.8 | 16.3 | 16.1 | 15.9 | 15.7 | 15.5 | 15.3 | 15.1 | 14.9 | 14.7  | 14.5  | 13.0  | 9.8   | 6.6   | N08800        |           |
| 20.0                                                                                      | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 19.9  | 17.0  | 13.0  | 9.8   | 6.6   | N08800        |           |
| 16.7                                                                                      | 15.4 | 14.4 | 13.6 | 12.9 | 12.2 | 11.9 | 11.6 | 11.4 | 11.1 | 10.9 | 10.7 | 10.5 | 10.4  | 10.2  | 10.0  | 9.3   | 7.4   | N08810        |           |
| 16.7                                                                                      | 16.7 | 16.7 | 16.7 | 16.7 | 16.5 | 16.1 | 15.7 | 15.3 | 15.0 | 14.7 | 14.5 | 14.2 | 14.0  | 13.8  | 11.6  | 9.3   | 7.4   | N08810        |           |
| 28.6                                                                                      | 25.6 | 23.1 | 21.3 | 20.1 | 19.3 | 18.9 | 18.7 | 18.4 | 18.2 | 18.0 | 17.8 | 17.6 | 17.5  | 17.3  | 17.1  | 16.9  | 13.6  | R30556        | B572      |
| 28.6                                                                                      | 28.6 | 28.0 | 27.1 | 26.4 | 26.0 | 25.6 | 25.2 | 24.9 | 24.6 | 24.3 | 24.1 | 23.8 | 23.6  | 23.3  | 21.2  | 17.0  | 13.6  | R30556        |           |
| 28.6                                                                                      | 22.9 | 22.9 | 22.6 | 22.2 | 22.1 | 22.1 | 22.0 | 21.9 | 21.8 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N06022        | B574      |
| 28.6                                                                                      | 28.6 | 28.2 | 27.2 | 26.5 | 26.0 | 25.8 | 25.6 | 25.4 | 25.3 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N06022        |           |
| 27.3                                                                                      | 24.9 | 23.0 | 21.3 | 19.9 | 18.8 | 18.2 | 17.8 | 17.4 | 17.1 | 16.9 | 16.7 | 16.6 | 16.5  | ...   | ...   | ...   | ...   | N10276        |           |
| 27.3                                                                                      | 27.3 | 27.3 | 26.9 | 25.2 | 24.6 | 24.0 | 23.5 | 23.1 | 22.8 | 22.6 | 22.4 | 22.3 | ...   | ...   | ...   | ...   | ...   | N10276        |           |
| 24.9                                                                                      | 23.2 | 21.3 | 19.8 | 18.3 | 17.3 | 17.0 | 16.9 | 16.9 | 16.9 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08925        | B649      |
| 24.9                                                                                      | 24.9 | 23.9 | 23.0 | 22.1 | 21.4 | 21.1 | 20.8 | 20.4 | 20.1 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08925        |           |
| 26.9                                                                                      | 24.1 | 21.5 | 19.7 | 18.7 | 18.0 | 17.7 | 17.5 | 17.4 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08926        |           |
| 26.9                                                                                      | 26.9 | 26.2 | 24.8 | 23.7 | 22.8 | 22.4 | 22.0 | 21.6 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08926        |           |
| 27.1                                                                                      | 26.2 | 23.8 | 21.9 | 20.5 | 19.4 | 19.0 | 18.6 | 18.3 | 18.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367        | B691      |
| 27.1                                                                                      | 27.1 | 25.7 | 24.6 | 23.8 | 23.3 | 23.1 | 22.9 | 22.8 | 22.6 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367        |           |

Table A-4 Nickel and High Nickel Alloys (Cont'd)

| Spec. No.         | UNS Alloy No. | Temper or Condition | Nominal Composition    | P-No. | Notes             | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|-------------------|---------------|---------------------|------------------------|-------|-------------------|--------------------------------|------------------------------|--------|
| Seamless Fittings |               |                     |                        |       |                   |                                |                              |        |
| B366              | N06022        | Sol. ann.           | Low C-Ni-Mo-Cr         | 44    | (1)(12)           | 100                            | 45                           | 1.00   |
|                   | N06022        | Sol. ann.           | Low C-Ni-Mo-Cr         | 44    | (1)(2)(12)        | 100                            | 45                           | 1.00   |
|                   | N06625        | Annealed            | Ni-Cr-Mo-Cb            | 43    | (1)(14)           | 110                            | 50                           | 1.00   |
| B366              | N08020        | Annealed            | Cr-Ni-Fe-Mo-Cu-Cb      | 45    | (1)               | 80                             | 35                           | 1.00   |
|                   | N08020        | Annealed            | Cr-Ni-Fe-Mo-Cu-Cb      | 45    | (1)(2)            | 80                             | 35                           | 1.00   |
|                   | N08367        | Annealed            | Fe-Ni-Cr-Mo-N          | 45    | (1)(8)(22)        | 95                             | 45                           | 1.00   |
|                   | N08367        | Annealed            | Fe-Ni-Cr-Mo-N          | 45    | (1)(2)(8)(22)     | 95                             | 45                           | 1.00   |
| B366              | N08925        | Annealed            | Low C-Ni-Fe-Cr-Mo-Cu   | 45    | (1)               | 87                             | 43                           | 1.00   |
|                   | N08925        | Annealed            | Low C-Ni-Fe-Cr-Mo-Cu   | 45    | (1)(2)            | 87                             | 43                           | 1.00   |
|                   | N08926        | Annealed            | Low C-Ni-Fe-Cr-Mo-Cu-N | 45    | (1)               | 94                             | 43                           | 1.00   |
|                   | N08926        | Annealed            | Low C-Ni-Fe-Cr-Mo-Cu-N | 45    | (1)(2)            | 94                             | 43                           | 1.00   |
| B366              | N10276        | Sol. ann.           | Low C-Ni-Mo-Cr         | 43    | (1)(12)           | 100                            | 41                           | 1.00   |
|                   | N10276        | Sol. ann.           | Low C-Ni-Mo-Cr         | 43    | (1)(2)(12)        | 100                            | 41                           | 1.00   |
|                   | R30556        | Annealed            | Ni-Fe-Cr-Co-Mo-W       | 45    | (1)               | 100                            | 45                           | 1.00   |
|                   | R30556        | Annealed            | Ni-Fe-Cr-Co-Mo-W       | 45    | (1)(2)            | 100                            | 45                           | 1.00   |
| B462              | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-N          | 45    | (1)(8)(22)        | 95                             | 45                           | 1.00   |
|                   | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-N          | 45    | (1)(2)(8)(22)     | 95                             | 45                           | 1.00   |
| Welded Fittings   |               |                     |                        |       |                   |                                |                              |        |
| B366              | N06022        | Sol. ann.           | Low C-Ni-Mo-Cr         | 44    | (1)(12)           | 100                            | 45                           | 0.85   |
|                   | N06022        | Sol. ann.           | Low C-Ni-Mo-Cr         | 44    | (1)(12)(13)       | 100                            | 45                           | 1.00   |
|                   | N06022        | Sol. ann.           | Low C-Ni-Mo-Cr         | 44    | (1)(2)(12)        | 100                            | 45                           | 0.85   |
|                   | N06022        | Sol. ann.           | Low C-Ni-Mo-Cr         | 44    | (1)(2)(12)(13)    | 100                            | 45                           | 1.00   |
|                   | N06625        | Annealed            | Ni-Cr-Mo-Cb            | 43    | (1)(14)           | 110                            | 50                           | 0.85   |
|                   | N06625        | Annealed            | Ni-Cr-Mo-Cb            | 43    | (1)(13)(14)       | 110                            | 50                           | 1.00   |
| B366              | N08020        | Annealed            | Cr-Ni-Fe-Mo-Cu-Cb      | 45    | (1)               | 80                             | 35                           | 0.85   |
|                   | N08020        | Annealed            | Cr-Ni-Fe-Mo-Cu-Cb      | 45    | (1)(13)           | 80                             | 35                           | 1.00   |
|                   | N08020        | Annealed            | Cr-Ni-Fe-Mo-Cu-Cb      | 45    | (1)(2)            | 80                             | 35                           | 0.85   |
|                   | N08020        | Annealed            | Cr-Ni-Fe-Mo-Cu-Cb      | 45    | (1)(2)(13)        | 80                             | 35                           | 1.00   |
| B366              | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-N          | 45    | (1)(8)(22)        | 95                             | 45                           | 0.85   |
|                   | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-N          | 45    | (1)(8)(13)(22)    | 95                             | 45                           | 1.00   |
|                   | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-N          | 45    | (1)(2)(8)(22)     | 95                             | 45                           | 0.85   |
|                   | N08367        | Sol. ann.           | Fe-Ni-Cr-Mo-N          | 45    | (1)(2)(8)(13)(22) | 95                             | 45                           | 1.00   |
| B366              | N08925        | Annealed            | Low C-Ni-Fe-Cr-Mo-Cu   | 45    | (1)               | 87                             | 43                           | 0.85   |
|                   | N08925        | Annealed            | Low C-Ni-Fe-Cr-Mo-Cu   | 45    | (1)(13)           | 87                             | 43                           | 1.00   |
|                   | N08925        | Annealed            | Low C-Ni-Fe-Cr-Mo-Cu   | 45    | (1)(2)            | 87                             | 43                           | 0.85   |
|                   | N08925        | Annealed            | Low C-Ni-Fe-Cr-Mo-Cu   | 45    | (1)(2)(13)        | 87                             | 43                           | 1.00   |
| B366              | N08926        | Annealed            | Low C-Ni-Fe-Cr-Mo-Cu-N | 45    | (1)(19)(20)       | 94                             | 43                           | 0.85   |
|                   | N08926        | Annealed            | Low C-Ni-Fe-Cr-Mo-Cu-N | 45    | (1)(13)           | 94                             | 43                           | 1.00   |
|                   | N08926        | Annealed            | Low C-Ni-Fe-Cr-Mo-Cu-N | 45    | (1)(2)(19)(20)    | 94                             | 43                           | 0.85   |
|                   | N08926        | Annealed            | Low C-Ni-Fe-Cr-Mo-Cu-N | 45    | (1)(2)(13)        | 94                             | 43                           | 1.00   |
| B366              | N10276        | Sol. ann.           | Low C-Ni-Mo-Cr         | 43    | (1)(12)           | 100                            | 41                           | 0.85   |
|                   | N10276        | Sol. ann.           | Low C-Ni-Mo-Cr         | 43    | (1)(12)(13)       | 100                            | 41                           | 1.00   |
|                   | N10276        | Sol. ann.           | Low C-Ni-Mo-Cr         | 43    | (1)(2)(12)        | 100                            | 41                           | 0.85   |
|                   | N10276        | Sol. ann.           | Low C-Ni-Mo-Cr         | 43    | (1)(2)(12)(13)    | 100                            | 41                           | 1.00   |

**Table A-4 Nickel and High Nickel Alloys (Cont'd)**

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       | UNS Alloy No. | Spec. No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|---------------|-----------|
| -20 to 100                                                                                | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 |               |           |
| Seamless Fittings                                                                         |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |               |           |
| 28.6                                                                                      | 26.7 | 24.6 | 22.9 | 21.5 | 20.4 | 20.0 | 19.6 | 19.3 | 19.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N06022        | B366      |
| 28.6                                                                                      | 28.6 | 28.2 | 27.2 | 26.5 | 26.0 | 25.8 | 25.6 | 25.4 | 25.3 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N06022        |           |
| 31.4                                                                                      | 31.4 | 31.4 | 30.8 | 30.2 | 29.7 | 29.4 | 29.1 | 28.9 | 28.6 | 28.3 | 28.0 | 27.7 | 27.4  | 27.0  | 26.6  | 21.0  | 13.2  | N06625        |           |
| 22.9                                                                                      | 20.6 | 19.7 | 18.9 | 18.2 | 17.7 | 17.5 | 17.4 | 17.2 | 16.8 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08020        | B366      |
| 22.9                                                                                      | 22.9 | 22.6 | 22.2 | 22.1 | 22.1 | 22.0 | 21.9 | 21.8 | 21.8 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08020        | (12)      |
| 27.1                                                                                      | 26.2 | 23.8 | 21.9 | 20.5 | 19.4 | 19.0 | 18.6 | 18.3 | 18.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367        | (12)      |
| 27.1                                                                                      | 27.1 | 25.7 | 24.6 | 23.8 | 23.3 | 23.1 | 22.9 | 22.8 | 22.6 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367        |           |
| 24.9                                                                                      | 23.2 | 21.3 | 19.8 | 18.3 | 17.3 | 17.0 | 16.9 | 16.9 | 16.9 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08925        | B366      |
| 24.9                                                                                      | 24.9 | 23.0 | 23.0 | 22.1 | 21.4 | 21.1 | 20.8 | 20.4 | 20.1 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08925        | (12)      |
| 26.9                                                                                      | 24.1 | 21.5 | 19.7 | 18.7 | 18.0 | 17.7 | 17.5 | 17.4 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08926        |           |
| 26.9                                                                                      | 26.9 | 26.2 | 24.8 | 23.7 | 22.8 | 22.4 | 22.0 | 21.6 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08926        |           |
| 27.3                                                                                      | 24.9 | 23.0 | 21.3 | 19.9 | 18.8 | 18.2 | 17.8 | 17.4 | 17.1 | 16.9 | 16.7 | 16.6 | 16.5  | ...   | ...   | ...   | ...   | N10276        | B366      |
| 27.3                                                                                      | 27.3 | 27.3 | 27.3 | 26.9 | 25.2 | 24.6 | 24.0 | 23.5 | 23.1 | 22.8 | 22.6 | 22.4 | 22.3  | ...   | ...   | ...   | ...   | N10276        |           |
| 28.6                                                                                      | 25.6 | 23.1 | 21.3 | 20.1 | 19.3 | 18.9 | 18.7 | 18.4 | 18.2 | 18.0 | 17.8 | 17.6 | 17.5  | 17.3  | 17.1  | 16.9  | 13.6  | R30556        |           |
| 28.6                                                                                      | 28.6 | 28.0 | 27.1 | 26.4 | 26.0 | 25.6 | 25.2 | 24.9 | 24.6 | 24.3 | 24.1 | 23.8 | 23.6  | 23.3  | 21.2  | 17.0  | 13.6  | R30556        |           |
| 27.1                                                                                      | 26.2 | 23.8 | 21.9 | 20.5 | 19.4 | 19.0 | 18.6 | 18.3 | 18.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367        | B462      |
| 27.1                                                                                      | 27.1 | 25.7 | 24.6 | 23.8 | 23.3 | 23.1 | 22.9 | 22.8 | 22.6 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367        |           |
| Welded Fittings                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |               |           |
| 24.3                                                                                      | 22.7 | 20.9 | 19.4 | 18.3 | 17.4 | 17.0 | 16.7 | 16.4 | 16.2 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N06022        | B366      |
| 28.6                                                                                      | 26.7 | 24.6 | 22.9 | 21.5 | 20.4 | 20.0 | 19.6 | 19.3 | 19.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N06022        |           |
| 24.3                                                                                      | 24.3 | 23.9 | 23.1 | 22.6 | 22.1 | 21.9 | 21.8 | 21.6 | 21.5 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N06022        |           |
| 28.6                                                                                      | 28.6 | 28.2 | 27.2 | 26.5 | 26.0 | 25.8 | 25.6 | 25.4 | 25.3 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N06022        |           |
| 26.7                                                                                      | 26.7 | 26.7 | 26.2 | 25.7 | 25.2 | 25.0 | 24.7 | 24.6 | 24.3 | 24.1 | 23.8 | 23.5 | 23.3  | 23.0  | 22.6  | 17.9  | 11.2  | N06625        | (12)      |
| 31.4                                                                                      | 31.4 | 31.4 | 30.8 | 30.2 | 29.7 | 29.4 | 29.1 | 28.9 | 28.6 | 28.3 | 28.0 | 27.7 | 27.4  | 27.0  | 26.6  | 21.0  | 13.2  | N06625        | (12)      |
| 19.4                                                                                      | 17.5 | 16.8 | 16.1 | 15.5 | 15.0 | 14.9 | 14.8 | 14.6 | 14.3 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08020        | B366      |
| 22.9                                                                                      | 20.6 | 19.7 | 18.9 | 18.2 | 17.7 | 17.5 | 17.4 | 17.2 | 16.8 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08020        |           |
| 19.4                                                                                      | 19.4 | 19.2 | 18.8 | 18.8 | 18.8 | 18.7 | 18.6 | 18.5 | 18.5 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08020        |           |
| 22.9                                                                                      | 22.9 | 22.6 | 22.2 | 22.1 | 22.1 | 22.0 | 21.9 | 21.8 | 21.8 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08020        |           |
| 23.1                                                                                      | 22.2 | 20.2 | 18.7 | 17.4 | 16.5 | 16.1 | 15.8 | 15.5 | 15.3 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367        | B366      |
| 27.1                                                                                      | 26.2 | 23.8 | 21.9 | 20.5 | 19.4 | 19.0 | 18.6 | 18.3 | 18.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367        |           |
| 23.1                                                                                      | 23.1 | 21.8 | 20.9 | 20.2 | 19.8 | 19.6 | 19.5 | 19.4 | 19.2 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367        |           |
| 27.1                                                                                      | 27.1 | 25.7 | 24.6 | 23.8 | 23.3 | 23.1 | 22.9 | 22.8 | 22.6 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08367        |           |
| 21.1                                                                                      | 19.7 | 18.1 | 16.8 | 15.6 | 14.7 | 14.4 | 14.4 | 14.4 | 14.4 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08925        | B366      |
| 24.9                                                                                      | 23.2 | 21.3 | 19.8 | 18.3 | 17.3 | 17.0 | 16.9 | 16.9 | 16.9 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08925        |           |
| 21.1                                                                                      | 21.1 | 20.4 | 19.5 | 18.8 | 18.2 | 17.9 | 17.7 | 17.4 | 17.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08925        |           |
| 24.9                                                                                      | 24.9 | 23.9 | 23.0 | 22.1 | 21.4 | 21.1 | 20.8 | 20.4 | 20.1 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08925        |           |
| 22.9                                                                                      | 20.5 | 18.3 | 16.7 | 15.9 | 15.3 | 15.0 | 14.9 | 14.8 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08926        | B366      |
| 26.9                                                                                      | 24.1 | 21.5 | 19.7 | 18.7 | 18.0 | 17.7 | 17.5 | 17.4 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08926        |           |
| 22.9                                                                                      | 22.9 | 22.3 | 21.1 | 20.1 | 19.4 | 19.0 | 18.7 | 18.4 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08926        |           |
| 26.9                                                                                      | 26.9 | 26.2 | 24.8 | 23.7 | 22.8 | 22.4 | 22.0 | 21.6 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | N08926        |           |
| 23.2                                                                                      | 21.2 | 19.6 | 18.1 | 16.9 | 16.0 | 15.5 | 15.1 | 14.8 | 14.5 | 14.4 | 14.2 | 14.1 | 14.0  | ...   | ...   | ...   | ...   | N10276        | B366      |
| 27.3                                                                                      | 24.9 | 23.0 | 21.3 | 19.9 | 18.8 | 18.2 | 17.8 | 17.4 | 17.1 | 16.9 | 16.7 | 16.6 | 16.5  | ...   | ...   | ...   | ...   | N10276        |           |
| 23.2                                                                                      | 23.2 | 23.2 | 23.2 | 22.9 | 21.4 | 20.9 | 20.4 | 20.0 | 19.6 | 19.4 | 19.2 | 19.0 | 19.0  | ...   | ...   | ...   | ...   | N10276        |           |
| 27.3                                                                                      | 27.3 | 27.3 | 27.3 | 26.9 | 25.2 | 24.6 | 24.0 | 23.5 | 23.1 | 22.8 | 22.6 | 22.4 | 22.3  | ...   | ...   | ...   | ...   | N10276        |           |

**Table A-4 Nickel and High Nickel Alloys (Cont'd)**

| Spec. No.                | UNS Alloy No. | Temper or Condition | Nominal Composition | P- No.           | Notes | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | <i>E</i> or <i>F</i> |      |
|--------------------------|---------------|---------------------|---------------------|------------------|-------|--------------------------------|------------------------------|----------------------|------|
| Welded Fittings (Cont'd) |               |                     |                     |                  |       |                                |                              |                      |      |
| (12)                     | B366          | R30556              | Annealed            | Ni-Fe-Cr-Co-Mo-W | 45    | (1)                            | 100                          | 45                   | 0.85 |
|                          |               | R30556              | Annealed            | Ni-Fe-Cr-Co-Mo-W | 45    | (1)(13)                        | 100                          | 45                   | 1.00 |
| (12)                     |               | R30556              | Annealed            | Ni-Fe-Cr-Co-Mo-W | 45    | (1)(2)                         | 100                          | 45                   | 0.85 |
|                          |               | R30556              | Annealed            | Ni-Fe-Cr-Co-Mo-W | 45    | (1)(2)(13)                     | 100                          | 45                   | 1.00 |

ASME B31.1-2012

Click to view the full PDF of ASME B31.1-2012

**Table A-4 Nickel and High Nickel Alloys (Cont'd)**

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       | UNS Alloy No.            | Spec. No. |      |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|--------------------------|-----------|------|
| -20 to 100                                                                                | 200  | 300  | 400  | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 |                          |           |      |
|                                                                                           |      |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       | Welded Fittings (Cont'd) |           |      |
| 24.3                                                                                      | 21.8 | 19.6 | 18.1 | 17.1 | 16.4 | 16.1 | 15.9 | 15.7 | 15.5 | 15.3 | 15.2 | 15.0 | 14.8  | 14.7  | 14.5  | 14.4  | 11.6  | R30556                   | B366      | (12) |
| 28.6                                                                                      | 25.6 | 23.1 | 21.3 | 20.1 | 19.3 | 18.9 | 18.7 | 18.4 | 18.2 | 18.0 | 17.8 | 17.6 | 17.5  | 17.3  | 17.1  | 16.9  | 13.6  | R30556                   |           |      |
| 24.3                                                                                      | 24.3 | 23.8 | 23.0 | 22.5 | 22.1 | 21.7 | 21.4 | 21.1 | 20.9 | 20.7 | 20.5 | 20.2 | 20.0  | 19.8  | 18.0  | 14.4  | 11.6  | R30556                   |           | (12) |
| 28.6                                                                                      | 28.6 | 28.0 | 27.1 | 26.4 | 26.0 | 25.6 | 25.2 | 24.9 | 24.6 | 24.3 | 24.1 | 23.8 | 23.6  | 23.3  | 21.2  | 17.0  | 13.6  | R30556                   |           |      |

ASME B31.1-2012

Click to view the full PDF of ASME B31.1-2012

**Table A-4 Nickel and High Nickel Alloys (Cont'd)**

## GENERAL NOTES:

- (a) The tabulated specifications are ANSI/ASTM or ASTM. For ASME Boiler and Pressure Vessel Code applications, see related specifications in Section II of the ASME Code.
- (b) The stress values in this Table may be interpolated to determine values for intermediate temperatures.
- (c) The P-Numbers indicated in this Table are identical to those adopted by the ASME Boiler and Pressure Vessel Code. Qualification of welding procedures, welders, and welding operators is required and shall comply with the ASME Boiler and Pressure Vessel Code, Section IX, except as modified by para. 127.5.
- (d) Tensile strengths and allowable stresses shown in "ksi" are "thousands of pounds per square inch."
- (e) The materials listed in this table shall not be used at design temperatures above those for which allowable stress values are given herein or in Table A-8.
- (f) The tabulated stress values are  $S \times E$  (weld joint efficiency factor) or  $S \times F$  (material quality factor), as applicable. Weld joint efficiency factors are shown in Table 102.4.3.
- (g) Pressure-temperature ratings of piping components, as published in standards referenced in this Code, may be used for components meeting the requirements of those standards. The allowable stress values given in this Table are for use in designing piping components which are not manufactured in accordance with referenced standards.
- (h) The  $y$  coefficient = 0.4 except where Note (7) applies [see Table 104.1.2(A)].
- (i) The tabulated stress values that are shown in italics are at temperatures in the range where creep and stress rupture strength govern the selection of stresses.

## NOTES:

- (1) THIS MATERIAL IS NOT ACCEPTABLE FOR USE ON BOILER EXTERNAL PIPING — SEE FIGS. 100.1.2(A) AND (B).
- (2) Due to the relatively low yield strengths of these materials, these higher allowable stress values were established at temperatures where the short time tensile properties govern to permit the use of these alloys where slightly greater deformation is acceptable. These stress values exceed 67% but do not exceed 90% of the yield strength at temperature. Use of these values may result in dimensional changes due to permanent strain. These values should not be used for flanges of gasketed joints or other applications where slight amounts of distortion can cause leakage or malfunction.
- (3) The maximum temperature is limited to 500°F because harder temper adversely affects design stress in the creep rupture temperature range.
- (4) These values may be used for plate material only.
- (5) These values apply to sizes NPS 5 and smaller.
- (6) These values apply to sizes larger than NPS 5.
- (7) See Table 104.1.2(A) for  $y$  coefficient value.
- (8) Heat treatment after forming or welding is neither required nor prohibited. However, if heat treatment is applied, the solution annealing treatment shall consist of heating to a minimum temperature of 2,025°F and then quenching in water or rapidly cooling by other means.
- (9) These values apply to thickness less than  $\frac{3}{16}$  in.
- (10) These values apply to thickness from  $\frac{3}{16}$  in. up to and including  $\frac{3}{4}$  in.
- (11) These values apply to thickness more than  $\frac{3}{4}$  in.
- (12) All filler metal, including consumable insert material, shall comply with the requirements of Section IX of the ASME Boiler and Pressure Vessel Code.
- (13) These values ( $E=1.00$ ) apply only to Class WX or WU fittings (all welds radiographed or ultrasonically examined).
- (14) This alloy is subject to severe loss of impact strength at room temperature after exposure in the range of 1,000°F to 1,400°F.
- (15) The minimum tensile strength of reduced tension specimens in accordance with QW-462.1 of Section IX shall not be less than 110,000 psi.
- (16) These values apply to material with a thickness of greater than 4 in. prior to machining or fabricating.
- (17) These values apply to material with a maximum thickness of 4 in. prior to machining or fabricating.
- (18) For service at 1,200°F or higher, the deposited weld metal shall be of the same nominal chemistry as the base metal.
- (19) Heat treatment after fabrication and forming is neither required nor prohibited. If heat treatment is performed, the material shall be heated for a sufficient time in the range of 2,010°F to 2,100°F followed by quenching in water or rapidly cooled by another means.
- (20) Welding electrodes or filler metal used for welding UNS N08926 shall conform to SFA-5.11 ENiCrMo-3 or ENiCrMo-4, or SFA-5.14 ERNiCrMo-3 or ERNiCrMo-4.
- (21) These values apply to thicknesses  $\frac{3}{16}$  in. or less.
- (22) These values apply to thicknesses greater than  $\frac{3}{16}$  in.

Table A-5 begins on the next page.

ASMENORMDOC.COM : Click to view the full PDF of ASME B31.1 2012

Table A-5 Cast Iron

| Spec. No.                | Class    | Notes        | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|--------------------------|----------|--------------|--------------------------------|------------------------------|--------|
| <b>Gray Cast Iron</b>    |          |              |                                |                              |        |
| A48                      | 20       | (1)(2)(3)(4) | 20                             | ...                          | ...    |
|                          | 25       | (1)(2)(3)(4) | 25                             | ...                          | ...    |
|                          | 30       | (1)(2)(3)(4) | 30                             | ...                          | ...    |
|                          | 35       | (1)(2)(3)(4) | 35                             | ...                          | ...    |
|                          | 40       | (1)(2)(3)(4) | 40                             | ...                          | ...    |
|                          | 45       | (1)(2)(3)(4) | 45                             | ...                          | ...    |
|                          | 50       | (1)(2)(3)(4) | 50                             | ...                          | ...    |
|                          | 55       | (1)(2)(3)(4) | 55                             | ...                          | ...    |
| A126                     | 60       | (1)(2)(3)(4) | 60                             | ...                          | ...    |
|                          | A        | (3)(4)(7)    | 21                             | ...                          | ...    |
|                          | B        | (3)(4)(7)    | 31                             | ...                          | ...    |
| A278                     | C        | (3)(4)(7)    | 41                             | ...                          | ...    |
|                          | 20       | (2)(4)(5)    | 20                             | ...                          | ...    |
|                          | 25       | (2)(4)(5)    | 25                             | ...                          | ...    |
|                          | 30       | (2)(4)(5)    | 30                             | ...                          | ...    |
|                          | 35       | (2)(4)(5)    | 35                             | ...                          | ...    |
|                          | 40       | (2)(4)(5)    | 40                             | ...                          | ...    |
|                          | 45       | (2)(4)(5)    | 45                             | ...                          | ...    |
|                          | 50       | (2)(4)(5)    | 50                             | ...                          | ...    |
|                          | 55       | (2)(4)(5)    | 55                             | ...                          | ...    |
| A395                     | 60       | (2)(4)(5)    | 60                             | ...                          | ...    |
|                          | 65       | (2)(4)(5)    | 65                             | ...                          | ...    |
| <b>Ductile Cast Iron</b> |          |              |                                |                              |        |
| A395                     | 60-40-18 | (6)(8)       | 60                             | 40                           | 0.80   |
|                          | 65-45-15 | (6)(8)       | 65                             | 45                           | 0.80   |
| A536                     | 60-42-10 | (1)(8)       | 60                             | 42                           | 0.80   |
|                          | 70-50-05 | (1)(8)       | 70                             | 50                           | 0.80   |

## GENERAL NOTES:

- The tabulated specifications are ANSI/ASTM or ASTM. For ASME Boiler and Pressure Vessel Code applications, see related specifications in Section II of the ASME Code.
- The stress values in this Table may be interpolated to determine values for intermediate temperatures.
- Cast iron components shall not be welded during fabrication or assembly as part of the piping system.
- Tensile strengths and allowable stresses shown in "ksi" are "thousands of pounds per square inch."
- The materials listed in this Table shall not be used at design temperatures above those for which allowable stress values are given.
- The tabulated stress values for ductile cast iron materials are  $S \times F$  (material quality factor). Material quality factors are not applicable to other types of cast iron.
- Pressure-temperature ratings of piping components, as published in standards referenced in this Code, may be used for components meeting the requirements of those standards. The allowable stress values given in this Table are for use in designing piping components which are not manufactured in accordance with referenced standards.
- The  $y$  coefficient equals 0.4 [see Table 104.1.2(A)].

**Table A-5 Cast Iron**

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |     |     |     |               |          |                |
|-------------------------------------------------------------------------------------------|------|-----|-----|-----|---------------|----------|----------------|
| -20 to<br>400                                                                             | 450  | 500 | 600 | 650 | -20 to<br>650 | Class    | Spec. No.      |
|                                                                                           |      |     |     |     |               |          | Gray Cast Iron |
| 2.0                                                                                       | ...  | ... | ... | ... | ...           | 20       | A48            |
| 2.5                                                                                       | ...  | ... | ... | ... | ...           | 25       |                |
| 3.0                                                                                       | ...  | ... | ... | ... | ...           | 30       |                |
| 3.5                                                                                       | ...  | ... | ... | ... | ...           | 35       |                |
| 4.0                                                                                       | ...  | ... | ... | ... | ...           | 40       |                |
| 4.5                                                                                       | ...  | ... | ... | ... | ...           | 45       |                |
| 5.0                                                                                       | ...  | ... | ... | ... | ...           | 50       |                |
| 5.5                                                                                       | ...  | ... | ... | ... | ...           | 55       |                |
| 6.0                                                                                       | ...  | ... | ... | ... | ...           | 60       |                |
| 2.1                                                                                       | ...  | ... | ... | ... | ...           | A        | A126           |
| 3.1                                                                                       | ...  | ... | ... | ... | ...           | B        |                |
| 4.1                                                                                       | ...  | ... | ... | ... | ...           | C        |                |
| 2.0                                                                                       | 2.0  | ... | ... | ... | ...           | 20       | A278           |
| 2.5                                                                                       | 2.5  | ... | ... | ... | ...           | 25       |                |
| 3.0                                                                                       | 3.0  | ... | ... | ... | ...           | 30       |                |
| 3.5                                                                                       | 3.5  | ... | ... | ... | ...           | 35       |                |
| ...                                                                                       | ...  | ... | ... | ... | 4.0           | 40       |                |
| ...                                                                                       | ...  | ... | ... | ... | 4.5           | 45       |                |
| ...                                                                                       | ...  | ... | ... | ... | 5.0           | 50       |                |
| ...                                                                                       | ...  | ... | ... | ... | 5.5           | 55       |                |
| ...                                                                                       | ...  | ... | ... | ... | 6.0           | 60       |                |
|                                                                                           |      |     |     |     |               |          |                |
| ...                                                                                       | ...  | ... | ... | ... | 9.6           | 60-40-18 | A395           |
| 10.4                                                                                      | 10.4 | ... | ... | ... | ...           | 65-45-15 |                |
| ...                                                                                       | ...  | ... | ... | ... | 4.8           | 60-42-10 | A536           |
| ...                                                                                       | ...  | ... | ... | ... | 5.6           | 70-50-05 |                |

**NOTES:**

- (1) THIS MATERIAL IS NOT ACCEPTABLE FOR BOILER EXTERNAL PIPING — SEE FIGS. 100.1.2(A) AND (B).
- (2) Material quality factors are not applicable to these materials.
- (3) For saturated steam at 250 psi (406°F), the stress values given at 400°F may be used.
- (4) For limitations on the use of this material, see para. 124.4.
- (5) This material shall not be used where the design pressure exceeds 250 psig [1 725 kPa (gage)] or where the design temperature exceeds 450°F (230°C).
- (6) This material shall not be used for boiler external piping where the design pressure exceeds 350 psig [2 415 kPa (gage)] or where the design temperature exceeds 450°F (230°C).
- (7) Piping components conforming to either ASME B16.1 or ASME B16.4 may be used for boiler external piping, subject to all the requirements of the particular standard.
- (8) For limitations on the use of this material, see para. 124.6.

Table A-6 Copper and Copper Alloys

| Spec. No.                     | UNS Alloy No.          | Temper or Condition | Size or Thickness, in. | P-No. | Notes  | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|-------------------------------|------------------------|---------------------|------------------------|-------|--------|--------------------------------|------------------------------|--------|
| <b>Seamless Pipe and Tube</b> |                        |                     |                        |       |        |                                |                              |        |
| B42                           | C10200, C12000, C12200 | Annealed            | ...                    | 31    | (2)    | 30                             | 9                            | 1.00   |
|                               | C10200, C12000, C12200 | Drawn               | 2 & under              | 31    | (2)(4) | 45                             | 40                           | 1.00   |
|                               | C10200, C12000, C12200 | Drawn               | Over 2 to 12           | 31    | (2)(4) | 36                             | 30                           | 1.00   |
| B43                           | C23000                 | Annealed            | ...                    | 31    | (2)    | 40                             | 12                           | 1.00   |
|                               | C23000                 | Drawn               | ...                    | 31    | (2)(4) | 40                             | 18                           | 1.00   |
| B68                           | C10200, C12000, C12200 | Annealed            | ...                    | 31    | (1)    | 30                             | 9                            | 1.00   |
| B75                           | C10200, C12000, C12200 | Annealed            | ...                    | 31    | (2)    | 30                             | 9                            | 1.00   |
|                               | C10200, C12000, C12200 | Light drawn         | ...                    | 31    | (2)(4) | 36                             | 30                           | 1.00   |
|                               | C10200, C12000, C12200 | Hard drawn          | ...                    | 31    | (2)(4) | 45                             | 40                           | 1.00   |
| B88                           | C10200, C12000, C12200 | Annealed            | ...                    | 31    | (1)    | 30                             | 9                            | 1.00   |
|                               | C10200, C12000, C12200 | Drawn               | ...                    | 31    | (1)(4) | 36                             | 30                           | 1.00   |
| B111                          | C10200, C12000         | Light drawn         | ...                    | 31    | (1)(3) | 36                             | 30                           | 1.00   |
|                               | C10200, C12000         | Hard drawn          | ...                    | 31    | (1)(3) | 45                             | 40                           | 1.00   |
|                               | C12200, C14200         | Light drawn         | ...                    | 31    | (1)(3) | 36                             | 30                           | 1.00   |
|                               | C12200, C14200         | Hard drawn          | ...                    | 31    | (1)(3) | 45                             | 40                           | 1.00   |
| B111                          | C23000                 | Annealed            | ...                    | 32    | (1)    | 40                             | 12                           | 1.00   |
|                               | C28000                 | Annealed            | ...                    | 32    | (2)    | 50                             | 20                           | 1.00   |
|                               | C44300, C44400, C44500 | Annealed            | ...                    | 32    | (2)    | 45                             | 15                           | 1.00   |
|                               | C60800                 | Annealed            | ...                    | 35    | (1)    | 50                             | 19                           | 1.00   |
| B111                          | C68700                 | Annealed            | ...                    | 32    | (1)    | 50                             | 18                           | 1.00   |
|                               | C70400                 | Annealed            | ...                    | 34    | (1)    | 38                             | 12                           | 1.00   |
|                               | C70400                 | Light drawn         | ...                    | 34    | (1)(4) | 40                             | 30                           | 1.00   |
| B111                          | C70600                 | Annealed            | ...                    | 34    | (2)    | 40                             | 15                           | 1.00   |
|                               | C71000                 | Annealed            | ...                    | 34    | (2)    | 45                             | 16                           | 1.00   |
|                               | C71500                 | Annealed            | ...                    | 34    | (2)    | 52                             | 18                           | 1.00   |
| B280                          | C12200                 | Annealed            | ...                    | 31    | (1)    | 30                             | 9                            | 1.00   |
|                               | C12200                 | Drawn               | ...                    | 31    | (1)(4) | 36                             | 30                           | 1.00   |
| B302                          | C12000, C12200         | Drawn               | ...                    | 31    | (1)(3) | 36                             | 30                           | 1.00   |
| B315                          | C61300, C61400         | Annealed            | ...                    | 35    | (1)    | 65                             | 28                           | 1.00   |
| B466                          | C70600                 | Annealed            | ...                    | 34    | (1)    | 38                             | 13                           | 1.00   |
|                               | C71500                 | Annealed            | ...                    | 34    | (1)    | 52                             | 18                           | 1.00   |
| <b>Welded Pipe and Tube</b>   |                        |                     |                        |       |        |                                |                              |        |
| B467                          | C70600                 | Annealed            | 4½ & under             | 34    | (1)    | 40                             | 15                           | 0.85   |
|                               | C70600                 | Annealed            | Over 4½                | 34    | (1)    | 38                             | 13                           | 0.85   |
|                               | C71500                 | Annealed            | 4½ & under             | 34    | (1)    | 50                             | 20                           | 0.85   |
|                               | C71500                 | Annealed            | Over 4½                | 34    | (1)    | 45                             | 15                           | 0.85   |
| B608                          | C61300, C61400         | Annealed            | ...                    | 35    | (1)(6) | 70                             | 30                           | 0.80   |
| <b>Plate</b>                  |                        |                     |                        |       |        |                                |                              |        |
| B171                          | C70600                 | Annealed            | 2½ & under             | 34    | (1)    | 40                             | 15                           | 1.00   |
|                               | C70600                 | Hot rolled          | 2½ & under             | 34    | (1)    | 40                             | 15                           | 1.00   |
|                               | C71500                 | Annealed            | 2½ & under             | 34    | (1)    | 50                             | 20                           | 1.00   |
|                               | C71500                 | Annealed            | Over 2½ to 5           | 34    | (1)    | 45                             | 18                           | 1.00   |

Table A-6 Copper and Copper Alloys

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |      |      |     |     |                        | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|-----|-----|------------------------|--------------|
| -20<br>to<br>100                                                                          | 150  | 200  | 250  | 300  | 350  | 400  | 450  | 500  | 550  | 600  | 650  | 700  | 750 | 800 | UNS Alloy No.          |              |
| Seamless Pipe and Tube                                                                    |      |      |      |      |      |      |      |      |      |      |      |      |     |     |                        |              |
| 6.0                                                                                       | 5.1  | 4.9  | 4.8  | 4.7  | 4.0  | 3.0  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | C10200, C12000, C12200 | B42          |
| 12.9                                                                                      | 12.9 | 12.9 | 12.9 | 12.5 | 11.8 | 4.3  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | C10200, C12000, C12200 |              |
| 10.3                                                                                      | 10.3 | 10.3 | 10.3 | 10.0 | 9.7  | 9.4  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | C10200, C12000, C12200 |              |
| 8.0                                                                                       | 8.0  | 8.0  | 8.0  | 8.0  | 7.0  | 5.0  | 2.0  | ...  | ...  | ...  | ...  | ...  | ... | ... | C23000                 | B43          |
| 8.0                                                                                       | 8.0  | 8.0  | 8.0  | 8.0  | 7.0  | 5.0  | 2.0  | ...  | ...  | ...  | ...  | ...  | ... | ... | C23000                 |              |
| 6.0                                                                                       | 5.1  | 4.9  | 4.8  | 4.7  | 4.0  | 3.0  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | C10200, C12000, C12200 | B68          |
| 6.0                                                                                       | 5.1  | 4.9  | 4.8  | 4.7  | 4.0  | 3.0  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | C10200, C12000, C12200 | B75          |
| 10.3                                                                                      | 10.3 | 10.3 | 10.3 | 10.0 | 9.7  | 9.4  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | C10200, C12000, C12200 |              |
| 12.9                                                                                      | 12.9 | 12.9 | 12.9 | 12.5 | 11.8 | 4.3  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | C10200, C12000, C12200 |              |
| 6.0                                                                                       | 5.1  | 4.9  | 4.8  | 4.7  | 4.0  | 3.0  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | C10200, C12000, C12200 | B88          |
| 10.3                                                                                      | 10.3 | 10.3 | 10.3 | 10.0 | 9.7  | 9.4  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | C10200, C12000, C12200 |              |
| 10.3                                                                                      | 10.3 | 10.3 | 10.3 | 10.0 | 9.7  | 9.4  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | C10200, C12000         | B111         |
| 12.9                                                                                      | 12.9 | 12.9 | 12.9 | 12.5 | 11.8 | 4.3  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | C10200, C12000         |              |
| 10.3                                                                                      | 10.3 | 10.3 | 10.3 | 10.0 | 9.7  | 9.4  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | C12200, C14200         |              |
| 12.9                                                                                      | 12.9 | 12.9 | 12.9 | 12.5 | 11.8 | 4.3  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | C12200, C14200         |              |
| 8.0                                                                                       | 8.0  | 8.0  | 8.0  | 8.0  | 7.0  | 5.0  | 2.0  | ...  | ...  | ...  | ...  | ...  | ... | ... | C23000                 | B111         |
| 13.3                                                                                      | 13.3 | 13.3 | 13.3 | 13.3 | 10.8 | 5.3  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | C28000                 |              |
| 10.0                                                                                      | 10.0 | 10.0 | 10.0 | 10.0 | 9.8  | 3.5  | 2.0  | ...  | ...  | ...  | ...  | ...  | ... | ... | C44300, C44400, C44500 |              |
| 12.7                                                                                      | 12.2 | 12.2 | 12.2 | 12.0 | 10.0 | 6.0  | 4.0  | 2.0  | ...  | ...  | ...  | ...  | ... | ... | C60800                 |              |
| 12.0                                                                                      | 11.9 | 11.8 | 11.7 | 11.7 | 6.5  | 3.3  | 1.8  | ...  | ...  | ...  | ...  | ...  | ... | ... | C68700                 | B111         |
| 8.0                                                                                       | 8.0  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | C70400                 |              |
| 11.4                                                                                      | 11.4 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | C70400                 |              |
| 10.0                                                                                      | 9.7  | 9.5  | 9.3  | 9.0  | 8.8  | 8.7  | 8.5  | 8.0  | 7.0  | 6.0  | ...  | ...  | ... | ... | C70600                 | B111         |
| 10.7                                                                                      | 10.6 | 10.5 | 10.4 | 10.2 | 10.1 | 9.9  | 9.6  | 9.3  | 8.9  | 8.4  | 7.7  | 7.0  | ... | ... | C71000                 |              |
| 12.0                                                                                      | 11.6 | 11.3 | 11.0 | 10.8 | 10.5 | 10.3 | 10.1 | 9.9  | 9.8  | 9.6  | 9.5  | 9.4  | ... | ... | C71500                 |              |
| 6.0                                                                                       | 5.1  | 4.9  | 4.8  | 4.7  | 4.0  | 3.0  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | C12200                 | B280         |
| 10.3                                                                                      | 10.3 | 10.3 | 10.3 | 10.0 | 9.7  | 9.4  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | C12200                 |              |
| 10.3                                                                                      | 10.3 | 10.3 | 10.3 | 10.0 | 9.7  | 9.4  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | C12000, C12200         | B302         |
| 18.6                                                                                      | 18.6 | 18.5 | 18.3 | 18.2 | 18.1 | 17.9 | 17.5 | 17.0 | ...  | ...  | ...  | ...  | ... | ... | C61300, C61400         | B315         |
| 8.7                                                                                       | 8.4  | 8.2  | 8.0  | 7.8  | 7.7  | 7.5  | 7.4  | 7.3  | 7.0  | 6.0  | ...  | ...  | ... | ... | C70600                 | B466         |
| 12.0                                                                                      | 11.6 | 11.3 | 11.0 | 10.8 | 10.5 | 10.3 | 10.1 | 9.9  | 9.8  | 9.6  | 9.5  | 9.4  | ... | ... | C71500                 |              |
| Welded Pipe and Tube                                                                      |      |      |      |      |      |      |      |      |      |      |      |      |     |     |                        |              |
| 8.5                                                                                       | 8.3  | 8.1  | 7.9  | 7.7  | 7.5  | 7.4  | 7.2  | 6.3  | 5.7  | 4.3  | ...  | ...  | ... | ... | C70600                 | B467         |
| 7.4                                                                                       | 7.2  | 7.0  | 6.8  | 6.7  | 6.5  | 6.4  | 6.3  | 6.2  | 5.7  | 4.3  | ...  | ...  | ... | ... | C70600                 |              |
| 11.3                                                                                      | 10.9 | 10.7 | 10.4 | 10.2 | 10.0 | 9.7  | 9.6  | 9.4  | 9.2  | 9.1  | ...  | ...  | ... | ... | C71500                 |              |
| 8.5                                                                                       | 8.2  | 8.0  | 7.8  | 7.6  | 7.5  | 7.3  | 7.2  | 7.0  | 6.9  | 6.8  | ...  | ...  | ... | ... | C71500                 |              |
| 16.0                                                                                      | 15.9 | 15.8 | 15.7 | 15.6 | 15.5 | 15.4 | 15.1 | 14.6 | ...  | ...  | ...  | ...  | ... | ... | C61300, C61400         | B608         |
| Plate                                                                                     |      |      |      |      |      |      |      |      |      |      |      |      |     |     |                        |              |
| 10.0                                                                                      | 9.7  | 9.5  | 9.3  | 9.0  | 8.8  | 8.7  | 8.5  | 8.0  | 7.0  | 6.0  | ...  | ...  | ... | ... | C70600                 | B171         |
| 10.0                                                                                      | 9.7  | 9.5  | 9.3  | 9.0  | 8.8  | 8.7  | 8.5  | 8.0  | 7.0  | 6.0  | ...  | ...  | ... | ... | C70600                 |              |
| 13.3                                                                                      | 12.9 | 12.6 | 12.3 | 12.0 | 11.7 | 11.5 | 11.2 | 11.0 | 10.8 | 10.7 | 10.6 | 10.4 | ... | ... | C71500                 |              |
| 12.0                                                                                      | 11.6 | 11.3 | 11.0 | 10.8 | 10.5 | 10.3 | 10.1 | 9.9  | 9.8  | 9.6  | 9.5  | 9.4  | ... | ... | C71500                 |              |

Table A-6 Copper and Copper Alloys (Cont'd)

| Spec. No.                         | UNS Alloy No. | Temper or Condition | Size or Thickness, in. | P-No. | Notes        | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|-----------------------------------|---------------|---------------------|------------------------|-------|--------------|--------------------------------|------------------------------|--------|
| <b>(12) Rod</b>                   |               |                     |                        |       |              |                                |                              |        |
| B16                               | C36000        | Annealed            | 1 & under              | ...   | (2)(3)(7)(8) | 48                             | 20                           | 1.00   |
|                                   | C36000        | Annealed            | Over 1 to 2            | ...   | (2)(3)(7)(8) | 44                             | 18                           | 1.00   |
|                                   | C36000        | Annealed            | Over 2                 | ...   | (2)(3)(7)(8) | 40                             | 15                           | 1.00   |
| B151                              | C71500        | Annealed            | Over 1                 | 34    | (1)          | 45                             | 18                           | 1.00   |
| B453                              | C35300        | Annealed            | Under 1/2              | ...   | (2)(3)(7)(8) | 46                             | 16                           | 1.00   |
|                                   | C35300        | Annealed            | 1/2 to 1               | ...   | (2)(3)(7)(8) | 44                             | 15                           | 1.00   |
|                                   | C35300        | Annealed            | Over 1                 | ...   | (2)(3)(7)(8) | 40                             | 15                           | 1.00   |
| <b>(12) Bar</b>                   |               |                     |                        |       |              |                                |                              |        |
| B16                               | C36000        | Annealed            | 1 & under              | ...   | (2)(3)(7)(8) | 44                             | 18                           | 1.00   |
|                                   | C36000        | Annealed            | Over 1                 | ...   | (2)(3)(7)(8) | 40                             | 15                           | 1.00   |
| <b>Die Forgings (Hot Pressed)</b> |               |                     |                        |       |              |                                |                              |        |
| B283                              | C37700        | As forged           | 1 1/2 & under          | ...   | (1)(3)       | 50                             | 18                           | 1.00   |
|                                   | C37700        | As forged           | Over 1 1/2             | ...   | (1)(3)       | 46                             | 15                           | 1.00   |
| <b>Castings</b>                   |               |                     |                        |       |              |                                |                              |        |
| B61                               | C92200        | As cast             | ...                    | ...   | ...          | 34                             | 16                           | 0.80   |
| B62                               | C83600        | As cast             | ...                    | ...   | ...          | 30                             | 14                           | 0.80   |
| B148                              | C95200        | As cast             | ...                    | 35    | (1)          | 65                             | 25                           | 0.80   |
|                                   | C95400        | As cast             | ...                    | 35    | (1)(5)       | 75                             | 30                           | 0.80   |
| B584                              | C92200        | As cast             | ...                    | ...   | ...          | 34                             | 16                           | 0.80   |
|                                   | C93700        | As cast             | ...                    | ...   | (3)          | 30                             | 12                           | 0.80   |
|                                   | C97600        | As cast             | ...                    | ...   | (3)          | 40                             | 17                           | 0.80   |

## GENERAL NOTES:

- The tabulated specifications are ANSI/ASTM or ASTM. For ASME Boiler and Pressure Vessel Code applications, see related specifications in Section II of the ASME Code.
- The stress values in this Table may be interpolated to determine values for intermediate temperatures.
- The P-Numbers listed in this Table are identical to those adopted by the ASME Boiler and Pressure Vessel Code. Qualification of welding procedures, welders, and welding operators is required and shall comply with the ASME Boiler and Pressure Vessel Code, Section IX, except as modified by para. 127.5.
- Tensile strengths and allowable stresses shown in "ksi" are "thousands of pounds per square inch."
- The materials listed in this Table shall not be used at design temperatures above those for which allowable stress values are given. However, for saturated steam at 250 psi (406°F), the allowable stress values given for 400°F may be used.
- The tabulated stress values are  $S \times E$  (weld joint efficiency factor) or  $S \times F$  (material quality factor), as applicable. Weld joint efficiency factors are shown in Table 102.4.3.
- Pressure-temperature ratings of piping components, as published in standards referenced in this Code, may be used for components meeting the requirements of those standards. The allowable stress values given in this Table are for use in designing piping components that are not manufactured in accordance with referenced standards.
- For limitations on the use of copper and copper alloys for flammable liquids and gases, refer to paras. 122.7, 122.8, and 124.7.
- The  $y$  coefficient equals 0.4 [see Table 104.1.2(A)].
- The tabulated stress values that are shown in italics are at temperatures in the range where creep and stress rupture strength govern the selection of stresses.

**Table A-6 Copper and Copper Alloys (Cont'd)**

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |     |     |     |     |     |     |        | UNS Alloy No. | Spec. No.                  |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|-----|-----|-----|-----|-----|-----|--------|---------------|----------------------------|
| -20 to 100                                                                                | 150  | 200  | 250  | 300  | 350  | 400  | 450  | 500  | 550 | 600 | 650 | 700 | 750 | 800 |        |               |                            |
|                                                                                           |      |      |      |      |      |      |      |      |     |     |     |     |     |     |        |               |                            |
|                                                                                           |      |      |      |      |      |      |      |      |     |     |     |     |     |     |        |               | Rod (12)                   |
| 13.3                                                                                      | 12.6 | 12.0 | 11.5 | 11.1 | 10.7 | 5.3  | 2.0  | ...  | ... | ... | ... | ... | ... | ... | C36000 | B16           |                            |
| 12.0                                                                                      | 11.3 | 10.8 | 10.4 | 10.0 | 9.7  | 5.3  | 2.0  | ...  | ... | ... | ... | ... | ... | ... | C36000 |               |                            |
| 10.0                                                                                      | 9.4  | 9.0  | 8.7  | 8.3  | 8.1  | 5.3  | 2.0  | ...  | ... | ... | ... | ... | ... | ... | C36000 |               |                            |
| 12.0                                                                                      | 11.6 | 11.3 | 11.0 | 10.8 | 10.5 | 10.3 | 10.1 | 9.9  | 9.8 | 9.6 | 9.5 | 9.4 | ... | ... | C71500 | B151          |                            |
| 10.7                                                                                      | 10.1 | 9.6  | 9.2  | 8.9  | 8.6  | 5.3  | 2.0  | ...  | ... | ... | ... | ... | ... | ... | C35300 | B453          |                            |
| 10.0                                                                                      | 9.4  | 9.0  | 8.7  | 8.3  | 8.1  | 5.3  | 2.0  | ...  | ... | ... | ... | ... | ... | ... | C35300 |               |                            |
| 10.0                                                                                      | 9.4  | 9.0  | 8.7  | 8.3  | 8.1  | 5.3  | 2.0  | ...  | ... | ... | ... | ... | ... | ... | C35300 |               |                            |
|                                                                                           |      |      |      |      |      |      |      |      |     |     |     |     |     |     |        |               | Bar (12)                   |
| 12.0                                                                                      | 11.3 | 10.8 | 10.4 | 10.0 | 9.7  | 5.3  | 2.0  | ...  | ... | ... | ... | ... | ... | ... | C36000 | B16           |                            |
| 10.0                                                                                      | 9.4  | 9.0  | 8.7  | 8.3  | 8.1  | 5.3  | 2.0  | ...  | ... | ... | ... | ... | ... | ... | C36000 |               |                            |
|                                                                                           |      |      |      |      |      |      |      |      |     |     |     |     |     |     |        |               | Die Forgings (Hot Pressed) |
| 12.0                                                                                      | 11.3 | 10.8 | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | ... | ... | ... | ... | C37700 | B283          |                            |
| 10.0                                                                                      | 9.4  | 9.0  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | ... | ... | ... | ... | C37700 |               |                            |
|                                                                                           |      |      |      |      |      |      |      |      |     |     |     |     |     |     |        |               | Castings                   |
| 7.8                                                                                       | 7.8  | 7.8  | 7.8  | 7.8  | 7.8  | 6.6  | 6.2  | 5.8  | 4.0 | ... | ... | ... | ... | ... | C92200 | B61           |                            |
| 6.9                                                                                       | 6.9  | 6.9  | 6.9  | 6.6  | 6.5  | 5.5  | 5.4  | ...  | ... | ... | ... | ... | ... | ... | C83600 | B62           |                            |
| 13.4                                                                                      | 12.6 | 12.2 | 11.8 | 11.6 | 11.4 | 11.4 | 11.4 | 11.4 | 9.4 | 5.9 | ... | ... | ... | ... | C95200 | B148          |                            |
| 16.0                                                                                      | 15.2 | 15.0 | 14.8 | 14.8 | 14.8 | 14.8 | 12.8 | 11.1 | 8.8 | 6.8 | ... | ... | ... | ... | C95400 |               |                            |
| 7.8                                                                                       | 7.8  | 7.8  | 7.8  | 7.8  | 7.8  | 6.6  | 6.2  | 5.8  | 4.0 | ... | ... | ... | ... | ... | C92200 | B584          |                            |
| 6.4                                                                                       | 5.9  | 5.5  | 5.3  | 5.3  | 5.2  | 5.1  | ...  | ...  | ... | ... | ... | ... | ... | ... | C93700 |               |                            |
| 6.0                                                                                       | 5.8  | 5.6  | 5.5  | 5.4  | ...  | ...  | ...  | ...  | ... | ... | ... | ... | ... | ... | C97600 |               |                            |

**NOTES:**

- (1) THIS MATERIAL IS NOT ACCEPTABLE FOR USE ON BOILER EXTERNAL PIPING — SEE FIGS. 100.1.2(A) and (B).
- (2) This material may be used for Boiler External Piping provided that the nominal size does not exceed 3 in. and the design temperature does not exceed 406°F. This material shall not be used for blowoff or blowdown piping except as permitted in para. 122.1.4. Where threaded brass or copper pipe is used for feedwater piping, it shall have a wall thickness not less than that required for schedule 80 steel pipe of the same nominal size.
- (3) Welding or brazing of this material is not permitted.
- (4) When this material is used for welded or brazed construction, the allowable stress values used shall not exceed those given for the same material in the annealed condition.
- (5) Castings that are welded or repair welded shall be heat treated at 1,150°F–1,200°F, followed by moving-air cooling. The required time at temperature is based on the cross-section thicknesses as follows:
  - (a) 1½ hr for the first inch or fraction thereof
  - (b) ½ hr for each additional inch or fraction thereof
- (6) Welds must be made by an electric fusion welding process involving the addition of filler metal.
- (12) (7) Material conforming to ASTM B16 alloy C36000 shall not be used in primary pressure relief valve applications.
- (12) (8) Materials shall be tested to determine the presence of residual stresses that might result in failure of individual parts due to stress corrosion cracking. Tests shall be conducted in accordance with ASTM B154 or ASTM B858. The test frequency shall be as specified in ASTM B249.

Table A-7 Aluminum and Aluminum Alloys

| Spec. No.                                               | UNS Alloy No. | Temper        | Size or Thickness, in. | P-No. | Notes          | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|---------------------------------------------------------|---------------|---------------|------------------------|-------|----------------|--------------------------------|------------------------------|--------|
| <b>Drawn Seamless Tube</b>                              |               |               |                        |       |                |                                |                              |        |
| B210                                                    | A93003        | O             | 0.010 to 0.500         | 21    | (1)            | 14                             | 5                            | 1.00   |
|                                                         | A93003        | H14           | 0.010 to 0.500         | 21    | (1)(3)         | 20                             | 17                           | 1.00   |
|                                                         | Alclad A93003 | O             | 0.010 to 0.500         | 21    | (1)(4)         | 13                             | 4.5                          | 1.00   |
|                                                         | Alclad A93003 | H14           | 0.010 to 0.500         | 21    | (1)(3)(4)      | 19                             | 16                           | 1.00   |
| B210                                                    | A95050        | O             | 0.018 to 0.500         | 21    | (1)            | 18                             | 6                            | 1.00   |
|                                                         | Alclad A95050 | O             | 0.018 to 0.500         | 21    | (1)(13)(23)    | 17                             | ...                          | 1.00   |
|                                                         | A96061        | T4            | 0.025 to 0.500         | 23    | (1)(6)         | 30                             | 16                           | 1.00   |
|                                                         | A96061        | T6            | 0.025 to 0.500         | 23    | (1)(6)         | 42                             | 35                           | 1.00   |
|                                                         | A96061        | T4, T6 welded | 0.025 to 0.500         | 23    | (1)(7)         | 24                             | 10                           | 1.00   |
|                                                         |               |               |                        |       |                |                                |                              |        |
| <b>Seamless Pipe and Seamless Extruded Tube</b>         |               |               |                        |       |                |                                |                              |        |
| B241                                                    | A93003        | O             | All                    | 21    | (1)            | 14                             | 5                            | 1.00   |
|                                                         | A93003        | H18           | Less than 1.000        | 21    | (1)(3)         | 27                             | 24                           | 1.00   |
| B241                                                    | A93003        | H112          | Note (20)              | 21    | (1)(3)(20)     | 14                             | 5                            | 1.00   |
|                                                         | Alclad A93003 | O             | All                    | 21    | (1)(4)         | 13                             | 4.5                          | 1.00   |
|                                                         | Alclad A93003 | H112          | All                    | 21    | (1)(3)(4)      | 13                             | 4.5                          | 1.00   |
| B241                                                    | A95083        | O             | All                    | 25    | (1)(8)         | 39                             | 16                           | 1.00   |
|                                                         | A95083        | H112          | All                    | 25    | (1)(8)         | 39                             | 16                           | 1.00   |
|                                                         | A95454        | O             | Up thru 5.000          | 22    | (1)            | 31                             | 12                           | 1.00   |
|                                                         | A95454        | H112          | Up thru 5.000          | 22    | (1)            | 31                             | 12                           | 1.00   |
| B241                                                    | A96061        | T4            | All                    | 23    | (1)(6)(9)      | 26                             | 16                           | 1.00   |
|                                                         | A96061        | T6            | Under 1 in. dia.       | 23    | (1)(2)(5)      | 42                             | 35                           | 1.00   |
|                                                         | A96061        | T6            | All                    | 23    | (1)(6)(9)      | 38                             | 35                           | 1.00   |
|                                                         | A96061        | T4, T6 welded | All                    | 23    | (1)(7)(9)      | 24                             | 10                           | 1.00   |
|                                                         | A96063        | T6            | Note (10)              | 23    | (1)(6)(10)     | 30                             | 25                           | 1.00   |
|                                                         | A96063        | T5, T6 welded | Note (10)              | 23    | (1)(7)(10)     | 17                             | 10                           | 1.00   |
| <b>Drawn Seamless Condenser and Heat Exchanger Tube</b> |               |               |                        |       |                |                                |                              |        |
| B234                                                    | A93003        | H14           | 0.010 to 0.200         | 21    | (1)(2)         | 20                             | 17                           | 1.00   |
|                                                         | Alclad A93003 | H14           | 0.010 to 0.200         | 21    | (1)(2)(4)      | 19                             | 16                           | 1.00   |
|                                                         | A95454        | H34           | 0.010 to 0.200         | 22    | (1)(2)         | 39                             | 29                           | 1.00   |
| B234                                                    | A96061        | T4            | 0.025 to 0.200         | 23    | (1)(6)         | 30                             | 16                           | 1.00   |
|                                                         | A96061        | T6            | 0.025 to 0.200         | 23    | (1)(6)         | 42                             | 35                           | 1.00   |
|                                                         | A96061        | T4, T6 welded | 0.025 to 0.200         | 23    | (1)(7)         | 24                             | 10                           | 1.00   |
| <b>Arc-Welded Round Tube</b>                            |               |               |                        |       |                |                                |                              |        |
| B547                                                    | A93003        | O             | 0.125 to 0.500         | 21    | (1)(15)        | 14                             | 5                            | 1.00   |
|                                                         | A93003        | O             | 0.125 to 0.500         | 21    | (1)(16)        | 14                             | 5                            | 0.85   |
|                                                         | A93003        | H112          | 0.250 to 0.400         | 21    | (1)(14)(15)    | 17                             | 10                           | 1.00   |
|                                                         | A93003        | H112          | 0.250 to 0.400         | 21    | (1)(14)(16)    | 17                             | 10                           | 0.85   |
| B547                                                    | Alclad A93003 | O             | 0.125 to 0.499         | 21    | (1)(4)(15)     | 13                             | 4.5                          | 1.00   |
|                                                         | Alclad A93003 | O             | 0.125 to 0.499         | 21    | (1)(4)(16)     | 13                             | 4.5                          | 0.85   |
|                                                         | Alclad A93003 | H112          | 0.250 to 0.499         | 21    | (1)(4)(14)(15) | 16                             | 9                            | 1.00   |
|                                                         | Alclad A93003 | H112          | 0.250 to 0.499         | 21    | (1)(4)(14)(16) | 16                             | 9                            | 0.85   |

**Table A-7 Aluminum and Aluminum Alloys**

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |     |     |     |     |               |
|-------------------------------------------------------------------------------------------|------|------|-----|-----|-----|-----|---------------|
| -20<br>to<br>100                                                                          | 150  | 200  | 250 | 300 | 350 | 400 | UNS Alloy No. |
| Drawn Seamless Tube                                                                       |      |      |     |     |     |     |               |
| 3.4                                                                                       | 3.4  | 3.4  | 3.0 | 2.4 | 1.8 | 1.4 | A93003        |
| 5.7                                                                                       | 5.7  | 5.7  | 4.9 | 4.3 | 3.0 | 2.4 | A93003        |
| 3.0                                                                                       | 3.0  | 3.0  | 2.7 | 2.2 | 1.6 | 1.3 | Alclad A93003 |
| 5.1                                                                                       | 5.1  | 5.1  | 4.5 | 3.9 | 2.7 | 2.1 | Alclad A93003 |
| 4.0                                                                                       | 4.0  | 4.0  | 4.0 | 4.0 | 2.8 | 1.4 | A95050        |
| 3.3                                                                                       | 3.3  | 3.3  | 3.3 | 3.3 | 2.8 | 1.4 | Alclad A95050 |
| 8.6                                                                                       | 8.6  | 8.6  | 7.4 | 6.9 | 6.3 | 4.5 | A96061        |
| 12.0                                                                                      | 12.0 | 12.0 | 9.9 | 8.4 | 6.3 | 4.5 | A96061        |
| 6.0                                                                                       | 6.0  | 6.0  | 5.9 | 5.5 | 4.6 | 3.5 | A96061        |
| Seamless Pipe and Seamless Extruded Tube                                                  |      |      |     |     |     |     |               |
| 3.4                                                                                       | 3.4  | 3.4  | 3.0 | 2.4 | 1.8 | 1.4 | A93003        |
| 7.8                                                                                       | 7.8  | 7.7  | 6.3 | 5.4 | 3.5 | 2.5 | A93003        |
| 3.4                                                                                       | 3.4  | 3.4  | 3.0 | 2.4 | 1.8 | 1.4 | A93003        |
| 3.0                                                                                       | 3.0  | 3.0  | 2.7 | 2.2 | 1.6 | 1.2 | Alclad A93003 |
| 3.0                                                                                       | 3.0  | 3.0  | 2.7 | 2.2 | 1.6 | 1.2 | Alclad A93003 |
| 10.7                                                                                      | 10.7 | ...  | ... | ... | ... | ... | A95083        |
| 10.7                                                                                      | 10.7 | ...  | ... | ... | ... | ... | A95083        |
| 8.0                                                                                       | 8.0  | 8.0  | 7.5 | 5.5 | 4.1 | 3.0 | A95454        |
| 8.0                                                                                       | 8.0  | 8.0  | 7.5 | 5.5 | 4.1 | 3.0 | A95454        |
| 7.4                                                                                       | 7.4  | 7.4  | 6.4 | 6.0 | 5.8 | 4.5 | A96061        |
| 12.0                                                                                      | 12.0 | 12.0 | 9.9 | 8.4 | 6.3 | 4.5 | A96061        |
| 10.9                                                                                      | 10.9 | 10.9 | 9.1 | 7.9 | 6.3 | 4.5 | A96061        |
| 6.0                                                                                       | 6.0  | 6.0  | 5.9 | 5.5 | 4.6 | 3.5 | A96061        |
| 8.6                                                                                       | 8.6  | 8.6  | 6.8 | 5.0 | 3.4 | 2.0 | A96063        |
| 4.3                                                                                       | 4.3  | 4.3  | 4.2 | 3.9 | 3.0 | 2.0 | A96063        |
| Drawn Seamless Condenser and Heat Exchanger Tube                                          |      |      |     |     |     |     |               |
| 5.7                                                                                       | 5.7  | 5.7  | 4.9 | 4.3 | 3.0 | 2.4 | A93003        |
| 5.1                                                                                       | 5.1  | 5.1  | 4.5 | 3.9 | 2.7 | 2.1 | Alclad A93003 |
| 11.1                                                                                      | 11.1 | 11.1 | 7.5 | 5.5 | 4.1 | 3.0 | A95454        |
| 8.6                                                                                       | 8.6  | 8.6  | 7.4 | 6.9 | 6.3 | 4.5 | A96061        |
| 12.0                                                                                      | 12.0 | 12.0 | 9.9 | 8.4 | 6.3 | 4.5 | A96061        |
| 6.0                                                                                       | 6.0  | 6.0  | 5.9 | 5.5 | 4.6 | 3.5 | A96061        |
| Arc-Welded Round Tube                                                                     |      |      |     |     |     |     |               |
| 3.4                                                                                       | 3.4  | 3.4  | 3.0 | 2.4 | 1.8 | 1.4 | A93003        |
| 2.9                                                                                       | 2.9  | 2.9  | 2.6 | 2.0 | 1.5 | 1.2 | A93003        |
| 4.9                                                                                       | 4.9  | 4.9  | 4.0 | 3.6 | 3.0 | 2.4 | A93003        |
| 4.2                                                                                       | 4.2  | 4.2  | 3.4 | 3.1 | 2.6 | 2.0 | A93003        |
| 3.0                                                                                       | 3.0  | 3.0  | 2.7 | 2.2 | 1.6 | 1.3 | Alclad A93003 |
| 2.6                                                                                       | 2.6  | 2.6  | 2.3 | 1.9 | 1.4 | 1.1 | Alclad A93003 |
| 4.6                                                                                       | 4.6  | 4.6  | 2.7 | 2.2 | 1.6 | 1.3 | Alclad A93003 |
| 3.9                                                                                       | 3.9  | 3.9  | 2.3 | 1.9 | 1.4 | 1.1 | Alclad A93003 |

(12)

**Table A-7 Aluminum and Aluminum Alloys (Cont'd)**

| Spec. No.                             | UNS Alloy No. | Temper      | Size or Thickness, in. | P-No. | Notes          | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|---------------------------------------|---------------|-------------|------------------------|-------|----------------|--------------------------------|------------------------------|--------|
| <b>Arc-Welded Round Tube (Cont'd)</b> |               |             |                        |       |                |                                |                              |        |
| B547                                  | A95083        | O           | 0.125 to 0.500         | 25    | (1)(8)(15)     | 40                             | 18                           | 1.00   |
|                                       | A95083        | O           | 0.125 to 0.500         | 25    | (1)(8)(16)     | 40                             | 18                           | 0.85   |
| B547                                  | A95454        | O           | 0.125 to 0.500         | 22    | (1)(15)        | 31                             | 12                           | 1.00   |
|                                       | A95454        | O           | 0.125 to 0.500         | 22    | (1)(16)        | 31                             | 12                           | 0.85   |
|                                       | A95454        | H112        | 0.250 to 0.499         | 22    | (1)(14)(15)    | 32                             | 18                           | 1.00   |
|                                       | A95454        | H112        | 0.250 to 0.499         | 22    | (1)(14)(16)    | 32                             | 18                           | 0.85   |
| B547                                  | A96061        | T4          | 0.125 to 0.249         | 23    | (1)(7)(15)(17) | 30                             | 16                           | 1.00   |
|                                       | A96061        | T4          | 0.125 to 0.249         | 23    | (1)(7)(16)(17) | 30                             | 16                           | 0.85   |
|                                       | A96061        | T451        | 0.250 to 0.500         | 23    | (1)(7)(15)(17) | 30                             | 16                           | 1.00   |
|                                       | A96061        | T451        | 0.250 to 0.500         | 23    | (1)(7)(16)(17) | 30                             | 16                           | 0.85   |
| B547                                  | A96061        | T6          | 0.125 to 0.249         | 23    | (1)(7)(15)(17) | 42                             | 35                           | 1.00   |
|                                       | A96061        | T6          | 0.125 to 0.249         | 23    | (1)(7)(16)(17) | 42                             | 35                           | 0.85   |
|                                       | A96061        | T651        | 0.250 to 0.500         | 23    | (1)(7)(15)(17) | 42                             | 35                           | 1.00   |
|                                       | A96061        | T651        | 0.250 to 0.500         | 23    | (1)(7)(16)(17) | 42                             | 35                           | 0.85   |
| <b>Sheet and Plate</b>                |               |             |                        |       |                |                                |                              |        |
| B209                                  | A93003        | O           | 0.051 to 3.000         | 21    | (1)            | 14                             | 5                            | 1.00   |
|                                       | A93003        | H112        | 0.250 to 0.499         | 21    | (1)(3)         | 17                             | 10                           | 1.00   |
|                                       | A93003        | H112        | 0.500 to 2.000         | 21    | (1)(3)         | 15                             | 6                            | 1.00   |
| B209                                  | Alclad A93003 | O           | 0.051 to 0.499         | 21    | (1)(4)         | 13                             | 4.5                          | 1.00   |
|                                       | Alclad A93003 | O           | 0.500 to 3.000         | 21    | (1)(18)        | 14                             | 5                            | 1.00   |
|                                       | Alclad A93003 | H112        | 0.250 to 0.499         | 21    | (1)(3)(4)      | 16                             | 9                            | 1.00   |
|                                       | Alclad A93003 | H112        | 0.500 to 2.000         | 21    | (1)(3)(19)     | 15                             | 6                            | 1.00   |
| B209                                  | A95083        | O           | 0.051 to 1.500         | 25    | (1)(8)         | 40                             | 18                           | 1.00   |
|                                       | A95454        | O           | 0.051 to 3.000         | 22    | (1)            | 31                             | 12                           | 1.00   |
|                                       | A95454        | H112        | 0.250 to 0.499         | 22    | (1)(3)         | 32                             | 18                           | 1.00   |
|                                       | A95454        | H112        | 0.500 to 3.000         | 22    | (1)(3)         | 31                             | 12                           | 1.00   |
| B209                                  | A96061        | T4          | 0.051 to 0.249         | 23    | (1)(6)(9)      | 30                             | 16                           | 1.00   |
|                                       | A96061        | T451        | 0.250 to 3.000         | 23    | (1)(6)(9)      | 30                             | 16                           | 1.00   |
|                                       | A96061        | T4 welded   | 0.051 to 0.249         | 23    | (1)(7)(9)      | 24                             | 10                           | 1.00   |
|                                       | A96061        | T451 welded | 0.250 to 3.000         | 23    | (1)(7)(9)      | 24                             | 10                           | 1.00   |
| B209                                  | A96061        | T6          | 0.051 to 0.249         | 23    | (1)(6)(9)      | 42                             | 35                           | 1.00   |
|                                       | A96061        | T651        | 0.250 to 4.000         | 23    | (1)(6)(9)      | 42                             | 35                           | 1.00   |
|                                       | A96061        | T651        | 4.001 to 6.000         | 23    | (1)(6)(9)      | 40                             | 35                           | 1.00   |
|                                       | A96061        | T6 welded   | 0.051 to 0.249         | 23    | (1)(7)(9)      | 24                             | 10                           | 1.00   |
|                                       | A96061        | T651 welded | 0.250 to 6.000         | 23    | (1)(7)(9)      | 24                             | 10                           | 1.00   |
|                                       | A96061        | T651 welded | 0.250 to 6.000         | 23    | (1)(7)(9)      | 24                             | 10                           | 1.00   |
| <b>Die and Hand Forgings</b>          |               |             |                        |       |                |                                |                              |        |
| B247                                  | A93003        | H112        | Up thru 4.000          | 21    | (1)(11)        | 14                             | 5                            | 1.00   |
|                                       | A93003        | H112 welded | Up thru 4.000          | 21    | (1)(7)(11)     | 14                             | 5                            | 1.00   |

**Table A-7 Aluminum and Aluminum Alloys (Cont'd)**

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |     |     |     |     |               |              |
|-------------------------------------------------------------------------------------------|------|------|-----|-----|-----|-----|---------------|--------------|
| -20<br>to<br>100                                                                          | 150  | 200  | 250 | 300 | 350 | 400 | UNS Alloy No. | Spec.<br>No. |
| Arc-Welded Round Tube (Cont'd)                                                            |      |      |     |     |     |     |               |              |
| 11.4                                                                                      | 11.4 | ...  | ... | ... | ... | ... | A95083        | B547         |
| 9.7                                                                                       | 9.7  | ...  | ... | ... | ... | ... | A95083        |              |
| 8.0                                                                                       | 8.0  | 8.0  | 7.5 | 5.5 | 4.1 | 3.0 | A95454        | B547         |
| 6.8                                                                                       | 6.8  | 6.8  | 6.4 | 4.7 | 3.5 | 2.6 | A95454        |              |
| 9.1                                                                                       | 9.1  | 9.1  | 7.5 | 5.5 | 4.1 | 3.0 | A95454        |              |
| 7.8                                                                                       | 7.8  | 7.8  | 6.4 | 4.7 | 3.5 | 2.6 | A95454        |              |
| 8.6                                                                                       | 8.6  | 8.6  | 7.4 | 6.9 | 6.3 | 4.5 | A96061        | B547         |
| 7.3                                                                                       | 7.3  | 7.3  | 6.3 | 5.9 | 5.4 | 3.8 | A96061        |              |
| 8.6                                                                                       | 8.6  | 8.6  | 7.4 | 6.9 | 6.3 | 4.5 | A96061        |              |
| 7.3                                                                                       | 7.3  | 7.3  | 6.3 | 5.9 | 5.4 | 3.8 | A96061        |              |
| 12.0                                                                                      | 12.0 | 12.0 | 9.9 | 8.4 | 6.3 | 4.5 | A96061        | B547         |
| 10.2                                                                                      | 10.2 | 10.2 | 8.4 | 7.1 | 5.4 | 3.8 | A96061        |              |
| 12.0                                                                                      | 12.0 | 12.0 | 9.9 | 8.4 | 6.3 | 4.5 | A96061        |              |
| 10.2                                                                                      | 10.2 | 10.2 | 8.4 | 7.1 | 5.4 | 3.8 | A96061        |              |
| Sheet and Plate                                                                           |      |      |     |     |     |     |               |              |
| 3.4                                                                                       | 3.4  | 3.4  | 3.0 | 2.4 | 1.8 | 1.4 | A93003        | B209         |
| 4.9                                                                                       | 4.9  | 4.9  | 4.0 | 3.6 | 3.0 | 2.4 | A93003        |              |
| 3.8                                                                                       | 3.8  | 3.7  | 3.2 | 2.4 | 1.8 | 1.4 | A93003        |              |
| 3.0                                                                                       | 3.0  | 3.0  | 2.7 | 2.2 | 1.6 | 1.3 | Alclad A93003 | B209         |
| 3.0                                                                                       | 3.0  | 3.0  | 2.7 | 2.2 | 1.6 | 1.3 | Alclad A93003 |              |
| 4.3                                                                                       | 4.3  | 4.3  | 3.8 | 3.3 | 2.7 | 2.1 | Alclad A93003 |              |
| 3.9                                                                                       | 3.9  | 3.9  | 3.0 | 2.2 | 1.6 | 1.3 | Alclad A93003 |              |
| 11.4                                                                                      | 11.4 | ...  | ... | ... | ... | ... | A95083        | B209         |
| 8.0                                                                                       | 8.0  | 8.0  | 7.5 | 5.5 | 4.1 | 3.0 | A95454        |              |
| 9.1                                                                                       | 9.1  | 9.1  | 7.5 | 5.5 | 4.1 | 3.0 | A95454        |              |
| 8.0                                                                                       | 8.0  | 8.0  | 7.5 | 5.5 | 4.1 | 3.0 | A95454        |              |
| 8.6                                                                                       | 8.6  | 8.6  | 7.4 | 6.9 | 6.3 | 4.5 | A96061        | B209         |
| 8.6                                                                                       | 8.6  | 8.6  | 7.4 | 6.9 | 6.3 | 4.5 | A96061        |              |
| 6.0                                                                                       | 6.0  | 6.0  | 5.9 | 5.5 | 4.6 | 3.5 | A96061        |              |
| 6.0                                                                                       | 6.0  | 6.0  | 5.9 | 5.5 | 4.6 | 3.5 | A96061        |              |
| 12.0                                                                                      | 12.0 | 12.0 | 9.9 | 8.4 | 6.3 | 4.5 | A96061        | B209         |
| 12.0                                                                                      | 12.0 | 12.0 | 9.9 | 8.4 | 6.3 | 4.5 | A96061        |              |
| 11.4                                                                                      | 11.4 | 11.4 | 9.6 | 8.2 | 6.3 | 4.4 | A96061        |              |
| 6.0                                                                                       | 6.0  | 6.0  | 5.9 | 5.5 | 4.6 | 3.5 | A96061        |              |
| 6.0                                                                                       | 6.0  | 6.0  | 5.9 | 5.5 | 4.6 | 3.5 | A96061        |              |
| Die and Hand Forgings                                                                     |      |      |     |     |     |     |               |              |
| 3.4                                                                                       | 3.4  | 3.4  | 3.0 | 2.4 | 1.8 | 1.4 | A93003        | B247         |
| 3.4                                                                                       | 3.4  | 3.4  | 3.0 | 2.4 | 1.8 | 1.4 | A93003        |              |

**Table A-7 Aluminum and Aluminum Alloys (Cont'd)**

| Spec. No.                             | UNS Alloy No. | Temper            | Size or Thickness, in. | P-No. | Notes             | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|---------------------------------------|---------------|-------------------|------------------------|-------|-------------------|--------------------------------|------------------------------|--------|
| <b>Die and Hand Forgings (Cont'd)</b> |               |                   |                        |       |                   |                                |                              |        |
| B247                                  | A95083        | H111              | Up thru 4.000          | 25    | (1)(6)(8)         | 39                             | 20                           | 1.00   |
|                                       | A95083        | H112              | Up thru 4.000          | 25    | (1)(6)(8)         | 39                             | 16                           | 1.00   |
|                                       | A95083        | H111, H112 welded | Up thru 4.000          | 25    | (1)(7)(8)         | 38                             | 16                           | 1.00   |
| B247                                  | A96061        | T6                | Up thru 4.000          | 23    | (1)(6)(11)        | 38                             | 35                           | 1.00   |
|                                       | A96061        | T6                | Up thru 4.000          | 23    | (1)(6)(12)        | 37                             | 33                           | 1.00   |
|                                       | A96061        | T6                | 4.001 to 8.000         | 23    | (1)(6)(12)        | 35                             | 32                           | 1.00   |
|                                       | A96061        | T6 welded         | Up thru 8.000          | 23    | (1)(7)            | 24                             | 10                           | 1.00   |
| <b>Rods, Bars, and Shapes</b>         |               |                   |                        |       |                   |                                |                              |        |
| B221                                  | A91060        | O                 | All                    | 21    | (1)(21)(22)       | 8.5                            | 2.5                          | 1.00   |
|                                       | A91060        | H112              | All                    | 21    | (1)(3)(21)(22)    | 8.5                            | 2.5                          | 1.00   |
| B221                                  | A91100        | O                 | All                    | 21    | (1)(21)(22)       | 11                             | 3                            | 1.00   |
|                                       | A91100        | H112              | All                    | 21    | (1)(3)(21)(22)    | 11                             | 3                            | 1.00   |
| B221                                  | A93003        | O                 | All                    | 21    | (1)(21)(22)       | 14                             | 5                            | 1.00   |
|                                       | A93003        | H112              | All                    | 21    | (1)(3)(21)(22)    | 14                             | 5                            | 1.00   |
| B221                                  | A92024        | T3                | Up thru 0.249          | ...   | (1)(2)(9)(21)(22) | 57                             | 42                           | 1.00   |
|                                       | A92024        | T3                | 0.250–0.749            | ...   | (1)(2)(9)(21)(22) | 60                             | 44                           | 1.00   |
|                                       | A92024        | T3                | 0.750–1.499            | ...   | (1)(2)(9)(21)(22) | 65                             | 46                           | 1.00   |
|                                       | A92024        | T3                | 1.500 and over         | ...   | (1)(2)(9)(21)(22) | 68                             | 48                           | 1.00   |
| B221                                  | A95083        | O                 | Up thru 5.000          | 25    | (1)(8)(21)(22)    | 39                             | 16                           | 1.00   |
|                                       | A95083        | H111              | Up thru 5.000          | 25    | (1)(3)(8)(21)(22) | 40                             | 24                           | 1.00   |
|                                       | A95083        | H112              | Up thru 5.000          | 25    | (1)(3)(8)(21)(22) | 39                             | 16                           | 1.00   |
| B221                                  | A95086        | H112              | Up thru 5.000          | 25    | (1)(2)(8)(21)(22) | 35                             | 14                           | 1.00   |
| B221                                  | A95154        | O                 | All                    | 22    | (1)(8)(21)(22)    | 30                             | 11                           | 1.00   |
|                                       | A95154        | H112              | All                    | 22    | (1)(3)(8)(21)(22) | 30                             | 11                           | 1.00   |
| B221                                  | A95454        | O                 | Up thru 5.000          | 22    | (1)(21)(22)       | 31                             | 12                           | 1.00   |
|                                       | A95454        | H111              | Up thru 5.000          | 22    | (1)(3)(21)(22)    | 33                             | 19                           | 1.00   |
|                                       | A95454        | H112              | Up thru 5.000          | 22    | (1)(3)(21)(22)    | 31                             | 12                           | 1.00   |
| B221                                  | A95456        | O                 | Up thru 5.000          | 25    | (1)(8)(21)(22)    | 41                             | 19                           | 1.00   |
|                                       | A95456        | H111              | Up thru 5.000          | 25    | (1)(3)(8)(21)(22) | 42                             | 26                           | 1.00   |
|                                       | A95456        | H112              | Up thru 5.000          | 25    | (1)(3)(8)(21)(22) | 41                             | 19                           | 1.00   |
| B221                                  | A96061        | T4                | All                    | 23    | (1)(2)(9)(21)(22) | 26                             | 16                           | 1.00   |
|                                       | A96061        | T6                | All                    | 23    | (1)(2)(9)(21)(22) | 38                             | 35                           | 1.00   |
|                                       | A96061        | T4 welded         | All                    | 23    | (1)(7)(9)(21)(22) | 24                             | 10                           | 1.00   |
|                                       | A96061        | T6 welded         | All                    | 23    | (1)(7)(9)(21)(22) | 24                             | 10                           | 1.00   |

**Table A-7 Aluminum and Aluminum Alloys (Cont'd)**

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |     |     |               |              |
|-------------------------------------------------------------------------------------------|------|------|------|------|-----|-----|---------------|--------------|
| –20<br>to<br>100                                                                          | 150  | 200  | 250  | 300  | 350 | 400 | UNS Alloy No. | Spec.<br>No. |
| Die and Hand Forgings (Cont'd)                                                            |      |      |      |      |     |     |               |              |
| 11.1                                                                                      | 11.1 | ...  | ...  | ...  | ... | ... | A95083        | B247         |
| 10.7                                                                                      | 10.7 | ...  | ...  | ...  | ... | ... | A95083        |              |
| 10.9                                                                                      | 10.9 | ...  | ...  | ...  | ... | ... | A95083        |              |
| 10.9                                                                                      | 10.9 | 10.9 | 9.1  | 7.9  | 6.3 | 4.5 | A96061        | B247         |
| 10.6                                                                                      | 10.6 | 10.6 | 8.8  | 7.7  | 6.3 | 4.5 | A96061        |              |
| 10.0                                                                                      | 10.0 | 10.0 | 8.4  | 7.4  | 6.1 | 4.5 | A96061        |              |
| 6.0                                                                                       | 6.0  | 6.0  | 5.9  | 5.5  | 4.6 | 3.5 | A96061        |              |
| Rods, Bars, and Shapes                                                                    |      |      |      |      |     |     |               |              |
| 1.7                                                                                       | 1.7  | 1.6  | 1.5  | 1.3  | 1.1 | 0.8 | A91060        | B221         |
| 1.7                                                                                       | 1.7  | 1.6  | 1.5  | 1.3  | 1.1 | 0.8 | A91060        |              |
| 2.0                                                                                       | 2.0  | 2.0  | 2.0  | 1.8  | 1.4 | 1.0 | A91100        | B221         |
| 2.0                                                                                       | 2.0  | 2.0  | 2.0  | 1.8  | 1.4 | 1.0 | A91100        |              |
| 3.4                                                                                       | 3.4  | 3.4  | 3.0  | 2.4  | 1.8 | 1.4 | A93003        | B221         |
| 3.4                                                                                       | 3.4  | 3.4  | 3.0  | 2.4  | 1.8 | 1.4 | A93003        |              |
| 16.3                                                                                      | 16.3 | 16.3 | 12.6 | 9.5  | 6.0 | 4.2 | A92024        | B221         |
| 17.1                                                                                      | 17.1 | 17.1 | 13.2 | 10.0 | 6.3 | 4.4 | A92024        |              |
| 18.6                                                                                      | 18.6 | 18.6 | 14.3 | 10.8 | 6.8 | 4.7 | A92024        |              |
| 19.4                                                                                      | 19.4 | 19.4 | 15.0 | 11.3 | 7.1 | 5.0 | A92024        |              |
| 10.7                                                                                      | 10.7 | ...  | ...  | ...  | ... | ... | A95083        | B221         |
| 11.4                                                                                      | 11.4 | ...  | ...  | ...  | ... | ... | A95083        |              |
| 10.7                                                                                      | 10.7 | ...  | ...  | ...  | ... | ... | A95083        |              |
| 9.3                                                                                       | 9.3  | ...  | ...  | ...  | ... | ... | A95086        | B221         |
| 7.3                                                                                       | 7.3  | ...  | ...  | ...  | ... | ... | A95154        | B221         |
| 7.3                                                                                       | 7.3  | ...  | ...  | ...  | ... | ... | A95154        |              |
| 8.0                                                                                       | 8.0  | 8.0  | 7.5  | 5.5  | 4.1 | 3.0 | A95454        | B221         |
| 9.4                                                                                       | 9.4  | 9.4  | 7.5  | 5.5  | 4.1 | 3.0 | A95454        |              |
| 8.0                                                                                       | 8.0  | 8.0  | 7.5  | 5.5  | 4.1 | 3.0 | A95454        |              |
| 11.7                                                                                      | 11.7 | ...  | ...  | ...  | ... | ... | A95456        | B221         |
| 12.0                                                                                      | 12.0 | ...  | ...  | ...  | ... | ... | A95456        |              |
| 11.7                                                                                      | 11.7 | ...  | ...  | ...  | ... | ... | A95456        |              |
| 7.4                                                                                       | 7.4  | 7.4  | 6.4  | 6.0  | 5.8 | 4.5 | A96061        | B221         |
| 10.9                                                                                      | 10.9 | 10.9 | 9.1  | 7.9  | 6.3 | 4.5 | A96061        |              |
| 6.0                                                                                       | 6.0  | 6.0  | 5.9  | 5.5  | 4.6 | 3.5 | A96061        |              |
| 6.0                                                                                       | 6.0  | 6.0  | 5.9  | 5.5  | 4.6 | 3.5 | A96061        |              |

**Table A-7 Aluminum and Aluminum Alloys (Cont'd)**

| Spec. No.                              | UNS Alloy No. | Temper        | Size or Thickness, in. | P-No. | Notes          | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|----------------------------------------|---------------|---------------|------------------------|-------|----------------|--------------------------------|------------------------------|--------|
| <b>Rods, Bars, and Shapes (Cont'd)</b> |               |               |                        |       |                |                                |                              |        |
| B221                                   | A96063        | T1            | Up thru 0.500          | 23    | (1)(2)(21)(22) | 17                             | 9                            | 1.00   |
|                                        | A96063        | T1            | 0.501–1.000            | 23    | (1)(2)(21)(22) | 16                             | 8                            | 1.00   |
|                                        | A96063        | T5            | Up thru 0.500          | 23    | (1)(2)(21)(22) | 22                             | 16                           | 1.00   |
|                                        | A96063        | T5            | 0.501–1.000            | 23    | (1)(2)(21)(22) | 21                             | 15                           | 1.00   |
|                                        | A96063        | T6            | Up thru 1.000          | 23    | (1)(2)(21)(22) | 30                             | 25                           | 1.00   |
|                                        | A96063        | T5, T6 welded | Up thru 1.000          | 23    | (1)(7)(21)(22) | 17                             | 10                           | 1.00   |
| <b>Castings</b>                        |               |               |                        |       |                |                                |                              |        |
| B26                                    | A24430        | F             | ...                    | ...   | (1)(2)         | 17                             | 6                            | 0.80   |
|                                        | A03560        | T6            | ...                    | ...   | (1)(2)         | 30                             | 20                           | 0.80   |
|                                        | A03560        | T71           | ...                    | ...   | (1)(2)         | 25                             | 18                           | 0.80   |

**GENERAL NOTES:**

- The tabulated specifications are ANSI/ASTM or ASTM. For ASME Boiler and Pressure Vessel Code applications, see related specifications in Section II of the ASME Code.
- The stress values in this Table may be interpolated to determine values for intermediate temperatures.
- The P-Numbers listed in this Table are identical to those adopted by the ASME Boiler and Pressure Vessel Code. Qualification of welding procedures, welders, and welding operators is required and shall comply with the ASME Boiler and Pressure Vessel Code, Section IX, except as modified by para. 127.5.
- Tensile strengths and allowable stresses shown in “ksi” are “thousands of pounds per square inch.”
- The materials listed in this Table shall not be used at design temperatures above those for which allowable stress values are given.
- The tabulated stress values are  $S \times E$  (weld joint efficiency factor) or  $S \times F$  (material quality factor), as applicable. Weld joint efficiency factors are shown in Table 102.4.3.
- Pressure-temperature ratings of piping components, as published in standards referenced in this Code, may be used for components meeting the requirements of those standards. The allowable stress values given in this Table are for use in designing piping components that are not manufactured in accordance with referenced standards.
- Aluminum and aluminum alloys shall not be used for flammable fluids within the boiler plant structure (see para. 122.7).
- The  $\gamma$  coefficient equals 0.4 [see Table 104.1.2(A)].
- The tabulated stress values that are shown in *italics* are at temperatures in the range where creep and stress rupture strength govern the selection of stresses.

**NOTES:**

- THIS MATERIAL IS NOT ACCEPTABLE FOR USE ON BOILER EXTERNAL PIPING — SEE FIGS. 100.1.2(A) and (B).
- These allowable stress values are not applicable when either welding or thermal cutting is employed.
- These allowable stress values are not applicable when either welding or thermal cutting is employed. In such cases, the corresponding stress values for the O temper shall be used.
- These allowable stress values are 90% of those for the corresponding core material.
- These allowable stress values apply only to seamless pipe smaller than NPS 1 that is extruded and then drawn.
- These allowable stress values are not applicable when either welding or thermal cutting is employed. In such cases, the corresponding stress values for the welded condition shall be used.

**Table A-7 Aluminum and Aluminum Alloys (Cont'd)**

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |     |     |     |     |     |     |               |              |
|-------------------------------------------------------------------------------------------|-----|-----|-----|-----|-----|-----|---------------|--------------|
| –20<br>to<br>100                                                                          | 150 | 200 | 250 | 300 | 350 | 400 | UNS Alloy No. | Spec.<br>No. |
| Rods, Bars, and Shapes (Cont'd)                                                           |     |     |     |     |     |     |               |              |
| 4.9                                                                                       | 4.9 | 4.9 | 4.2 | 4.2 | 3.4 | 2.0 | A96063        | B221         |
| 4.6                                                                                       | 4.6 | 4.6 | 4.0 | 4.0 | 3.4 | 2.0 | A96063        |              |
| 6.3                                                                                       | 6.3 | 6.3 | 5.1 | 4.6 | 3.4 | 2.0 | A96063        |              |
| 6.0                                                                                       | 6.0 | 6.0 | 4.9 | 4.3 | 3.4 | 2.0 | A96063        |              |
| 8.6                                                                                       | 8.6 | 8.6 | 6.8 | 5.0 | 3.4 | 2.0 | A96063        |              |
| 4.3                                                                                       | 4.3 | 4.3 | 4.2 | 3.9 | 3.0 | 2.0 | A96063        |              |
| Castings                                                                                  |     |     |     |     |     |     |               |              |
| 3.2                                                                                       | 3.2 | 3.2 | 3.0 | 2.8 | 2.5 | 2.2 | A24430        | B26          |
| 6.9                                                                                       | 6.9 | 6.9 | 5.0 | ... | ... | ... | A03560        |              |
| 5.8                                                                                       | 5.8 | 5.8 | 5.0 | 4.3 | 3.3 | 1.9 | A03560        |              |

**NOTES (Cont'd):**

- (7) The strength of a reduced-section tensile specimen is required to qualify welding procedures. Refer to the ASME Boiler and Pressure Vessel Code, Section IX, QW-150.
- (8) Refer to the ASME Boiler and Pressure Vessel Code, Section VIII, Division 1, Part UNF, NF-13(b) regarding stress corrosion.
- (9) For stress relieved tempers (T351, T3510, T3511, T451, T4510, T4511, T651, T6510, and T6511), stress values for the material in the basic temper shall be used.
- (10) These allowable stress values apply to all thicknesses and sizes of seamless pipe. They also apply to seamless extruded tube in thicknesses up to and including 1.000 in.
- (11) These allowable stress values are for die forgings.
- (12) These allowable stress values are for hand forgings.
- (13) For temperatures up to 300°F, these allowable stress values are 83% of those for the corresponding core material. At temperatures of 350°F and 400°F, these allowable stress values are 90% of those for the corresponding core material.
- (14) These allowable stress values are for the tempers listed in the welded condition and are identical to those for the O temper.
- (15) These allowable stress values are based on 100% radiography of the longitudinal weld in accordance with ASTM B547, para. 11.
- (16) These allowable stress values are based on spot radiography of the longitudinal weld in accordance with ASTM B547, para. 11.
- (17) These allowable stress values are for the heat-treated tempers listed in the welded condition.
- (18) The tension test specimen from plate which is not less than 0.500 in. thick is machined from the core and does not include the cladding alloy. Therefore, the allowable stress values for thicknesses less than 0.500 in. shall be used.
- (19) The tension test specimen from plate which is not less than 0.500 in. thick is machined from the core and does not include the cladding alloy. Therefore, these allowable stress values are 90% of those for the core material of the same thickness.
- (20) The allowable stress values for seamless pipe in sizes NPS 1 and larger are as follows:
 

|       |         |
|-------|---------|
| 100°F | 3.5 ksi |
| 150°F | 3.5 ksi |
| 200°F | 3.4 ksi |
- (21) Stress values in restricted shear, such as in dowel bolts or similar construction in which the shearing member is so restricted that the section under consideration would fail without reduction of area, shall be 0.80 times the values in this Table.
- (22) Stress values in bearing shall be 1.60 times the values in this Table.
- (23) ASTM B210 does not include this alloy/grade of material.

(12)

**Table A-8 Temperatures 1,200°F and Above**

| Spec. No.                                          | Type or Grade | UNS Alloy No. | Temper    | Nominal Composition | P-No. | Notes     | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi |
|----------------------------------------------------|---------------|---------------|-----------|---------------------|-------|-----------|--------------------------------|------------------------------|
| <b>Seamless Pipe and Tube</b>                      |               |               |           |                     |       |           |                                |                              |
| A213                                               | TP304H        | S30409        | ...       | 18Cr-8Ni            | 8     | ...       | 75                             | 30                           |
|                                                    | ...           | S30815        | ...       | 21Cr-11Ni-N         | 8     | (1)       | 87                             | 45                           |
|                                                    | TP310H        | S31009        | ...       | 25Cr-20Ni           | 8     | (2)(4)    | 75                             | 30                           |
|                                                    | TP316H        | S31609        | ...       | 16Cr-12Ni-2Mo       | 8     | ...       | 75                             | 30                           |
|                                                    | TP316L        | S31603        | ...       | 16Cr-12Ni-2Mo       | 8     | (1)       | 70                             | 25                           |
| A213                                               | TP321H        | S32109        | ...       | 18Cr-10Ni-Ti        | 8     | ...       | 75                             | 30                           |
|                                                    | TP347H        | S34709        | ...       | 18Cr-10Ni-Cb        | 8     | ...       | 75                             | 30                           |
|                                                    | TP348H        | S34809        | ...       | 18Cr-10Ni-Cb        | 8     | ...       | 75                             | 30                           |
| A312                                               | TP304H        | S30409        | ...       | 18Cr-8Ni            | 8     | ...       | 75                             | 30                           |
|                                                    | ...           | S30815        | ...       | 21Cr-11Ni-N         | 8     | (1)       | 87                             | 45                           |
|                                                    | TP310H        | S31009        | ...       | 25Cr-20Ni           | 8     | (2)(4)    | 75                             | 30                           |
|                                                    | TP316H        | S31609        | ...       | 16Cr-12Ni-2Mo       | 8     | ...       | 75                             | 30                           |
| A312                                               | TP321H        | S32109        | ...       | 18Cr-10Ni-Ti        | 8     | ...       | 75                             | 30                           |
|                                                    | TP347H        | S34709        | ...       | 18Cr-10Ni-Cb        | 8     | ...       | 75                             | 30                           |
|                                                    | TP348H        | S34809        | ...       | 18Cr-10Ni-Cb        | 8     | ...       | 75                             | 30                           |
| A376                                               | TP304H        | S30409        | ...       | 18Cr-8Ni            | 8     | ...       | 75                             | 30                           |
|                                                    | TP316H        | S31609        | ...       | 16Cr-12Ni-2Mo       | 8     | ...       | 75                             | 30                           |
|                                                    | TP321H        | S32109        | ...       | 18Cr-10Ni-Ti        | 8     | ...       | 75                             | 30                           |
|                                                    | TP347H        | S34709        | ...       | 18Cr-10Ni-Cb        | 8     | ...       | 75                             | 30                           |
| B163                                               | ...           | N08800        | Annealed  | Ni-Cr-Fe            | 45    | (1)       | 75                             | 30                           |
|                                                    | ...           | N08810        | Annealed  | Ni-Cr-Fe            | 45    | (1)       | 65                             | 25                           |
| B167                                               | ...           | N06617        | Annealed  | 52Ni-22Cr-13Co-9Mo  | 43    | ...       | 95                             | 35                           |
| B407                                               | ...           | N08800        | C.D./ann. | Ni-Cr-Fe            | 45    | ...       | 75                             | 30                           |
|                                                    | ...           | N08810        | Annealed  | Ni-Cr-Fe            | 45    | ...       | 65                             | 25                           |
| B622                                               | ...           | R30556        | Annealed  | Ni-Fe-Cr-Co-Mo-W    | 45    | (1)       | 100                            | 45                           |
| <b>Welded Pipe and Tube — Without Filler Metal</b> |               |               |           |                     |       |           |                                |                              |
| A249                                               | TP304H        | S30409        | ...       | 18Cr-8Ni            | 8     | ...       | 75                             | 35                           |
|                                                    | ...           | S30815        | ...       | 21Cr-11Ni-N         | 8     | (1)       | 87                             | 45                           |
|                                                    | TP310H        | S31009        | ...       | 25Cr-20Ni           | 8     | (1)(2)(4) | 75                             | 35                           |
|                                                    | TP316H        | S31609        | ...       | 16Cr-12Ni-2Mo       | 8     | ...       | 75                             | 35                           |
| A249                                               | TP321H        | S32109        | ...       | 18Cr-10Ni-Ti        | 8     | ...       | 75                             | 35                           |
|                                                    | TP347H        | S34709        | ...       | 18Cr-10Ni-Cb        | 8     | ...       | 75                             | 35                           |
|                                                    | TP348H        | S34809        | ...       | 18Cr-10Ni-Cb        | 8     | ...       | 75                             | 35                           |
| A312                                               | TP304H        | S30409        | ...       | 18Cr-8Ni            | 8     | ...       | 75                             | 30                           |
|                                                    | ...           | S30815        | ...       | 21Cr-11Ni-N         | 8     | (1)       | 87                             | 45                           |
|                                                    | TP310H        | S31009        | ...       | 25Cr-20Ni           | 8     | (2)(4)    | 75                             | 30                           |
|                                                    | TP316H        | S31609        | ...       | 16Cr-12Ni-2Mo       | 8     | ...       | 75                             | 30                           |

Table A-8 Temperatures 1,200°F and Above

(12)

| E or<br>F                                   | Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |       |       |       |       |       |       | Type or<br>Grade | Spec.<br>No. |
|---------------------------------------------|-------------------------------------------------------------------------------------------|-------|-------|-------|-------|-------|-------|------------------|--------------|
|                                             | 1,200                                                                                     | 1,250 | 1,300 | 1,350 | 1,400 | 1,450 | 1,500 |                  |              |
| Seamless Pipe and Tube                      |                                                                                           |       |       |       |       |       |       |                  |              |
| 1.00                                        | 6.1                                                                                       | 4.7   | 3.7   | 2.9   | 2.3   | 1.8   | 1.4   | TP304H           | A213         |
| 1.00                                        | 5.2                                                                                       | 4.0   | 3.1   | 2.4   | 1.9   | 1.6   | 1.3   | ...              |              |
| 1.00                                        | 4.0                                                                                       | 3.0   | 2.2   | 1.7   | 1.3   | 0.97  | 0.75  | TP310H           |              |
| 1.00                                        | 7.4                                                                                       | 5.5   | 4.1   | 3.1   | 2.3   | 1.7   | 1.3   | TP316H           |              |
| 1.00                                        | 6.4                                                                                       | 4.7   | 3.5   | 2.5   | 1.8   | 1.3   | 1.0   | TP316L           |              |
| 1.00                                        | 5.4                                                                                       | 4.1   | 3.2   | 2.5   | 1.9   | 1.5   | 1.1   | TP321H           | A213         |
| 1.00                                        | 7.9                                                                                       | 5.9   | 4.4   | 3.2   | 2.5   | 1.8   | 1.3   | TP347H           |              |
| 1.00                                        | 7.9                                                                                       | 5.9   | 4.4   | 3.2   | 2.5   | 1.8   | 1.3   | TP348H           |              |
| 1.00                                        | 6.1                                                                                       | 4.7   | 3.7   | 2.9   | 2.3   | 1.8   | 1.4   | TP304H           | A312         |
| 1.00                                        | 5.2                                                                                       | 4.0   | 3.1   | 2.4   | 1.9   | 1.6   | 1.3   | ...              |              |
| 1.00                                        | 4.0                                                                                       | 3.0   | 2.2   | 1.7   | 1.3   | 0.97  | 0.75  | TP310H           |              |
| 1.00                                        | 7.4                                                                                       | 5.5   | 4.1   | 3.1   | 2.3   | 1.7   | 1.3   | TP316H           |              |
| 1.00                                        | 5.4                                                                                       | 4.1   | 3.2   | 2.5   | 1.9   | 1.5   | 1.1   | TP321H           | A312         |
| 1.00                                        | 7.9                                                                                       | 5.9   | 4.4   | 3.2   | 2.5   | 1.8   | 1.3   | TP347H           |              |
| 1.00                                        | 7.9                                                                                       | 5.9   | 4.4   | 3.2   | 2.5   | 1.8   | 1.3   | TP348H           |              |
| 1.00                                        | 6.1                                                                                       | 4.7   | 3.7   | 2.9   | 2.3   | 1.8   | 1.4   | TP304H           | A376         |
| 1.00                                        | 7.4                                                                                       | 5.5   | 4.1   | 3.1   | 2.3   | 1.7   | 1.3   | TP316H           |              |
| 1.00                                        | 5.4                                                                                       | 4.1   | 3.2   | 2.5   | 1.9   | 1.5   | 1.1   | TP321H           |              |
| 1.00                                        | 7.9                                                                                       | 5.9   | 4.4   | 3.2   | 2.5   | 1.8   | 1.3   | TP347H           |              |
| 1.00                                        | 6.6                                                                                       | 4.2   | 2.0   | 1.6   | 1.1   | 1.0   | 0.80  | ...              | B163         |
| 1.00                                        | 7.4                                                                                       | 5.9   | 4.7   | 3.8   | 3.0   | 2.4   | 1.9   | ...              |              |
| 1.00                                        | 15.3                                                                                      | 14.5  | 11.2  | 8.7   | 6.6   | 5.1   | 3.9   | ...              | B167         |
| 1.00                                        | 6.6                                                                                       | 4.2   | 2.0   | 1.6   | 1.1   | 1.0   | 0.80  | ...              | B407         |
| 1.00                                        | 7.4                                                                                       | 5.9   | 4.7   | 3.8   | 3.0   | 2.4   | 1.9   | ...              |              |
| 1.00                                        | 13.6                                                                                      | 10.9  | 8.8   | 7.0   | 5.6   | 4.5   | 3.6   | R30556           | B622         |
| Welded Pipe and Tube — Without Filler Metal |                                                                                           |       |       |       |       |       |       |                  |              |
| 0.85                                        | 5.2                                                                                       | 4.0   | 3.2   | 2.5   | 2.0   | 1.6   | 1.2   | TP304H           | A249         |
| 0.85                                        | 4.4                                                                                       | 3.4   | 2.6   | 2.0   | 1.6   | 1.4   | 1.1   | ...              |              |
| 0.85                                        | 3.4                                                                                       | 2.6   | 1.9   | 1.4   | 1.1   | 0.82  | 0.64  | TP310H           |              |
| 0.85                                        | 6.3                                                                                       | 4.7   | 3.5   | 2.6   | 1.9   | 1.5   | 1.1   | TP316H           |              |
| 0.85                                        | 4.6                                                                                       | 3.5   | 2.7   | 2.1   | 1.6   | 1.3   | 1.0   | TP321H           | A249         |
| 0.85                                        | 6.7                                                                                       | 5.0   | 3.7   | 2.7   | 2.1   | 1.6   | 1.1   | TP347H           |              |
| 0.85                                        | 6.7                                                                                       | 5.0   | 3.7   | 2.7   | 2.1   | 1.6   | 1.1   | TP348H           |              |
| 0.85                                        | 5.2                                                                                       | 4.0   | 3.2   | 2.5   | 2.0   | 1.6   | 1.2   | TP304H           | A312         |
| 0.85                                        | 4.4                                                                                       | 3.4   | 2.6   | 2.0   | 1.6   | 1.4   | 1.1   | ...              |              |
| 0.85                                        | 3.4                                                                                       | 2.6   | 1.9   | 1.4   | 1.1   | 0.82  | 0.64  | TP310H           |              |
| 0.85                                        | 6.3                                                                                       | 4.7   | 3.5   | 2.6   | 1.9   | 1.5   | 1.1   | TP316H           |              |

**Table A-8 Temperatures 1,200°F and Above (Cont'd)**

| Spec. No.                                                   | Type or Grade | UNS Alloy No. | Temper   | Nominal Composition | P- No. | Notes     | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi |
|-------------------------------------------------------------|---------------|---------------|----------|---------------------|--------|-----------|--------------------------------|------------------------------|
| <b>Welded Pipe and Tube — Without Filler Metal (Cont'd)</b> |               |               |          |                     |        |           |                                |                              |
| A312                                                        | TP321H        | S32109        | ...      | 18Cr-10Ni-Ti        | 8      | ...       | 75                             | 30                           |
|                                                             | TP347H        | S32709        | ...      | 18Cr-10Ni-Cb        | 8      | ...       | 75                             | 30                           |
| A409                                                        | ...           | S30815        | ...      | 21Cr-11Ni-N         | 8      | (1)       | 87                             | 45                           |
| B619                                                        | ...           | R30556        | Annealed | Ni-Fe-Cr-Co-Mo-W    | 45     | (1)       | 100                            | 45                           |
| B626                                                        | ...           | R30556        | Annealed | Ni-Fe-Cr-Co-Mo-W    | 45     | (1)       | 100                            | 45                           |
| <b>Welded Pipe and Tube — Filler Metal Added</b>            |               |               |          |                     |        |           |                                |                              |
| A358                                                        | 1 & 3         | S30815        | ...      | 21Cr-11Ni-N         | 8      | (1)       | 87                             | 45                           |
|                                                             | 2             | S30815        | ...      | 21Cr-11Ni-N         | 8      | (1)       | 87                             | 45                           |
| A409                                                        | ...           | S30815        | ...      | 21Cr-11Ni-N         | 8      | (1)       | 87                             | 45                           |
| B546                                                        | ...           | N06617        | Annealed | 52Ni-22Cr-13Co-9Mo  | 43     | ...       | 95                             | 35                           |
| <b>Plate</b>                                                |               |               |          |                     |        |           |                                |                              |
| A240                                                        | 304           | S30400        | ...      | 18Cr-8Ni            | 8      | (2)(3)    | 75                             | 30                           |
|                                                             | ...           | S30815        | ...      | 21Cr-11Ni-N         | 8      | (1)       | 87                             | 45                           |
|                                                             | 310S          | S31008        | ...      | 25Cr-20Ni           | 8      | (2)(3)(4) | 75                             | 30                           |
|                                                             | 316           | S31600        | ...      | 16Cr-12Ni-2Mo       | 8      | (2)(3)    | 75                             | 30                           |
|                                                             | 316L          | S31603        | ...      | 16Cr-12Ni-2Mo       | 8      | (1)       | 70                             | 25                           |
| A240                                                        | 321           | S32100        | ...      | 18Cr-10Ni-Ti        | 8      | (2)(3)    | 75                             | 30                           |
|                                                             | 347           | S34700        | ...      | 18Cr-10Ni-Cb        | 8      | (2)(3)    | 75                             | 30                           |
|                                                             | 348           | S34800        | ...      | 18Cr-10Ni-Cb        | 8      | (1)(2)(3) | 75                             | 30                           |
| B168                                                        | ...           | N06617        | Annealed | 52Ni-22Cr-13Co-9Mo  | 43     | ...       | 95                             | 35                           |
| B409                                                        | ...           | N08800        | Annealed | Ni-Cr-Fe            | 45     | (3)       | 75                             | 30                           |
|                                                             | ...           | N08810        | Annealed | Ni-Cr-Fe            | 45     | (3)       | 65                             | 25                           |
| <b>Plate, Sheet, and Strip</b>                              |               |               |          |                     |        |           |                                |                              |
| B435                                                        | ...           | R30556        | Annealed | Ni-Fe-Cr-Co-Mo-W    | 45     | (1)       | 100                            | 45                           |
| <b>Bars, Rods, and Shapes</b>                               |               |               |          |                     |        |           |                                |                              |
| A479                                                        | ...           | S30815        | ...      | 21Cr-11Ni-N         | 8      | (1)       | 87                             | 45                           |
|                                                             | TP316L        | S31603        | ...      | 16Cr-12Ni-2Mo       | 8      | (1)(5)    | 70                             | 25                           |
| B166                                                        | ...           | N06617        | Annealed | 52Ni-22Cr-13Co-9Mo  | 43     | ...       | 95                             | 36                           |
| B408                                                        | ...           | N08800        | Annealed | Ni-Cr-Fe            | 45     | ...       | 75                             | 30                           |
|                                                             | ...           | N08810        | Annealed | Ni-Cr-Fe            | 45     | ...       | 65                             | 25                           |
| B572                                                        | ...           | R30556        | Annealed | Ni-Fe-Cr-Co-Mo-W    | 45     | (1)       | 100                            | 45                           |
| <b>Forgings</b>                                             |               |               |          |                     |        |           |                                |                              |
| A182                                                        | F304H         | S30409        | ...      | 18Cr-8Ni            | 8      | ...       | 75                             | 30                           |
|                                                             | ...           | S30815        | ...      | 21Cr-11Ni-N         | 8      | (1)       | 87                             | 45                           |
|                                                             | F310H         | S31009        | ...      | 25Cr-20Ni           | 8      | (1)(2)(4) | 75                             | 30                           |
|                                                             | F316H         | S31609        | ...      | 16Cr-12Ni-2Mo       | 8      | ...       | 75                             | 30                           |
|                                                             | F316L         | S31603        | ...      | 16Cr-12Ni-2Mo       | 8      | (1)       | 70                             | 25                           |

**Table A-8 Temperatures 1,200°F and Above (Cont'd)**

| <i>E</i> or<br><i>F</i>                              | Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |       |       |       |       |       |       | Type or<br>Grade | Spec.<br>No. |
|------------------------------------------------------|-------------------------------------------------------------------------------------------|-------|-------|-------|-------|-------|-------|------------------|--------------|
|                                                      | 1,200                                                                                     | 1,250 | 1,300 | 1,350 | 1,400 | 1,450 | 1,500 |                  |              |
| Welded Pipe and Tube — Without Filler Metal (Cont'd) |                                                                                           |       |       |       |       |       |       |                  |              |
| 0.85                                                 | 4.6                                                                                       | 3.5   | 2.7   | 2.1   | 1.6   | 1.3   | 1.0   | TP321H           | A312         |
| 0.85                                                 | 6.7                                                                                       | 5.0   | 3.7   | 2.7   | 2.1   | 1.6   | 1.1   | TP347H           |              |
| 0.85                                                 | 4.4                                                                                       | 3.4   | 2.6   | 2.0   | 1.6   | 1.4   | 1.1   | ...              | A409         |
| 0.85                                                 | 11.6                                                                                      | 9.3   | 7.5   | 6.0   | 4.8   | 3.8   | 3.1   | R30556           | B619         |
| 0.85                                                 | 11.6                                                                                      | 9.3   | 7.5   | 6.0   | 4.8   | 3.8   | 3.1   | R30556           | B626         |
| Welded Pipe and Tube — Filler Metal Added            |                                                                                           |       |       |       |       |       |       |                  |              |
| 1.00                                                 | 5.2                                                                                       | 4.0   | 3.1   | 2.4   | 1.9   | 1.6   | 1.3   | 1 & 3            | A358         |
| 0.90                                                 | 4.7                                                                                       | 3.6   | 2.8   | 2.2   | 1.7   | 1.4   | 1.2   | 2                |              |
| 0.80                                                 | 4.2                                                                                       | 3.2   | 2.5   | 1.9   | 1.5   | 1.3   | 1.0   | ...              | A409         |
| 0.85                                                 | 13.0                                                                                      | 12.3  | 9.5   | 7.4   | 5.6   | 4.3   | 3.3   | ...              | B546         |
| Plate                                                |                                                                                           |       |       |       |       |       |       |                  |              |
| 1.00                                                 | 6.1                                                                                       | 4.7   | 3.7   | 2.9   | 2.3   | 1.8   | 1.4   | 304              | A240         |
| 1.00                                                 | 5.2                                                                                       | 4.0   | 3.1   | 2.4   | 1.9   | 1.6   | 1.3   | ...              |              |
| 1.00                                                 | 2.5                                                                                       | 1.5   | 0.80  | 0.50  | 0.40  | 0.30  | 0.20  | 310S             |              |
| 1.00                                                 | 7.4                                                                                       | 5.5   | 4.1   | 3.1   | 2.3   | 1.7   | 1.3   | 316              |              |
| 1.00                                                 | 6.4                                                                                       | 4.7   | 3.5   | 2.5   | 1.8   | 1.3   | 1.0   | 316L             |              |
| 1.00                                                 | 3.6                                                                                       | 2.6   | 1.7   | 1.1   | 0.80  | 0.50  | 0.30  | 321              | A240         |
| 1.00                                                 | 4.4                                                                                       | 3.3   | 2.2   | 1.5   | 1.2   | 0.90  | 0.80  | 347              |              |
| 1.00                                                 | 4.4                                                                                       | 3.3   | 2.2   | 1.5   | 1.2   | 0.90  | 0.80  | 348              |              |
| 1.00                                                 | 15.3                                                                                      | 14.5  | 11.2  | 8.7   | 6.6   | 5.1   | 3.9   | ...              | B168         |
| 1.00                                                 | 6.6                                                                                       | 4.2   | 2.0   | 1.6   | 1.1   | 1.0   | 0.80  | ...              | B409         |
| 1.00                                                 | 7.4                                                                                       | 5.9   | 4.7   | 3.8   | 3.0   | 2.4   | 1.9   | ...              |              |
| Plate, Sheet, and Strip                              |                                                                                           |       |       |       |       |       |       |                  |              |
| 1.00                                                 | 13.6                                                                                      | 10.9  | 8.8   | 7.0   | 5.6   | 4.5   | 3.6   | R30556           | B435         |
| Bars, Rods, and Shapes                               |                                                                                           |       |       |       |       |       |       |                  |              |
| 1.00                                                 | 5.2                                                                                       | 4.0   | 3.1   | 2.4   | 1.9   | 1.6   | 1.3   | ...              | A479         |
| 1.00                                                 | 6.4                                                                                       | 4.7   | 3.5   | 2.5   | 1.8   | 1.3   | 1.0   | TP316L           |              |
| 1.00                                                 | 15.3                                                                                      | 14.5  | 11.2  | 8.7   | 6.6   | 5.1   | 3.9   | ...              | B166         |
| 1.00                                                 | 6.6                                                                                       | 4.2   | 2.0   | 1.6   | 1.1   | 1.0   | 0.80  | ...              | B408         |
| 1.00                                                 | 7.4                                                                                       | 5.9   | 4.7   | 3.8   | 3.0   | 2.4   | 1.9   | ...              |              |
| 1.00                                                 | 13.6                                                                                      | 10.9  | 8.8   | 7.0   | 5.6   | 4.5   | 3.6   | R30556           | B572         |
| Forgings                                             |                                                                                           |       |       |       |       |       |       |                  |              |
| 1.00                                                 | 6.1                                                                                       | 4.7   | 3.7   | 2.9   | 2.3   | 1.8   | 1.4   | F304H            | A182         |
| 1.00                                                 | 5.2                                                                                       | 4.0   | 3.1   | 2.4   | 1.9   | 1.6   | 1.3   | ...              |              |
| 1.00                                                 | 4.0                                                                                       | 3.0   | 2.2   | 1.7   | 1.3   | 0.97  | 0.75  | F310H            |              |
| 1.00                                                 | 7.4                                                                                       | 5.5   | 4.1   | 3.1   | 2.3   | 1.7   | 1.3   | F316H            |              |
| 1.00                                                 | 6.4                                                                                       | 4.7   | 3.5   | 2.5   | 1.8   | 1.3   | 1.0   | F316L            |              |

Table A-8 Temperatures 1,200°F and Above (Cont'd)

| Spec. No.                             | Type or Grade | UNS Alloy No. | Temper   | Nominal Composition | P-No. | Notes  | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi |
|---------------------------------------|---------------|---------------|----------|---------------------|-------|--------|--------------------------------|------------------------------|
| <b>Forgings (Cont'd)</b>              |               |               |          |                     |       |        |                                |                              |
| A182                                  | F321H         | S32109        | ...      | 18Cr-10Ni-Ti        | 8     | ...    | 75                             | 30                           |
|                                       | F347H         | S34709        | ...      | 18Cr-10Ni-Cb        | 8     | ...    | 75                             | 30                           |
|                                       | F348H         | S34809        | ...      | 18Cr-10Ni-Cb        | 8     | ...    | 75                             | 30                           |
| B564                                  | ...           | N06617        | Annealed | 52Ni-22Cr-13Co-9Mo  | 43    | ...    | 95                             | 35                           |
|                                       | ...           | N08800        | Annealed | Ni-Cr-Fe            | 45    | ...    | 75                             | 30                           |
|                                       | ...           | N08810        | Annealed | Ni-Cr-Fe            | 45    | ...    | 65                             | 25                           |
| <b>Fittings (Seamless and Welded)</b> |               |               |          |                     |       |        |                                |                              |
| A403                                  | WP304H        | S30409        | ...      | 18Cr-8Ni            | 8     | (1)    | 75                             | 30                           |
|                                       | WP316H        | S31609        | ...      | 16Cr-12Ni-2Mo       | 8     | (1)    | 75                             | 30                           |
|                                       | WP316L        | S31603        | ...      | 16Cr-12Ni-2Mo       | 8     | (1)    | 70                             | 25                           |
|                                       | WP321H        | S32109        | ...      | 18Cr-10Ni-Ti        | 8     | (1)    | 75                             | 30                           |
|                                       | WP347H        | S34709        | ...      | 18Cr-10Ni-Cb        | 8     | (1)    | 75                             | 30                           |
|                                       | WP348H        | S34809        | ...      | 18Cr-10Ni-Cb        | 8     | (1)    | 75                             | 30                           |
| B366                                  | ...           | R30556        | Annealed | Ni-Fe-Cr-Co-Mo-W    | 45    | (1)(6) | 100                            | 45                           |
|                                       | ...           | R30556        | Annealed | Ni-Fe-Cr-Co-Mo-W    | 45    | (1)(7) | 100                            | 45                           |

## GENERAL NOTES:

- The tabulated specifications are ANSI/ASTM or ASTM. For ASME Boiler and Pressure Vessel Code applications, see related specifications in Section II of the ASME Code.
- The stress values in this Table may be interpolated to determine values for intermediate temperatures.
- The P-Numbers listed in this Table are identical to those adopted by the ASME Boiler and Pressure Vessel Code. Qualification of welding procedures, welders, and welding operators is required and shall comply with the ASME Boiler and Pressure Vessel Code, Section IX, except as modified by para. 127.5.
- Tensile strengths and allowable stresses shown in "ksi" are "thousands of pounds per square inch."
- The materials listed in this Table shall not be used at design temperatures above those for which allowable stress values are given.
- The tabulated stress values are  $S \times E$  (weld joint efficiency factor) or  $S \times F$  (material quality factor), as applicable. Weld joint efficiency factors are shown in Table 102.4.3.
- Pressure-temperature ratings of piping components, as published in standards referenced in this Code, may be used for components meeting the requirements of those standards. The allowable stress values given in this Table are for use in designing piping components which are not manufactured in accordance with referenced standards.
- All the materials listed are classified as austenitic [see Table 104.1.2(A)].
- The tabulated stress values that are shown in italics are at temperatures in the range where creep and stress rupture strength govern the selection of stresses.

**Table A-8 Temperatures 1,200°F and Above (Cont'd)**

| <i>E or<br/>F</i>              | Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |       |       |       |       |       |       | Type or<br>Grade | Spec.<br>No. |
|--------------------------------|-------------------------------------------------------------------------------------------|-------|-------|-------|-------|-------|-------|------------------|--------------|
|                                | 1,200                                                                                     | 1,250 | 1,300 | 1,350 | 1,400 | 1,450 | 1,500 |                  |              |
| Forgings (Cont'd)              |                                                                                           |       |       |       |       |       |       |                  |              |
| 1.00                           | 5.4                                                                                       | 4.1   | 3.2   | 2.5   | 1.9   | 1.5   | 1.1   | F321H            | A182         |
| 1.00                           | 7.9                                                                                       | 5.9   | 4.4   | 3.2   | 2.5   | 1.8   | 1.3   | F347H            |              |
| 1.00                           | 7.9                                                                                       | 5.9   | 4.4   | 3.2   | 2.5   | 1.8   | 1.3   | F348H            |              |
| 1.00                           | 15.3                                                                                      | 14.5  | 11.2  | 8.7   | 6.6   | 5.1   | 3.9   | ...              | B564         |
| 1.00                           | 6.6                                                                                       | 4.2   | 2.0   | 1.6   | 1.1   | 1.0   | 0.80  | ...              |              |
| 1.00                           | 7.4                                                                                       | 5.9   | 4.7   | 3.8   | 3.0   | 2.4   | 1.9   | ...              |              |
| Fittings (Seamless and Welded) |                                                                                           |       |       |       |       |       |       |                  |              |
| 1.00                           | 6.1                                                                                       | 4.7   | 3.7   | 2.9   | 2.3   | 1.8   | 1.4   | WP304H           | A403         |
| 1.00                           | 7.4                                                                                       | 5.5   | 4.1   | 3.1   | 2.3   | 1.7   | 1.3   | WP316H           |              |
| 1.00                           | 6.4                                                                                       | 4.7   | 3.5   | 2.5   | 1.8   | 1.3   | 1.0   | WP316L           |              |
| 1.00                           | 5.4                                                                                       | 4.1   | 3.2   | 2.5   | 1.9   | 1.5   | 1.1   | WP321H           |              |
| 1.00                           | 7.9                                                                                       | 5.9   | 4.4   | 3.2   | 2.5   | 1.8   | 1.3   | WP347H           |              |
| 1.00                           | 7.9                                                                                       | 5.9   | 4.4   | 3.2   | 2.5   | 1.8   | 1.3   | WP348H           |              |
| 1.00                           | 13.6                                                                                      | 10.9  | 8.8   | 7.0   | 5.6   | 4.5   | 3.6   | R30556           | B366         |
| 0.85                           | 11.6                                                                                      | 9.3   | 7.5   | 6.0   | 4.8   | 3.8   | 3.1   | R30556           |              |

**NOTES:**

- (1) THIS MATERIAL IS NOT ACCEPTABLE FOR USE ON BOILER EXTERNAL PIPING — SEE FIGS. 100.1.2(A) and (B).
- (2) These allowable stress values shall be used only if the carbon content of the material is 0.04% or higher.
- (3) These allowable stress values tabulated shall be used only if the material is heat treated by heating to a minimum temperature of 1,900°F and quenching in water or rapidly cooling by other means.
- (4) These allowable stress values shall be used only when the grain size of the material is ASTM No. 6 or coarser.
- (5) These allowable stress values shall be used only when Supplementary Requirement S1 per ASTM A479 has been specified.
- (6) Seamless.
- (7) Welded—all filler metal, including consumable insert material, shall comply with the requirements of Section IX of the ASME Boiler and Pressure Vessel Code.

Table A-9 Titanium and Titanium Alloys

| Spec. No.                      | Grade | Condition | Nominal Composition | P-No. | Notes  | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | E or F |
|--------------------------------|-------|-----------|---------------------|-------|--------|--------------------------------|------------------------------|--------|
| <b>Seamless Pipe and Tube</b>  |       |           |                     |       |        |                                |                              |        |
| B338                           | 1     | Annealed  | Ti                  | 51    | (1)    | 35                             | 25                           | 1.00   |
|                                | 2     | Annealed  | Ti                  | 51    | (1)    | 50                             | 40                           | 1.00   |
|                                | 3     | Annealed  | Ti                  | 52    | (1)    | 65                             | 55                           | 1.00   |
|                                | 7     | Annealed  | Ti-Pd               | 51    | (1)    | 50                             | 40                           | 1.00   |
|                                | 12    | Annealed  | Ti-Mo-Ni            | 52    | (1)    | 70                             | 50                           | 1.00   |
| B861                           | 1     | Annealed  | Ti                  | 51    | (1)    | 35                             | 25                           | 1.00   |
|                                | 2     | Annealed  | Ti                  | 51    | (1)    | 50                             | 40                           | 1.00   |
|                                | 3     | Annealed  | Ti                  | 52    | (1)    | 65                             | 55                           | 1.00   |
|                                | 7     | Annealed  | Ti-Pd               | 51    | (1)    | 50                             | 40                           | 1.00   |
|                                | 12    | Annealed  | Ti-Mo-Ni            | 52    | (1)    | 70                             | 50                           | 1.00   |
| <b>Welded Pipe and Tube</b>    |       |           |                     |       |        |                                |                              |        |
| B338                           | 1     | Annealed  | Ti                  | 51    | (1)(2) | 35                             | 25                           | 0.85   |
|                                | 2     | Annealed  | Ti                  | 51    | (1)(2) | 50                             | 40                           | 0.85   |
|                                | 3     | Annealed  | Ti                  | 52    | (1)(2) | 65                             | 55                           | 0.85   |
|                                | 7     | Annealed  | Ti-Pd               | 51    | (1)(2) | 50                             | 40                           | 0.85   |
|                                | 12    | Annealed  | Ti-Mo-Ni            | 52    | (1)(2) | 70                             | 50                           | 0.85   |
| B862                           | 1     | Annealed  | Ti                  | 51    | (1)(2) | 35                             | 25                           | 0.85   |
|                                | 2     | Annealed  | Ti                  | 51    | (1)(2) | 50                             | 40                           | 0.85   |
|                                | 3     | Annealed  | Ti                  | 52    | (1)(2) | 65                             | 55                           | 0.85   |
|                                | 7     | Annealed  | Ti-Pd               | 51    | (1)(2) | 50                             | 40                           | 0.85   |
|                                | 12    | Annealed  | Ti-Mo-Ni            | 52    | (1)(2) | 70                             | 50                           | 0.85   |
| <b>Plate, Sheet, and Strip</b> |       |           |                     |       |        |                                |                              |        |
| B265                           | 1     | Annealed  | Ti                  | 51    | (1)    | 35                             | 25                           | 1.00   |
|                                | 2     | Annealed  | Ti                  | 51    | (1)    | 50                             | 40                           | 1.00   |
|                                | 3     | Annealed  | Ti                  | 52    | (1)    | 65                             | 55                           | 1.00   |
|                                | 7     | Annealed  | Ti-Pd               | 51    | (1)    | 50                             | 40                           | 1.00   |
|                                | 12    | Annealed  | Ti-Mo-Ni            | 52    | (1)    | 70                             | 50                           | 1.00   |
| <b>Forgings</b>                |       |           |                     |       |        |                                |                              |        |
| B381                           | F1    | Annealed  | Ti                  | 51    | (1)    | 35                             | 25                           | 1.00   |
|                                | F2    | Annealed  | Ti                  | 51    | (1)    | 50                             | 40                           | 1.00   |
|                                | F3    | Annealed  | Ti                  | 52    | (1)    | 65                             | 55                           | 1.00   |
|                                | F7    | Annealed  | Ti-Pd               | 51    | (1)    | 50                             | 40                           | 1.00   |
|                                | F12   | Annealed  | Ti-Mo-Ni            | 52    | (1)    | 70                             | 50                           | 1.00   |

**Table A-9 Titanium and Titanium Alloys**

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |       | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|-------|--------------|
| -20<br>to<br>100                                                                          | 150  | 200  | 250  | 300  | 350  | 400  | 450  | 500  | 550  | 600  | Grade |              |
| Seamless Pipe and Tube                                                                    |      |      |      |      |      |      |      |      |      |      |       |              |
| 10.0                                                                                      | 9.3  | 8.3  | 7.4  | 6.6  | 6.0  | 5.5  | 5.1  | 4.7  | 4.2  | 3.6  | 1     | B338         |
| 14.3                                                                                      | 13.7 | 12.4 | 11.3 | 10.3 | 9.5  | 8.8  | 8.2  | 7.6  | 7.0  | 6.5  | 2     |              |
| 18.6                                                                                      | 17.5 | 15.8 | 14.2 | 12.8 | 11.5 | 10.3 | 9.3  | 8.5  | 7.9  | 7.4  | 3     |              |
| 14.3                                                                                      | 13.7 | 12.4 | 11.3 | 10.3 | 9.5  | 8.8  | 8.2  | 7.6  | 7.0  | 6.5  | 7     |              |
| 20.0                                                                                      | 20.0 | 18.7 | 17.4 | 16.2 | 15.2 | 14.3 | 13.6 | 13.1 | 12.7 | 12.3 | 12    |              |
| 10.0                                                                                      | 9.3  | 8.3  | 7.4  | 6.6  | 6.0  | 5.5  | 5.1  | 4.7  | 4.2  | 3.6  | 1     | B861         |
| 14.3                                                                                      | 13.7 | 12.4 | 11.3 | 10.3 | 9.5  | 8.8  | 8.2  | 7.6  | 7.0  | 6.5  | 2     |              |
| 18.6                                                                                      | 17.5 | 15.8 | 14.2 | 12.8 | 11.5 | 10.3 | 9.3  | 8.5  | 7.9  | 7.4  | 3     |              |
| 14.3                                                                                      | 13.7 | 12.4 | 11.3 | 10.3 | 9.5  | 8.8  | 8.2  | 7.6  | 7.0  | 6.5  | 7     |              |
| 20.0                                                                                      | 20.0 | 18.7 | 17.4 | 16.2 | 15.2 | 14.3 | 13.6 | 13.1 | 12.7 | 12.3 | 12    |              |
| Welded Pipe and Tube                                                                      |      |      |      |      |      |      |      |      |      |      |       |              |
| 8.5                                                                                       | 7.9  | 7.0  | 6.3  | 5.6  | 5.1  | 4.7  | 4.3  | 4.0  | 3.6  | 3.0  | 1     | B338         |
| 12.1                                                                                      | 11.6 | 10.6 | 9.6  | 8.8  | 8.1  | 7.5  | 7.0  | 6.5  | 6.0  | 5.5  | 2     |              |
| 15.8                                                                                      | 14.9 | 13.4 | 12.1 | 10.8 | 9.7  | 8.8  | 7.9  | 7.2  | 6.7  | 6.3  | 3     |              |
| 12.1                                                                                      | 11.6 | 10.6 | 9.6  | 8.8  | 8.1  | 7.5  | 7.0  | 6.5  | 6.0  | 5.5  | 7     |              |
| 17.0                                                                                      | 17.0 | 15.9 | 14.8 | 13.8 | 12.9 | 12.1 | 11.5 | 11.1 | 10.8 | 10.5 | 12    |              |
| 8.5                                                                                       | 7.9  | 7.0  | 6.3  | 5.6  | 5.1  | 4.7  | 4.3  | 4.0  | 3.6  | 3.0  | 1     | B862         |
| 12.1                                                                                      | 11.6 | 10.6 | 9.6  | 8.8  | 8.1  | 7.5  | 7.0  | 6.5  | 6.0  | 5.5  | 2     |              |
| 15.8                                                                                      | 14.9 | 13.4 | 12.1 | 10.8 | 9.7  | 8.8  | 7.9  | 7.2  | 6.7  | 6.3  | 3     |              |
| 12.1                                                                                      | 11.6 | 10.6 | 9.6  | 8.8  | 8.1  | 7.5  | 7.0  | 6.5  | 6.0  | 5.5  | 7     |              |
| 17.0                                                                                      | 17.0 | 15.9 | 14.8 | 13.8 | 12.9 | 12.1 | 11.5 | 11.1 | 10.8 | 10.5 | 12    |              |
| Plate, Sheet, and Strip                                                                   |      |      |      |      |      |      |      |      |      |      |       |              |
| 10.0                                                                                      | 9.3  | 8.3  | 7.4  | 6.6  | 6.0  | 5.5  | 5.1  | 4.7  | 4.2  | 3.6  | 1     | B265         |
| 14.3                                                                                      | 13.7 | 12.4 | 11.3 | 10.3 | 9.5  | 8.8  | 8.2  | 7.6  | 7.0  | 6.5  | 2     |              |
| 18.6                                                                                      | 17.5 | 15.8 | 14.2 | 12.8 | 11.5 | 10.3 | 9.3  | 8.5  | 7.9  | 7.4  | 3     |              |
| 14.3                                                                                      | 13.7 | 12.4 | 11.3 | 10.3 | 9.5  | 8.8  | 8.2  | 7.6  | 7.0  | 6.5  | 7     |              |
| 20.0                                                                                      | 20.0 | 18.7 | 17.4 | 16.2 | 15.2 | 14.3 | 13.6 | 13.1 | 12.7 | 12.3 | 12    |              |
| Forgings                                                                                  |      |      |      |      |      |      |      |      |      |      |       |              |
| 10.0                                                                                      | 9.3  | 8.3  | 7.4  | 6.6  | 6.0  | 5.5  | 5.1  | 4.7  | 4.2  | 3.6  | F1    | B381         |
| 14.3                                                                                      | 13.7 | 12.4 | 11.3 | 10.3 | 9.5  | 8.8  | 8.2  | 7.6  | 7.0  | 6.5  | F2    |              |
| 18.6                                                                                      | 17.5 | 15.8 | 14.2 | 12.8 | 11.5 | 10.3 | 9.3  | 8.5  | 7.9  | 7.4  | F3    |              |
| 14.3                                                                                      | 13.7 | 12.4 | 11.3 | 10.3 | 9.5  | 8.8  | 8.2  | 7.6  | 7.0  | 6.5  | F7    |              |
| 20.0                                                                                      | 20.0 | 18.7 | 17.4 | 16.2 | 15.2 | 14.3 | 13.6 | 13.1 | 12.7 | 12.3 | F12   |              |

Table A-9 Titanium and Titanium Alloys (Cont'd)

| Spec. No.               | Grade | Condition | Nominal Composition | P-No. | Notes  | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi | <i>E</i> or <i>F</i> |
|-------------------------|-------|-----------|---------------------|-------|--------|--------------------------------|------------------------------|----------------------|
| <b>Bars and Billets</b> |       |           |                     |       |        |                                |                              |                      |
| B348                    | 1     | Annealed  | Ti                  | 51    | (1)    | 35                             | 25                           | 1.00                 |
|                         | 2     | Annealed  | Ti                  | 51    | (1)    | 50                             | 40                           | 1.00                 |
|                         | 3     | Annealed  | Ti                  | 52    | (1)    | 65                             | 55                           | 1.00                 |
|                         | 7     | Annealed  | Ti-Pd               | 51    | (1)    | 50                             | 40                           | 1.00                 |
|                         | 12    | Annealed  | Ti-Mo-Ni            | 52    | (1)    | 70                             | 50                           | 1.00                 |
| <b>Castings</b>         |       |           |                     |       |        |                                |                              |                      |
| B367                    | C-2   | As-cast   | Ti                  | 50    | (1)(3) | 50                             | 40                           | 0.80                 |

## GENERAL NOTES:

- The tabulated specifications are ANSI/ASTM or ASTM. For ASME Boiler and Pressure Vessel Code applications, see related specifications in Section II of the ASME Code.
- The stress values in this Table may be interpolated to determine values for intermediate temperatures.
- The P-Numbers listed in this Table are identical to those adopted by the ASME Boiler and Pressure Vessel Code. Qualification of welding procedures, welders, and welding operators is required and shall comply with the ASME Boiler and Pressure Vessel Code, Section IX, except as modified by para. 127.5.
- Tensile strengths and allowable stresses shown in "ksi" are "thousands of pounds per square inch."
- The materials listed in this Table shall not be used at design temperatures above those for which allowable stress values are given.
- The tabulated stress values are  $S \times E$  (weld joint efficiency factor) or  $S \times F$  (material quality factor), as applicable. Weld joint efficiency factors are shown in Table 102.4.3.
- Pressure-temperature ratings of piping components, as published in standards referenced in this Code, may be used for components meeting the requirements of those standards. The allowable stress values given in this Table are for use in designing piping components which are not manufactured in accordance with referenced standards.
- The  $y$  coefficient equals 0.4 [see Table 104.1.2(A)].
- The tabulated stress values that are shown in italics are at temperatures in the range where creep and stress rupture strength govern the selection of stresses.

**Table A-9 Titanium and Titanium Alloys (Cont'd)**

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |      |      |      |      |      |      |      |      |       |              |
|-------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|-------|--------------|
| -20<br>to<br>100                                                                          | 150  | 200  | 250  | 300  | 350  | 400  | 450  | 500  | 550  | 600  | Grade | Spec.<br>No. |
| Bars and Billets                                                                          |      |      |      |      |      |      |      |      |      |      |       |              |
| 10.0                                                                                      | 9.3  | 8.3  | 7.4  | 6.6  | 6.0  | 5.5  | 5.1  | 4.7  | 4.2  | 3.6  | 1     | B348         |
| 14.3                                                                                      | 13.7 | 12.4 | 11.3 | 10.3 | 9.5  | 8.8  | 8.2  | 7.6  | 7.0  | 6.5  | 2     |              |
| 18.6                                                                                      | 17.5 | 15.8 | 14.2 | 12.8 | 11.5 | 10.3 | 9.3  | 8.5  | 7.9  | 7.4  | 3     |              |
| 14.3                                                                                      | 13.7 | 12.4 | 11.3 | 10.3 | 9.5  | 8.8  | 8.2  | 7.6  | 7.0  | 6.5  | 7     |              |
| 20.0                                                                                      | 20.0 | 18.7 | 17.4 | 16.2 | 15.2 | 14.3 | 13.6 | 13.1 | 12.7 | 12.3 | 12    |              |
| Castings                                                                                  |      |      |      |      |      |      |      |      |      |      |       |              |
| 11.4                                                                                      | 10.5 | 10.0 | 9.0  | 8.3  | 7.6  | ...  | ...  | ...  | ...  | ...  | C-2   | B367         |

Table A-10 Bolts, Nuts, and Studs

| Spec. No.                               | Grade    | Type or Class | Nominal Composition                                    | Material Category / UNS No. | Notes       | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi |
|-----------------------------------------|----------|---------------|--------------------------------------------------------|-----------------------------|-------------|--------------------------------|------------------------------|
| <b>Carbon Steel</b>                     |          |               |                                                        |                             |             |                                |                              |
| A194                                    | 1, 2, 2H | ...           | ...                                                    | Carbon steel                | (1)         | ...                            | ...                          |
| A307                                    | B        | ...           | C                                                      | Carbon steel                | (2)(3)(4)   | 60                             | ...                          |
| A449                                    | ...      | ...           | C                                                      | Carbon steel                | (2)(5)(6)   | 120                            | ...                          |
|                                         | ...      | ...           | C                                                      | Carbon steel                | (2)(5)(7)   | 105                            | ...                          |
|                                         | ...      | ...           | C                                                      | Carbon steel                | (2)(5)(8)   | 90                             | ...                          |
| <b>Low and Intermediate Alloy Steel</b> |          |               |                                                        |                             |             |                                |                              |
| A193                                    | B5       | ...           | 5Cr- $\frac{1}{2}$ Mo                                  | Alloy steel                 | (5)(9)(10)  | 100                            | 80                           |
|                                         | B7       | ...           | 1Cr- $\frac{1}{5}$ Mo                                  | Alloy steel                 | (11)        | 125                            | 105                          |
|                                         | B7       | ...           | 1Cr- $\frac{1}{5}$ Mo                                  | Alloy steel                 | (12)        | 115                            | 95                           |
|                                         | B7       | ...           | 1Cr- $\frac{1}{5}$ Mo                                  | Alloy steel                 | (13)        | 100                            | 75                           |
|                                         | B7M      | ...           | 1Cr- $\frac{1}{5}$ Mo                                  | Alloy steel                 | (2)(11)     | 100                            | 80                           |
| A193                                    | B16      | ...           | 1Cr- $\frac{1}{2}$ Mo-V                                | Alloy steel                 | (14)        | 125                            | 105                          |
|                                         | B16      | ...           | 1Cr- $\frac{1}{2}$ Mo-V                                | Alloy steel                 | (12)        | 110                            | 95                           |
|                                         | B16      | ...           | 1Cr- $\frac{1}{2}$ Mo-V                                | Alloy steel                 | (13)        | 100                            | 85                           |
| A194                                    | 3        | ...           | 5Cr- $\frac{1}{2}$ Mo-V                                | Alloy steel                 | (1)         | ...                            | ...                          |
|                                         | 4        | ...           | C-Mo                                                   | Alloy steel                 | (1)(14)     | ...                            | ...                          |
|                                         | 7        | ...           | Cr-Mo                                                  | Alloy steel                 | (1)         | ...                            | ...                          |
| A320                                    | L7       | ...           | 1Cr- $\frac{1}{5}$ Mo                                  | Alloy steel                 | (2)(5)(15)  | 125                            | 105                          |
|                                         | L7M      | ...           | 1Cr- $\frac{1}{5}$ Mo                                  | Alloy steel                 | (2)(11)     | 100                            | 80                           |
|                                         | L43      | ...           | 1 $\frac{3}{4}$ Ni- $\frac{3}{4}$ Cr- $\frac{1}{4}$ Mo | Alloy steel                 | (2)(5)(15)  | 125                            | 105                          |
| A354                                    | BC       | ...           | ...                                                    | Alloy steel                 | (5)(9)(11)  | 125                            | 109                          |
|                                         | BC       | ...           | ...                                                    | Alloy steel                 | (5)(9)(12)  | 115                            | 99                           |
|                                         | BD       | ...           | ...                                                    | Alloy steel                 | (5)(9)(11)  | 150                            | 130                          |
|                                         | BD       | ...           | ...                                                    | Alloy steel                 | (5)(9)(12)  | 140                            | 120                          |
| <b>Stainless Steels</b>                 |          |               |                                                        |                             |             |                                |                              |
| <b>Austenitic</b>                       |          |               |                                                        |                             |             |                                |                              |
| A193                                    | B8       | 1             | 18Cr-8Ni                                               | S30400                      | (5)(16)(17) | 75                             | 30                           |
|                                         | B8C      | 1             | 18Cr-10Ni-Cb                                           | S34700                      | (5)(16)(17) | 75                             | 30                           |
|                                         | B8M      | 1             | 16Cr-12Ni-2Mo                                          | S31600                      | (5)(16)(17) | 75                             | 30                           |
|                                         | B8T      | 1             | 18Cr-10Ni-Ti                                           | S32100                      | (5)(16)(17) | 75                             | 30                           |
| A193                                    | B8       | 2             | 18Cr-8Ni                                               | S30400                      | (5)(18)(19) | 125                            | 100                          |
|                                         | B8       | 2             | 18Cr-8Ni                                               | S30400                      | (5)(18)(20) | 115                            | 80                           |
|                                         | B8       | 2             | 18Cr-8Ni                                               | S30400                      | (5)(18)(21) | 105                            | 65                           |
|                                         | B8       | 2             | 18Cr-8Ni                                               | S30400                      | (5)(18)(22) | 100                            | 50                           |
| A193                                    | B8C      | 2             | 18Cr-10Ni-Cb                                           | S34700                      | (5)(18)(19) | 125                            | 100                          |
|                                         | B8C      | 2             | 18Cr-10Ni-Cb                                           | S34700                      | (5)(18)(20) | 115                            | 80                           |
|                                         | B8C      | 2             | 18Cr-10Ni-Cb                                           | S34700                      | (5)(18)(21) | 105                            | 65                           |
|                                         | B8C      | 2             | 18Cr-10Ni-Cb                                           | S34700                      | (5)(18)(22) | 100                            | 50                           |
| A193                                    | B8M      | 2             | 16Cr-12Ni-2Mo                                          | S31600                      | (5)(18)(19) | 110                            | 80                           |
|                                         | B8M      | 2             | 16Cr-12Ni-2Mo                                          | S31600                      | (5)(18)(20) | 100                            | 80                           |
|                                         | B8M      | 2             | 16Cr-12Ni-2Mo                                          | S31600                      | (5)(18)(21) | 95                             | 75                           |
|                                         | B8M      | 2             | 16Cr-12Ni-2Mo                                          | S31600                      | (5)(18)(22) | 90                             | 65                           |
| A193                                    | B8T      | 2             | 18Cr-10Ni-Ti                                           | S32100                      | (5)(18)(19) | 125                            | 100                          |
|                                         | B8T      | 2             | 18Cr-10Ni-Ti                                           | S32100                      | (5)(18)(20) | 115                            | 80                           |
|                                         | B8T      | 2             | 18Cr-10Ni-Ti                                           | S32100                      | (5)(18)(21) | 105                            | 65                           |
|                                         | B8T      | 2             | 18Cr-10Ni-Ti                                           | S32100                      | (5)(18)(22) | 100                            | 50                           |

**Table A-10 Bolts, Nuts, and Studs**

| Maximum Allowable Stress Values in Tension, ksi, for Metal Temperature, °F, Not Exceeding |      |      |     |      |     |      |      |      |      |      |      |      |      |      |       |       |       |       |       |          | Spec.<br>No. |
|-------------------------------------------------------------------------------------------|------|------|-----|------|-----|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|----------|--------------|
| -20<br>to<br>100                                                                          | 200  | 300  | 350 | 400  | 450 | 500  | 600  | 650  | 700  | 750  | 800  | 850  | 900  | 950  | 1,000 | 1,050 | 1,100 | 1,150 | 1,200 | Grade    |              |
| <b>Carbon Steel</b>                                                                       |      |      |     |      |     |      |      |      |      |      |      |      |      |      |       |       |       |       |       |          |              |
| ...                                                                                       | ...  | ...  | ... | ...  | ... | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | 1, 2, 2H | A194         |
| 7.0                                                                                       | 7.0  | 7.0  | ... | 7.0  | ... | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | B        | A307         |
| 23.0                                                                                      | 23.0 | 23.0 | ... | 23.0 | ... | 23.0 | 23.0 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...      | A449         |
| 20.2                                                                                      | 20.2 | 20.2 | ... | 20.2 | ... | 20.2 | 20.2 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...      |              |
| 14.5                                                                                      | 14.5 | 14.5 | ... | 14.5 | ... | 14.5 | 14.5 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | ...      |              |
| <b>Low and Intermediate Alloy Steel</b>                                                   |      |      |     |      |     |      |      |      |      |      |      |      |      |      |       |       |       |       |       |          |              |
| 20.0                                                                                      | 20.0 | 20.0 | ... | 20.0 | ... | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 18.5 | 14.5 | 10.4 | 7.6  | 5.6   | 4.2   | 3.1   | 2.0   | 1.3   | B5       | A193         |
| 25.0                                                                                      | 25.0 | 25.0 | ... | 25.0 | ... | 25.0 | 25.0 | 25.0 | 25.0 | 23.6 | 21.0 | 16.3 | 12.5 | 8.5  | 4.5   | ...   | ...   | ...   | ...   | B7       |              |
| 23.0                                                                                      | 23.0 | 23.0 | ... | 23.0 | ... | 23.0 | 23.0 | 23.0 | 23.0 | 22.2 | 20.0 | 16.3 | 12.5 | 8.5  | 4.5   | ...   | ...   | ...   | ...   | B7       |              |
| 18.8                                                                                      | 18.8 | 18.8 | ... | 18.8 | ... | 18.8 | 18.8 | 18.8 | 18.8 | 18.8 | 18.0 | 16.3 | 12.5 | 8.5  | 4.5   | ...   | ...   | ...   | ...   | B7       |              |
| 20.0                                                                                      | 20.0 | 20.0 | ... | 20.0 | ... | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 18.5 | 16.5 | 12.5 | 8.5  | 4.5   | ...   | ...   | ...   | ...   | B7M      |              |
| 25.0                                                                                      | 25.0 | 25.0 | ... | 25.0 | ... | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 23.5 | 20.5 | 16.0 | 11.0  | 6.3   | 2.8   | ...   | ...   | B16      | A193         |
| 22.0                                                                                      | 22.0 | 22.0 | ... | 22.0 | ... | 22.0 | 22.0 | 22.0 | 22.0 | 22.0 | 22.0 | 21.0 | 18.5 | 15.3 | 11.0  | 6.3   | 2.8   | ...   | ...   | B16      |              |
| 20.0                                                                                      | 20.0 | 20.0 | ... | 20.0 | ... | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 18.8 | 16.7 | 14.3 | 11.0  | 6.3   | 2.8   | ...   | ...   | B16      |              |
| ...                                                                                       | ...  | ...  | ... | ...  | ... | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | 3        | A194         |
| ...                                                                                       | ...  | ...  | ... | ...  | ... | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | 4        |              |
| ...                                                                                       | ...  | ...  | ... | ...  | ... | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | 7        |              |
| 25.0                                                                                      | 25.0 | 25.0 | ... | 25.0 | ... | 25.0 | 25.0 | 25.0 | 25.0 | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | L7       | A320         |
| 20.0                                                                                      | 20.0 | 20.0 | ... | 20.0 | ... | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 18.5 | 16.3 | 12.5 | 8.5  | 4.5   | ...   | ...   | ...   | ...   | L7M      |              |
| 25.0                                                                                      | 25.0 | 25.0 | ... | 25.0 | ... | 25.0 | 25.0 | 25.0 | 25.0 | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | L43      |              |
| 25.0                                                                                      | 25.0 | 25.0 | ... | 25.0 | ... | 25.0 | 25.0 | 25.0 | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | BC       | A354         |
| 23.0                                                                                      | 23.0 | 23.0 | ... | 23.0 | ... | 23.0 | 23.0 | 23.0 | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | BC       |              |
| 30.0                                                                                      | 30.0 | 30.0 | ... | 30.0 | ... | 30.0 | 30.0 | 30.0 | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | BD       |              |
| 28.0                                                                                      | 28.0 | 28.0 | ... | 28.0 | ... | 28.0 | 28.0 | 28.0 | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | BD       |              |
| <b>Stainless Steels</b>                                                                   |      |      |     |      |     |      |      |      |      |      |      |      |      |      |       |       |       |       |       |          |              |
| <b>Austenitic</b>                                                                         |      |      |     |      |     |      |      |      |      |      |      |      |      |      |       |       |       |       |       |          |              |
| 18.8                                                                                      | 16.7 | 15.0 | ... | 13.8 | ... | 12.9 | 12.1 | 12.0 | 11.8 | 11.5 | 11.2 | 11.0 | 10.8 | 10.6 | 10.4  | 10.1  | 9.8   | 7.7   | 6.1   | B8       | A193         |
| 18.8                                                                                      | 17.9 | 16.4 | ... | 15.5 | ... | 15.0 | 14.3 | 14.1 | 13.8 | 13.7 | 13.6 | 13.5 | 13.5 | 13.4 | 13.4  | 12.1  | 9.1   | 6.1   | 4.4   | B8C      |              |
| 18.8                                                                                      | 17.7 | 15.6 | ... | 14.3 | ... | 13.3 | 12.6 | 12.3 | 12.1 | 11.9 | 11.7 | 11.6 | 11.5 | 11.4 | 11.3  | 11.2  | 11.0  | 9.8   | 7.4   | B8M      |              |
| 18.8                                                                                      | 17.8 | 16.5 | ... | 15.3 | ... | 14.3 | 13.5 | 13.3 | 12.9 | 12.7 | 12.5 | 12.4 | 12.3 | 12.1 | 12.0  | 9.6   | 6.9   | 5.0   | 3.6   | B8T      |              |
| 25.0                                                                                      | ...  | ...  | ... | ...  | ... | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | B8       | A193         |
| 20.0                                                                                      | ...  | ...  | ... | ...  | ... | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | B8       |              |
| 18.8                                                                                      | ...  | ...  | ... | ...  | ... | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | B8       |              |
| 18.8                                                                                      | ...  | ...  | ... | ...  | ... | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | B8       |              |
| 25.0                                                                                      | ...  | ...  | ... | ...  | ... | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | B8C      | A193         |
| 20.0                                                                                      | ...  | ...  | ... | ...  | ... | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | B8C      |              |
| 18.8                                                                                      | ...  | ...  | ... | ...  | ... | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | B8C      |              |
| 18.8                                                                                      | ...  | ...  | ... | ...  | ... | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | B8C      |              |
| 22.0                                                                                      | 22.0 | 22.0 | ... | 22.0 | ... | 22.0 | 22.0 | 22.0 | 22.0 | 22.0 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | B8M      | A193         |
| 20.0                                                                                      | 20.0 | 20.0 | ... | 20.0 | ... | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | B8M      |              |
| 18.8                                                                                      | 17.7 | 16.3 | ... | 16.3 | ... | 16.3 | 16.3 | 16.3 | 16.3 | 16.3 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | B8M      |              |
| 18.8                                                                                      | 17.7 | 15.6 | ... | 14.3 | ... | 13.3 | 12.5 | 12.5 | 12.5 | 12.5 | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | B8M      |              |
| 25.0                                                                                      | ...  | ...  | ... | ...  | ... | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | B8T      | A193         |
| 20.0                                                                                      | ...  | ...  | ... | ...  | ... | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | B8T      |              |
| 18.8                                                                                      | ...  | ...  | ... | ...  | ... | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | B8T      |              |
| 18.8                                                                                      | ...  | ...  | ... | ...  | ... | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   | B8T      |              |

Table A-10 Bolts, Nuts, and Studs (Cont'd)

| Spec. No.                        | Grade  | Type or Class | Nominal Composition  | Material Category / UNS No. | Notes           | Specified Minimum Tensile, ksi | Specified Minimum Yield, ksi |
|----------------------------------|--------|---------------|----------------------|-----------------------------|-----------------|--------------------------------|------------------------------|
| <b>Stainless Steels (Cont'd)</b> |        |               |                      |                             |                 |                                |                              |
| <b>Austenitic (Cont'd)</b>       |        |               |                      |                             |                 |                                |                              |
| A194                             | 8      | ...           | 18Cr–8Ni             | S30400                      | (1)             | ...                            | ...                          |
|                                  | 8C     | ...           | 18Cr–10Ni–Cb         | S34700                      | (1)             | ...                            | ...                          |
| A194                             | 8M     | ...           | 16Cr–12Ni–Mo         | S31600                      | (1)             | ...                            | ...                          |
|                                  | 8T     | ...           | 18Cr–10Ni–Ti         | S32100                      | (1)             | ...                            | ...                          |
|                                  | 8F     | ...           | 18Cr–8Ni–Fm          | ...                         | (1)             | ...                            | ...                          |
| A320                             | B8     | 1             | 18Cr–8Ni             | S30400                      | (5)(18)         | 75                             | 30                           |
|                                  | B8     | 1             | 18Cr–8Ni             | S30400                      | (5)(23)         | 75                             | 30                           |
|                                  | B8     | 2             | 18Cr–8Ni             | S30400                      | (5)(18)(22)     | 100                            | 50                           |
|                                  | B8     | 2             | 18Cr–8Ni             | S30400                      | (5)(18)(21)     | 105                            | 65                           |
|                                  | B8     | 2             | 18Cr–8Ni             | S30400                      | (5)(18)(20)     | 115                            | 80                           |
|                                  | B8     | 2             | 18Cr–8Ni             | S30400                      | (5)(18)(19)     | 125                            | 100                          |
| A320                             | B8C    | 1             | 18Cr–10Ni–Cb         | S34700                      | (5)             | 75                             | 30                           |
|                                  | B8C    | 1             | 18Cr–10Ni–Cb         | S34700                      | (5)(23)         | 75                             | 30                           |
|                                  | B8C    | 2             | 18Cr–10Ni–Cb         | S34700                      | (5)(18)(22)     | 100                            | 50                           |
|                                  | B8C    | 2             | 18Cr–10Ni–Cb         | S34700                      | (5)(18)(21)     | 105                            | 65                           |
|                                  | B8C    | 2             | 18Cr–10Ni–Cb         | S34700                      | (5)(18)(20)     | 115                            | 80                           |
|                                  | B8C    | 2             | 18Cr–10Ni–Cb         | S34700                      | (5)(18)(19)     | 125                            | 100                          |
| A320                             | B8M    | 1             | 16Cr–12Ni–2Mo        | S31600                      | (5)             | 75                             | 30                           |
|                                  | B8M    | 1             | 16Cr–12Ni–2Mo        | S31600                      | (5)(23)         | 75                             | 30                           |
|                                  | B8M    | 2             | 16Cr–12Ni–2Mo        | S31600                      | (5)(18)(22)     | 90                             | 50                           |
|                                  | B8M    | 2             | 16Cr–12Ni–2Mo        | S31600                      | (5)(18)(21)     | 95                             | 65                           |
|                                  | B8M    | 2             | 16Cr–12Ni–2Mo        | S31600                      | (5)(18)(20)     | 100                            | 80                           |
|                                  | B8M    | 2             | 16Cr–12Ni–2Mo        | S31600                      | (5)(18)(19)     | 110                            | 95                           |
| A320                             | B8T    | 1             | 18Cr–10Ni–Ti         | S32100                      | (5)             | 75                             | 30                           |
|                                  | B8T    | 1             | 18Cr–10Ni–Ti         | S32100                      | (5)(23)         | 75                             | 30                           |
|                                  | B8T    | 2             | 18Cr–10Ni–Ti         | S32100                      | (5)(18)(22)     | 100                            | 50                           |
|                                  | B8T    | 2             | 18Cr–10Ni–Ti         | S32100                      | (5)(18)(21)     | 105                            | 65                           |
|                                  | B8T    | 2             | 18Cr–10Ni–Ti         | S32100                      | (5)(18)(20)     | 115                            | 80                           |
|                                  | B8T    | 2             | 18Cr–10Ni–Ti         | S32100                      | (5)(18)(19)     | 125                            | 100                          |
| A453                             | 660    | A & B         | 15Cr–25Ni–Mo–Ti–V–B  | S66286                      | (5)             | 130                            | 85                           |
| A479                             | TP309H | ...           | 23Cr–12Ni            | S30909                      | (24)            | 75                             | 30                           |
|                                  | TP309H | ...           | 23Cr–12Ni            | S30909                      | ...             | 75                             | 30                           |
|                                  | TP310H | ...           | 25Cr–20Ni            | S31009                      | (24)            | 75                             | 30                           |
|                                  | TP310H | ...           | 25Cr–20Ni            | S31009                      | ...             | 75                             | 30                           |
| <b>Martensitic</b>               |        |               |                      |                             |                 |                                |                              |
| A193                             | B6     | (410)         | 13Cr                 | S41000                      | (5)(10)         | 110                            | 85                           |
| A194                             | 6      | ...           | 13Cr                 | S41000                      | (1)             | ...                            | ...                          |
| <b>Precipitation Hardened</b>    |        |               |                      |                             |                 |                                |                              |
| A564                             | 630    | H1100         | 17Cr–4Ni–3.5Cu–0.04P | S17400                      | (5)(25)         | 140                            | 115                          |
| <b>Copper and Copper Alloys</b>  |        |               |                      |                             |                 |                                |                              |
| B150                             | ...    | ...           | ...                  | C61400                      | (2)(26)(27)(28) | 80                             | 40                           |
|                                  | ...    | ...           | ...                  | C61400                      | (2)(26)(28)(29) | 75                             | 35                           |
|                                  | ...    | ...           | ...                  | C61400                      | (2)(26)(28)(30) | 70                             | 32                           |
|                                  | ...    | ...           | ...                  | C61400                      | (2)(26)(28)(31) | 70                             | 30                           |



**Table A-10 Bolts, Nuts, and Studs (Cont'd)****NOTES:**

- (1) This is a product specification. Allowable stresses are not necessary. Limitations on metal temperature for materials covered by this specification for use under B31.1 are as follows:
  - (a) Grades 1 and 2,  $-20^{\circ}\text{F}$  to  $600^{\circ}\text{F}$
  - (b) Grade 2H,  $-20^{\circ}\text{F}$  to  $800^{\circ}\text{F}$
  - (c) Grades 3 and 7,  $-20^{\circ}\text{F}$  to  $1,100^{\circ}\text{F}$
  - (d) Grade 4,  $-20^{\circ}\text{F}$  to  $900^{\circ}\text{F}$
  - (e) Grades 6 and 8F,  $-20^{\circ}\text{F}$  to  $800^{\circ}\text{F}$
  - (f) Grades 8, 8C, 8M, and 8T,  $-20^{\circ}\text{F}$  to  $1,200^{\circ}\text{F}$
- (2) THIS MATERIAL IS NOT ACCEPTABLE FOR CONSTRUCTION OF PRESSURE-RETAINING PARTS OF BOILER EXTERNAL PIPING — SEE FIGS. 100.1.2(A) AND (B).
- (3) This material shall not be used above  $400^{\circ}\text{F}$ . The allowable stress value is 7,000 psi.
- (4) The allowable stress values listed in MSS SP-58 for this material may be used for pipe supporting elements designed in accordance with MSS SP-58.
- (5) These allowable stress values are established from a consideration of strength only and will be satisfactory for average service. For bolted joints, where freedom from leakage over a long period of time without retightening is required, lower stress values may be necessary as determined from the relative flexibility of the flange, bolt, and corresponding relaxation properties.
- (6) These allowable stress values apply to bolting materials less than or equal to 1 in. in diameter.
- (7) These allowable stress values apply to bolting materials greater than or equal to 1 in. in diameter and less than or equal to  $1\frac{1}{2}$  in. in diameter.
- (8) These allowable stress values apply to bolting materials greater than or equal to  $1\frac{1}{2}$  in. in diameter and less than or equal to 3 in. in diameter.
- (9) Between temperatures of  $-20^{\circ}\text{F}$  and  $400^{\circ}\text{F}$ , allowable stress values equal to the lower of the following may be used: 20% of the specified tensile strength or 25% of the specified yield strength.
- (10) These allowable stress values apply to bolting materials 4 in. in diameter and smaller.
- (11) These allowable stress values apply to bolting materials  $2\frac{1}{2}$  in. in diameter and smaller.
- (12) These allowable stress values apply to bolting materials larger than  $2\frac{1}{2}$  in. in diameter but not larger than 4 in. in diameter.
- (13) These allowable stress values apply to bolting materials larger than 4 in. in diameter but not larger than 7 in. in diameter.
- (14) Upon prolonged exposures to temperatures above  $875^{\circ}\text{F}$ , the carbide phase of carbon-molybdenum steel may be converted to graphite.
- (15) Minimum tempering temperature shall be  $800^{\circ}\text{F}$ .
- (16) The allowable stress values tabulated for temperatures over  $1,000^{\circ}\text{F}$  apply only if the carbon content of the material is 0.04% or higher.
- (17) The allowable stress values tabulated for temperatures over  $1,000^{\circ}\text{F}$  apply only if the material is heat treated by heating to a minimum temperature of  $1,900^{\circ}\text{F}$  and quenching in water or rapidly cooling by other means.
- (18) The hardness of this material, under the thread roots, shall not exceed Rockwell C35. The hardness shall be measured on a flat area, at least  $\frac{1}{8}$  in. across, prepared by removing thread. No more material than necessary shall be removed to prepare the flat area. Hardness measurements shall be made at the same frequency as the tensile test.
- (19) These allowable stress values apply to bolting materials  $\frac{3}{4}$  in. in diameter and smaller.
- (20) These allowable stress values apply to bolting materials larger than  $\frac{3}{4}$  in. but not larger than 1 in. in diameter.
- (21) These allowable stress values apply to bolting materials larger than 1 in. but not larger than  $1\frac{1}{4}$  in. in diameter.
- (22) These allowable stress values apply to bolting materials larger than  $1\frac{1}{4}$  in. but not larger than  $1\frac{1}{2}$  in. in diameter.
- (23) These allowable stress values apply to bolting material that has been carbide solution treated.
- (24) Due to relatively low yield strength of these materials, these higher allowable stress values were established at temperatures where the short-time tensile properties govern to permit the use of these alloys where slightly greater deformation is acceptable. These stress values exceed 67% but do not exceed 90% of the yield strength at temperature. Use of these stress values may result in dimensional changes due to permanent strain. These values should not be used for the flanges of gasketed joints or other applications where slight amounts of distortion can cause leakage or malfunction.
- (25) These allowable stress values apply to bolting materials 8 in. in diameter and smaller.
- (26) Welding or brazing of this material is not permitted.
- (27) These allowable stress values apply to bolting materials  $\frac{1}{2}$  in. in diameter and smaller.
- (28) Tempered to HR50.
- (29) These allowable stress values apply to bolting materials greater than  $\frac{1}{2}$  in. but not larger than 1 in. in diameter.
- (30) These allowable stress values apply to bolting materials greater than 1 in. but not larger than 2 in. in diameter.
- (31) These allowable stress values apply to bolting materials greater than 2 in. but not larger than 3 in. in diameter.

## **MANDATORY APPENDIX B THERMAL EXPANSION DATA**

Begins on next page.

ASMENORMDOC.COM : Click to view the full PDF of ASME B31.1 2012

(12)

Table B-1 Thermal Expansion Data

|                                                                                           |                  | in Going From 70°F to Indicated Temperature [Note (1)] |      |      |     |     |     |     |     |     |      |      |      |       |       |       |       |       |
|-------------------------------------------------------------------------------------------|------------------|--------------------------------------------------------|------|------|-----|-----|-----|-----|-----|-----|------|------|------|-------|-------|-------|-------|-------|
|                                                                                           |                  | Temperature Range 70°F to                              |      |      |     |     |     |     |     |     |      |      |      |       |       |       |       |       |
| Material                                                                                  | Coef-<br>ficient |                                                        |      |      |     |     |     |     |     |     |      |      |      |       |       |       |       |       |
|                                                                                           |                  | -325                                                   | -150 | -50  | 70  | 200 | 300 | 400 | 500 | 600 | 700  | 800  | 900  | 1,000 | 1,100 | 1,200 | 1,300 | 1,400 |
| Group 1 carbon and low alloy<br>steels [Note (2)]                                         | A                | 5.5                                                    | 5.9  | 6.2  | 6.4 | 6.7 | 6.9 | 7.1 | 7.3 | 7.4 | 7.6  | 7.8  | 7.9  | 8.1   | 8.2   | 8.3   | 8.4   | 8.4   |
|                                                                                           | B                | -2.6                                                   | -1.6 | -0.9 | 0   | 1.0 | 1.9 | 2.8 | 3.7 | 4.7 | 5.7  | 6.8  | 7.9  | 9.0   | 10.1  | 11.3  | 12.4  | 14.7  |
| Group 2 low alloy steels [Note (3)]                                                       | A                | 6.0                                                    | 6.5  | 6.7  | 7.0 | 7.3 | 7.4 | 7.6 | 7.7 | 7.8 | 7.9  | 8.0  | 8.1  | 8.2   | 8.3   | 8.4   | 8.4   | 8.5   |
|                                                                                           | B                | -2.9                                                   | -1.7 | -1.0 | 0   | 1.1 | 2.0 | 3.0 | 4.0 | 5.0 | 6.0  | 7.0  | 8.1  | 9.2   | 10.3  | 11.4  | 12.5  | 13.5  |
| 5Cr-1Mo steels                                                                            | A                | 5.6                                                    | 6.0  | 6.2  | 6.4 | 6.7 | 6.9 | 7.0 | 7.1 | 7.2 | 7.2  | 7.3  | 7.4  | 7.5   | 7.6   | 7.6   | 7.7   | 7.8   |
|                                                                                           | B                | -2.7                                                   | -1.6 | -0.9 | 0   | 1.0 | 1.9 | 2.8 | 3.7 | 4.6 | 5.5  | 6.4  | 7.4  | 8.4   | 9.3   | 10.3  | 11.4  | 12.4  |
| 9Cr-1Mo steels                                                                            | A                | 5.0                                                    | 5.4  | 5.6  | 5.8 | 6.0 | 6.2 | 6.3 | 6.4 | 6.5 | 6.6  | 6.7  | 6.8  | 6.9   | 7.0   | 7.1   | 7.2   | 7.2   |
|                                                                                           | B                | -2.4                                                   | -1.4 | -0.8 | 0   | 0.9 | 1.7 | 2.5 | 3.3 | 4.1 | 5.0  | 5.9  | 6.8  | 7.7   | 8.7   | 9.7   | 10.6  | 11.6  |
| Straight chromium stainless steels<br>12Cr to 13Cr steels                                 | A                | 5.1                                                    | 5.5  | 5.7  | 5.9 | 6.2 | 6.3 | 6.4 | 6.5 | 6.5 | 6.6  | 6.7  | 6.7  | 6.8   | 6.8   | 6.9   | 6.9   | 7.0   |
|                                                                                           | B                | -2.4                                                   | -1.5 | -0.8 | 0   | 1.0 | 1.7 | 2.5 | 3.3 | 4.2 | 5.0  | 5.8  | 6.7  | 7.6   | 8.5   | 9.4   | 10.2  | 11.1  |
| 15Cr to 17Cr steels                                                                       | A                | 4.5                                                    | 4.9  | 5.1  | 5.3 | 5.5 | 5.7 | 5.8 | 5.9 | 6.0 | 6.1  | 6.2  | 6.2  | 6.3   | 6.4   | 6.4   | 6.5   | 6.5   |
|                                                                                           | B                | -2.1                                                   | -1.3 | -0.7 | 0   | 0.9 | 1.6 | 2.3 | 3.0 | 3.8 | 4.6  | 5.4  | 6.2  | 7.0   | 7.9   | 8.7   | 9.5   | 10.4  |
| 27Cr steels                                                                               | A                | 4.3                                                    | 4.7  | 4.9  | 5.0 | 5.2 | 5.2 | 5.3 | 5.4 | 5.4 | 5.5  | 5.6  | 5.7  | 5.7   | 5.8   | 5.9   | 5.9   | 6.0   |
|                                                                                           | B                | -2.0                                                   | -1.2 | -0.7 | 0   | 0.8 | 1.4 | 2.1 | 2.8 | 3.5 | 4.2  | 4.9  | 5.6  | 6.4   | 7.2   | 8.0   | 8.7   | 9.6   |
| Austenitic stainless steels (304,<br>305, 316, 317, 321, 347, 348<br>19-9DL, XM-15, etc.) | A                | 7.5                                                    | 8.0  | 8.2  | 8.5 | 8.9 | 9.2 | 9.5 | 9.7 | 9.9 | 10.0 | 10.1 | 10.2 | 10.3  | 10.4  | 10.6  | 10.7  | 10.8  |
|                                                                                           | B                | -3.6                                                   | -2.1 | -1.2 | 0   | 1.4 | 2.5 | 3.8 | 5.0 | 6.3 | 7.5  | 8.8  | 10.2 | 11.5  | 12.9  | 14.3  | 15.8  | 17.2  |
| Other austenitic stainless steels<br>(309, 310, 315, XM-19, etc.)                         | A                | 7.1                                                    | 7.6  | 7.8  | 8.2 | 8.5 | 8.7 | 8.9 | 9.1 | 9.2 | 9.3  | 9.4  | 9.5  | 9.6   | 9.7   | 9.8   | 9.9   | 10.1  |
|                                                                                           | B                | -3.4                                                   | -2.0 | -1.1 | 0   | 1.3 | 2.4 | 3.5 | 4.7 | 5.8 | 7.0  | 8.2  | 9.5  | 10.7  | 12.0  | 13.3  | 14.7  | 16.1  |
| Gray cast iron                                                                            | A                | ...                                                    | ...  | ...  | ... | 5.8 | 5.9 | 6.1 | 6.3 | 6.5 | 6.7  | 6.8  | 7.0  | 7.2   | ...   | ...   | ...   | ...   |
|                                                                                           | B                | ...                                                    | ...  | ...  | 0   | 0.9 | 1.6 | 2.4 | 3.2 | 4.1 | 5.0  | 6.0  | 7.0  | 8.0   | ...   | ...   | ...   | ...   |
| Ductile cast iron                                                                         | A                | ...                                                    | 4.9  | 5.3  | 5.7 | 6.0 | 6.3 | 6.6 | 6.8 | 7.0 | 7.1  | 7.3  | 7.4  | 7.5   | ...   | ...   | ...   | ...   |
|                                                                                           | B                | ...                                                    | -1.3 | -0.8 | 0   | 0.9 | 1.7 | 2.6 | 3.5 | 4.5 | 5.4  | 6.4  | 7.3  | 8.4   | ...   | ...   | ...   | ...   |

(12)

Table B-1 Thermal Expansion Data (Cont'd)

| Material                                                        |   | in Going From 70°F to Indicated Temperature [Note (1)] |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |
|-----------------------------------------------------------------|---|--------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|
|                                                                 |   | Temperature Range 70°F to                              |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |
|                                                                 |   | Coefficient of Thermal Expansion, $10^{-6}$ in./in./°F |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |
| A = Mean Coefficient of Thermal Expansion, $10^{-6}$ in./in./°F |   | B = Linear Thermal Expansion, in./100 ft               |      |      |      |      |      |      |      |      |      |      |      |       |       |       |       |       |
|                                                                 |   | 325                                                    | 150  | -50  | 70   | 200  | 300  | 400  | 500  | 600  | 700  | 800  | 900  | 1,000 | 1,100 | 1,200 | 1,300 | 1,400 |
| Monel (67Ni-30Cu) N04400                                        | A | 5.8                                                    | 6.8  | 7.2  | 7.7  | 8.1  | 8.3  | 8.5  | 8.7  | 8.8  | 8.9  | 8.9  | 9.0  | 9.1   | 9.1   | 9.2   | 9.2   | 9.3   |
|                                                                 | B | -2.7                                                   | -1.8 | -1.0 | 0    | 1.3  | 2.3  | 3.4  | 4.5  | 5.6  | 6.7  | 7.8  | 9.0  | 10.1  | 11.3  | 12.4  | 13.6  | 14.8  |
| Nickel alloys N02200 and N02201                                 | A | 5.3                                                    | 6.0  | 6.3  | 6.6  | 7.2  | 7.5  | 7.7  | 7.9  | 8.0  | 8.2  | 8.3  | 8.4  | 8.5   | 8.6   | 8.7   | 8.8   | 8.9   |
|                                                                 | B | -2.7                                                   | -1.7 | -1.0 | 0    | 1.1  | 2.1  | 3.1  | 4.1  | 5.1  | 6.2  | 7.3  | 8.4  | 9.5   | 10.7  | 11.8  | 13.0  | 14.2  |
| Nickel alloy N06022                                             | A | ...                                                    | ...  | ...  | 6.9  | 6.9  | 6.9  | 6.9  | 7.0  | 7.0  | 7.2  | 7.3  | 7.5  | 7.7   | 7.9   | 8.1   | 8.3   | 8.5   |
|                                                                 | B | ...                                                    | ...  | ...  | 0    | 1.1  | 1.9  | 2.7  | 3.6  | 4.5  | 5.4  | 6.4  | 7.5  | 8.6   | 9.8   | 11.0  | 12.2  | 13.6  |
| Nickel alloy N06600                                             | A | 5.5                                                    | 6.1  | 6.4  | 6.8  | 7.1  | 7.3  | 7.5  | 7.6  | 7.8  | 7.9  | 8.0  | 8.2  | 8.3   | 8.4   | 8.6   | 8.7   | 8.9   |
|                                                                 | B | -2.6                                                   | -1.6 | -0.9 | 0    | 1.1  | 2.0  | 3.0  | 3.9  | 5.0  | 6.0  | 7.0  | 8.1  | 9.3   | 10.4  | 11.6  | 12.9  | 14.2  |
| Nickel alloy N06625                                             | A | ...                                                    | ...  | ...  | 6.7  | 7.1  | 7.2  | 7.3  | 7.4  | 7.4  | 7.5  | 7.6  | 7.7  | 7.9   | 8.0   | 8.2   | 8.4   | 8.5   |
|                                                                 | B | ...                                                    | ...  | ...  | 0    | 1.1  | 2.0  | 2.9  | 3.8  | 4.7  | 5.6  | 6.6  | 7.7  | 8.8   | 9.9   | 11.1  | 12.3  | 13.6  |
| Nickel alloys N08800 and N08810                                 | A | 5.9                                                    | 6.9  | 7.4  | 7.9  | 8.4  | 8.6  | 8.8  | 8.9  | 9.0  | 9.1  | 9.2  | 9.3  | 9.4   | 9.5   | 9.6   | 9.7   | 9.8   |
|                                                                 | B | -2.8                                                   | -1.7 | -1.1 | 0    | 1.3  | 2.4  | 3.5  | 4.6  | 5.7  | 6.9  | 8.1  | 9.3  | 10.5  | 11.8  | 13.0  | 14.4  | 15.7  |
| Nickel alloy N08825                                             | A | ...                                                    | ...  | 7.2  | 7.5  | 7.7  | 7.9  | 8.0  | 8.1  | 8.2  | 8.3  | 8.4  | 8.5  | 8.6   | ...   | ...   | ...   | ...   |
|                                                                 | B | ...                                                    | ...  | -1.0 | 0    | 1.2  | 2.2  | 3.2  | 4.2  | 5.2  | 6.3  | 7.4  | 8.5  | 9.6   | ...   | ...   | ...   | ...   |
| Nickel alloy N10276                                             | A | ...                                                    | ...  | ...  | 6.0  | 6.3  | 6.5  | 6.7  | 6.9  | 7.1  | 7.2  | 7.4  | 7.5  | 7.6   | 7.7   | 7.8   | 7.9   | 8.0   |
|                                                                 | B | ...                                                    | ...  | ...  | 0    | 1.0  | 1.8  | 2.7  | 3.6  | 4.5  | 5.5  | 6.4  | 7.5  | 8.5   | 9.5   | 10.6  | 11.7  | 12.8  |
| Copper alloys C1XXXX series                                     | A | 7.7                                                    | 8.7  | 9.0  | 9.3  | 9.6  | 9.7  | 9.8  | 9.9  | 10.0 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   |
|                                                                 | B | -3.7                                                   | -2.3 | -1.3 | 0    | 1.5  | 2.7  | 3.9  | 5.1  | 6.4  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   |
| Bronze alloys                                                   | A | 8.4                                                    | 8.8  | 9.2  | 9.6  | 10.0 | 10.1 | 10.2 | 10.3 | 10.4 | 10.5 | 10.6 | 10.7 | 10.8  | 10.9  | 11.0  | ...   | ...   |
|                                                                 | B | -4.0                                                   | -2.3 | -1.3 | 0    | 1.6  | 2.8  | 4.0  | 5.3  | 6.6  | 8.0  | 9.3  | 10.7 | 12.1  | 13.5  | 14.9  | ...   | ...   |
| Brass alloys                                                    | A | 8.2                                                    | 8.5  | 9.0  | 9.3  | 9.8  | 10.0 | 10.2 | 10.5 | 10.7 | 10.9 | 11.2 | 11.4 | 11.6  | 11.9  | 12.1  | ...   | ...   |
|                                                                 | B | -3.9                                                   | -2.2 | -1.3 | 0    | 1.5  | 2.8  | 4.1  | 5.4  | 6.8  | 8.2  | 9.8  | 11.4 | 13.0  | 14.7  | 16.4  | ...   | ...   |
| Copper-nickel (70Cu-30Ni)                                       | A | 6.7                                                    | 7.4  | 7.8  | 8.1  | 8.5  | 8.7  | 8.9  | 9.1  | 9.2  | 9.2  | ...  | ...  | ...   | ...   | ...   | ...   | ...   |
|                                                                 | B | -3.2                                                   | -2.0 | -1.1 | 0    | 1.3  | 2.4  | 3.5  | 4.7  | 5.8  | 7.0  | ...  | ...  | ...   | ...   | ...   | ...   | ...   |
| Aluminum alloys                                                 | A | 9.9                                                    | 10.9 | 11.6 | 12.1 | 13.0 | 13.3 | 13.6 | 13.9 | 14.2 | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   |
|                                                                 | B | -4.7                                                   | -2.9 | -1.7 | 0    | 2.0  | 3.7  | 5.4  | 7.2  | 9.0  | ...  | ...  | ...  | ...   | ...   | ...   | ...   | ...   |
| Titanium alloys (Grades 1, 2, 3, 7, and 12)                     | A | ...                                                    | ...  | 4.5  | 4.6  | 4.7  | 4.8  | 4.8  | 4.9  | 4.9  | 5.0  | 5.1  | ...  | ...   | ...   | ...   | ...   | ...   |
|                                                                 | B | ...                                                    | ...  | -0.6 | 0    | 0.7  | 1.3  | 1.9  | 2.5  | 3.1  | 3.8  | 4.5  | ...  | ...   | ...   | ...   | ...   | ...   |

**Table B-1 Thermal Expansion Data (Cont'd)****NOTES:**

- (1) These data are for information and it is not to be implied that materials are suitable for all the temperature ranges shown.  
 (2) Group 1 alloys (by nominal composition):

## Carbon steels

(C, C-Si, C-Mn, and C-Mn-Si)

|                                                      |                                                           |
|------------------------------------------------------|-----------------------------------------------------------|
| C- $\frac{1}{2}$ Mo                                  | $\frac{1}{2}$ Ni- $\frac{1}{2}$ Mo-V                      |
| $\frac{1}{2}$ Cr- $\frac{1}{5}$ Mo-V                 | $\frac{1}{2}$ Ni- $\frac{1}{2}$ Cr- $\frac{1}{4}$ Mo-V    |
| $\frac{1}{2}$ Cr- $\frac{1}{4}$ Mo-Si                | $\frac{3}{4}$ Ni- $\frac{1}{2}$ Mo-Cr-V                   |
| $\frac{1}{2}$ Cr- $\frac{1}{2}$ Mo                   | $\frac{3}{4}$ Ni- $\frac{1}{2}$ Mo- $\frac{1}{3}$ Cr-V    |
| $\frac{1}{2}$ Cr- $\frac{1}{2}$ Ni- $\frac{1}{4}$ Mo | $\frac{3}{4}$ Ni- $\frac{1}{2}$ Cu-Mo                     |
| $\frac{3}{4}$ Cr- $\frac{1}{2}$ Ni-Cu                | $\frac{3}{4}$ Ni- $\frac{1}{2}$ Cr- $\frac{1}{2}$ Mo-V    |
| $\frac{3}{4}$ Cr- $\frac{3}{4}$ Ni-Cu-Al             | $\frac{3}{4}$ Ni-1Mo- $\frac{3}{4}$ Cr                    |
| 1Cr- $\frac{1}{5}$ Mo                                | 1Ni- $\frac{1}{2}$ Cr- $\frac{1}{2}$ Mo                   |
| 1Cr- $\frac{1}{5}$ Mo-Si                             | 1 $\frac{1}{4}$ Ni-1Cr- $\frac{1}{2}$ Mo                  |
| 1Cr- $\frac{1}{2}$ Mo                                | 1 $\frac{3}{4}$ Ni- $\frac{3}{4}$ Cr- $\frac{1}{4}$ Mo    |
| 1Cr- $\frac{1}{2}$ Mo-V                              | 2Ni- $\frac{3}{4}$ Cr- $\frac{1}{4}$ Mo                   |
| 1 $\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo                 | 2Ni- $\frac{3}{4}$ Cr- $\frac{1}{3}$ Mo                   |
| 1 $\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo-Si              | 2 $\frac{1}{2}$ Ni                                        |
| 1 $\frac{3}{4}$ Cr- $\frac{1}{2}$ Mo-Cu              | 3 $\frac{1}{2}$ Ni                                        |
| 2Cr- $\frac{1}{2}$ Mo                                | 3 $\frac{1}{2}$ Ni-1 $\frac{3}{4}$ Cr- $\frac{1}{2}$ Mo-V |
| 2 $\frac{1}{4}$ Cr-1Mo                               |                                                           |
| 3Cr-1Mo                                              |                                                           |

- (3) Group 2 alloys (by nominal composition):

Mn-V  
 Mn- $\frac{1}{4}$ Mo  
 Mn- $\frac{1}{2}$ Mo  
 Mn- $\frac{1}{2}$ Mo- $\frac{1}{4}$ Ni  
 Mn- $\frac{1}{2}$ Mo- $\frac{1}{2}$ Ni  
 Mn- $\frac{1}{2}$ Mo- $\frac{3}{4}$ Ni

ASME B31.1-2012

Click to view the full PDF of ASME B31.1 2012

Table B-1 (SI) begins on the next page.

ASMENORMDOC.COM : Click to view the full PDF of ASME B31.1 2012

(12)

Table B-1 (SI) Thermal Expansion Data

| $A$ = Mean Coefficient of Thermal Expansion, $10^{-6}$ mm/mm/°C<br>$B$ = Linear Thermal Expansion, mm/m |                  | } in Going From 20°C to Indicated Temperature [Note (1)] |      |      |      |      |      |      |      |      |      |      |      |      |      |
|---------------------------------------------------------------------------------------------------------|------------------|----------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| Material                                                                                                | Coef-<br>ficient | Temperature Range 20°C to                                |      |      |      |      |      |      |      |      |      |      |      |      |      |
|                                                                                                         |                  | -200                                                     | -100 | -50  | 20   | 50   | 75   | 100  | 125  | 150  | 175  | 200  | 225  | 250  | 275  |
| Group 1 carbon and low alloy steels [Note (2)]                                                          | $A$              | 9.9                                                      | 10.7 | 11.1 | 11.5 | 11.8 | 11.9 | 12.1 | 12.3 | 12.4 | 12.6 | 12.7 | 12.9 | 13.0 | 13.2 |
|                                                                                                         | $B$              | -2.2                                                     | -1.3 | -0.8 | 0    | 0.4  | 0.7  | 1.0  | 1.3  | 1.6  | 2.0  | 2.3  | 2.6  | 3.0  | 3.4  |
| Group 2 low alloy steels [Note (3)]                                                                     | $A$              | 10.8                                                     | 11.7 | 12.0 | 12.6 | 12.8 | 13.0 | 13.1 | 13.2 | 13.4 | 13.5 | 13.6 | 13.7 | 13.8 | 13.9 |
|                                                                                                         | $B$              | -2.4                                                     | -1.4 | -0.8 | 0    | 0.4  | 0.7  | 1.0  | 1.4  | 1.7  | 2.1  | 2.4  | 2.8  | 3.2  | 3.6  |
| 5Cr-1Mo steels                                                                                          | $A$              | 10.1                                                     | 10.8 | 11.2 | 11.5 | 11.8 | 12.0 | 12.1 | 12.3 | 12.4 | 12.5 | 12.6 | 12.6 | 12.7 | 12.8 |
|                                                                                                         | $B$              | -2.2                                                     | -1.3 | -0.8 | 0    | 0.4  | 0.7  | 1.0  | 1.3  | 1.6  | 1.9  | 2.3  | 2.6  | 2.9  | 3.3  |
| 9Cr-1Mo steels                                                                                          | $A$              | 9.0                                                      | 9.8  | 10.1 | 10.5 | 10.6 | 10.7 | 10.9 | 11.0 | 11.1 | 11.2 | 11.3 | 11.4 | 11.5 | 11.6 |
|                                                                                                         | $B$              | -2.0                                                     | -1.2 | -0.7 | 0    | 0.3  | 0.6  | 0.9  | 1.2  | 1.4  | 1.7  | 2.0  | 2.3  | 2.6  | 3.0  |
| Straight chromium stainless steels<br>12Cr to 13Cr steels                                               | $A$              | 9.1                                                      | 9.9  | 10.2 | 10.6 | 10.9 | 11.0 | 11.1 | 11.3 | 11.4 | 11.4 | 11.5 | 11.6 | 11.6 | 11.7 |
|                                                                                                         | $B$              | -2.0                                                     | -1.2 | -0.7 | 0    | 0.3  | 0.6  | 0.9  | 1.2  | 1.5  | 1.8  | 2.1  | 2.4  | 2.7  | 3.0  |
| 15Cr to 17Cr steels                                                                                     | $A$              | 8.1                                                      | 8.8  | 9.1  | 9.6  | 9.7  | 9.9  | 10.0 | 10.1 | 10.2 | 10.3 | 10.4 | 10.5 | 10.6 | 10.7 |
|                                                                                                         | $B$              | -1.8                                                     | -1.1 | -0.6 | 0    | 0.3  | 0.5  | 0.8  | 1.1  | 1.3  | 1.6  | 1.9  | 2.2  | 2.4  | 2.7  |
| 27Cr steels                                                                                             | $A$              | 7.7                                                      | 8.5  | 8.7  | 9.0  | 9.2  | 9.2  | 9.3  | 9.4  | 9.4  | 9.5  | 9.5  | 9.6  | 9.6  | 9.7  |
|                                                                                                         | $B$              | -1.7                                                     | -1.0 | -0.6 | 0    | 0.3  | 0.5  | 0.7  | 1.0  | 1.2  | 1.5  | 1.7  | 2.0  | 2.2  | 2.5  |
| Austenitic stainless steels (304,<br>305, 316, 317, 321, 347, 348<br>19-9DL XM-15, etc.)                | $A$              | 13.5                                                     | 14.3 | 14.7 | 15.3 | 15.6 | 15.9 | 16.2 | 16.4 | 16.6 | 16.8 | 17.0 | 17.2 | 17.4 | 17.5 |
|                                                                                                         | $B$              | -3.0                                                     | -1.7 | -1.0 | 0    | 0.5  | 0.9  | 1.3  | 1.7  | 2.2  | 2.6  | 3.1  | 3.5  | 4.0  | 4.5  |
| Other austenitic stainless steels<br>(309, 310, 315, XM-19, etc.)                                       | $A$              | 12.8                                                     | 13.6 | 14.1 | 14.7 | 15.0 | 15.2 | 15.4 | 15.6 | 15.7 | 15.9 | 16.0 | 16.1 | 16.3 | 16.4 |
|                                                                                                         | $B$              | -2.8                                                     | -1.6 | -1.0 | 0    | 0.4  | 0.8  | 1.2  | 1.6  | 2.0  | 2.5  | 2.9  | 3.3  | 3.7  | 4.2  |
| Gray cast iron                                                                                          | $A$              | ...                                                      | ...  | ...  | 9.8  | 10.1 | 10.2 | 10.4 | 10.5 | 10.7 | 10.8 | 11.0 | 11.1 | 11.2 | 11.4 |
|                                                                                                         | $B$              | ...                                                      | ...  | ...  | 0    | 0.3  | 0.6  | 0.8  | 1.1  | 1.4  | 1.7  | 2.0  | 2.3  | 2.6  | 2.9  |
| Ductile cast iron                                                                                       | $A$              | ...                                                      | 8.8  | 9.5  | 10.3 | 10.5 | 10.7 | 10.9 | 11.1 | 11.3 | 11.6 | 11.8 | 12.0 | 12.2 | 12.4 |
|                                                                                                         | $B$              | ...                                                      | -1.1 | -0.7 | 0    | 0.3  | 0.6  | 0.9  | 1.2  | 1.5  | 1.8  | 2.1  | 2.5  | 2.8  | 3.1  |
| Monel (67Ni-30Cu) N04400                                                                                | $A$              | 10.4                                                     | 12.2 | 13.0 | 13.8 | 14.1 | 14.4 | 14.6 | 14.8 | 15.0 | 15.1 | 15.3 | 15.4 | 15.5 | 15.6 |
|                                                                                                         | $B$              | -2.3                                                     | -1.5 | -0.9 | 0    | 0.4  | 0.8  | 1.2  | 1.6  | 1.9  | 2.3  | 2.8  | 3.2  | 3.6  | 4.0  |
| Nickel alloys N02200 and N02201                                                                         | $A$              | 9.6                                                      | 10.8 | 11.4 | 11.9 | 12.4 | 12.7 | 13.0 | 13.3 | 13.5 | 13.7 | 13.9 | 14.0 | 14.2 | 14.3 |
|                                                                                                         | $B$              | -2.2                                                     | -1.4 | -0.8 | 0    | 0.4  | 0.7  | 1.0  | 1.4  | 1.8  | 2.1  | 2.5  | 2.9  | 3.3  | 3.6  |
| Nickel alloy N06022                                                                                     | $A$              | ...                                                      | ...  | ...  | 12.4 | 12.4 | 12.4 | 12.4 | 12.4 | 12.4 | 12.4 | 12.4 | 12.5 | 12.5 | 12.6 |
|                                                                                                         | $B$              | ...                                                      | ...  | ...  | 0    | 0.4  | 0.7  | 1.0  | 1.3  | 1.6  | 1.9  | 2.2  | 2.6  | 2.9  | 3.2  |
| Nickel alloy N06600                                                                                     | $A$              | 9.9                                                      | 10.8 | 11.5 | 12.3 | 12.5 | 12.7 | 12.8 | 13.0 | 13.2 | 13.3 | 13.5 | 13.6 | 13.7 | 13.8 |
|                                                                                                         | $B$              | -2.2                                                     | -1.3 | -0.8 | 0    | 0.4  | 0.7  | 1.0  | 1.4  | 1.7  | 2.1  | 2.4  | 2.8  | 3.2  | 3.5  |
| Nickel alloy N06625                                                                                     | $A$              | ...                                                      | ...  | ...  | 12.0 | 12.4 | 12.6 | 12.8 | 12.9 | 13.0 | 13.1 | 13.2 | 13.2 | 13.2 | 13.3 |
|                                                                                                         | $B$              | ...                                                      | ...  | ...  | 0    | 0.4  | 0.7  | 1.0  | 1.4  | 1.7  | 2.0  | 2.4  | 2.7  | 3.0  | 3.4  |
| Nickel alloys N08800 and N08810                                                                         | $A$              | 10.6                                                     | 12.5 | 13.3 | 14.2 | 14.6 | 14.9 | 15.1 | 15.3 | 15.5 | 15.6 | 15.8 | 15.9 | 16.0 | 16.1 |
|                                                                                                         | $B$              | -2.3                                                     | -1.5 | -0.9 | 0    | 0.4  | 0.8  | 1.2  | 1.6  | 2.0  | 2.4  | 2.8  | 3.3  | 3.7  | 4.1  |
| Nickel alloy N08825                                                                                     | $A$              | ...                                                      | ...  | 12.9 | 13.5 | 13.6 | 13.7 | 13.9 | 14.0 | 14.2 | 14.3 | 14.4 | 14.4 | 14.5 | 14.6 |
|                                                                                                         | $B$              | ...                                                      | ...  | -0.9 | 0    | 0.4  | 0.8  | 1.1  | 1.5  | 1.8  | 2.2  | 2.6  | 3.0  | 3.3  | 3.7  |
| Nickel alloy N10276                                                                                     | $A$              | ...                                                      | ...  | ...  | 10.8 | 11.0 | 11.2 | 11.4 | 11.6 | 11.7 | 11.9 | 12.0 | 12.2 | 12.4 | 12.5 |
|                                                                                                         | $B$              | ...                                                      | ...  | ...  | 0    | 0.3  | 0.6  | 0.9  | 1.2  | 1.5  | 1.8  | 2.2  | 2.5  | 2.8  | 3.2  |

Table B-1 (SI) Thermal Expansion Data

(12)

| A = Mean Coefficient of Thermal Expansion, 10 <sup>-6</sup> mm/mm/°C<br>B = Linear Thermal Expansion, mm/m |             |             |             |             |             |             |             |             |             | in Going From 20°C to Indicated Temperature [Note (1)] |              |              |              |              |              |              |              |              |              |              |
|------------------------------------------------------------------------------------------------------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|--------------------------------------------------------|--------------|--------------|--------------|--------------|--------------|--------------|--------------|--------------|--------------|--------------|
| Temperature Range 20°C to                                                                                  |             |             |             |             |             |             |             |             |             |                                                        |              |              |              |              |              |              |              |              |              |              |
| 300                                                                                                        | 325         | 350         | 375         | 400         | 425         | 450         | 475         | 500         | 525         | 550                                                    | 575          | 600          | 625          | 650          | 675          | 700          | 725          | 750          | 775          | 800          |
| 13.3<br>3.7                                                                                                | 13.4<br>4.1 | 13.6<br>4.5 | 13.7<br>4.9 | 13.8<br>5.3 | 14.0<br>5.7 | 14.1<br>6.1 | 14.2<br>6.5 | 14.4<br>6.9 | 14.5<br>7.3 | 14.6<br>7.7                                            | 14.7<br>8.2  | 14.8<br>8.6  | 14.9<br>9.0  | 15.0<br>9.4  | 15.1<br>9.9  | 15.1<br>10.3 | 15.2<br>10.7 | 15.3<br>11.1 | 15.3<br>11.6 | 15.4<br>12.0 |
| 14.0<br>3.9                                                                                                | 14.1<br>4.3 | 14.2<br>4.7 | 14.3<br>5.1 | 14.4<br>5.5 | 14.5<br>5.9 | 14.6<br>6.3 | 14.6<br>6.7 | 14.7<br>7.1 | 14.8<br>7.5 | 14.8<br>7.9                                            | 14.9<br>8.3  | 15.0<br>8.7  | 15.0<br>9.1  | 15.1<br>9.5  | 15.1<br>9.9  | 15.2<br>10.3 | 15.2<br>10.7 | 15.3<br>11.1 | 15.3<br>11.1 | 15.3<br>11.5 |
| 12.8<br>3.6                                                                                                | 12.9<br>3.9 | 13.0<br>4.3 | 13.0<br>4.6 | 13.1<br>5.0 | 13.2<br>5.3 | 13.2<br>5.7 | 13.3<br>6.1 | 13.4<br>6.4 | 13.4<br>6.8 | 13.5<br>7.2                                            | 13.6<br>7.5  | 13.6<br>7.9  | 13.7<br>8.3  | 13.7<br>8.7  | 13.8<br>9.0  | 13.9<br>9.4  | 13.9<br>9.8  | 14.0<br>10.2 | 14.0<br>10.6 | 14.1<br>11.0 |
| 11.7<br>3.3                                                                                                | 11.8<br>3.6 | 11.9<br>3.9 | 11.9<br>4.2 | 12.0<br>4.6 | 12.1<br>4.9 | 12.2<br>5.2 | 12.3<br>5.6 | 12.3<br>5.9 | 12.4<br>6.3 | 12.5<br>6.6                                            | 12.6<br>7.0  | 12.7<br>7.3  | 12.7<br>7.7  | 12.8<br>8.1  | 12.9<br>8.5  | 13.0<br>8.9  | 13.1<br>9.3  | 13.3<br>9.7  | 13.4<br>10.1 | 13.6<br>10.6 |
| 11.7<br>3.3                                                                                                | 11.8<br>3.6 | 11.8<br>3.9 | 11.9<br>4.2 | 11.9<br>4.5 | 12.0<br>4.9 | 12.0<br>5.2 | 12.1<br>5.5 | 12.1<br>5.8 | 12.2<br>6.2 | 12.2<br>6.5                                            | 12.3<br>6.8  | 12.3<br>7.2  | 12.4<br>7.5  | 12.4<br>7.8  | 12.5<br>8.2  | 12.5<br>8.5  | 12.5<br>8.8  | 12.5<br>9.2  | 12.6<br>9.5  | 12.6<br>9.8  |
| 10.8<br>3.0                                                                                                | 10.8<br>3.3 | 10.9<br>3.6 | 11.0<br>3.9 | 11.0<br>4.2 | 11.1<br>4.5 | 11.2<br>4.8 | 11.2<br>5.1 | 11.3<br>5.4 | 11.3<br>5.7 | 11.4<br>6.0                                            | 11.4<br>6.3  | 11.5<br>6.6  | 11.5<br>7.0  | 11.5<br>7.3  | 11.6<br>7.6  | 11.6<br>7.9  | 11.7<br>8.2  | 11.7<br>8.6  | 11.8<br>8.9  | 11.9<br>9.3  |
| 9.7<br>2.7                                                                                                 | 9.8<br>3.0  | 9.9<br>3.3  | 9.9<br>3.5  | 10.0<br>3.8 | 10.0<br>4.1 | 10.1<br>4.3 | 10.2<br>4.6 | 10.2<br>4.9 | 10.3<br>5.2 | 10.4<br>5.5                                            | 10.4<br>5.8  | 10.5<br>6.1  | 10.5<br>6.4  | 10.6<br>6.7  | 10.6<br>7.0  | 10.7<br>7.2  | 10.7<br>7.6  | 10.8<br>7.9  | 10.8<br>8.2  | 10.9<br>8.5  |
| 17.7<br>4.9                                                                                                | 17.8<br>5.4 | 17.9<br>5.9 | 18.0<br>6.4 | 18.1<br>6.9 | 18.2<br>7.4 | 18.3<br>7.9 | 18.4<br>8.3 | 18.4<br>8.9 | 18.5<br>9.4 | 18.6<br>9.9                                            | 18.7<br>10.4 | 18.8<br>10.9 | 18.9<br>11.4 | 19.0<br>12.0 | 19.1<br>12.5 | 19.2<br>13.1 | 19.3<br>13.6 | 19.4<br>14.1 | 19.4<br>14.7 | 19.4<br>15.2 |
| 16.5<br>4.6                                                                                                | 16.6<br>5.0 | 16.6<br>5.5 | 16.7<br>5.9 | 16.8<br>6.4 | 16.9<br>6.8 | 17.0<br>7.3 | 17.1<br>7.8 | 17.2<br>8.2 | 17.2<br>8.7 | 17.3<br>9.2                                            | 17.4<br>9.7  | 17.5<br>10.2 | 17.6<br>10.6 | 17.7<br>11.1 | 17.8<br>11.7 | 17.9<br>12.2 | 18.0<br>12.7 | 18.1<br>13.2 | 18.2<br>13.7 | 18.3<br>14.3 |
| 11.5<br>3.2                                                                                                | 11.7<br>3.6 | 11.8<br>3.9 | 12.0<br>4.2 | 12.1<br>4.6 | 12.3<br>5.0 | 12.4<br>5.3 | 12.6<br>5.7 | 12.7<br>6.1 | 12.9<br>6.5 | 13.0<br>6.9                                            | ...          | ...          | ...          | ...          | ...          | ...          | ...          | ...          | ...          | ...          |
| 12.5<br>3.5                                                                                                | 12.6<br>3.9 | 12.8<br>4.2 | 12.9<br>4.6 | 13.0<br>4.9 | 13.1<br>5.3 | 13.2<br>5.7 | 13.2<br>6.0 | 13.3<br>6.4 | 13.4<br>6.8 | 13.5<br>7.2                                            | ...          | ...          | ...          | ...          | ...          | ...          | ...          | ...          | ...          | ...          |
| 15.7<br>4.4                                                                                                | 15.8<br>4.8 | 15.9<br>5.2 | 16.0<br>5.7 | 16.0<br>6.1 | 16.1<br>6.5 | 16.1<br>6.9 | 16.2<br>7.4 | 16.2<br>7.8 | 16.3<br>8.2 | 16.3<br>8.6                                            | 16.4<br>9.1  | 16.4<br>9.5  | 16.5<br>10.0 | 16.5<br>10.4 | 16.5<br>10.8 | 16.6<br>11.3 | 16.6<br>11.7 | 16.7<br>12.2 | 16.7<br>12.6 | 16.8<br>13.1 |
| 14.4<br>4.0                                                                                                | 14.5<br>4.4 | 14.6<br>4.8 | 14.7<br>5.2 | 14.8<br>5.6 | 14.9<br>6.0 | 15.0<br>6.5 | 15.1<br>6.9 | 15.2<br>7.3 | 15.3<br>7.7 | 15.4<br>8.2                                            | 15.5<br>8.6  | 15.6<br>9.0  | 15.6<br>9.5  | 15.7<br>9.9  | 15.8<br>10.3 | 15.9<br>10.8 | 15.9<br>11.2 | 16.0<br>11.7 | 16.1<br>12.2 | 16.2<br>12.6 |
| 12.6<br>3.5                                                                                                | 12.7<br>3.9 | 12.8<br>4.2 | 12.9<br>4.6 | 13.0<br>5.0 | 13.2<br>5.3 | 13.3<br>5.7 | 13.5<br>6.1 | 13.6<br>6.5 | 13.8<br>7.0 | 13.9<br>7.4                                            | 14.1<br>7.8  | 14.3<br>8.3  | 14.4<br>8.7  | 14.6<br>9.2  | 14.8<br>9.7  | 14.9<br>10.1 | 15.1<br>10.6 | 15.2<br>11.1 | 15.4<br>11.6 | 15.6<br>12.1 |
| 14.0<br>3.9                                                                                                | 14.1<br>4.3 | 14.2<br>4.7 | 14.3<br>5.1 | 14.4<br>5.5 | 14.5<br>5.9 | 14.6<br>6.3 | 14.7<br>6.7 | 14.8<br>7.1 | 14.9<br>7.5 | 15.0<br>7.9                                            | 15.1<br>8.4  | 15.2<br>8.8  | 15.3<br>9.3  | 15.4<br>9.7  | 15.6<br>10.2 | 15.7<br>10.7 | 15.8<br>11.1 | 15.9<br>11.6 | 16.1<br>12.1 | 16.2<br>12.6 |
| 13.3<br>3.7                                                                                                | 13.3<br>4.1 | 13.4<br>4.4 | 13.5<br>4.8 | 13.5<br>5.1 | 13.6<br>5.5 | 13.7<br>5.9 | 13.8<br>6.3 | 14.0<br>6.7 | 14.1<br>7.1 | 14.2<br>7.5                                            | 14.3<br>8.0  | 14.5<br>8.4  | 14.6<br>8.8  | 14.8<br>9.3  | 14.9<br>9.8  | 15.0<br>10.2 | 15.1<br>10.7 | 15.3<br>11.2 | 15.4<br>11.6 | 15.6<br>12.1 |
| 16.2<br>4.5                                                                                                | 16.3<br>5.0 | 16.4<br>5.4 | 16.5<br>5.8 | 16.5<br>6.3 | 16.6<br>6.7 | 16.7<br>7.2 | 16.8<br>7.6 | 16.8<br>8.1 | 16.9<br>8.5 | 17.0<br>9.0                                            | 17.1<br>9.5  | 17.2<br>9.9  | 17.2<br>10.4 | 17.3<br>10.9 | 17.4<br>11.4 | 17.5<br>11.9 | 17.6<br>12.4 | 17.7<br>12.9 | 17.8<br>13.4 | 17.9<br>14.0 |
| 14.7<br>4.1                                                                                                | 14.8<br>4.5 | 14.9<br>4.9 | 15.0<br>5.3 | 15.1<br>5.7 | 15.1<br>6.1 | 15.2<br>6.5 | 15.3<br>7.0 | 15.4<br>7.4 | 15.5<br>7.8 | 15.6<br>8.3                                            | ...          | ...          | ...          | ...          | ...          | ...          | ...          | ...          | ...          | ...          |
| 12.6<br>3.5                                                                                                | 12.8<br>3.9 | 12.9<br>4.3 | 13.0<br>4.6 | 13.1<br>5.0 | 13.2<br>5.4 | 13.3<br>5.7 | 13.4<br>6.1 | 13.5<br>6.5 | 13.6<br>6.9 | 13.7<br>7.3                                            | 13.8<br>7.7  | 13.9<br>8.1  | 14.0<br>8.5  | 14.1<br>8.9  | 14.2<br>9.3  | 14.3<br>9.7  | 14.3<br>10.1 | 14.4<br>10.5 | 14.5<br>10.9 | 14.6<br>11.4 |

(12)

Table B-1 (SI) Thermal Expansion Data (Cont'd)

| A = Mean Coefficient of Thermal Expansion, $10^{-6}$ mm/mm/°C<br>B = Linear Thermal Expansion, mm/m |                  | } in Going From 20°C to Indicated Temperature [Note (1)] |      |      |      |      |      |      |      |      |      |      |      |      |      |
|-----------------------------------------------------------------------------------------------------|------------------|----------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| Material                                                                                            | Coef-<br>ficient | Temperature Range 20°C to                                |      |      |      |      |      |      |      |      |      |      |      |      |      |
|                                                                                                     |                  | -200                                                     | -100 | -50  | 20   | 50   | 75   | 100  | 125  | 150  | 175  | 200  | 225  | 250  | 275  |
| Copper alloys C1XXX series                                                                          | A                | 13.9                                                     | 15.7 | 16.2 | 16.7 | 17.0 | 17.2 | 17.3 | 17.4 | 17.5 | 17.6 | 17.7 | 17.8 | 17.8 | 17.9 |
|                                                                                                     | B                | -3.1                                                     | -1.9 | -1.1 | 0    | 0.5  | 0.9  | 1.4  | 1.8  | 2.3  | 2.7  | 3.2  | 3.6  | 4.1  | 4.6  |
| Bronze alloys                                                                                       | A                | 15.1                                                     | 15.8 | 16.4 | 17.2 | 17.6 | 17.9 | 18.0 | 18.2 | 18.2 | 18.3 | 18.4 | 18.5 | 18.5 | 18.6 |
|                                                                                                     | B                | -3.3                                                     | -1.9 | -1.1 | 0    | 0.5  | 1.0  | 1.4  | 1.9  | 2.4  | 2.8  | 3.3  | 3.8  | 4.3  | 4.7  |
| Brass alloys                                                                                        | A                | 14.7                                                     | 15.4 | 16.0 | 16.7 | 17.1 | 17.4 | 17.6 | 17.8 | 18.0 | 18.2 | 18.4 | 18.6 | 18.8 | 19.0 |
|                                                                                                     | B                | -3.2                                                     | -1.9 | -1.1 | 0    | 0.5  | 1.0  | 1.4  | 1.9  | 2.3  | 2.8  | 3.3  | 3.8  | 4.3  | 4.8  |
| Copper-nickel (70Cu-30Ni)                                                                           | A                | 11.9                                                     | 13.4 | 14.0 | 14.5 | 14.9 | 15.2 | 15.3 | 15.5 | 15.7 | 15.8 | 16.0 | 16.1 | 16.3 | 16.4 |
|                                                                                                     | B                | -2.6                                                     | -1.6 | -1.0 | 0    | 0.4  | 0.8  | 1.2  | 1.6  | 2.0  | 2.5  | 2.9  | 3.3  | 3.7  | 4.2  |
| Aluminum alloys                                                                                     | A                | 18.0                                                     | 19.7 | 20.8 | 21.7 | 22.6 | 23.1 | 23.4 | 23.7 | 23.9 | 24.2 | 24.4 | 24.7 | 25.0 | 25.2 |
|                                                                                                     | B                | -4.0                                                     | -2.4 | -1.5 | 0    | 0.7  | 1.3  | 1.9  | 2.5  | 3.1  | 3.7  | 4.4  | 5.1  | 5.7  | 6.4  |
| Titanium alloys (Grades 1, 2, 3, 7, and 12)                                                         | A                | ...                                                      | ...  | 8.2  | 8.3  | 8.4  | 8.5  | 8.5  | 8.6  | 8.6  | 8.6  | 8.7  | 8.7  | 8.7  | 8.8  |
|                                                                                                     | B                | ...                                                      | ...  | -0.6 | 0    | 0.3  | 0.5  | 0.7  | 0.9  | 1.1  | 1.3  | 1.6  | 1.8  | 2.0  | 2.2  |

## NOTES:

(1) These data are for information and it is not to be implied that materials are suitable for all the temperature ranges shown.

(2) Group 1 alloys (by nominal composition):

Carbon steels

(C, C-Si, C-Mn, and C-Mn-Si)

C- $\frac{1}{2}$ Mo $\frac{1}{2}$ Cr- $\frac{1}{5}$ Mo-V $\frac{1}{2}$ Cr- $\frac{1}{4}$ Mo-Si $\frac{1}{2}$ Cr- $\frac{1}{2}$ Mo $\frac{1}{2}$ Cr- $\frac{1}{2}$ Ni- $\frac{1}{4}$ Mo $\frac{3}{4}$ Cr- $\frac{1}{2}$ Ni-Cu $\frac{3}{4}$ Cr- $\frac{3}{4}$ Ni-Cu-Al1Cr- $\frac{1}{5}$ Mo1Cr- $\frac{1}{5}$ Mo-Si1Cr- $\frac{1}{2}$ Mo1Cr- $\frac{1}{2}$ Mo-V $1\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo $1\frac{1}{4}$ Cr- $\frac{1}{2}$ Mo-Si $1\frac{3}{4}$ Cr- $\frac{1}{2}$ Mo-Cu2Cr- $\frac{1}{2}$ Mo $2\frac{1}{4}$ Cr-1Mo

3Cr-1Mo

 $\frac{1}{2}$ Ni- $\frac{1}{2}$ Mo-V $\frac{1}{2}$ Ni- $\frac{1}{2}$ Cr- $\frac{1}{4}$ Mo-V $\frac{3}{4}$ Ni- $\frac{1}{2}$ Mo-Cr-V $\frac{3}{4}$ Ni- $\frac{1}{2}$ Mo- $\frac{1}{3}$ Cr-V $\frac{3}{4}$ Ni- $\frac{1}{2}$ Cu-Mo $\frac{3}{4}$ Ni- $\frac{1}{2}$ Cr- $\frac{1}{2}$ Mo-V $\frac{3}{4}$ Ni-1Mo- $\frac{3}{4}$ Cr1Ni- $\frac{1}{2}$ Cr- $\frac{1}{2}$ Mo $1\frac{1}{4}$ Ni-1Cr- $\frac{1}{2}$ Mo $1\frac{3}{4}$ Ni- $\frac{3}{4}$ Cr- $\frac{1}{4}$ Mo2Ni- $\frac{3}{4}$ Cr- $\frac{1}{4}$ Mo2Ni- $\frac{3}{4}$ Cr- $\frac{1}{3}$ Mo2 $\frac{1}{2}$ Ni3 $\frac{1}{2}$ Ni3 $\frac{1}{2}$ Ni-1 $\frac{3}{4}$ Cr- $\frac{1}{2}$ Mo-V

(3) Group 2 alloys (by nominal composition):

Mn-V

Mn- $\frac{1}{4}$ MoMn- $\frac{1}{2}$ MoMn- $\frac{1}{2}$ Mo- $\frac{3}{4}$ NiMn- $\frac{1}{2}$ Mo- $\frac{1}{2}$ NiMn- $\frac{1}{2}$ Mo- $\frac{3}{4}$ Ni

Table B-1 (SI) Thermal Expansion Data (Cont'd)

(12)

| $A = \text{Mean Coefficient of Thermal Expansion, } 10^{-6} \text{ mm/mm/}^{\circ}\text{C}$<br>$B = \text{Linear Thermal Expansion, mm/m}$ |      |      |      |      |      |      |      |      |      |      |      |      |      |      |     |     |     |     |     |
|--------------------------------------------------------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|-----|-----|-----|-----|-----|
| in Going From 20°C to Indicated Temperature [Note (1)]                                                                                     |      |      |      |      |      |      |      |      |      |      |      |      |      |      |     |     |     |     |     |
| Temperature Range 20°C to                                                                                                                  |      |      |      |      |      |      |      |      |      |      |      |      |      |      |     |     |     |     |     |
| 300                                                                                                                                        | 325  | 350  | 375  | 400  | 425  | 450  | 475  | 500  | 525  | 550  | 575  | 600  | 625  | 650  | 675 | 700 | 725 | 750 | 800 |
| 18.0                                                                                                                                       | 18.0 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | ... | ... | ... |
| 5.0                                                                                                                                        | 5.5  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | ... | ... | ... |
| 18.7                                                                                                                                       | 18.8 | 18.9 | 19.0 | 19.0 | 19.1 | 19.2 | 19.3 | 19.4 | 19.4 | 19.5 | 19.6 | 19.7 | 19.7 | 19.8 | ... | ... | ... | ... | ... |
| 5.2                                                                                                                                        | 5.7  | 6.2  | 6.7  | 7.2  | 7.7  | 8.3  | 8.8  | 9.3  | 9.8  | 10.3 | 10.9 | 11.4 | 11.9 | 12.5 | ... | ... | ... | ... | ... |
| 19.2                                                                                                                                       | 19.3 | 19.5 | 19.6 | 19.8 | 20.1 | 20.3 | 20.5 | 20.7 | 20.8 | 21.0 | 21.2 | 21.4 | 21.6 | 21.8 | ... | ... | ... | ... | ... |
| 5.4                                                                                                                                        | 5.9  | 6.4  | 7.0  | 7.5  | 8.2  | 8.7  | 9.3  | 9.9  | 10.5 | 11.1 | 11.8 | 12.4 | 13.1 | 13.7 | ... | ... | ... | ... | ... |
| 16.5                                                                                                                                       | 16.5 | 16.6 | 16.6 | 16.7 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | ... | ... | ... |
| 4.6                                                                                                                                        | 5.0  | 5.5  | 5.9  | 6.3  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | ... | ... | ... |
| 25.5                                                                                                                                       | 25.6 | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | ... | ... | ... |
| 7.1                                                                                                                                        | 7.8  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | ... | ... | ... |
| 8.8                                                                                                                                        | 8.8  | 8.9  | 8.9  | 9.0  | 9.2  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | ... | ... | ... |
| 2.5                                                                                                                                        | 2.7  | 2.9  | 3.2  | 3.4  | 3.7  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ...  | ... | ... | ... | ... | ... |

ASME B31.1-2012

Click to view the full PDF of ASME B31.1-2012

## MANDATORY APPENDIX C

### MODULI OF ELASTICITY

(12)

**Table C-1 Moduli of Elasticity for Ferrous Material**

| Material                                              | <i>E</i> = Modulus of Elasticity, psi (Multiply Tabulated Values by 10 <sup>6</sup> ) [Note (1)] |      |      |      |      |      |      |      |      |      |       |       |       |       |       |       |
|-------------------------------------------------------|--------------------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|------|-------|-------|-------|-------|-------|-------|
|                                                       | Temperature, °F                                                                                  |      |      |      |      |      |      |      |      |      |       |       |       |       |       |       |
|                                                       | -100                                                                                             | 70   | 200  | 300  | 400  | 500  | 600  | 700  | 800  | 900  | 1,000 | 1,100 | 1,200 | 1,300 | 1,400 | 1,500 |
| Carbon steels with carbon content 0.30% or less       | 30.3                                                                                             | 29.4 | 28.8 | 28.3 | 27.4 | 27.3 | 26.5 | 25.5 | 24.2 | 22.5 | 20.4  | 18.0  | ...   | ...   | ...   | ...   |
| Carbon steels with carbon content above 0.30%         | 30.1                                                                                             | 29.2 | 28.6 | 28.1 | 27.7 | 27.1 | 26.4 | 25.3 | 24.0 | 22.3 | 20.2  | 17.9  | 15.4  | ...   | ...   | ...   |
| Carbon-molybdenum steels                              | 30.0                                                                                             | 29.0 | 28.5 | 28.0 | 27.6 | 27.0 | 26.3 | 25.3 | 23.9 | 22.2 | 20.1  | 17.8  | 15.3  | ...   | ...   | ...   |
| Nickel steels                                         | 28.6                                                                                             | 27.8 | 27.1 | 26.7 | 26.2 | 25.7 | 25.1 | 24.6 | 23.9 | 23.2 | 22.4  | 21.5  | 20.4  | 19.2  | 17.7  | ...   |
| Chromium steels:                                      |                                                                                                  |      |      |      |      |      |      |      |      |      |       |       |       |       |       |       |
| $\frac{1}{2}$ Cr through 2Cr                          | 30.5                                                                                             | 29.6 | 29.0 | 28.5 | 28.0 | 27.4 | 26.9 | 26.2 | 25.6 | 24.8 | 23.9  | 23.0  | 21.8  | 20.5  | 18.9  | ...   |
| $2\frac{1}{4}$ Cr through 3Cr                         | 31.4                                                                                             | 30.6 | 29.9 | 29.4 | 28.8 | 28.3 | 27.7 | 27.0 | 26.3 | 25.6 | 24.7  | 23.7  | 22.5  | 21.1  | 19.4  | ...   |
| 5Cr through 9Cr                                       | 31.9                                                                                             | 31.0 | 30.3 | 29.7 | 29.2 | 28.6 | 28.1 | 27.5 | 26.9 | 26.2 | 25.4  | 24.4  | 23.3  | 22.0  | 20.5  | ...   |
| Austenitic stainless steels:                          |                                                                                                  |      |      |      |      |      |      |      |      |      |       |       |       |       |       |       |
| Type 304, 18Cr-8Ni                                    | 29.2                                                                                             | 28.3 | 27.5 | 27.0 | 26.4 | 25.9 | 25.3 | 24.8 | 24.1 | 23.5 | 22.8  | 22.0  | 21.2  | 20.3  | 19.2  | 18.1  |
| Type 310, 25Cr-20Ni                                   |                                                                                                  |      |      |      |      |      |      |      |      |      |       |       |       |       |       |       |
| Type 316, 16Cr-12Ni-2Mo                               |                                                                                                  |      |      |      |      |      |      |      |      |      |       |       |       |       |       |       |
| Type 321, 18Cr-10Ni-Ti                                |                                                                                                  |      |      |      |      |      |      |      |      |      |       |       |       |       |       |       |
| Type 347, 18Cr-10Ni-Cb                                |                                                                                                  |      |      |      |      |      |      |      |      |      |       |       |       |       |       |       |
| Type 309, 23Cr-12Ni                                   |                                                                                                  |      |      |      |      |      |      |      |      |      |       |       |       |       |       |       |
| Straight chromium stainless steels (12Cr, 17Cr, 27Cr) | 30.2                                                                                             | 29.2 | 28.4 | 27.9 | 27.3 | 26.8 | 26.2 | 25.5 | 24.5 | 23.2 | 21.5  | 19.2  | 16.5  | ...   | ...   | ...   |
| Gray cast iron                                        | ...                                                                                              | 13.4 | 13.2 | 12.9 | 12.6 | 12.2 | 11.7 | 11.0 | 10.2 | ...  | ...   | ...   | ...   | ...   | ...   | ...   |

**NOTE:**

(1) These data are for information and it is not to be implied that materials are suitable for all the temperature ranges shown.

**Table C-1 (SI) Moduli of Elasticity for Ferrous Material****(12)**

| Material                                              | <i>E</i> = Modulus of Elasticity, MPa (Multiply Tabulated Values by 10 <sup>3</sup> ) [Note (1)] |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
|-------------------------------------------------------|--------------------------------------------------------------------------------------------------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
|                                                       | Temperature, °C                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
|                                                       | −75                                                                                              | 25  | 100 | 150 | 200 | 250 | 300 | 350 | 400 | 450 | 500 | 550 | 600 | 650 | 700 | 750 | 800 |
| Carbon steels with carbon content 0.30% or less       | 209                                                                                              | 202 | 198 | 195 | 192 | 189 | 185 | 179 | 171 | 162 | 151 | 137 | 122 | 107 | ... | ... | ... |
| Carbon steels with carbon content above 0.30%         | 207                                                                                              | 201 | 197 | 194 | 191 | 188 | 183 | 178 | 170 | 161 | 149 | 136 | 121 | 106 | ... | ... | ... |
| Carbon–molybdenum steels                              | 207                                                                                              | 200 | 196 | 193 | 190 | 187 | 183 | 177 | 170 | 160 | 149 | 135 | 121 | 106 | ... | ... | ... |
| Nickel steels                                         | 197                                                                                              | 191 | 187 | 184 | 181 | 178 | 174 | 171 | 167 | 163 | 158 | 153 | 147 | 141 | 133 | ... | ... |
| Chromium steels:                                      |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| ½Cr through 2Cr                                       | 210                                                                                              | 204 | 200 | 197 | 193 | 190 | 186 | 183 | 179 | 174 | 169 | 164 | 157 | 150 | 142 | ... | ... |
| 2¼Cr through 3Cr                                      | 217                                                                                              | 210 | 206 | 202 | 199 | 196 | 192 | 188 | 184 | 180 | 175 | 169 | 162 | 155 | 146 | ... | ... |
| 5Cr through 9Cr                                       | 220                                                                                              | 213 | 208 | 205 | 201 | 198 | 195 | 191 | 187 | 183 | 179 | 174 | 168 | 161 | 153 | ... | ... |
| Austenitic stainless steels:                          |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| Type 304, 18Cr–8Ni                                    | 201                                                                                              | 195 | 189 | 186 | 183 | 179 | 176 | 172 | 169 | 165 | 160 | 156 | 151 | 146 | 140 | 134 | 127 |
| Type 310, 25Cr–20Ni                                   |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| Type 316, 16Cr–12Ni–2Mo                               |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| Type 321, 18Cr–10Ni–Ti                                |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| Type 347, 18Cr–10Ni–Cb                                |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| Type 309, 23Cr–12Ni                                   |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| Straight chromium stainless steels (12Cr, 17Cr, 27Cr) | 208                                                                                              | 201 | 195 | 192 | 189 | 186 | 182 | 178 | 173 | 166 | 157 | 145 | 131 | ... | ... | ... | ... |
| Gray cast iron                                        | ...                                                                                              | 92  | 91  | 89  | 87  | 85  | 82  | 78  | 73  | 67  | ... | ... | ... | ... | ... | ... | ... |

**NOTE:**

(1) These data are for information and it is not to be implied that materials are suitable for all the temperature ranges shown.

(12)

**Table C-2 Moduli of Elasticity for Nonferrous Material**

| <i>E</i> = Modulus of Elasticity, psi (Multiply Tabulated Values by 10 <sup>6</sup> ) [Note (1)] |                 |      |      |      |      |      |      |      |      |      |       |       |       |
|--------------------------------------------------------------------------------------------------|-----------------|------|------|------|------|------|------|------|------|------|-------|-------|-------|
| Materials                                                                                        | Temperature, °F |      |      |      |      |      |      |      |      |      |       |       |       |
|                                                                                                  | -100            | 70   | 200  | 300  | 400  | 500  | 600  | 700  | 800  | 900  | 1,000 | 1,100 | 1,200 |
| High Nickel Alloys                                                                               |                 |      |      |      |      |      |      |      |      |      |       |       |       |
| N02200 (200)                                                                                     | 30.9            | 30.0 | 29.4 | 28.9 | 28.5 | 28.1 | 27.6 | 27.2 | 26.7 | 26.2 | 25.7  | 25.1  | 24.5  |
| N02201 (201)                                                                                     |                 |      |      |      |      |      |      |      |      |      |       |       |       |
| N04400 (400)                                                                                     | 26.8            | 26.0 | 25.5 | 25.1 | 24.7 | 24.3 | 23.9 | 23.6 | 23.1 | 22.7 | 22.2  | 21.7  | 21.2  |
| N06002 (X)                                                                                       | 29.3            | 28.5 | 27.9 | 27.5 | 27.1 | 26.7 | 26.2 | 25.8 | 25.4 | 24.9 | 24.3  | 23.8  | 23.2  |
| N06007 (G)                                                                                       | 28.6            | 27.8 | 27.2 | 26.8 | 26.4 | 26.0 | 25.6 | 25.2 | 24.7 | 24.3 | 23.8  | 23.2  | 22.6  |
| N06022                                                                                           | 29.3            | 28.5 | 27.9 | 27.5 | 27.1 | 26.7 | 26.2 | 25.8 | 25.4 | 24.9 | 24.3  | 23.8  | 23.2  |
| N06455 (C-4)                                                                                     | 30.7            | 29.8 | 29.2 | 28.7 | 28.3 | 27.9 | 27.4 | 27.0 | 26.5 | 26.0 | 25.5  | 24.9  | 24.3  |
| N06600 (600)                                                                                     | 31.9            | 31.0 | 30.3 | 29.9 | 29.4 | 29.0 | 28.6 | 28.1 | 27.6 | 27.1 | 26.5  | 25.9  | 25.3  |
| N06617 (617)                                                                                     | ...             | 29.2 | 28.4 | 28.0 | 27.7 | 27.4 | 27.0 | 26.5 | 26.0 | 25.5 | 24.9  | 24.3  | 23.8  |
| N06625 (625)                                                                                     | 30.9            | 30.0 | 29.4 | 28.9 | 28.5 | 28.1 | 27.6 | 27.2 | 26.7 | 26.2 | 25.7  | 25.1  | 24.5  |
| N08020                                                                                           | 28.8            | 28.0 | 27.4 | 27.0 | 26.6 | 26.2 | 25.8 | 25.4 | 24.9 | 24.4 | 23.9  | 23.4  | 22.8  |
| N08320 (20 Mod)                                                                                  | 28.6            | 27.8 | 27.1 | 26.7 | 26.4 | 26.0 | 25.7 | 25.3 | 24.7 | 24.2 | 23.6  | 23.2  | 22.7  |
| N08800 (800) (2)                                                                                 | 29.3            | 28.5 | 27.9 | 27.5 | 27.1 | 26.7 | 26.2 | 25.8 | 25.4 | 24.9 | 24.4  | 23.8  | 23.2  |
| N08810 (800H) (2)                                                                                |                 |      |      |      |      |      |      |      |      |      |       |       |       |
| N08825                                                                                           | 28.8            | 28.0 | 27.4 | 27.0 | 26.6 | 26.2 | 25.8 | 25.4 | 24.9 | 24.4 | 23.9  | 23.4  | 22.8  |
| N10001 (B)                                                                                       | 32.0            | 31.1 | 30.4 | 30.0 | 29.5 | 29.1 | 28.7 | 28.2 | 27.7 | 27.2 | 26.6  | 26.0  | 25.3  |
| N10276 (C-276)                                                                                   | 30.7            | 29.8 | 29.2 | 28.7 | 28.3 | 27.9 | 27.4 | 27.0 | 26.5 | 26.0 | 25.5  | 24.9  | 24.3  |
| N10665 (B-2)                                                                                     | 32.3            | 31.4 | 30.7 | 30.2 | 29.8 | 29.3 | 28.9 | 28.4 | 27.9 | 27.4 | 26.8  | 26.2  | 25.6  |
| Aluminum and Aluminum Alloys                                                                     |                 |      |      |      |      |      |      |      |      |      |       |       |       |
| A24430 (B443)                                                                                    | 10.5            | 10.0 | 9.6  | 9.2  | 8.7  | 8.1  | ...  | ...  | ...  | ...  | ...   | ...   | ...   |
| A91060 (1060)                                                                                    |                 |      |      |      |      |      |      |      |      |      |       |       |       |
| A91100 (1100)                                                                                    |                 |      |      |      |      |      |      |      |      |      |       |       |       |
| A93003 (3003)                                                                                    |                 |      |      |      |      |      |      |      |      |      |       |       |       |
| A93004 (3004)                                                                                    |                 |      |      |      |      |      |      |      |      |      |       |       |       |
| A96061 (6061)                                                                                    |                 |      |      |      |      |      |      |      |      |      |       |       |       |
| A96063 (6063)                                                                                    |                 |      |      |      |      |      |      |      |      |      |       |       |       |
| A95052 (5052)                                                                                    | 10.7            | 10.2 | 9.7  | 9.4  | 8.9  | 8.3  | ...  | ...  | ...  | ...  | ...   | ...   |       |
| A95154 (5154)                                                                                    |                 |      |      |      |      |      |      |      |      |      |       |       |       |
| A95454 (5454)                                                                                    |                 |      |      |      |      |      |      |      |      |      |       |       |       |
| A95652 (5652)                                                                                    |                 |      |      |      |      |      |      |      |      |      |       |       |       |
| A03560 (356)                                                                                     | 10.8            | 10.3 | 9.8  | 9.5  | 9.0  | 8.3  | ...  | ...  | ...  | ...  | ...   | ...   |       |
| A95083 (5083)                                                                                    |                 |      |      |      |      |      |      |      |      |      |       |       |       |
| A95086 (5086)                                                                                    |                 |      |      |      |      |      |      |      |      |      |       |       |       |
| A95456 (5456)                                                                                    |                 |      |      |      |      |      |      |      |      |      |       |       |       |
| Copper and Copper Alloys                                                                         |                 |      |      |      |      |      |      |      |      |      |       |       |       |
| C83600                                                                                           | 14.4            | 14.0 | 13.7 | 13.4 | 13.2 | 12.9 | 12.5 | 12.0 | ...  | ...  | ...   | ...   | ...   |
| C92200                                                                                           |                 |      |      |      |      |      |      |      |      |      |       |       |       |
| C46400                                                                                           | 15.4            | 15.0 | 14.6 | 14.4 | 14.1 | 13.8 | 13.4 | 12.8 | ...  | ...  | ...   | ...   | ...   |
| C65500                                                                                           |                 |      |      |      |      |      |      |      |      |      |       |       |       |
| C95200                                                                                           |                 |      |      |      |      |      |      |      |      |      |       |       |       |
| C95400                                                                                           |                 |      |      |      |      |      |      |      |      |      |       |       |       |

**Table C-2 Moduli of Elasticity for Nonferrous Material (Cont'd)**

(12)

| Materials                                | $E$ = Modulus of Elasticity, psi (Multiply Tabulated Values by $10^6$ ) [Note (1)] |      |      |      |      |      |      |      |      |     |       |       |       |
|------------------------------------------|------------------------------------------------------------------------------------|------|------|------|------|------|------|------|------|-----|-------|-------|-------|
|                                          | Temperature, °F                                                                    |      |      |      |      |      |      |      |      |     |       |       |       |
|                                          | -100                                                                               | 70   | 200  | 300  | 400  | 500  | 600  | 700  | 800  | 900 | 1,000 | 1,100 | 1,200 |
| <b>Copper and Copper Alloys (Cont'd)</b> |                                                                                    |      |      |      |      |      |      |      |      |     |       |       |       |
| C10200                                   | 17.5                                                                               | 17.0 | 16.6 | 16.3 | 16.0 | 15.6 | 15.1 | 14.5 | ...  | ... | ...   | ...   | ...   |
| C11000                                   |                                                                                    |      |      |      |      |      |      |      |      |     |       |       |       |
| C12000                                   |                                                                                    |      |      |      |      |      |      |      |      |     |       |       |       |
| C12200                                   |                                                                                    |      |      |      |      |      |      |      |      |     |       |       |       |
| C12500                                   |                                                                                    |      |      |      |      |      |      |      |      |     |       |       |       |
| C14200                                   |                                                                                    |      |      |      |      |      |      |      |      |     |       |       |       |
| C23000                                   |                                                                                    |      |      |      |      |      |      |      |      |     |       |       |       |
| C61400                                   |                                                                                    |      |      |      |      |      |      |      |      |     |       |       |       |
| C70600                                   | 18.5                                                                               | 18.0 | 17.6 | 17.3 | 16.9 | 16.5 | 16.0 | 15.4 | ...  | ... | ...   | ...   | ...   |
| C97600                                   | 19.6                                                                               | 19.0 | 18.5 | 18.2 | 17.9 | 17.5 | 16.9 | 16.2 | ...  | ... | ...   | ...   | ...   |
| C71000                                   | 20.6                                                                               | 20.0 | 19.5 | 19.2 | 18.8 | 18.4 | 17.8 | 17.1 | ...  | ... | ...   | ...   | ...   |
| C71500                                   | 22.6                                                                               | 22.0 | 21.5 | 21.1 | 20.7 | 20.2 | 19.6 | 18.8 | ...  | ... | ...   | ...   | ...   |
| <b>Unalloyed Titanium</b>                |                                                                                    |      |      |      |      |      |      |      |      |     |       |       |       |
| Grades 1, 2, 3,<br>7, and 12             | ...                                                                                | 15.5 | 15.0 | 14.6 | 14.0 | 13.3 | 12.6 | 11.9 | 11.2 | ... | ...   | ...   | ...   |

## NOTES:

- (1) These data are for information and it is not to be implied that materials are suitable for all the temperature ranges shown.
- (2) For N08800 and N08810, use the following  $E$  values above 1,200°F: at 1,300°F,  $E = 22.7$ ; at 1,400°F,  $E = 21.9$ ; at 1,500°F,  $E = 21.2 \times 10^6$  psi.

(12) Table C-2 (SI) Moduli of Elasticity for Nonferrous Material

|                              |   | <i>E</i> = Modulus of Elasticity, MPa (Multiply Tabulated Values by 10 <sup>3</sup> ) [Note (1)] |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
|------------------------------|---|--------------------------------------------------------------------------------------------------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
|                              |   | Temperature, °C                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| Materials                    |   | -75                                                                                              | 25  | 100 | 150 | 200 | 250 | 300 | 350 | 400 | 450 | 500 | 550 | 600 | 650 | 700 | 750 | 800 |
| High Nickel Alloys           |   |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| N02200 (200)                 | ] |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| N02201 (201)                 |   | 213                                                                                              | 207 | 202 | 199 | 197 | 194 | 191 | 189 | 186 | 183 | 180 | 176 | 172 | 169 | 164 | 160 | 156 |
| N04400 (400)                 |   | 185                                                                                              | 179 | 175 | 173 | 171 | 168 | 166 | 163 | 161 | 158 | 155 | 152 | 149 | 146 | 142 | 139 | 135 |
| N06002 (X)                   |   | 202                                                                                              | 196 | 192 | 189 | 187 | 184 | 182 | 179 | 176 | 173 | 170 | 167 | 163 | 160 | 156 | 152 | 148 |
| N06007 (G)                   |   | 197                                                                                              | 191 | 187 | 185 | 182 | 180 | 177 | 175 | 172 | 169 | 166 | 163 | 160 | 156 | 152 | 148 | 144 |
| N06022                       |   | 212                                                                                              | 206 | 201 | 199 | 196 | 193 | 191 | 188 | 185 | 182 | 179 | 175 | 172 | 168 | 164 | 160 | 155 |
| N06455 (C-4)                 |   | 212                                                                                              | 205 | 201 | 198 | 195 | 193 | 190 | 187 | 184 | 181 | 178 | 175 | 171 | 167 | 163 | 159 | 155 |
| N06600 (600)                 |   | 220                                                                                              | 213 | 209 | 206 | 203 | 201 | 198 | 195 | 192 | 189 | 186 | 182 | 178 | 174 | 170 | 165 | 161 |
| N06617 (617)                 |   | ...                                                                                              | 201 | 196 | 193 | 191 | 189 | 187 | 184 | 181 | 178 | 174 | 171 | 167 | 164 | 160 | 156 | 152 |
| N06625 (625)                 |   | 213                                                                                              | 207 | 202 | 199 | 197 | 194 | 191 | 189 | 186 | 183 | 180 | 176 | 172 | 169 | 164 | 160 | 156 |
| N08020                       |   | 199                                                                                              | 193 | 189 | 186 | 184 | 181 | 179 | 176 | 173 | 170 | 167 | 164 | 161 | 157 | 153 | 150 | ... |
| N08320 (20 Mod)              |   | 198                                                                                              | 192 | 187 | 185 | 182 | 180 | 177 | 175 | 172 | 169 | 167 | 163 | 159 | 156 | 152 | 149 | 144 |
| N08800 (800)                 | ] |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| N08810 (800H)                |   | 202                                                                                              | 196 | 192 | 189 | 187 | 184 | 182 | 179 | 176 | 173 | 170 | 167 | 164 | 160 | 156 | 152 | 148 |
| N08825                       |   | 199                                                                                              | 193 | 189 | 186 | 184 | 181 | 179 | 176 | 173 | 170 | 167 | 164 | 161 | 157 | 153 | 150 | ... |
| N10001 (B)                   |   | 221                                                                                              | 214 | 209 | 206 | 204 | 201 | 198 | 196 | 193 | 189 | 186 | 182 | 178 | 174 | 170 | 166 | 161 |
| N10276 (C-276)               |   | 212                                                                                              | 205 | 201 | 198 | 195 | 193 | 190 | 187 | 184 | 181 | 178 | 175 | 171 | 167 | 163 | 159 | 155 |
| N10665 (B-2)                 |   | 223                                                                                              | 216 | 211 | 208 | 206 | 203 | 200 | 197 | 194 | 191 | 188 | 184 | 180 | 176 | 172 | 168 | 163 |
| Aluminum and Aluminum Alloys |   |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| A24430 (B443)                | ] |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| A91060 (1060)                |   |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| A91100 (1100)                |   |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| A93003 (3003)                |   | 72                                                                                               | 69  | 66  | 63  | 60  | 57  | 52  | 46  | ... | ... | ... | ... | ... | ... | ... | ... | ... |
| A93004 (3004)                |   |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| A96061 (6061)                |   |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| A96063 (6063)                |   |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| A95052 (5052)                | ] |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| A95154 (5154)                |   |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| A95454 (5454)                |   | 74                                                                                               | 70  | 67  | 65  | 62  | 58  | 53  | 47  | ... | ... | ... | ... | ... | ... | ... | ... | ... |
| A95652 (5652)                |   |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| A03560 (356)                 | ] |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| A95083 (5083)                |   |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| A95086 (5086)                |   | 75                                                                                               | 71  | 68  | 65  | 62  | 58  | 54  | 47  | ... | ... | ... | ... | ... | ... | ... | ... | ... |
| A95456 (5456)                |   |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| Copper and Copper Alloys     |   |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| C83600                       | ] |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| C92200                       |   | 99                                                                                               | 96  | 94  | 93  | 91  | 89  | 87  | 84  | 81  | ... | ... | ... | ... | ... | ... | ... | ... |
| C46400                       | ] |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| C65500                       |   |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| C95200                       |   | 106                                                                                              | 103 | 101 | 99  | 97  | 96  | 93  | 90  | 86  | ... | ... | ... | ... | ... | ... | ... | ... |
| C95400                       |   |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| C10200                       | ] |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| C11000                       |   |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| C12000                       |   |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| C12200                       |   |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| C12500                       |   | 121                                                                                              | 117 | 114 | 112 | 110 | 108 | 106 | 102 | 98  | ... | ... | ... | ... | ... | ... | ... | ... |
| C14200                       |   |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| C23000                       |   |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| C61400                       |   |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |

**Table C-2 (SI) Moduli of Elasticity for Nonferrous Material (Cont'd)**

(12)

| Materials                                | <i>E</i> = Modulus of Elasticity, MPa (Multiply Tabulated Values by 10 <sup>3</sup> ) [Note (1)] |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
|------------------------------------------|--------------------------------------------------------------------------------------------------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
|                                          | Temperature, °C                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
|                                          | -75                                                                                              | 25  | 100 | 150 | 200 | 250 | 300 | 350 | 400 | 450 | 500 | 550 | 600 | 650 | 700 | 750 | 800 |
| <b>Copper and Copper Alloys (Cont'd)</b> |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| C70600                                   | 127                                                                                              | 124 | 121 | 119 | 117 | ... | ... | ... | ... | ... | ... | ... | ... | ... | ... | ... | ... |
| C97600                                   | 135                                                                                              | 131 | 128 | 126 | 123 | ... | ... | ... | ... | ... | ... | ... | ... | ... | ... | ... | ... |
| C71000                                   | 142                                                                                              | 138 | 134 | 132 | 130 | ... | ... | ... | ... | ... | ... | ... | ... | ... | ... | ... | ... |
| C71500                                   | 156                                                                                              | 152 | 148 | 145 | 143 | ... | ... | ... | ... | ... | ... | ... | ... | ... | ... | ... | ... |
| <b>Unalloyed Titanium</b>                |                                                                                                  |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| Grades 1, 2, 3,<br>7, and 12             | ...                                                                                              | 107 | 103 | 101 | 97  | 93  | 88  | 84  | 80  | 75  | 71  | ... | ... | ... | ... | ... | ... |

## NOTE:







(1) These data are for information and it is not to be implied that materials are suitable for all the temperature ranges shown.

ASMENORMDOC.COM : Click to view the full PDF of ASME B31.1 2012






# MANDATORY APPENDIX D

## FLEXIBILITY AND STRESS INTENSIFICATION FACTORS


**Table D-1 Flexibility and Stress Intensification Factors**
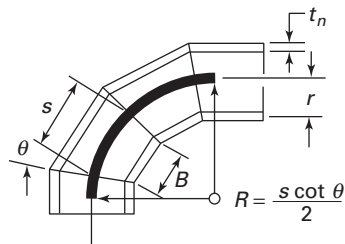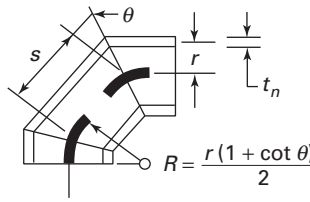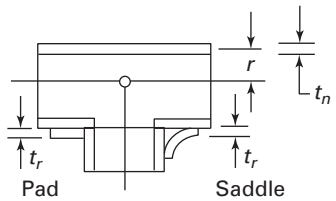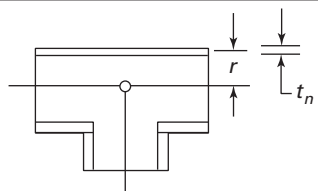
| Description                                                                                                                                      | Flexibility Characteristic, $h$                                | Flexibility Factor, $k$ | Stress Intensification Factor, $i$ | Sketch                                                                                |
|--------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------|-------------------------|------------------------------------|---------------------------------------------------------------------------------------|
| Welding elbow or pipe bend<br>[Notes (1), (2), (3), (4), (5)]                                                                                    | $\frac{t_n R}{r^2}$                                            | $\frac{1.65}{h}$        | $\frac{0.9}{h^{2/3}}$              |    |
| Closely spaced miter bend<br>[Notes (1), (2), (3), (5)]<br>$s < r(1 + \tan \theta)$<br>$B \geq 6 t_n$<br>$\theta \leq 22\frac{1}{2} \text{ deg}$ | $\frac{s t_n \cot \theta}{2r^2}$                               | $\frac{1.52}{h^{5/6}}$  | $\frac{0.9}{h^{2/3}}$              |   |
| Widely spaced miter bend<br>[Notes (1), (2), (5), (6)]<br>$s \geq r(1 + \tan \theta)$<br>$\theta \leq 22\frac{1}{2} \text{ deg}$                 | $\frac{t_n (1 + \cot \theta)}{2r}$                             | $\frac{1.52}{h^{5/6}}$  | $\frac{0.9}{h^{2/3}}$              |  |
| Welding tee per ASME B16.9 [Notes (1), (2), (7)]                                                                                                 | $\frac{3.1 t_n}{r}$                                            | 1                       | $\frac{0.9}{h^{2/3}}$              |  |
| Reinforced fabricated tee<br>[Notes (1), (2), (8), (9)]                                                                                          | $\frac{\left(t_n + \frac{t_r}{2}\right)^{5/2}}{r (t_n)^{3/2}}$ | 1                       | $\frac{0.9}{h^{2/3}}$              |  |
| Unreinforced fabricated tee<br>[Notes (1), (2), (9)]                                                                                             | $\frac{t_n}{r}$                                                | 1                       | $\frac{0.9}{h^{2/3}}$              |  |

**Table D-1 Flexibility and Stress Intensification Factors (Cont'd)**
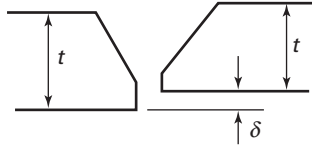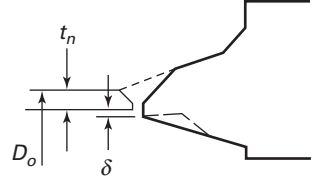
| Description                                                                                                    | Flexibility Characteristic, $h$ | Flexibility Factor, $k$                                                                                                                                                             | Stress Intensification Factor, $i$ | Sketch                                                                                |
|----------------------------------------------------------------------------------------------------------------|---------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------|---------------------------------------------------------------------------------------|
| Branch welded-on fitting (integrally reinforced) per MSS SP-97 [Notes (1), (2)]                                | $\frac{3.3t_n}{r}$              | 1                                                                                                                                                                                   | $\frac{0.9}{h^{2/3}}$              |    |
| Extruded outlet meeting the requirements of para. 104.3.1(G) [Notes (1), (2)]                                  | $\frac{t_n}{r}$                 | 1                                                                                                                                                                                   | $\frac{0.9}{h^{2/3}}$              |    |
| Welded-in contour insert [Notes (1), (2), (7)]                                                                 | $3.1 \frac{t_n}{r}$             | 1                                                                                                                                                                                   | $\frac{0.9}{h^{2/3}}$              |    |
| Description                                                                                                    | Flexibility Factor, $k$         | Stress Intensification Factor, $i$                                                                                                                                                  |                                    | Sketch                                                                                |
| Branch connection [Notes (1), (10)]                                                                            | 1                               | For checking branch end<br>$1.5 \left( \frac{R_m}{t_{nh}} \right)^{2/3} \left( \frac{r'_m}{R_m} \right)^{1/2} \left( \frac{t_{nb}}{t_{nh}} \right) \left( \frac{r'_m}{r_p} \right)$ |                                    | See Fig. D-1                                                                          |
| Butt weld [Note (1)]                                                                                           |                                 |                                                                                                                                                                                     |                                    |                                                                                       |
| $t \geq 0.237$ in.,<br>$\delta_{\max} \leq \frac{1}{16}$ in.,<br>and $\delta_{\text{avg}}/t \leq 0.13$         | 1                               | 1.0 [Note (11)]                                                                                                                                                                     |                                    |                                                                                       |
| Butt weld [Note (1)]                                                                                           |                                 |                                                                                                                                                                                     |                                    |                                                                                       |
| $t \geq 0.237$ in.,<br>$\delta_{\max} \leq \frac{1}{8}$ in.,<br>and $\delta_{\text{avg}}/t = \text{any value}$ | 1                               | 1.9 max. or $[0.9 + 2.7(\delta_{\text{avg}}/t)]$ ,<br>but not less than 1.0<br>[Note (11)]                                                                                          |                                    |  |
| Butt weld [Note (1)]                                                                                           |                                 |                                                                                                                                                                                     |                                    |                                                                                       |
| $t < 0.237$ in.,<br>$\delta_{\max} \leq \frac{1}{16}$ in.,<br>and $\delta_{\text{avg}}/t \leq 0.33$            | 1                               |                                                                                                                                                                                     |                                    |                                                                                       |
| Fillet welds                                                                                                   | 1                               | 1.3 [Note (12)]                                                                                                                                                                     |                                    | See Figs. 127.4.4(A), 127.4.4(B), and 127.4.4(C)                                      |
| Tapered transition per para. 127.4.2(B) and ASME B16.25 [Note (1)]                                             | 1                               | 1.9 max. or<br>$1.3 + 0.0036 \frac{D_o}{t_n} + 3.6 \frac{\delta}{t_n}$                                                                                                              |                                    |  |

(12) **Table D-1 Flexibility and Stress Intensification Factors (Cont'd)**
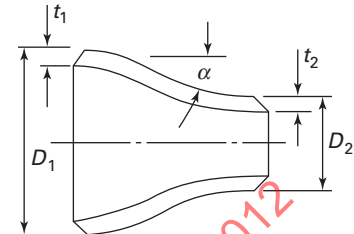
| Description                                                         | Flexibility Factor, $k$ | Stress Intensification Factor, $i$                                   | Sketch                                                                              |
|---------------------------------------------------------------------|-------------------------|----------------------------------------------------------------------|-------------------------------------------------------------------------------------|
| Concentric reducer per ASME B16.9 [Notes (1), (13)]                 | 1                       | 2.0 max. or<br>$0.5 + 0.01\alpha \left(\frac{D_2}{t_2}\right)^{1/2}$ |  |
| Threaded pipe joint or threaded flange                              | 1                       | 2.3                                                                  | ...                                                                                 |
| Corrugated straight pipe, or corrugated or creased bend [Note (14)] | 5                       | 2.5                                                                  | ...                                                                                 |

## NOTES:

- The following nomenclature applies to Table D-1:
  - $B$  = length of miter segment at crotch, in. (mm)
  - $D_o$  = outside diameter, in. (mm)
  - $D_{ob}$  = outside diameter of branch, in. (mm)
  - $D_1$  = outside diameter of reducer on large end, in. (mm)
  - $D_2$  = outside diameter of reducer on small end, in. (mm)
  - $R$  = bend radius of elbow or pipe bend, in. (mm)
  - $r$  = mean radius of pipe, in. (mm) (matching pipe for tees)
  - $r_x$  = external crotch radius of welded-in contour inserts and welding tees, in. (mm)
  - $s$  = miter spacing at centerline, in. (mm)
  - $T_c$  = crotch thickness of welded-in contour inserts and welding tees, in. (mm)
  - $t_n$  = nominal wall thickness of pipe, in. (mm) (matching pipe for tees)
  - $t_r$  = reinforcement pad or saddle thickness, in. (mm)
  - $\alpha$  = reducer cone angle, deg
  - $\delta$  = mismatch, in. (mm)
  - $\theta$  = one-half angle between adjacent miter axes, deg
- The flexibility factors  $k$  and stress intensification factors  $i$  in Table D-1 apply to bending in any plane for fittings and shall in no case be taken less than unity. Both factors apply over the effective arc length (shown by heavy centerlines in the sketches) for curved and miter elbows, and to the intersection point for tees. The values of  $k$  and  $i$  can be read directly from Chart D-1 by entering with the characteristic  $h$  computed from the formulas given.
- Where flanges are attached to one or both ends, the values of  $k$  and  $i$  in Table D-1 shall be multiplied by the factor  $c$  given below, which can be read directly from Chart D-2, entering with the computed  $h$ : one end flanged,  $c = h^{1/6}$ ; both ends flanged,  $c = h^{1/3}$ .
- The designer is cautioned that cast butt welding elbows may have considerably heavier walls than those of the pipe with which they are used. Large errors may be introduced unless the effect of these greater thicknesses is considered.
- In large diameter thin-wall elbows and bends, pressure can significantly affect magnitudes of  $k$  and  $i$ . Values from the Table may be corrected by dividing  $k$  by

$$\left[ 1 + 6 \left( \frac{P}{E_c} \right) \left( \frac{r}{t_n} \right)^{7/3} \left( \frac{R}{r} \right)^{1/3} \right]$$

and dividing  $i$  by


$$\left[ 1 + 3.25 \left( \frac{P}{E_c} \right) \left( \frac{r}{t_n} \right)^{5/2} \left( \frac{R}{r} \right)^{2/3} \right]$$

- Also includes single miter joints.
- If  $r_x \geq D_{ob}/8$  and  $T_c \geq 1.5t_n$ , a flexibility characteristic,  $h$ , of  $4.4t_n/r$  may be used.
- When  $t_r > 1.5t_n$ ,  $h = 4.05t_n/r$ .
- The stress intensification factors in the Table were obtained from tests on full size outlet connections. For less than full size outlets, the full size values should be used until more applicable values are developed.

**Table D-1 Flexibility and Stress Intensification Factors (Cont'd)**

NOTES (Cont'd):

- (10) The equation applies only if the following conditions are met:
- (a) The reinforcement area requirements of para. 104.3 are met.
  - (b) The axis of the branch pipe is normal to the surface of run pipe wall.
  - (c) For branch connections in a pipe, the arc distance measured between the centers of adjacent branches along the surface of the run pipe is not less than three times the sum of their inside radii in the longitudinal direction or is not less than two times the sum of their radii along the circumference of the run pipe.
  - (d) The inside corner radius  $r_1$  (see Fig. D-1) is between 10% and 50% of  $t_{nh}$ .
  - (e) The outer radius  $r_2$  (see Fig. D-1) is not less than the larger of  $T_b/2$ ,  $(T_b + y)/2$  [shown in Fig. D-1 sketch (c)], or  $t_{nh}/2$ .
  - (f) The outer radius  $r_3$  (see Fig. D-1) is not less than the larger of:
    - (1)  $0.002\theta d_o$ ;
    - (2)  $2(\sin \theta)^3$  times the offset for the configurations shown in Fig. D-1 sketches (a) and (b).
  - (g)  $R_m/t_{nh} \leq 50$  and  $r'_m/R_m \leq 0.5$ .
- (11) The stress intensification factors apply to girth butt welds between two items for which the wall thicknesses are between  $0.875t$  and  $1.10t$  for an axial distance of  $\sqrt{D_o t}$ .  $D_o$  and  $t$  are nominal outside diameter and nominal wall thickness, respectively.  $\delta_{avg}$  is the average mismatch or offset.
- (12) For welds to socket welded fittings, the stress intensification factor is based on the assumption that the pipe and fitting are matched in accordance with ASME B16.11 and a full weld is made between the pipe and fitting as shown in Fig. 127.4.4(C). For welds to socket welding flanges, the stress intensification factor is based on the weld geometry shown in Fig. 127.4.4(B) and has been shown to envelop the results of the pipe to socket welded fitting tests. Blending the toe of the fillet weld, with no undercut, smoothly into the pipe wall, as shown in the concave fillet welds in Fig. 127.4.4(A) sketches (b) and (d), has been shown to improve the fatigue performance of the weld.
- (13) The equation applies only if the following conditions are met:
- (a) Cone angle  $\alpha$  does not exceed 60 deg, and the reducer is concentric.
  - (b) The larger of  $D_1/t_1$  and  $D_2/t_2$  does not exceed 100.
  - (c) The wall thickness is not less than  $t_1$  throughout the body of the reducer, except in and immediately adjacent to the cylindrical portion on the small end, where the thickness shall not be less than  $t_2$ .
- (14) Factors shown apply to bending; flexibility factor for torsion equals 0.9.

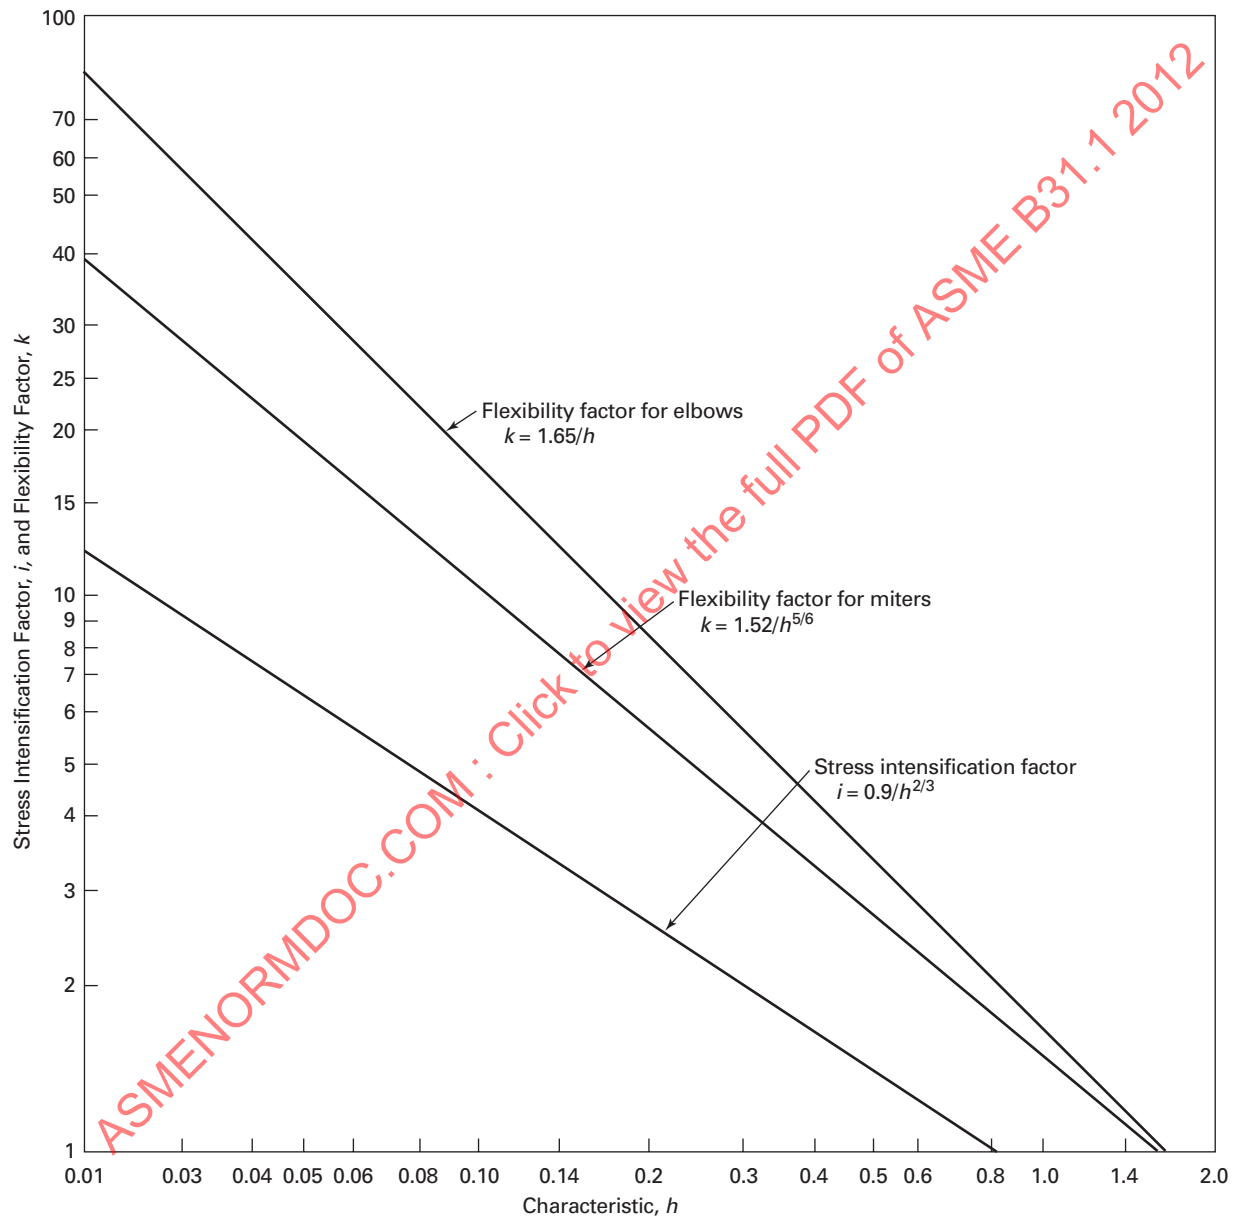Chart D-1 Flexibility Factor,  $k$ , and Stress Intensification Factor,  $i$ 


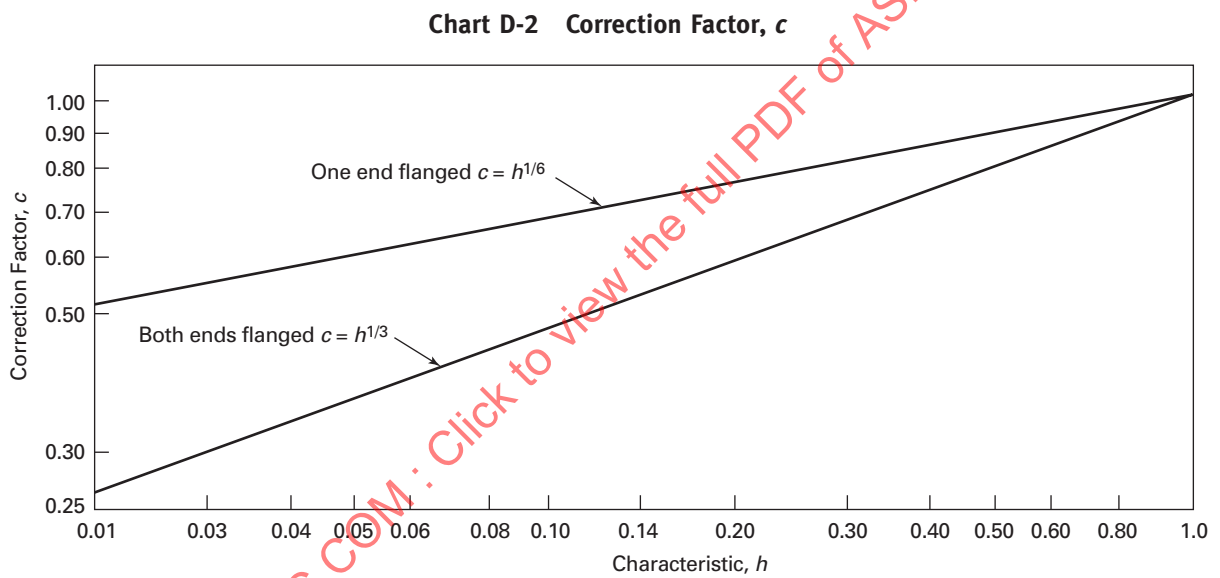


Fig. D-1 Branch Connection Dimensions

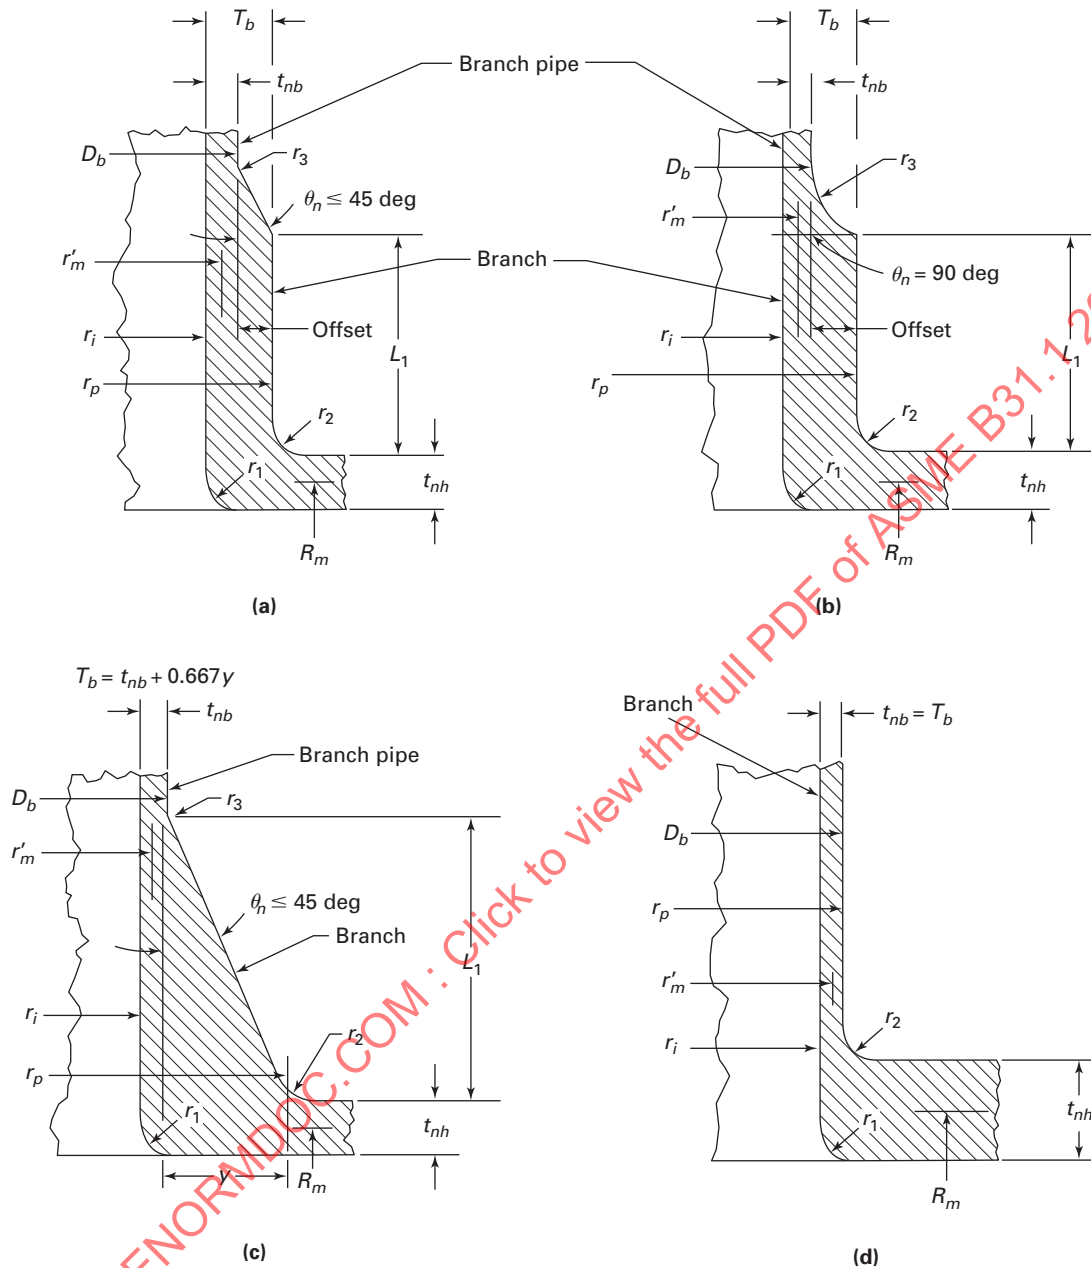

$D_b$  = outside diameter of branch pipe, in. (mm)  
 $L_1$  = height of nozzle, in. (mm)  
 $R_m$  = mean radius of run pipe, in. (mm)  
 $T_b$  = effective thickness of branch reinforcement, in. (mm)  
 $r_i$  = inside radius of branch, in. (mm)  
 $r'_m$  = mean radius of branch pipe, in. (mm)

$r_1, r_2, r_3$  = transition radii of branch reinforcement, in. (mm)  
 $r_p$  = outside radius of branch reinforcement, in. (mm)  
 $t_{nb}$  = nominal thickness of branch pipes, in. (mm)  
 $t_{nh}$  = nominal thickness of run pipe, in. (mm)  
 $\theta_n$  = transition angle of branch reinforcement, deg

# MANDATORY APPENDIX F

## REFERENCED STANDARDS

(12)

Specific editions of standards incorporated in this Code by reference are shown in this issue of Mandatory Appendix F. It is not practical to refer to a specific edition of each standard throughout the Code text, but instead, the specific edition reference dates are shown here. Mandatory Appendix F will be revised at intervals as needed and issued. The names and addresses of the sponsoring organizations are also shown in this issue.

| American National Standard     | ASTM Specifications [Note (1)]<br>(Cont'd) | ASTM Specifications [Note (1)]<br>(Cont'd) |
|--------------------------------|--------------------------------------------|--------------------------------------------|
| Z223.1-1999                    | A307-07b                                   | A815/A815M-07a                             |
| ASCE/SEI Standard              | A312/A312M-07                              | A928/A928M-05                              |
| 7-05                           | A320/A320M-07a                             | A992/A992M-06a                             |
| ASTM Specifications [Note (1)] | A322-07                                    |                                            |
|                                | A333/A333M-05                              |                                            |
| A36/A36M-05                    | A335/A335M-06                              | B26/B26M-05                                |
| A47/A47M-99 (R04)              | A336/A336M-07                              | B32-04                                     |
| A48/A48M-03                    | A350/A350M-04a                             | B42-02                                     |
| A53/A53M-07                    | A351/A351M-06                              | B43-98 (R04)                               |
|                                | A354-07                                    | B61-02                                     |
|                                | A358/A358M-05                              | B62-02                                     |
|                                | A369/A369M-06                              | B68-02                                     |
| A105/A105M-05                  | A376/A376M-06                              | B68M-99 (R05)                              |
| A106/A106M-10                  | A377-03                                    | B75-02                                     |
| A125-96 (R07)                  | A387/A387M-06a                             | B88-03                                     |
| A126-04                        | A389/A389M-03                              | B88M-05                                    |
| A134-96 (R05)                  | A395/A395M-99 (R04)                        |                                            |
| A135/A135M-06                  |                                            | B108-06                                    |
| A139/A139M-04                  | A403/A403M-07                              | B111/B111M-04                              |
| A178/A178M-02                  | A409/A409M-01 (R05)                        | B148-97                                    |
| A179/A179M-90a (R05)           | A420/A420M-07                              | B150/B150M-03                              |
| A181/A181M-06                  | A426/A426M-07                              | B151/B151M-05                              |
| A182/A182M-07a                 | A437/A437M-06                              | B161-05                                    |
| A192/A192M-02                  | A449-07b                                   | B163-04                                    |
| A193/A193M-07                  | A450/A450M-04a                             | B165-05                                    |
| A194/A194M-07a                 | A451/A451M-06                              | B166-04                                    |
| A197/A197M-00 (R06)            | A453/A453M-04                              | B167-06                                    |
|                                | A479/A479M-06a                             | B168-04                                    |
|                                |                                            | B171-04                                    |
| A210/A210M-02                  | A515/A515M-03                              |                                            |
| A213/A213M-07a                 | A516/A516M-06                              | B209/B209M-06                              |
| A214/A214M-96 (R05)            | A530/A530M-04a                             | B210-04                                    |
| A216/A216M-07                  | A564/A564M-04                              | B210M-05                                   |
| A217/A217M-07                  | A575-96 (R02)                              | B221-06                                    |
| A229/A229M-99                  | A576-90b (R06)                             | B234-04                                    |
| A234/A234M-07                  | A587-96 (R05)                              | B234M-04                                   |
| A240/A240M-07 <sup>†1</sup>    |                                            | B241/B241M-02                              |
| A242/A242M-04 <sup>†1</sup>    |                                            | B247-02a                                   |
| A249/A249M-07                  | A671-06                                    | B247M-02a                                  |
| A254-97 (R02)                  | A672-06                                    | B251-02 <sup>†1</sup>                      |
| A268/A268M-05a                 | A691-98 (R02)                              | B251M-97 (R03)                             |
| A276-06                        |                                            | B265-07                                    |
| A278/A278M-01 (R06)            | A714-99 (R03)                              | B280-03                                    |
| A283/A283M-00                  | A789/A789M-05b                             | B283-06                                    |
| A285/A285M-03                  | A790/A790M-07                              |                                            |
| A299/A299M-04                  |                                            |                                            |

(12)

## Referenced Standards (Cont'd)

ASTM Specifications [Note (1)]  
(Cont'd)

B302-07  
 B315-06  
 B338-06a  
 B348-06a  
 B361-02  
 B366-04b<sup>e1</sup>  
 B367-06  
 B381-06a  
  
 B407-04  
 B408-06  
 B409-06<sup>e1</sup>  
 B423-05  
 B424-05  
 B425-99 (R05)  
 B435-06  
 B443-00 (R05)  
 B444-06  
 B446-03 (R08)  
 B462-06  
 B463-04  
 B464-05  
 B466/B466M-07  
 B467-88 (R03)  
 B468-04  
 B473-07  
  
 B546-04  
 B547/B547M-02  
 B564-06a  
 B572-06  
 B574-06<sup>e1</sup>  
 B575-06  
 B584-06a  
  
 B608-07  
 B619-06  
 B622-06  
 B625-05  
 B626-06  
 B649-06  
 B673-05<sup>e1</sup>  
 B674-05  
 B675-02  
 B676-03  
 B677-05  
 B688-96 (R04)  
 B690-02 (R07)  
 B691-95  
  
 B704-03  
 B705-05  
 B729-05

ASTM Specifications [Note (1)]  
(Cont'd)

B804-02  
 B828-02  
 B861-06a  
 B862-06b<sup>e1</sup>

## ASTM Standard Test Methods

D323-06  
 E94-04  
 E125-85 (R04)  
 E186-04  
 E280-04  
 E446-04

## MSS Standard Practices

SP-6-06  
 SP-9-08  
 SP-25-98  
 SP-42-09  
 SP-43-08  
 SP-45-03  
 SP-51-07  
 SP-53-99 (R07)  
 SP-54-99 (R07)  
 SP-55-06  
 SP-58-09  
 SP-61-09  
 SP-67-02a  
 SP-68-97 (R04)  
 SP-75-08  
 SP-79-04  
 SP-80-08  
 SP-83-06  
 SP-88-93 (R01)  
 SP-93-99 (R04)  
 SP-94-92  
 SP-95-06  
 SP-97-06  
 SP-105-96 (R05)  
 SP-106-03

## AWS Specifications

A3.0-01  
 D10.10-99  
 QC1-07

## API Specification

5L, 38th Edition, 1990

## ASME Codes &amp; Standards

Boiler and Pressure Vessel Code,  
 2001 Edition, including  
 Addenda

B1.1-1989  
 B1.13M-2001  
 B1.20.1-1983 (R01)  
 (ANSI/ASME B1.20.1)  
 B1.20.3-1976 (R98)  
 (ANSI B1.20.3)  
 B16.1-2005  
 B16.3-1998  
 B16.4-2005  
 B16.5-2003  
 B16.9-2001  
 B16.10-2000  
 B16.11-2005  
 B16.14-1991  
 B16.15-1985 (R94)  
 (ANSI/ASME B16.15)  
 B16.18-1984 (R94)  
 (ANSI B16.18)  
 B16.20-1998  
 B16.21-2005  
 B16.22-2001 (R05)  
 B16.24-2001  
 B16.25-2003  
 B16.34-2004  
 B16.42-1998  
 B16.47-1996 (98A)  
 B16.48-2005  
 B16.50-2001

B18.2.1-1996 (99A)  
 B18.2.2-1987 (R99)  
 (ASME/ANSI B18.2.2)  
 B18.2.3.5M-1979 (R01)  
 B18.2.3.6M-1979 (R01)  
 B18.2.4.6M-1979 (R98)  
 B18.21.1-1999  
 B18.22M-1981  
 B18.22.1-1965 (R98)

B31.3-2002  
 B31.4-2002  
 B31.8-1999  
 B36.10M-2004  
 B36.19M-2004

TDP-1-1998

## Referenced Standards (Cont'd)

| AWWA and ANSI/AWWA Standards | AWWA and ANSI/AWWA Standards (Cont'd) | National Fire Codes    |
|------------------------------|---------------------------------------|------------------------|
| C110/A21.10-98               | C300-97                               | NFPA 54/ANSI Z223.1-06 |
| C111/A21.11-95               | C301-99                               | NFPA 85-04             |
| C115/A21.15-99               | C302-95                               | NFPA 1963-03           |
| C150/A21.50-96               | C304-99                               |                        |
| C151/A21.51-96               |                                       | <b>PFI Standards</b>   |
| C153/A21.53-94               | C500-93(95a)                          | ES-16-08               |
|                              | C504-94                               | ES-24-08               |
| C200-97                      | C509-94                               |                        |
| C207-94                      |                                       | <b>FCI Standard</b>    |
| C208-96                      | C600-99                               |                        |
|                              | C606-97                               | 79-1-03                |

GENERAL NOTE: The issue date shown immediately following the hyphen after the number of the standard (e.g., B1.1-1989, A 36-89, SP-6-96) is the effective date of issue (edition) of the standard. B18.2.2-1987 (R99) designates specification reaffirmed without change in 1999.

NOTE:

(1) For boiler external piping material application, see para. 123.2.2.

Specifications and standards of the following organizations appear in this Appendix:

|      |                                                                                                                                                                                                                                                                                   |      |                                                                                                                                                                                      |
|------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| AISC | American Institute of Steel Construction, Inc.<br>One East Wacker Drive<br>Chicago, IL 60601-1802<br>Phone: 312 670-2400<br>Fax: 312 670-5403<br>www.aisc.org                                                                                                                     | ASTM | American Society for Testing and Materials<br>100 Barr Harbor Drive<br>P.O. Box C700<br>West Conshohocken, PA 19428-2959<br>Phone: 610 832-9585<br>Fax: 610 832-9555<br>www.astm.org |
| ANSI | American National Standards Institute<br>25 West 43rd Street, 4th Floor<br>New York, NY 10036<br>Phone: 212 642-4900<br>Fax: 212 398-0023<br>www.ansi.org                                                                                                                         | AWS  | American Welding Society<br>550 NW LeJeune Road<br>Miami, FL 33126<br>Phone: 305 443-9353 or 800 443-9353<br>www.aws.org                                                             |
| API  | American Petroleum Institute<br>1220 L Street, NW<br>Washington, DC 20005-4070<br>Phone: 202 682-8000<br>www.api.org                                                                                                                                                              | AWWA | American Water Works Association<br>6666 W. Quincy Avenue<br>Denver, CO 80235<br>Phone: 303 794-7711 or 800 926-7337<br>www.awwa.org                                                 |
| ASCE | American Society of Civil Engineers<br>1801 Alexander Bell Drive<br>Reston, VA 20191-4400<br>Phone: 800 548-2723<br>703 295-6300 (International)<br>Fax: 703 295-6222<br>www.asce.org                                                                                             | FCI  | Fluid Controls Institute, Inc.<br>1300 Sumner Avenue<br>Cleveland, OH 44115-2851<br>Phone: 216 241-7333<br>Fax: 216 241-0105<br>www.fluidcontrolsinstitute.org                       |
| ASME | The American Society of Mechanical Engineers<br>Three Park Avenue<br>New York, NY 10016-5990<br><br>ASME Order Department<br>22 Law Drive<br>Box 2900<br>Fairfield, NJ 07007-2900<br>Phone: 973 882-1167<br>800-843-2763 (US & Canada)<br>Fax: 973 882-1717, 5155<br>www.asme.org | MSS  | Manufacturers Standardization Society of<br>the Valve and Fittings Industry, Inc.<br>127 Park Street, NE<br>Vienna, VA 22180-4602<br>Phone: 703 281-6613<br>www.mss-hq.com           |
|      |                                                                                                                                                                                                                                                                                   | NFPA | National Fire Protection Association<br>1 Batterymarch Park<br>Quincy, MA 02169-7471<br>Phone: 617 770-3000 or 800-344-3555<br>Fax: 617 770-0700<br>www.nfpa.org                     |

### Referenced Standards (Cont'd)

PFI Pipe Fabrication Institute  
USA Office: 511 Avenue of the Americas, #601  
New York, NY 10011  
Canada Office: 655-32nd Ave., #201  
Lachine, QC H8T 3G6  
Phone: 514 634-3434 or 866 913-3434  
Fax: 514 634-9736  
[www.pfi-institute.org](http://www.pfi-institute.org)

PPI Plastics Pipe Institute  
105 Decker Court, Suite 825  
Irving, TX 75062  
Phone: 469 499-1044  
Fax: 469 499-1063  
[www.plasticpipe.org](http://www.plasticpipe.org)

SEI Structural Engineering Institute of ASCE  
1801 Alexander Bell Drive  
Reston, VA 20191-4400  
Phone: 800 548-2723  
Fax: 703 295-6361  
[www.seinstitute.org](http://www.seinstitute.org)

ASMENORMDOC.COM : Click to view the full PDF of ASME B31.1 2012

# MANDATORY APPENDIX G

## NOMENCLATURE

(12)

This Appendix is a compilation of the nomenclature used within this Code. Included are the term definitions and units that can be uniformly applied. These terms are also defined at a convenient location within the Code. When used elsewhere within the Code, definitions given here shall be understood to apply.

| Symbol                            | Definition                                                                                                               | Units           |                  | References                                                                                                                       |                          |
|-----------------------------------|--------------------------------------------------------------------------------------------------------------------------|-----------------|------------------|----------------------------------------------------------------------------------------------------------------------------------|--------------------------|
|                                   |                                                                                                                          | SI              | U.S.             | Paragraph                                                                                                                        | Table/Fig./App.          |
| $A$                               | Corrosion, erosion, and mechanical allowances (including threading, grooving)                                            | mm              | in.              | 104.1.2(A)[eqs. (3), (4), (7), (8), (9), (10)]<br>104.3.1(D.2)<br>104.3.1(G)<br>104.4.1(B)<br>104.5.2(B)[eq. (13)]<br>104.5.3(A) | 104.3.1(G)               |
| Area available for reinforcement: |                                                                                                                          |                 |                  |                                                                                                                                  |                          |
| $A_1$                             | in run pipe                                                                                                              | mm <sup>2</sup> | in. <sup>2</sup> | 104.3.1(D.2.3)<br>104.3.1(G.6)                                                                                                   | 104.3.1(D)<br>104.3.1(G) |
| $A_2$                             | in branch pipe                                                                                                           | mm <sup>2</sup> | in. <sup>2</sup> | 104.3.1(D.2.3)<br>104.3.1(G.6)                                                                                                   | 104.3.1(D)<br>104.3.1(G) |
| $A_3$                             | by deposited metal beyond outside diameter of run and branch and for fillet weld attachments of rings, pads, and saddles | mm <sup>2</sup> | in. <sup>2</sup> | 104.3.1(D.2.3)                                                                                                                   | 104.3.1(D)               |
| $A_4$                             | by reinforcing ring, pad, or integral reinforcement                                                                      | mm <sup>2</sup> | in. <sup>2</sup> | 104.3.1(D.2.3)<br>104.3.1(G.6)                                                                                                   | 104.3.1(D)<br>104.3.1(G) |
| $A_5$                             | in saddle on right angle connection                                                                                      | mm <sup>2</sup> | in. <sup>2</sup> | 104.3.1(D.2.3)                                                                                                                   | 104.3.1(D)               |
| $A_6$                             | Pressure design area expected at the end of service life                                                                 | mm <sup>2</sup> | in. <sup>2</sup> | 104.3.1(D.2)                                                                                                                     | 104.3.1(D)               |
| $A_7$                             | Required reinforcement area                                                                                              | mm <sup>2</sup> | in. <sup>2</sup> | 104.3.1(D.2.2)<br>104.3.1(G.5)                                                                                                   | 104.3.1(D)<br>104.3.1(G) |
| $B$                               | Length of miter segment at crotch                                                                                        | mm              | in.              | 104.3.3(A&B)                                                                                                                     | App. D, Table D-1        |
| $b$                               | Subscript referring to branch                                                                                            | ...             | ...              | 104.3.1(D.2)                                                                                                                     | 104.3.1(D)               |
| $C$                               | Cold-spring factor                                                                                                       | ...             | ...              | 119.10.1[eqs. (18), (19)]                                                                                                        | ...                      |
| $C_x$                             | Size of fillet weld for socket welding components other than flanges                                                     | mm              | in.              | ...                                                                                                                              | 127.4.4(C)               |
| $c$                               | Flanged elbow correction factor                                                                                          | ...             | ...              | ...                                                                                                                              | Table D-1<br>Chart D-2   |
| $D$                               | Nominal pipe size                                                                                                        | mm              | in.              | 119.7.1(A.3)                                                                                                                     | ...                      |
| $D_{1,2}$                         | Outside diameter of reducer                                                                                              | mm              | in.              | ...                                                                                                                              | App. D, Table D-1        |
| $D_n$                             | Nominal outside diameter of pipe                                                                                         | mm              | in.              | 102.3.2(D)                                                                                                                       | ...                      |

| Symbol   | Definition                                                                                     | Units |      | References                                                                        |                                                 |
|----------|------------------------------------------------------------------------------------------------|-------|------|-----------------------------------------------------------------------------------|-------------------------------------------------|
|          |                                                                                                | SI    | U.S. | Paragraph                                                                         | Table/Fig./App.                                 |
| $D_o$    | Outside diameter of pipe                                                                       | mm    | in.  | 102.3.2(D)<br>104.1.2(A)[eqs. (7), (9)]<br>104.8.1[eq. (15)]<br>104.8.2[eq. (16)] | App. D, Table D-1<br>104.1.2(A)                 |
| $D_{ob}$ | Outside diameter of branch                                                                     | mm    | in.  | 104.3.1(D.2)<br>104.3.1(D.2.3)<br>104.3.1(E)<br>104.3.1(G.4)<br>104.3.1(G.5)      | App. D, Fig. D-1<br>104.3.1(G)                  |
| $D_{oh}$ | Outside diameter of header or run pipe                                                         | mm    | in.  | 104.3.1(D.2)<br>104.3.1(E)<br>104.3.1(G.4)<br>104.3.1(G.5)                        | 104.3.1(G)                                      |
| $d$      | Inside diameter of pipe                                                                        | mm    | in.  | 104.1.2(A)[eqs. (8), (10)]                                                        | 104.1.2(A)                                      |
| $d_1$    | Inside centerline longitudinal direction of the finished branch opening in the run of the pipe | mm    | in.  | 104.3.1(D)<br>104.3.1(E)                                                          | 104.3.1(D)                                      |
| $d_2$    | Half-width of reinforcement zone                                                               | mm    | in.  | 104.3.1(D.2)                                                                      | 104.3.1(D)                                      |
| $d_5$    | Diameter of finished opening                                                                   | mm    | in.  | 104.4.2                                                                           | ...                                             |
| $d_6$    | Inside or pitch diameter of gasket                                                             | mm    | in.  | 104.5.3(A)[eq. (14)]                                                              | 104.5.3                                         |
| $d_b$    | Corroded internal diameter of branch pipe                                                      | mm    | in.  | 104.3.1(G.4)                                                                      | 104.3.1(G)                                      |
| $d_c$    | Corroded internal diameter of extruded outlet                                                  | mm    | in.  | 104.3.1(G.4)<br>104.3.1(G.5)<br>104.3.1(G.6)                                      | 104.3.1(G)                                      |
| $d_i$    | Inside diameter of Y-globe valve                                                               | mm    | in.  | ...                                                                               | 122.1.7(C)                                      |
| $d_n$    | Nominal inside diameter of pipe                                                                | mm    | in.  | 102.3.2(D)                                                                        | ...                                             |
| $d_r$    | Corroded internal diameter of run                                                              | mm    | in.  | 104.3.1(G.4)                                                                      | 104.3.1(G)                                      |
| $E$      | Weld joint efficiency factor                                                                   | ...   | ...  | 104.1.2(A.5)                                                                      | 102.4.3<br>App. A Notes and Tables              |
| $E$      | Young's modulus of elasticity (used with subscripts)                                           | MPa   | psi  | 119.6.2<br>119.6.4<br>119.10.1[eqs. (18), (19)]                                   | App. C, Tables C-1 and C-2<br>App. D, Table D-1 |
| $F$      | Casting quality factor                                                                         | ...   | ...  | 104.1.2(A.5)                                                                      | App. A Notes and Tables                         |
| $f$      | Stress range reduction factor                                                                  | ...   | ...  | 102.3.2(C)[eq. (1)]                                                               | 102.3.2(C)                                      |
| $h$      | Subscript referring to run or header                                                           | ...   | ...  | 104.3.1(D.2)                                                                      | 104.3.1(D)<br>104.3.1(G)                        |
| $h$      | Thread depth (ref. ASME B1.20.1)                                                               | mm    | in.  | 102.4.2                                                                           | ...                                             |
| $h$      | Flexibility characteristic, to compute $i$ , $k$                                               | ...   | ...  | ...                                                                               | App. D, Table D-1                               |

| Symbol | Definition                                                                                                           | Units |        | References                                                                              |                   |
|--------|----------------------------------------------------------------------------------------------------------------------|-------|--------|-----------------------------------------------------------------------------------------|-------------------|
|        |                                                                                                                      | SI    | U.S.   | Paragraph                                                                               | Table/Fig./App.   |
| $h_o$  | Height of extruded lip                                                                                               | mm    | in.    | 104.3.1(G.2)<br>104.3.1(G.4)                                                            | 104.3.1(G)        |
| $I$    | Lorenz equation compensation factor                                                                                  | ...   | ...    | 102.4.5[eqs. (3), (4),<br>(5), (6)]                                                     | ...               |
| $i$    | Stress intensification factor                                                                                        | ...   | ...    | 104.8.1[eq. (15)]<br>104.8.2[eq. (16)]<br>104.8.3[eq. (17)]<br>104.8.4(C)               | App. D, Table D-1 |
| $j$    | Subscript for resultant moment                                                                                       | ...   | ...    | 104.8.4(A)                                                                              | ...               |
| $K$    | Factor for reinforcing area                                                                                          | ...   | ...    | 104.3.1(G.5)                                                                            | 104.3.1(G)        |
| $k$    | Factor for occasional loads                                                                                          | ...   | ...    | 104.8.2[eq. (16)]                                                                       | ...               |
| $k$    | Flexibility factor                                                                                                   | ...   | ...    | ...                                                                                     | App. D, Table D-1 |
| $L$    | Developed length of line axis                                                                                        | m     | ft     | 119.7.1(A.3)                                                                            | ...               |
| $L_1$  | Height of nozzle                                                                                                     | mm    | in.    | 104.8.4(C)                                                                              | App. D, Fig. D-1  |
| $L_4$  | Altitude of reinforcing zone outside run pipe                                                                        | mm    | in.    | 104.3.1(D.2)                                                                            | 104.3.1(D)        |
| $L_8$  | Altitude of reinforcing zone for extruded outlet                                                                     | mm    | in.    | 104.3.1(G.4)<br>104.3.1(G.6)                                                            | 104.3.1(G)        |
| $M$    | Moment of bending or torsional force (used with subscripts to define applications as shown in referenced paragraphs) | mm·N  | in.-lb | 104.8.1[eq. (15)]<br>104.8.2[eq. (16)]<br>104.8.3[eq. (17)]<br>104.8.4(A)<br>104.8.4(C) | 104.8.4           |
| MAWP   | Maximum allowable working pressure                                                                                   | kPa   | psi    | 100.2                                                                                   | ...               |
| MSOP   | Maximum sustained operating pressure                                                                                 | kPa   | psi    | 101.2.2                                                                                 | ...               |
| $N$    | Total number of equivalent reference displacement stress range cycles                                                | ...   | ...    | 102.3.2(C)[eq. (2)]                                                                     | 102.3.2(C)        |
| $N_E$  | Number of cycles of reference displacement stress range                                                              | ...   | ...    | 102.3.2(C)[eq. (2)]                                                                     | ...               |
| $N_i$  | Number of cycles associated with displacement stress range                                                           | ...   | ...    | 102.3.2(C)[eq. (2)]                                                                     | ...               |
| NPS    | Nominal pipe size                                                                                                    | ...   | in.    | General                                                                                 | ...               |

| Symbol          | Definition                                                                | Units |        | References                                                                                                                                                                                                                                                     |                                       |
|-----------------|---------------------------------------------------------------------------|-------|--------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------|
|                 |                                                                           | SI    | U.S.   | Paragraph                                                                                                                                                                                                                                                      | Table/Fig./App.                       |
| $P$             | Internal design gage pressure of pipe, component                          | kPa   | psi    | 102.3.2(D)<br>104.1.2(A)[eqs. (7), (8), (9), (10)]<br>104.5.1(A)<br>104.5.2(B)<br>104.5.3(A)[eq. (14)]<br>104.5.3(B)<br>104.8.1[eq. (15)]<br>104.8.2[eq. (16)]<br>122.1.2(A)<br>122.1.3(A)<br>122.1.4(A)<br>122.1.4(B)<br>122.1.6(B)<br>122.1.7(C)<br>122.4(B) | App. D, Table D-1                     |
| $q$             | Ratio of partial $\Delta T$ to maximum $\Delta T$ (used with subscripts)  | ...   | ...    | 102.3.2(C)[eq. (2)]                                                                                                                                                                                                                                            | ...                                   |
| $R$             | Reaction moment in flexibility analysis (used with subscripts)            | mm-N  | in.-lb | 119.10.1[eqs. (18), (19)]                                                                                                                                                                                                                                      | ...                                   |
| $R$             | Centerline radius of elbow or bend, and effective "radius" of miter bends | mm    | in.    | 102.4.5(B)<br>104.3.3(C.3.1)<br>129.3.4.1                                                                                                                                                                                                                      | App. D, Table D-1<br>102.4.5          |
| $R_f$           | Mean radius after forming                                                 | mm    | in.    | 129.3.4.1                                                                                                                                                                                                                                                      | ...                                   |
| $R_g$           | Original mean radius                                                      | mm    | in.    | 129.3.4.1                                                                                                                                                                                                                                                      | ...                                   |
| $R_m$           | Mean radius of run pipe                                                   | mm    | in.    | ...                                                                                                                                                                                                                                                            | App. D, Fig. D-1<br>App. D, Table D-1 |
| $r$             | Mean radius of pipe using nominal wall $t_n$                              | mm    | in.    | 104.3.3                                                                                                                                                                                                                                                        | App. D, Table D-1                     |
| $r_1$           | Half width of reinforcement zone                                          | mm    | in.    | 104.3.1(G.4)                                                                                                                                                                                                                                                   | 104.3.1(G)                            |
| $r_1, r_2, r_3$ | Transition radii of branch reinforcement                                  | mm    | in.    | ...                                                                                                                                                                                                                                                            | App. D, Fig. D-1                      |
| $r_b$           | Branch mean cross-sectional radius                                        | mm    | in.    | 104.8.4                                                                                                                                                                                                                                                        | ...                                   |
| $r_i$           | Inside radius of branch                                                   | mm    | in.    | 104.8.4(C)                                                                                                                                                                                                                                                     | App. D, Fig. D-1                      |
| $r'_m$          | Mean radius of branch                                                     | mm    | in.    | 104.8.4(C)                                                                                                                                                                                                                                                     | App. D, Fig. D-1<br>App. D, Table D-1 |
| $r_o$           | Radius of curvature of external curved portion                            | mm    | in.    | 104.3.1(G.2)<br>104.3.1(G.4)<br>104.3.1(G.6)                                                                                                                                                                                                                   | 104.3.1(G)                            |
| $r_{od}$        | Normal outside radius of pipe or tube                                     | mm    | in.    | 129.3.4.1                                                                                                                                                                                                                                                      | ...                                   |
| $r_p$           | Outside radius of branch reinforcement                                    | mm    | in.    | ...                                                                                                                                                                                                                                                            | App. D, Fig. D-1<br>App. D, Table D-1 |
| $r_x$           | External crotch radius of welded-in contour inserts                       | mm    | in.    | ...                                                                                                                                                                                                                                                            | App. D                                |
| $S$             | Basic material allowable stress                                           | MPa   | psi    | 122.1.2(A)<br>122.1.3(B)<br>122.4(B.3)                                                                                                                                                                                                                         | ...                                   |

| Symbol   | Definition                                                                                                                                                                                                                          | Units |      | References                                                                                                              |                                              |
|----------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------|------|-------------------------------------------------------------------------------------------------------------------------|----------------------------------------------|
|          |                                                                                                                                                                                                                                     | SI    | U.S. | Paragraph                                                                                                               | Table/Fig./App.                              |
| $S$      | Basic material allowable stress                                                                                                                                                                                                     | MPa   | ksi  | 102.3.1(A)                                                                                                              | App. A Tables and Notes                      |
| $S_a$    | Bolt design stress at atmospheric temperature                                                                                                                                                                                       | kPa   | psi  | 104.5.1(A)                                                                                                              | ...                                          |
| $S_b$    | Bolt design stress at design temperature                                                                                                                                                                                            | kPa   | psi  | 104.5.1(A)                                                                                                              | ...                                          |
| $S_c$    | Basic material allowable stress at minimum (cold) temperature                                                                                                                                                                       | MPa   | psi  | 102.3.2(C)[eq. (1)]                                                                                                     | ...                                          |
| $S_f$    | Allowable stress for flange material or pipe                                                                                                                                                                                        | kPa   | psi  | 104.5.1(A)                                                                                                              | ...                                          |
| $S_h$    | Basic material allowable stress at maximum (hot) temperature                                                                                                                                                                        | MPa   | psi  | 102.3.2(C)[eq. (1)]<br>102.3.2(D)<br>104.8.1[eq. (15)]<br>104.8.2[eq. (16)]<br>104.8.3[eq. (17)]<br>119.10.1 [eq. (19)] | ...                                          |
| $S_{lp}$ | Longitudinal pressure stress                                                                                                                                                                                                        | kPa   | psi  | 102.3.2(D)<br>104.8                                                                                                     | ...                                          |
| $S_A$    | Allowable stress range for expansion stress                                                                                                                                                                                         | MPa   | psi  | 102.3.2(C)[eq. (1)]<br>104.8.3[eq. (17)]                                                                                | ...                                          |
| $S_E$    | Computed thermal expansion stress range                                                                                                                                                                                             | MPa   | psi  | 104.8.3[eq. (17)]<br>119.6.4<br>119.10.1[eq. (19)]                                                                      | ...                                          |
| $S_L$    | Longitudinal stress due to pressure, weight, and other sustained loads                                                                                                                                                              | MPa   | psi  | 102.3.2(D)<br>104.8.1[eq. (15)]                                                                                         | ...                                          |
| $SE$     | Allowable stress (including weld joint efficiency factor)                                                                                                                                                                           | MPa   | psi  | 102.3.2(C)<br>104.1.2(A)[eqs. (7), (8), (9), (10)]<br>104.5.2(B)<br>104.5.3(A)[eq. (14)]<br>104.5.3(B)                  | ...                                          |
| $SE$     | Allowable stress (including weld joint efficiency factor)                                                                                                                                                                           | MPa   | ksi  | 102.3.1(A)                                                                                                              | App. A Tables and Notes                      |
| $SF$     | Allowable stress (including casting quality factor)                                                                                                                                                                                 | MPa   | psi  | 104.1.2(A)                                                                                                              | ...                                          |
| $SF$     | Allowable stress (including casting quality factor)                                                                                                                                                                                 | MPa   | ksi  | 102.3.1(A)                                                                                                              | App. A Tables and Notes                      |
| $s$      | Miter spacing pipe centerline                                                                                                                                                                                                       | mm    | in.  | ...                                                                                                                     | App. D, Table D-1                            |
| $T$      | Actual pipe wall thickness (by measurement) or the minimum wall thickness permissible under the purchase specification, used with or without subscripts, namely<br>$T_b$ = thickness of branch<br>$T_h$ = thickness of header, etc. | mm    | in.  | 104.3.1(D.2)<br>104.3.1(G.4)<br>104.3.1(G.6)<br>104.8.4(C)                                                              | 104.3.1(D)<br>104.3.1(G)<br>App. D, Fig. D-1 |
| $T_c$    | Crotch thickness of welded-in contour inserts                                                                                                                                                                                       | mm    | in.  | ...                                                                                                                     | App. D, Table D-1                            |
| $T_o$    | Corroded finished thickness extruded outlet                                                                                                                                                                                         | mm    | in.  | 104.3.1(G.4)<br>104.3.1(G.6)                                                                                            | 104.3.1(G)                                   |

| Symbol    | Definition                                                                                                                                                                                                                   | Units |      | References                                                                                                                                                                                                                                           |                                                                                               |
|-----------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------|------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------|
|           |                                                                                                                                                                                                                              | SI    | U.S. | Paragraph                                                                                                                                                                                                                                            | Table/Fig./App.                                                                               |
| $t$       | Pressure design thickness pipe, components (used with subscripts)                                                                                                                                                            | mm    | in.  | 104.1.2(A)[eqs. (7), (8), (9), (10)]<br>104.3.1(D.2)<br>104.3.1(G.4)<br>104.3.3(C.3.1)<br>104.3.3(C.3.2)<br>104.4.1(B)<br>104.4.2<br>104.5.2(B)[eq. (13)]<br>104.5.3(A)[eq. (14)]<br>104.5.3(B)<br>104.8.1<br>104.8.4(C)<br>127.4.8(B)<br>132.4.2(E) | 104.3.1(G)<br>104.5.3<br>127.4.8(D)                                                           |
| $t_{1,2}$ | Nominal wall thickness of reducer                                                                                                                                                                                            | mm    | in.  | ...                                                                                                                                                                                                                                                  | App. D, Table D-1                                                                             |
| $t_c$     | Throat thickness of cover fillet weld, branch connection                                                                                                                                                                     | mm    | in.  | 127.4.8(B)<br>132.4.2(E)                                                                                                                                                                                                                             | 127.4.8(D)<br>127.4.8(E)                                                                      |
| $t_e$     | Effective branch wall thickness                                                                                                                                                                                              | mm    | in.  | 104.8.4(C)                                                                                                                                                                                                                                           | ...                                                                                           |
| $t_m$     | Minimum required thickness of component, including allowances (c) for mechanical joining, corrosion, etc. (used with subscripts), namely<br>$t_{mb}$ = minimum thickness of branch<br>$t_{mh}$ = minimum thickness of header | mm    | in.  | 104.1.2(A)[eqs. (7), (8), (9), (10)]<br>104.3.1(D.2)<br>104.3.1(E)<br>104.3.1(G)<br>104.3.3(C.3.1)<br>104.3.3(C.3.2)<br>104.4.1(B)<br>104.5.2(B)[eq. (13)]<br>104.5.3(A)                                                                             | 102.4.5<br>104.1.2(A)<br>104.3.1(D)<br>104.3.1(G)<br>127.4.2                                  |
| $t_n$     | Nominal wall thickness of component (used with subscripts), namely<br>$t_{nb}$ = nominal wall thickness of branch<br>$t_{nh}$ = nominal wall thickness of header<br>$t_{nr}$ = nominal thickness of reinforcement            | mm    | in.  | 102.3.2(A.3)<br>104.3.3<br>104.8.1[eq. (15)]<br>104.8.2[eq. (16)]<br>104.8.4(C)<br>127.4.8(B)<br>129.3.4.1<br>132.4.2(E)                                                                                                                             | 127.4.4(B)<br>127.4.4(C)<br>127.4.8(D)<br>127.4.8(E)<br>App. D, Fig. D-1<br>App. D, Table D-1 |
| $t_r$     | Thickness of reinforcing pad or saddle                                                                                                                                                                                       | mm    | in.  | 104.3.1(D.2)<br>104.3.1(E)                                                                                                                                                                                                                           | 104.3.1(D)<br>App. D, Table D-1                                                               |
| $t_s$     | Wall thickness of segment or miter                                                                                                                                                                                           | mm    | in.  | 104.3.3(C.3)                                                                                                                                                                                                                                         | ...                                                                                           |
| $t_w$     | Weld thickness                                                                                                                                                                                                               | mm    | in.  | 104.3.1(C.2)                                                                                                                                                                                                                                         | 127.4.8(G)                                                                                    |
| $U$       | Anchor distance (length of straight line joining anchors)                                                                                                                                                                    | m     | ft   | 119.7.1(A.3)                                                                                                                                                                                                                                         | ...                                                                                           |
| $W$       | Weld strength reduction factor                                                                                                                                                                                               | ...   | ...  | 102.4.7<br>104.1.4                                                                                                                                                                                                                                   | 102.4.7                                                                                       |
| $x_{min}$ | Size of fillet weld for slip-on and socket welding flanges or socket wall for socket welds                                                                                                                                   | mm    | in.  | ...                                                                                                                                                                                                                                                  | 127.4.4(B)                                                                                    |
| $Y$       | Resultant of movement to be absorbed by pipelines                                                                                                                                                                            | ...   | ...  | 119.7.1(A.3)                                                                                                                                                                                                                                         | ...                                                                                           |

| Symbol     | Definition                                            | Units           |                  | References                                                                              |                                                                   |
|------------|-------------------------------------------------------|-----------------|------------------|-----------------------------------------------------------------------------------------|-------------------------------------------------------------------|
|            |                                                       | SI              | U.S.             | Paragraph                                                                               | Table/Fig./App.                                                   |
| $y$        | A coefficient having values given in Table 104.1.2(A) | ...             | ...              | 104.1.2(A.7)[eqs. (7), (8), (9), (10)]                                                  | 104.1.2(A)<br>App. A, Notes to Tables A-4, A-5, A-6, A-7, and A-9 |
| $y$        | Branch offset dimension                               | mm              | in.              | ...                                                                                     | App. D, Fig. D-1                                                  |
| $Z$        | Section modulus of pipe                               | mm <sup>3</sup> | in. <sup>3</sup> | 104.8.1[eq. (15)]<br>104.8.2[eq. (16)]<br>104.8.3[eq. (17)]<br>104.8.4(A)<br>104.8.4(C) | ...                                                               |
| $\alpha$   | Angle between axes of branch and run                  | deg             | deg              | 104.3.1(D.2)<br>104.3.1(E)                                                              | 104.3.1(D)                                                        |
| $\alpha$   | Reducer cone angle                                    | deg             | deg              | ...                                                                                     | App. D, Table D-1                                                 |
| $\delta$   | Mismatch or offset                                    | mm              | in.              | ...                                                                                     | App. D, Table D-1                                                 |
| $\Delta T$ | Range of temperature change (used with subscripts)    | °C              | °F               | 102.3.2(C)                                                                              | ...                                                               |
| $\theta$   | Angle of miter cut                                    | deg             | deg              | 104.3.3                                                                                 | App. D, Table D-1                                                 |
| $\theta_n$ | Transition angle of branch reinforcement              | deg             | deg              | ...                                                                                     | App. D, Fig. D-1                                                  |
| $\geq$     | Equal to or greater than                              | ...             | ...              | ...                                                                                     | ...                                                               |
| $\leq$     | Equal to or less than                                 | ...             | ...              | ...                                                                                     | ...                                                               |

# MANDATORY APPENDIX H

## PREPARATION OF TECHNICAL INQUIRIES

### H-1 INTRODUCTION

The ASME B31 Committee, Code for Pressure Piping, will consider written requests for interpretations and revisions of the Code rules, and develop new rules if dictated by technical development. The Committee's activities in this regard are limited strictly to interpretations of the rules or to the consideration of revisions to the present rules on the basis of new data or technology. The Introduction to this Code states "It is the owner's responsibility to determine which Code Section is applicable to a piping installation." The Committee will not respond to inquiries requesting assignment of a Code Section to a piping installation. As a matter of published policy, ASME does not approve, certify, rate, or endorse any item, construction, proprietary device, or activity, and, accordingly, inquiries requiring such consideration will be returned. Moreover, ASME does not act as a consultant on specific engineering problems or on the general application or understanding of the Code rules. If, based on the inquiry information submitted, it is the opinion of the Committee that the inquirer should seek professional assistance, the inquiry will be returned with the recommendation that such assistance be obtained.

Inquiries that do not provide the information needed for the Committee's full understanding will be returned.

### H-2 REQUIREMENTS

Inquiries shall be limited strictly to interpretations of the rules or to the consideration of revisions to the present rules on the basis of new data or technology. Inquiries shall meet the following requirements:

(a) *Scope.* Involve a single rule or closely related rules in the scope of the Code. An inquiry letter concerning unrelated subjects will be returned.

(b) *Background.* State the purpose of the inquiry, which may be either to obtain an interpretation of Code rules, or to propose consideration of a revision to the present rules. Provide concisely the information needed for the Committee's understanding of the inquiry, being sure to include reference to the applicable Code Section, Edition, Addenda, paragraphs, figures, and tables. If sketches are provided, they shall be limited to the scope of the inquiry.

(c) *Inquiry Structure*

(1) *Proposed Question(s).* The inquiry shall be stated in a condensed and precise question format, omitting superfluous background information, and, where appropriate, composed in such a way that "yes" or "no" (perhaps with provisos) would be an acceptable reply. The inquiry statement should be technically and editorially correct.

(2) *Proposed Reply(ies).* Provide a proposed reply stating what it is believed that the Code requires. If in the inquirer's opinion, a revision to the Code is needed, recommended wording shall be provided in addition to information justifying the change.

### H-3 SUBMITTAL

Inquiries should be submitted in typewritten form; however, legible handwritten inquiries will be considered. They shall include the name and mailing address of the inquirer, and be mailed to the following address:

Secretary  
ASME B31 Committee  
Three Park Avenue  
New York, NY 10016-5990

# MANDATORY APPENDIX J

## QUALITY CONTROL REQUIREMENTS FOR BOILER EXTERNAL PIPING (BEP)

(12)

### FOREWORD

This Mandatory Appendix contains the quality control requirements for boiler external piping. The following is that portion of Nonmandatory Appendix A, A-301 and A-302, of the ASME Boiler and Pressure Vessel Code, Section I, which is applicable to BEP.

### J-1 QUALITY CONTROL SYSTEM

#### J-1.1 General

**J-1.1.1 Quality Control System.** The Manufacturer or assembler shall have and maintain a quality control system which will establish that all Code requirements, including material, design, fabrication, examination (by the Manufacturer), and inspection of boilers and boiler parts (by the Authorized Inspector), will be met. Provided that Code requirements are suitably identified, the system may include provisions for satisfying any requirements by the Manufacturer or user that exceed minimum Code requirements and may include provisions for quality control of non-Code work. In such systems, the Manufacturer may make changes in parts of the system that do not affect the Code requirements without securing acceptance by the Authorized Inspector. Before implementation, revisions to quality control systems of Manufacturers and assemblers of safety and safety relief valves shall have been found acceptable to an ASME designee if such revisions affect Code requirements.

The system that the Manufacturer or assembler uses to meet the requirements of this Section must be one suitable for his/her own circumstances. The necessary scope and detail of the system shall depend on the complexity of the work performed and on the size and complexity of the Manufacturer's (or assembler's) organization. A written description of the system the Manufacturer or assembler will use to produce a Code item shall be available for review. Depending upon the circumstances, the description may be brief or voluminous.

The written description may contain information of proprietary nature relating to the Manufacturer's (or assembler's) processes. Therefore, the Code does not require any distribution of this information, except for the Authorized Inspector or ASME designee.

It is intended that information learned about the system in connection with evaluation will be treated as confidential and that all loaned descriptions will be returned to the Manufacturer upon completion of the evaluation.

#### J-1.2 Outline of Features to Be Included in the Written Description of the Quality Control System

The following is a guide to some of the features that should be covered in the written description of the quality control system and that is equally applicable to both shop and field work.

**J-1.2.1 Authority and Responsibility.** The authority and responsibility of those in charge of the quality control system shall be clearly established. Persons performing quality control functions shall have sufficient and well-defined responsibility, the authority, and the organizational freedom to identify quality control problems and to initiate, recommend, and provide solutions.

**J-1.2.2 Organization.** An organization chart showing the relationship between management and engineering, purchasing, manufacturing, field assembling, inspection, and quality control is required to reflect the actual organization. The purpose of this chart is to identify and associate the various organizational groups with the particular function for which they are responsible. The Code does not intend to encroach on the Manufacturer's right to establish, and from time to time to alter, whatever form of organization the Manufacturer considers appropriate for its Code work.

**J-1.2.3 Drawings, Design Calculations, and Specification Control.** The Manufacturer's or assembler's quality control system shall provide procedures that will ensure that the latest applicable drawings, design calculations, specifications, and instructions, required by the Code, as well as authorized changes, are used for manufacture, assembly, examination, inspection, and testing.

**J-1.2.4 Material Control.** The Manufacturer or assembler shall include a system of receiving control that will ensure that the material received is properly identified and has documentation, including required material certifications or material test reports, to satisfy

Code requirements as ordered. The material control system shall insure that only the intended material is used in Code construction.

**J-1.2.5 Examination and Inspection Program.** The Manufacturer's quality control system shall describe the fabrication operations, including examinations, sufficiently to permit the Authorized Inspector to determine at what stages specific inspections are to be performed.

**J-1.2.6 Correction of Nonconformities.** There shall be a system agreed upon with the Authorized Inspector for correction of nonconformities. A nonconformity is any condition that does not comply with the applicable rules of this Section. Nonconformities must be corrected or eliminated in some way before the completed component can be considered to comply with this Section.

**J-1.2.7 Welding.** The quality control system shall include provisions for indicating that welding conforms to requirements of Section IX as supplemented by this Section.

**J-1.2.8 Nondestructive Examination.** The quality control system shall include provisions for identifying nondestructive examination procedures the Manufacturer will apply to conform with requirements of this Section.

**J-1.2.9 Heat Treatment.** The quality control system shall provide controls to ensure that heat treatments as required by the rules of this Section are applied. Means shall be indicated by which the Authorized Inspector can satisfy him/herself that these Code heat treatment requirements are met. This may be by review of furnace time – temperature records or by other methods as appropriate.

**J-1.2.10 Calibration of Measurement and Test Equipment.** The Manufacturer or assembler shall have a system for the calibration of examination, measuring, and test equipment used in fulfillment of requirements of this Section.

**J-1.2.11 Records Retention.** The Manufacturer or assembler shall have a system for the maintenance of radiographs and Manufacturers' Data Reports as required by this Section.

**J-1.2.12 Sample Forms.** The forms used in the quality control system and any detailed procedures for their use shall be available for review. The written description shall make necessary references to these forms.

### **J-1.2.13 Inspection of Boilers and Boiler Parts**

**J-1.2.13.1** Inspection of boilers and boiler parts shall be by the Authorized Inspector described in PG-91.

**J-1.2.13.2** The written description of the quality control system shall include reference to the Authorized Inspector.

**J-1.2.13.2.1** The Manufacturer (or assembler) shall make available to the Authorized Inspector at the Manufacturer's plant (or construction site) a current copy of the written description or the applicable quality control system.

**J-1.2.13.2.2** The Manufacturer's quality control system shall provide for the Authorized Inspector at the Manufacturer's plant to have access to all drawings, calculations, specifications, procedures, process sheets, repair procedures, records, test results, and any other documents as necessary for the Inspector to perform his/her duties in accordance with this Section. The Manufacturer may provide such access either to his/her own files of such documents or by providing copies to the Inspector.

### **J-1.2.14 Inspection of Pressure-Relieving Valves (12)**

**J-1.2.14.1** Inspection of safety, safety-relief, and power-actuated pressure-relieving valves shall be by designated representative of the ASME, as described in PG-73.3.

**J-1.2.14.2** The written description of the quality control system shall include reference to the ASME designee.

**J-1.2.14.2.1** The valve Manufacturer (or assembler) shall make available to the ASME designee at the Manufacturer's plant a current copy of the written description of the applicable quality control system.

**J-1.2.14.2.2** The valve Manufacturer's (or assembler's) quality control system shall provide for the ASME designee to have access to all drawings, calculations, specifications, procedures, process sheets, repair procedures, records, test results, and any other documents as necessary for the designee to perform his/her duties in accordance with this Section. The Manufacturer may provide such access either to his/her own files of such documents or by providing copies to the designee.

# NONMANDATORY APPENDICES

## NONMANDATORY APPENDIX II RULES FOR THE DESIGN OF SAFETY VALVE INSTALLATIONS<sup>1</sup>

### FOREWORD

ASME B31.1 contains rules governing the design, fabrication, materials, erection, and examination of power piping systems. Experience over the years has demonstrated that these rules may be reasonably applied to safety valve installations. Nevertheless, instances have occurred wherein the design of safety valve installations may not have properly and fully applied the ASME B31.1 rules. Accordingly, this Appendix to ASME B31.1 has been prepared to illustrate and clarify the application of ASME B31.1 rules to safety valve installations. To this end, this Appendix presents the designer with design guidelines and alternative design methods.

### II-1 SCOPE AND DEFINITION

#### II-1.1 Scope

The scope of this Appendix is confined to the design of the safety valve installations as defined in para. II-1.2. The loads acting at the safety valve station will affect the bending moments and stresses in the complete piping system, out to its anchors and/or extremities, and it is the designer's responsibility to consider these loads. This Appendix, however, deals primarily with the safety valve installation, and not the complete piping system.

The design of the safety valve installation requires that careful attention be paid to

- (A) all loads acting on the system
- (B) the forces and bending moments in the piping and piping components resulting from the loads
- (C) the loading and stress criteria
- (D) general design practices

All components in the safety valve installation must be given consideration, including the complete piping system, the connection to the main header, the safety valve, valve and pipe flanges, the downstream discharge

or vent piping, and the system supports. The scope of this Appendix is intended to cover all loads on all components. It is assumed that the safety valve complies with the requirements of American National Standards prescribed by ASME B31.1 for structural integrity.

This Appendix has application to either safety, relief, or safety-relief valve installations. For convenience, however, the overpressure protection device is generally referred to as a safety valve. The loads associated with relief or safety-relief valve operation may differ significantly from those of safety valve operation, but otherwise the rules contained herein are equally applicable to each type of valve installation. See para. II-1.2 for definition.

This Appendix provides analytic and nomenclature definition figures to assist the designer, and is not intended to provide actual design layout (drains, drip pans, suspension, air gaps, flanges, weld ends, and other design details are not shown). Sample problems have been provided at the end of the text to assist the designer in application of the rules in this Appendix.

#### II-1.2 Definitions (Valve Descriptions Follow the Definitions Given in Section I of the ASME Boiler and Pressure Vessel Code)

*safety valve*: an automatic pressure relieving device actuated by the static pressure upstream of the valve and characterized by full opening pop action. It is used for gas or vapor service.

*relief valve*: an automatic pressure relieving device actuated by the static pressure upstream of the valve that opens further with the increase in pressure over the opening pressure. It is used primarily for liquid service.

*safety relief valve*: an automatic pressure actuated relieving device suitable for use either as a safety valve or relief valve, depending on application.

<sup>1</sup> Nonmandatory appendices are identified by a Roman numeral; mandatory appendices are identified by a letter. Therefore, Roman numeral I is not used, in order to avoid confusion with the letter I.

*power-actuated pressure relieving valve:* a relieving device whose movements to open or close are fully controlled by a source of power (electricity, air, steam, or hydraulic). The valve may discharge to atmosphere or to a container at lower pressure. The discharge capacity may be affected by the downstream conditions, and such effects shall be taken into account. If the power-actuated pressure relieving valves are also positioned in response to other control signals, the control impulse to prevent overpressure shall be responsive only to pressure and shall override any other control function.

*open discharge installation:* an installation where the fluid is discharged directly to the atmosphere or to a vent pipe that is uncoupled from the safety valve. Figure II-1-2(A) shows a typical open discharge installation with an elbow installed at the valve discharge to direct the flow into a vent pipe. The values for  $l$  and  $m$  on Fig. II-1-2(A) are upper limits for which the rules for open discharge systems may be used.  $l$  shall be limited to a value less than or equal to  $4D_o$ ;  $m$  shall be limited to a value less than or equal to  $6D_o$  where  $D_o$  is the outside diameter of the discharge pipe. Open discharge systems which do not conform to these limits shall be evaluated by the designer for the applicability of these rules.

*closed discharge installation:* an installation where the effluent is carried to a distant spot by a discharge pipe which is connected directly to the safety valve. Figure II-1-2(B) shows a typical closed discharge system.

*safety valve installation:* the safety valve installation is defined as that portion of the system shown on Figs. II-1-2(A) and II-1-2(B). It includes the run pipe, branch connection, the inlet pipe, the valve, the discharge piping, and the vent pipe. Also included are the components used to support the system for all static and dynamic loads.

## II-2 LOADS

### II-2.1 Thermal Expansion

Loads acting on the components in the safety valve installation and the displacements at various points due to thermal expansion of the piping shall be determined by analyzing the complete piping system out to its anchors, in accordance with procedures in para. 119.

**II-2.1.1 Installations With Open Discharge.** For safety valve installations with open discharge, there will be no thermal expansion loads acting on the discharge elbow, the valve, or the valve inlet other than that from restraint to thermal expansion as described below. Restraint to thermal expansion can sometimes occur due to drain lines, or when structural supports are provided to carry the reaction forces associated with safety valve lift. Examples of such structural supports are shown in Fig. II-6-1, sketch (b). When such restraints exist, the

thermal expansion loads and stresses shall be calculated and effects evaluated.

**II-2.1.2 Installations With Closed Discharge.** Loads due to thermal expansion and back pressure of a safety valve installation with a closed discharge can be high enough to cause malfunction of the valve, excessive leakage of the valve or flange, or overstress of other components. The loads due to thermal expansion shall be evaluated for all significant temperature combinations, including the cases where the discharge piping is hot following safety valve operation.

### II-2.2 Pressure

Pressure loads acting on the safety valve installation are important from two main considerations. The first consideration is that the pressure acting on the walls of the safety valve installation can cause membrane stresses which could result in rupture of the pressure retaining parts. The second consideration is that the pressure effects associated with discharge can cause high loads acting on the system which create bending moments throughout the piping system. These pressure effects are covered in para. II-2.3.

All parts of the safety valve installation must be designed to withstand the design pressures without exceeding the Code allowable stresses. The branch connection, the inlet pipe, and the inlet flanges shall be designed for the same design pressure as that of the run pipe. The design pressure of the discharge system will depend on the safety valve rating and on the configuration of the discharge piping. The open discharge installation and the closed discharge installation present somewhat different problems in the determination of design pressures, and these problems are discussed in the paragraphs below.

**II-2.2.1 Design Pressure and Velocity for Open Discharge Installation Discharge Elbows and Vent Pipes.** There are several methods available to the designer for determining the design pressure and velocity in the discharge elbow and vent pipe. It is the responsibility of the designer to assure himself that the method used yields conservative results. A method for determining the design pressures and velocities in the discharge elbow and vent pipe for open discharge installation is shown below and illustrated in the sample problem.

(A) First, calculate the design pressure and velocity for the discharge elbow.

(A.1) Determine the pressure,  $P_1$ , that exists at the discharge elbow outlet (Fig. II-2-1).

$$P_1 = \frac{W}{A_1} \frac{(b-1)}{b} \sqrt{\frac{2(h_o - a)l}{g_c (2b-1)}}$$

Fig. II-1-2(A) Safety Valve Installation (Open Discharge System)



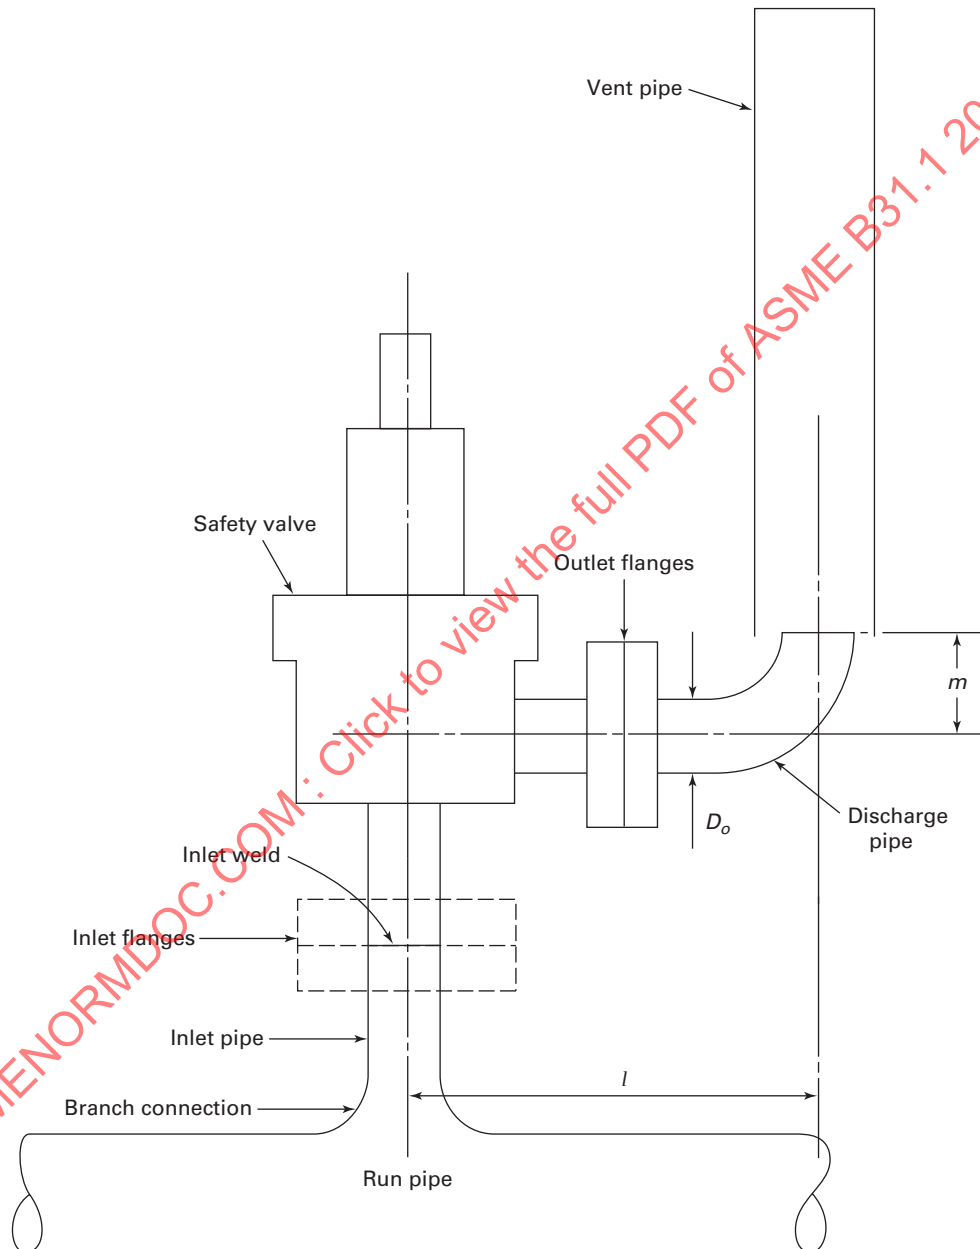


Fig. II-1-2(B) Safety Valve Installation (Closed Discharge System)

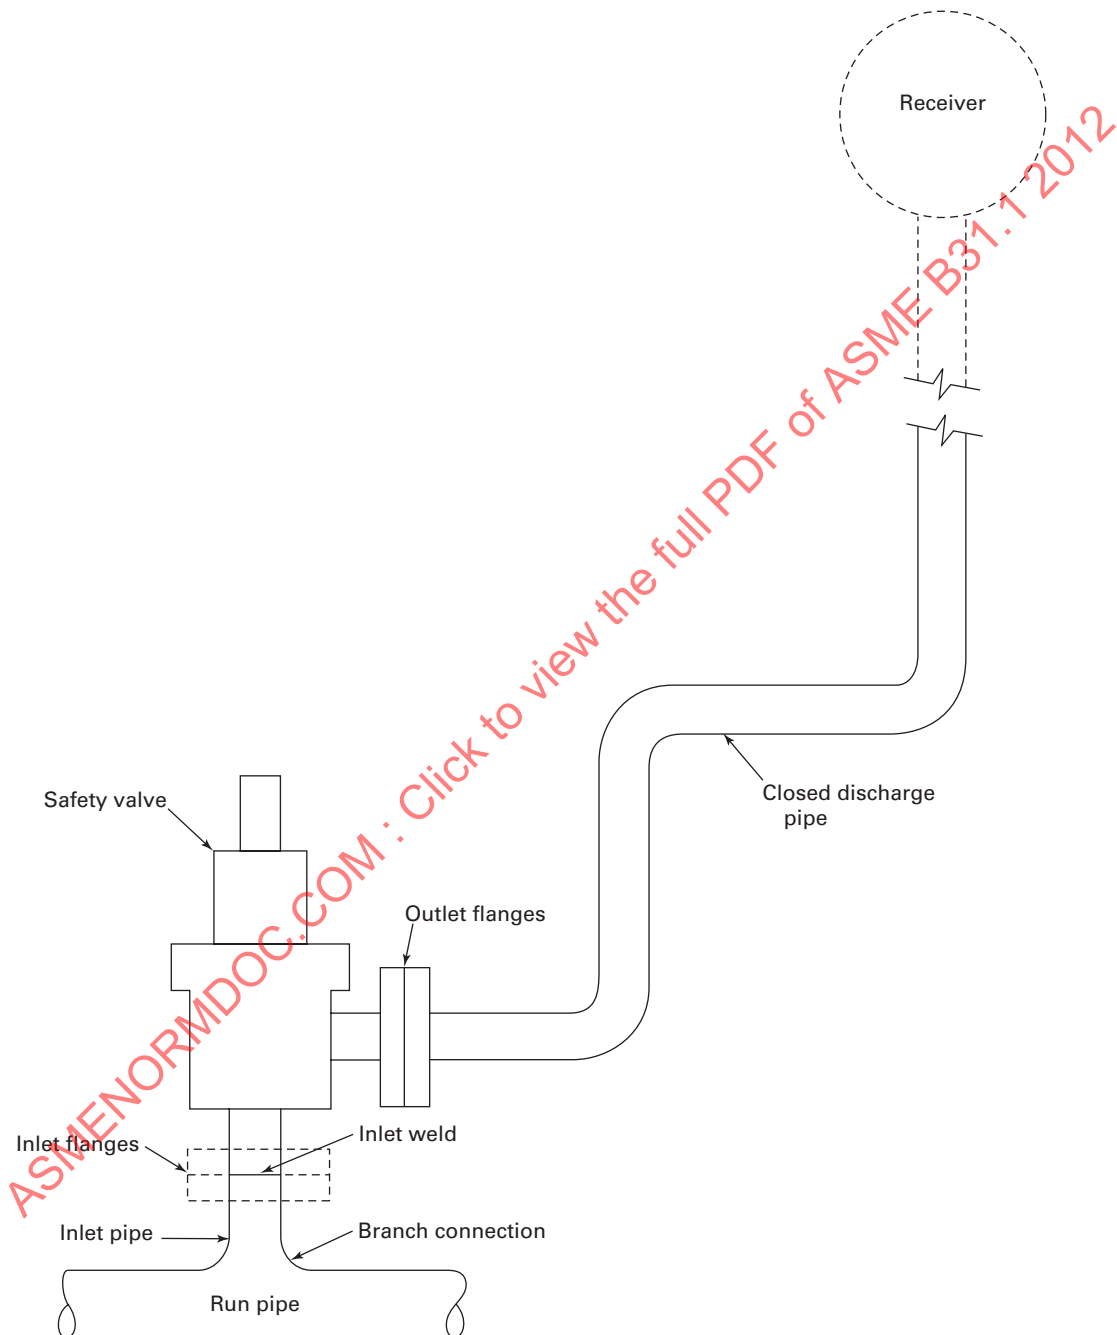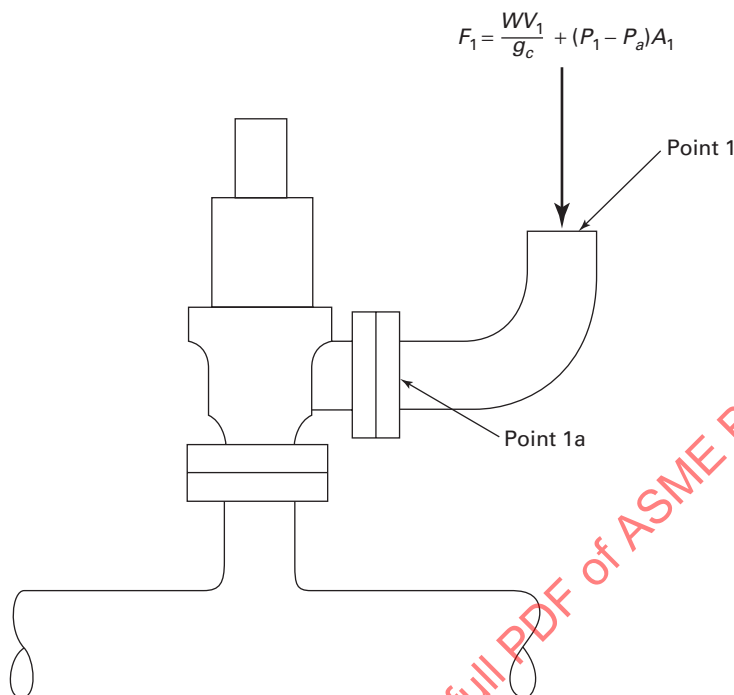

**Fig. II-2-1 Discharge Elbow (Open Discharge Installation)**

(A.2) Determine the velocity,  $V_1$ , that exists at the discharge elbow outlet (Fig. II-2-1).

$$V_1 = \sqrt{\frac{2g_c J(h_o - a)}{(2b - 1)}}$$

where

$A_1$  = discharge elbow area, in.<sup>2</sup>

$g_c$  = gravitational constant  
= 32.2 lbm-ft/lbf-sec<sup>2</sup>

$h_o$  = stagnation enthalpy at the safety valve inlet, Btu/lbm

$J$  = 778.16 ft-lbf/Btu

$P_1$  = pressure, psia (lbf/in.<sup>2</sup>, absolute)

$V_1$  = ft/sec

$W$  = actual mass flow rate, lbm/sec

Common values of  $a$  and  $b$  are listed in Table II-2.2.1.

(A.3) Determine the safety valve outlet pressure,  $P_{1a}$ , at the inlet to the discharge elbow (Fig. II-2-1).

(A.3.1) Determine the length to diameter ratio (dimensionless) for the pipe sections in the discharge elbow ( $L/D$ )

$$L/D = \frac{L_{\max}}{D}$$

(A.3.2) Determine a Darcy-Weisbach friction factor,  $f$ , to be used. (For steam, a value of 0.013 can be used as a good estimate since  $f$  will vary slightly in turbulent pipe flow.)

**Table II-2.2.1 Values of  $a$  and  $b$** 

| Steam Condition                                                                      | $a$ , Btu/lbm | $b$  |
|--------------------------------------------------------------------------------------|---------------|------|
| Wet steam,<br>< 90% quality                                                          | 291           | 11   |
| Saturated steam,<br>≥ 90% quality,<br>15 psia ≤ $P_1$ ≤ 1,000 psia                   | 823           | 4.33 |
| Superheated steam,<br>≥ 90% quality,<br>1,000 psia < $P_1$ ≤ 2,000 psia <sup>1</sup> | 831           | 4.33 |

NOTE:

(1) This method may be used as an approximation for pressures over 2,000 psi, but an alternate method should be used for verification.

(A.3.3) Determine a specific heat ratio (for superheated steam,  $k = 1.3$  can be used as an estimate — for saturated steam,  $k = 1.1$ ).

(A.3.4) Calculate  $f(L_{\max}/D)$ .


(A.3.5) Enter Chart II-1 with value of  $f(L_{\max}/D)$  and determine  $P/P^*$ .

(A.3.6)  $P_{1a} = P_1 (P/P^*)$ .

(A.3.7)  $P_{1a}$  is the maximum operating pressure of the discharge elbow.

(B) Second, determine the design pressure and velocity for the vent pipe.

Chart II-1 Compressible Flow Analysis

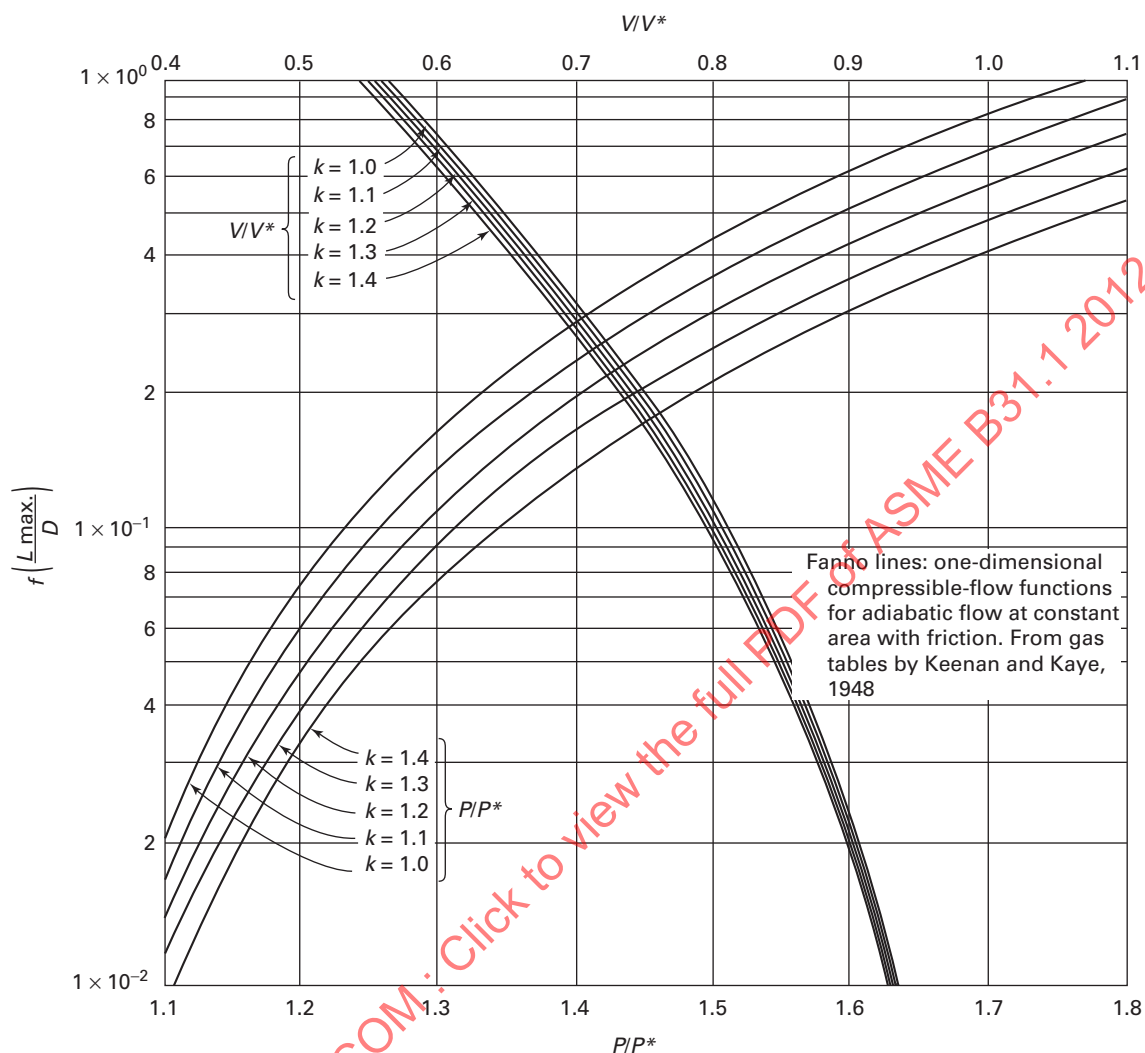

(B.1) Determine the pressure,  $P_3$ , that exists at the vent pipe outlet (Fig. II-2-2)

$$P_3 = P_1 \left( \frac{A_1}{A_3} \right)$$

(B.2) Determine the velocity,  $V_3$ , that exists at the vent pipe outlet (Fig. II-2-2)

$$V_3 = V_1$$

(B.3) Repeat Steps (3.1) to (3.7) in the calculation of the discharge elbow maximum operating pressure to determine the maximum operating pressure of the vent pipe.

(B.4) Determine the velocity,  $V_2$ , and pressure,  $P_2$ , that exist at the inlet to the vent pipe (Fig. II-2-2).

(B.4.1) Enter Chart II-1<sup>2</sup> with value of  $f(L_{\max}/D)$  from Step (3.4) and determine values of  $V/V^*$  and  $P/P^*$ .

(B.4.2) Calculate  $V_2$


$$V_2 = V_3 (V/V^*)$$

(B.4.3)  $P_2 = P_3 (P/P^*)$ . This is the highest pressure the vent stack will see and should be used in calculating vent pipe blowback (see para. II-2.3.1.2).

#### II-2.2.2 Pressure for Closed Discharge Installations.

The pressures in a closed discharge pipe during steady

<sup>2</sup> Chart II-1 may be extended to other values of  $f(L_{\max}/D)$  by use of the Keenan and Kaye Gas Tables for Fanno lines. The Darcy-Weisbach friction factor is used in Chart II-1, whereas the Gas Tables use the Fanning factor which is one-fourth the value of the Darcy-Weisbach factor.

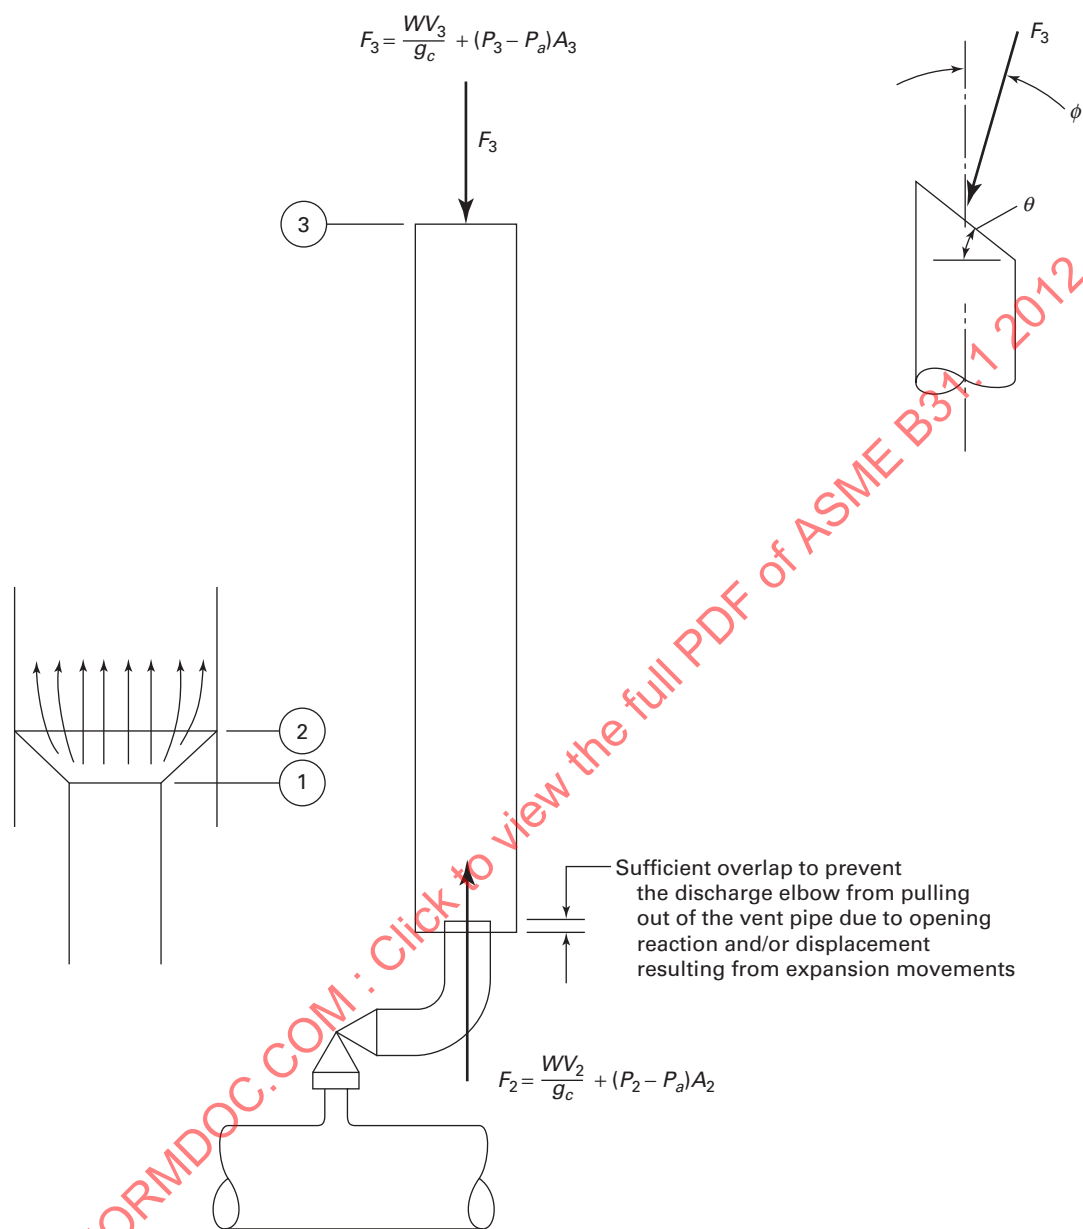**Fig. II-2-2 Vent Pipe (Open Discharge Installation)**

state flow may be determined by the methods described in para. II-2.2.1. However, when a safety valve discharge is connected to a relatively long run of pipe and is suddenly opened, there is a period of transient flow until the steady state discharge condition is reached. During this transient period, the pressure and flow will not be uniform. When the safety valve is initially opened, the discharge pipe may be filled with air. If the safety valve is on a steam system, the steam discharge from the valve must purge the air from the pipe before steady state steam flow is established and, as the pressure builds up at the valve outlet flange and waves start to travel down the discharge pipe, the pressure wave

initially emanating from the valve will steepen as it propagates, and it may steepen into a shock wave before it reaches the exit. Because of this, it is recommended that the design pressure of the closed discharge pipe be greater than the steady state operating pressure by a factor of at least 2.

### II-2.3 Reaction Forces From Valve Discharge

It is the responsibility of the piping system designer to determine the reaction forces associated with valve discharge. These forces can create bending moments at various points in the piping system so high as to cause catastrophic failure of the pressure boundary parts. Since

the magnitude of the forces may differ substantially, depending on the type of discharge system, each system type is discussed in the paragraphs below.

### II-2.3.1 Reaction Forces With Open Discharge Systems

**II-2.3.1.1 Discharge Elbow.** The reaction force,  $F$ , due to steady state flow following the opening of the safety valve includes both momentum and pressure effects. The reaction force applied is shown in Fig. II-2-1, and may be computed by the following equation:

$$F_1 = \frac{W}{g_c} V_1 + (P_1 - P_a) A_1$$

where

- $A_1$  = exit flow area at Point 1, in.<sup>2</sup>
- $F_1$  = reaction force at Point 1, lbf
- $g_c$  = gravitational constant  
= 32.2 lbf-ft/lbf-sec<sup>2</sup>
- $P_1$  = static pressure at Point 1, psia
- $P_a$  = atmospheric pressure, psia
- $V_1$  = exit velocity at Point 1, ft/sec
- $W$  = mass flow rate (relieving capacity stamped on the valve  $\times$  1.11), lbfm/sec

To ensure consideration of the effects of the suddenly applied load  $F$ , a dynamic load factor,  $DLF$ , should be applied (see para. II-3.5.1.3).

The methods for calculating the velocities and pressures at the exit point of the discharge elbow are the same as those discussed in para. II-2.2 of this Appendix.

**II-2.3.1.2 Vent Pipe.** Figure II-2-2 shows the external forces resulting from a safety valve discharge, which act on the vent pipe. The methods for calculating  $F_2$  and  $F_3$  are the same as those previously described. The vent pipe anchor and restraint system must be capable of taking the moments caused by these two forces, and also be capable of sustaining the unbalanced forces in the vertical and horizontal directions.

A bevel of the vent pipe will result in a flow that is not vertical. The equations shown are based on vertical flow. To take account for the effect of a bevel at the exit, the exit force will act at an angle,  $\phi$ , with the axis of the vent pipe discharge which is a function of the bevel angle,  $\theta$ . The beveled top of the vent deflects the jet approximately 30 deg off the vertical for a 60 deg bevel, and this will introduce a horizontal component force on the vent pipe systems.

The terms in the equations shown on Fig. II-2-2 are the same as those defined in para. II-2.3.1 above.

The vent pipe must be sized so that no steam is blown back at the vent line entrance. The criteria which may be used as a guide to prevent this condition are listed below.

$$\frac{W (V_1 - V_2)}{g_c} > (P_2 - P_a) A_2 - (P_1 - P_a) A_1$$

where

- $A$  = area, in.<sup>2</sup>
- $g_c$  = gravitational constant  
= 32.2 lbfm-ft/lbf-sec<sup>2</sup>
- $P_1, P_2$  = local absolute pressure, psia
- $P_a$  = standard atmospheric pressure, psia
- $V$  = velocity, ft/sec
- $W$  = mass flow rate, lbfm/sec

The inequality states that the momentum at Point 1 has to be greater than the momentum at Point 2 in order that air is educted into the vent pipe. If the momentum at Point 1 equalled the momentum at Point 2, no air would be educted into the vent pipe. If the momentum at Point 1 was less than the momentum at Point 2, steam would "blow back" from the vent pipe.

The educting effect of the vent pipe is especially important for indoor installation of safety valves. The steam being vented from the upper body during safety valve operation will be removed from the area through the vent pipe. For that reason, the fluid momentum at 1 should exceed the fluid momentum at 2, not just be equal.

If this inequality is satisfied, blowback will not occur. The pressures and velocities are those calculated in para. II-2.2.1.

### II-2.3.2 Reaction Forces With Closed Discharge Systems.

When safety valves discharge a closed piping system, the forces acting on the piping system under steady state flow will be self-equilibrated, and do not create significant bending moments on the piping system. The large steady state force will act only at the point of discharge, and the magnitude of this force may be determined as described for open discharge systems.

Relief valves discharging into an enclosed piping system create momentary unbalanced forces which act on the piping system during the first few milliseconds following relief valve lift. The pressure waves traveling through the piping system following the rapid opening of the safety valve will cause bending moments in the safety valve discharge piping and throughout the remainder of the piping system. In such a case, the designer must compute the magnitude of the loads, and perform appropriate evaluation of their effects.

## II-2.4 Other Mechanical Loads

Other design mechanical loads that must be considered by the piping designer include the following:

**II-2.4.1** Interaction loads on the pipe run when more than one valve opens.

**II-2.4.2** Loads due to earthquake and/or piping system vibration (see para. II-3.4).

## II-3 BENDING MOMENT COMPUTATIONS

### II-3.1 General

One of the most important considerations related to the mechanical design and analysis of safety valve installation is the identification and calculation of the moments at critical points in the installation. If the bending moments are not properly calculated, it will not be possible to meet the loading and stress criteria contained in ASME B31.1. As a minimum, the following loads, previously discussed in para. II-2 of this Appendix, should be considered in determining these moments:

- (A) thermal expansion
- (B) dead weight
- (C) earthquake
- (D) reaction force from valve discharge
- (E) other mechanical loads

The analysis of the safety valve installation should include all critical sections, such as intersection points, elbows, transition sections, etc., and any related piping, vessels, and their supports that may interact with the safety valve installation. It is often most appropriate to model the safety valve installation and its related piping as a lumped mass system joined by straight or curved elements.

### II-3.2 Thermal Expansion Analysis

There are many standard and acceptable methods for determination of moments due to thermal expansion of the piping installation. The thermal expansion analysis must comply with the requirements in para. 119. The safety valve installation often presents a special problem in that there may be a variety of operational modes to consider where each mode represents a different combination of temperatures in various sections of the piping system. The design condition shall be selected so that none of the operational modes represents a condition that gives thermal expansion bending moments greater than the design condition.

The design of the safety valve installation should consider the differential thermal growth and expansion loads, as well as the local effects of reinforcing and supports. The design should also consider the differential thermal growth and expansion loads existing after any combination of safety valves (one valve to all valves) operates, raising the temperature of the discharge piping.

### II-3.3 Dead Weight Analysis

The methods used for determination of bending moments due to dead weight in a safety valve installation are not different from the methods used in any other piping installation. If the support system meets the requirements in para. 121, the bending moments due to dead weight may be assumed to be  $1,500Z$  (in.-lb) where  $Z$  is the section modulus (in.<sup>3</sup>) of the pipe or fitting being considered. However, bending moments

due to dead weight are easily determined and should always be calculated in systems where stresses exceed 90% of the allowable stress limits in meeting the requirements of eqs. (15) and (16) of para. 104.8.

### II-3.4 Earthquake Analysis

Seismic loads must be known to calculate bending moments at critical points in the safety valve installation. If a design specification exists, it should stipulate if the piping system must be designed for earthquake. If so, it should specify the magnitude of the earthquake, the plant conditions under which the earthquake is assumed to occur, and the type earthquake analysis to be used (equivalent static or dynamic). If a design specification does not exist, it is the responsibility of the designer to determine what consideration must be given to earthquake analysis. It is beyond the scope of this Appendix to provide rules for calculating moments due to earthquake. The literature contains satisfactory references for determining moments by use of static seismic coefficients and how to perform more sophisticated dynamic analyses of the piping system using inputs in such form as time histories of displacement, velocity, and acceleration or response spectra where displacement, velocity, or acceleration is presented as a function of frequency.

Two types of seismic bending moments occur. One type is due to inertia effects and the other type is due to seismic motions of pipe anchors and other attachments. As will be shown later, the moments due to inertia effects must be considered in eq. (16), para. 104.8, in the  $kS_h$  category. Moments due to seismic motions of the attachments may be combined with thermal expansion stress and considered in eq. (17), para. 104.8 in the  $S_A$  category. For this reason, it may sometimes be justified for the designer to consider the moments separately; otherwise both sets of moments would have to be included in the  $kS_h$  category.

### II-3.5 Analysis for Reaction Forces Due to Valve Discharge

#### II-3.5.1 Open Discharge Systems

**II-3.5.1.1** The moments due to valve reaction forces may be calculated by simply multiplying the force, calculated as described in para. II-2.3.1.1, times the distance from the point in the piping system being analyzed, times a suitable dynamic load factor. In no case shall the reaction moment used in para. II-4.2 at the branch connection below the valve be taken at less than the product of

$$(DLF)(F_1)(D)$$

where

$D$  = nominal O.D. of inlet pipe

$DLF$  = dynamic load factor (see para. II-3.5.1.3)

$F_1$  = force calculated per para. II-2.3.1.1

Reaction force and resultant moment effects on the header, supports, and nozzles for each valve or combination of valves blowing shall be considered.

**II-3.5.1.2 Multiple Valve Arrangements.** Reaction force and moment effects on the run pipe, header, supports, vessel, and connecting nozzles for each valve blowing, and when appropriate, for combinations of valves blowing should be considered. In multiple valve arrangements, each valve will open at a different time, and since all valves may not be required to open during an overpressure transient, several possible combinations of forces can exist. It may be desirable to vary the direction of discharge of several safety valves on the same header to reduce the maximum possible forces when all valves are blowing.

**II-3.5.1.3 Dynamic Amplification of Reaction Forces.** In a piping system acted upon by time varying loads, the internal forces and moments are generally greater than those produced under static application of the load. This amplification is often expressed as the dynamic load factor, *DLF*, and is defined as the maximum ratio of the dynamic deflection at any time to the deflection which would have resulted from the static application of the load. For structures having essentially one degree-of-freedom and a single load application, the *DLF* value will range between one and two depending on the time-history of the applied load and the natural frequency of the structure. If the run pipe is rigidly supported, the safety valve installation can be idealized as a one degree-of-freedom system and the time-history of the applied loads can often be assumed to be a single ramp function between the no-load and steady state condition. In this case, the *DLF* may be determined in the following manner:

(A) Calculate the safety valve installation period *T* using the following equation and Fig. II-3-1:

$$T = 0.1846 \sqrt{\frac{Wh^3}{EI}}$$

where

*E* = Young's modulus of inlet pipe, lb/in.<sup>2</sup>, at design temperature

*h* = distance from run pipe to centerline of outlet piping, in.

*I* = moment of inertia of inlet pipe, in.<sup>4</sup>

*T* = safety valve installation period, sec

*W* = weight of safety valve, installation piping, flanges, attachments, etc., lb

(B) Calculate ratio of safety valve opening time to installation period (*t<sub>o</sub>/T*), where *t<sub>o</sub>* is the time the safety valve takes to go from fully closed to fully open, sec, and *T* is determined in (A) above.

(C) Enter Fig. II-3-2 with the ratio of safety valve opening time to installation period and read the *DLF*

from the ordinate. The *DLF* shall never be taken less than 1.1.

If a less conservative *DLF* is used, the *DLF* shall be determined by calculation or test.

**II-3.5.1.4 Valve Cycling.** Often, safety valves are full lift, pop-type valves, and are essentially full-flow devices, with no capability for flow modulation. In actual pressure transients, the steam flow required to prevent overpressure is a varying quantity, from zero to the full rated capacity of the safety valves. As a result, the valves may be required to open and close a number of times during the transient. Since each opening and closing produces a reaction force, consideration should be given to the effects of multiple valve operations on the piping system, including supports.

**II-3.5.1.5 Time-History Analysis.** The reaction force effects are dynamic in nature. A time-history dynamic solution, incorporating a multidegree of freedom lumped mass model solved for the transient hydraulic forces is considered to be more accurate than the form of analysis presented in this Appendix.

**II-3.5.2 Closed Discharge Systems.** Closed discharge systems do not easily lend themselves to simplified analysis techniques. The discussions on pressure in para. II-2.2.2 and on forces in para. II-2.3.2 indicate that a time-history analysis of the piping system may be required to achieve realistic values of moments.

**II-3.5.3 Water Seals.** To reduce the problem of steam or gas leakage through the safety valve seats, the valve inlet piping may be shaped to form a water seal below each valve seat. If the valves are required to open to prevent overpressure, the water from the seal is discharged ahead of the steam as the valve disk lifts. The subsequent flow of water and steam through the discharge piping produces a significant pressure and momentum transient. Each straight run of discharge piping experiences a resulting force cycle as the water mass moves from one end of the run to the other.

For most plants that employ water seals, only the first cycle of each occurrence has a force transient based on water in the seal. The remaining cycles of each occurrence would be based on steam occupying the seal piping, and the transient forces would be reduced in magnitude.

## II-4 LOADING CRITERIA AND STRESS COMPUTATION


### II-4.1 Loading Criteria

All critical points in the safety valve installation shall meet the following loading criteria:

$$S_{lp} + S_{SL} \leq S_h \quad (1)$$

$$S_{lp} + S_{SL} + S_{OL} \leq kS_h \quad (2)$$

$$S_{lp} + S_{SL} + S_E \leq S_A + S_h \quad (3)$$

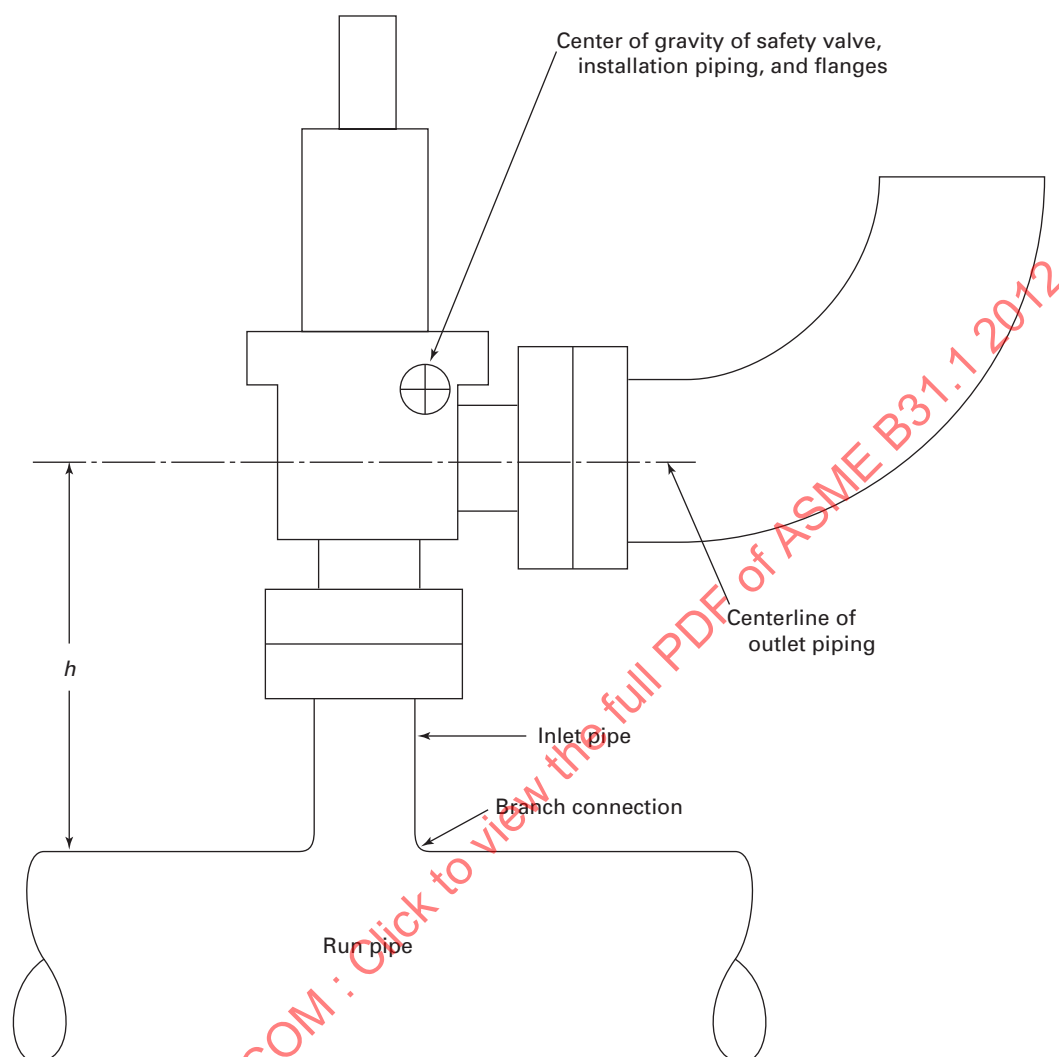**Fig. II-3-1 Safety Valve Installation (Open Discharge System)**

where

- $S_E$  = bending stresses due to thermal expansion
- $S_{lp}$  = longitudinal pressure stress
- $S_{OL}$  = bending stresses due to occasional loads, such as earthquake, reaction from safety valve discharge and impact loads
- $S_{SL}$  = bending stresses due to sustained loads, such as dead weight

$S_H$ ,  $k$ , and  $S_A$  are as defined in ASME B31.1.

The three loading criteria defined above are represented by eqs. (15) and (16) in para. 104.8.

## II-4.2 Stress Calculations

**II-4.2.1 Pressure Stresses.** The Code does not require determination of the pressure stresses that could cause failure of the pressure containing membrane. Instead, the Code provides rules to ensure that sufficient

wall thickness is provided to prevent failures due to pressure. It is not necessary to repeat these rules in this Appendix; however, some of the more important are listed below for reference.


(A) All pipe (plus other components) must satisfy the minimum required wall thickness of eq. (7) of para. 104.1.2. In addition, wall thickness must be adequate to satisfy eqs. (15) and (16) in para. 104.8. These two equations may govern determination of wall thickness in low pressure systems.

(B) No minimum wall thickness calculations are needed for components purchased to approved standards in Table 126.1.

(C) Pipe bends must meet the requirements of eq. (1) above *after* bending.

(D) Branch connections that do not meet the requirements of eq. (2) above must meet the area replacement requirements of para. 104.3.

Fig. II-3-2 Dynamic Load Factors for Open Discharge System

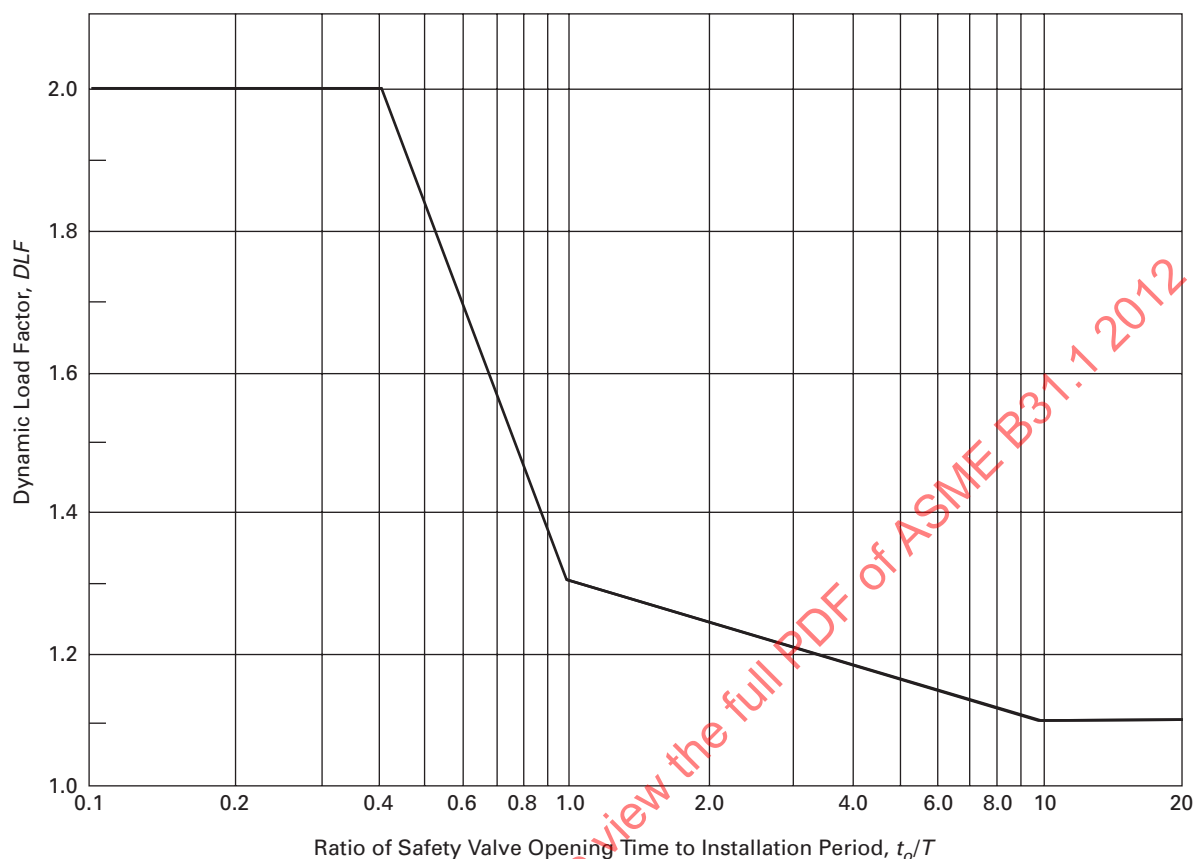

GENERAL NOTE: This Figure is based on curves from *Introduction to Structural Dynamics*, J. M. Biggs, McGraw-Hill Book Co., 1964.

**II-4.2.2 Pressure Plus Bending Stresses.** To guard against membrane failures (catastrophic), prevent fatigue (leak) failures, and to ensure shakedown, the equations in para. 104.8 must be satisfied. These equations apply to all components in the safety valve installation and will not be repeated here. However, some additional explanation of these equations in regard to the very critical points upstream of the safety valve are in the paragraphs below.

**II-4.2.2.1 Additive Stresses at Branch Connection.**

For the purposes of eqs. (15), (16), and (17) in para. 104.8, the section modulus and moments for application to branch connections, such as safety valve inlet pipes, are as follows:

(A) For branch connections, the  $Z$  should be the effective section modulus for the branch as defined in para. 104.8. Thus,

$$Z = Z_b = \pi r_b^2 t_s \text{ (effective section modulus)}$$

where

- $r_b$  = mean branch cross-sectional radius, in.
- $t_s$  = lesser of  $t_r$  and  $it_b$ , where
- $t_r$  = nominal thickness of run pipe

$i$  = the branch connection stress intensification factor

$t_b$  = nominal thickness of branch pipe

(B) Moment terms shall be defined as follows:

$$M_B = \sqrt{M_{x3}^2 + M_{y3}^2 + M_{z3}^2}$$

where  $M_B$ ,  $M_{x3}$ ,  $M_{y3}$ , and  $M_{z3}$  are defined in para. 104.8.

(C) Where the  $D_o/t_n$  of the branch connection differs from the  $D_o/t_n$  header or run, the larger of the two  $D_o/t_n$  values should be used in the first term of eqs. (15) and (16), where  $D_o$  and  $t_n$  are defined in paras. 104.1 and 104.8, respectively.

**II-4.2.2.2 Additive Stresses in Inlet Pipe.**

Equations (15), (16), and (17) in para. 104.8 may be applied to the inlet pipe in the same manner as described above for the branch connection, except that the values for  $D_o/t_n$  and  $Z$  should be for the inlet pipe and the stress intensification factor used will be different. It should be noted that the values  $D_o$ ,  $t_n$ , and  $Z$  should be taken from a point on the inlet pipe such that  $D_o/t_n$  will have a maximum and  $Z$  a minimum value for the inlet pipe.

**II-4.2.3 Analysis of Flange.** It is important that the moments from the various loading conditions described in para. II-4.2.2 do not overload the flanges on the safety valve inlet and outlet. One method of doing this is to convert the moments into an equivalent pressure that is then added to the internal pressure. The sum of these two pressures,  $P_{FD}$ , would be acceptable if either of the following criteria are met:

(A)  $P_{FD}$  does not exceed the ASME B16.5 flange rating.

(B)  $S_H$ ,  $S_R$ , and  $S_T$  should be less than the yield stress at design temperature, where  $S_H$ ,  $S_R$ , and  $S_T$  are as defined in 2-7 of ASME Section VIII, Division 1 with the following exceptions:

(B.1)  $P_{FD}$  should be used in the ASME Section VIII, Division 1 equations instead of the design pressure.

(B.2)  $S_H$  should include the longitudinal pressure stress at the flange hub.

**II-4.2.4 Analysis of Valve.** The allowable forces and moments which the piping system may place on the safety valves must be determined from the valve manufacturer. In some cases, the valve flanges are limiting rather than the valve body.

## II-5 DESIGN CONSIDERATIONS

### II-5.1 General

The design of safety valve installations shall be in accordance with para. 104 except that consideration be given to the rules provided in the following subparagraphs. These rules are particularly concerned with that portion of the piping system attached to and between the safety valve and the run pipe, header, or vessel that the valve services and includes the branch connection to the run pipe, header, or vessel.

### II-5.2 Geometry

#### II-5.2.1 Locations of Safety Valve Installations.

Safety valve installations should be located at least eight pipe diameters (based on I.D.) downstream from any bend in a high velocity steam line to help prevent sonic vibrations. This distance should be increased if the direction of the change of the steam flow is from vertical upwards to horizontal in such a manner as to increase density of the flow in the area directly beneath the station nozzles. Similarly, safety valve installation should not be located closer than eight pipe diameters (based on I.D.) either upstream or downstream from fittings.

**II-5.2.2 Spacing of Safety Valve Installation.** Spacing of safety valve installations must meet the requirements in Note (10)(c), Mandatory Appendix D, Table D-1.

### II-5.3 Types of Valves and Installations

#### II-5.3.1 Installations With Single Outlet Valves.

Locate unsupported valves as close to the run pipe or

header as is physically possible to minimize reaction moment effects.

Orientation of valve outlet should preferably be parallel to the longitudinal axis of the run pipe or header.

Angular discharge elbows oriented to minimize the reaction force moment shall have a straight pipe of at least one pipe diameter provided on the end of the elbow to ensure that the reaction force is developed at the desired angle. Cut the discharge pipe square with the centerline. Fabrication tolerances, realistic field erection tolerances, and reaction force angle tolerances must be considered when evaluating the magnitude of the reaction moment.

The length of unsupported discharge piping between the valve outlet and the first outlet elbow [Fig. II-1-2(A), distance  $l$ ] should be as short as practical to minimize reaction moment effects.

#### II-5.3.2 Installations With Double Outlet Valves.

Double outlet valves with symmetrical tail-pipes and vent stacks will eliminate the bending moment in the nozzle and the run pipe or header providing there is equal and steady flow from each outlet. If equal flow cannot be guaranteed, the bending moment due to the unbalanced flow must be considered. Thrust loads must also be considered.

**II-5.3.3 Multiple Installations.** The effects of the discharge of multiple safety valves on the same header shall be such as to tend to balance one another for all modes of operation.

### II-5.4 Installation Branch Connections

Standard branch connections shall as a minimum meet the requirements of para. 104.3. It should be noted that branch connections on headers frequently do not have sufficient reinforcement when used as a connection for a safety valve. It may be necessary to provide additional reinforcing (weld deposit buildup) or special headers that will satisfactorily withstand the reaction moments applied.

Material used for the branch connection and its reinforcement shall be the same or of higher strength than that of the run pipe or header.

It is strongly recommended that branch connections intersect the run pipe or header normal to the surface of the run pipe or header at  $\alpha = 90$  deg, where  $\alpha$  is defined as the angle between the longitudinal axis of the branch connection and the normal surface of the run pipe or header. Branch connections that intersect the run pipe or headers at angles,

$$90 \text{ deg} > \alpha \geq 45 \text{ deg}$$

should be avoided. Branch connections should not in any case intersect the run pipe or header at angles,

$$\alpha < 45 \text{ deg}$$

## II-5.5 Water in Installation Piping

**II-5.5.1 Drainage of Discharge Piping.** Drains shall be provided so that condensed leakage, rain, or other water sources will not collect on the discharge side of the valve and adversely affect the reaction force. Safety valves are generally provided with drain plugs that can be used for a drain connection. Discharge piping shall be sloped and provided with adequate drains if low points are unavoidable in the layout.

**II-5.5.2 Water Seals.** Where water seals are used ahead of the safety valve, the total water volume in the seals shall be minimized. To minimize forces due to slug flow or water seal excursion, the number of changes of direction and the lengths of straight runs of installation piping shall be limited. The use of short radius elbows is also discouraged; the pressure differential across the cross section is a function of the elbow radius.

## II-5.6 Discharge Stacks

If telescopic or uncoupled discharge stacks, or equivalent arrangements, are used then care should be taken to ensure that forces on the stack are not transmitted to the valve discharge elbow. Stack clearances shall be checked for interference from thermal expansion, earthquake displacements, etc. Discharge stacks shall be supported adequately for the forces resulting from valve discharge so that the stack is not deflected, allowing steam to escape in the vicinity of the valve. In addition, the deflection of the safety valve discharge nozzle (elbow) and the associated piping system when subjected to the reaction force of the blowing valve shall be calculated. This deflection shall be considered in the design of the discharge stacks slip-joint to ensure that the discharge nozzle remains in the stack, preventing steam from escaping in the vicinity of the valve.

To prevent blowback of discharging steam from inlet end of vent stack, consider the use of an antiblowback device that still permits thermal movements of header.

## II-5.7 Support Design

Supports provided for safety valves and the associated piping require analysis to determine their role in restraint as well as support. These analyses shall consider at least the following effects:

(A) differential thermal expansion of the associated piping, headers, and vessels.

(B) dynamic response characteristics of the support in relation to the equipment being supported and the structure to which it is attached, during seismic events and valve operation. Maximum relative motions of various portions of the building and structures to which supports are attached resulting from seismic excitation must be considered in selecting, locating, and analyzing support systems.

(C) capability of the support to provide or not provide torsional rigidity, per the support design requirements.

**II-5.7.1 Pipe Supports.** Where necessary, it is recommended that the support near the valve discharge be connected to the run pipe, header, or vessel rather than to adjacent structures in order to minimize differential thermal expansion and seismic interactions.

Each straight leg of discharge piping should have a support to take the force along that leg. If the support is not on the leg itself, it should be as near as possible on an adjacent leg.

When a large portion of the system lies in a plane, the piping, if possible, should be supported normal to that plane even though static calculations do not identify a direct force requiring restraint in that direction. Dynamic analyses of these systems have shown that out-of-plane motions can occur.

**II-5.7.2 Snubbers.** Snubbers are often used to provide a support or a stop against a rapidly applied load, such as the reaction force of a blowing valve or the pressure-momentum transient in a closed piping system. Since snubbers generally displace a small distance before becoming rigid, the displacement must be considered in the analysis. In addition, if the load is applied to the snubber for a relatively long time, the snubber performance characteristics shall be reviewed to ensure that the snubber will not permit motion during the time period of interest, or the additional displacement must be considered in the analysis. The snubber performance shall also be reviewed for response to repetitive load applications caused by the safety valve cycling open and closed several times during a pressure transient.

## II-5.8 Silencer Installation

Silencers are occasionally installed on safety valve discharges to dissipate the noise generated by the sonic velocity attained by the fluid flowing through the valve.

Silencers must be properly sized to avoid excessive backpressure on the safety valve causing improper valve action or reducing relieving capacity.

Safety valve discharge piping, silencers, and vent stacks shall be properly supported to avoid excessive loading on the valve discharge flange.

## II-6 SAMPLE DESIGNS

Examples of various safety valve installations that a designer may encounter in practice are presented in Figs. II-1-2(A) and II-6-1.


## II-7 SAMPLE PROBLEM (SEE FIGS. II-7-1 AND II-7-2)

### II-7.1 Procedure

(A) Determine pressure and velocity at discharge elbow exit.

(B) Calculate maximum operating pressure for discharge exit.

Fig. II-6-1 Examples of Safety Valve Installations

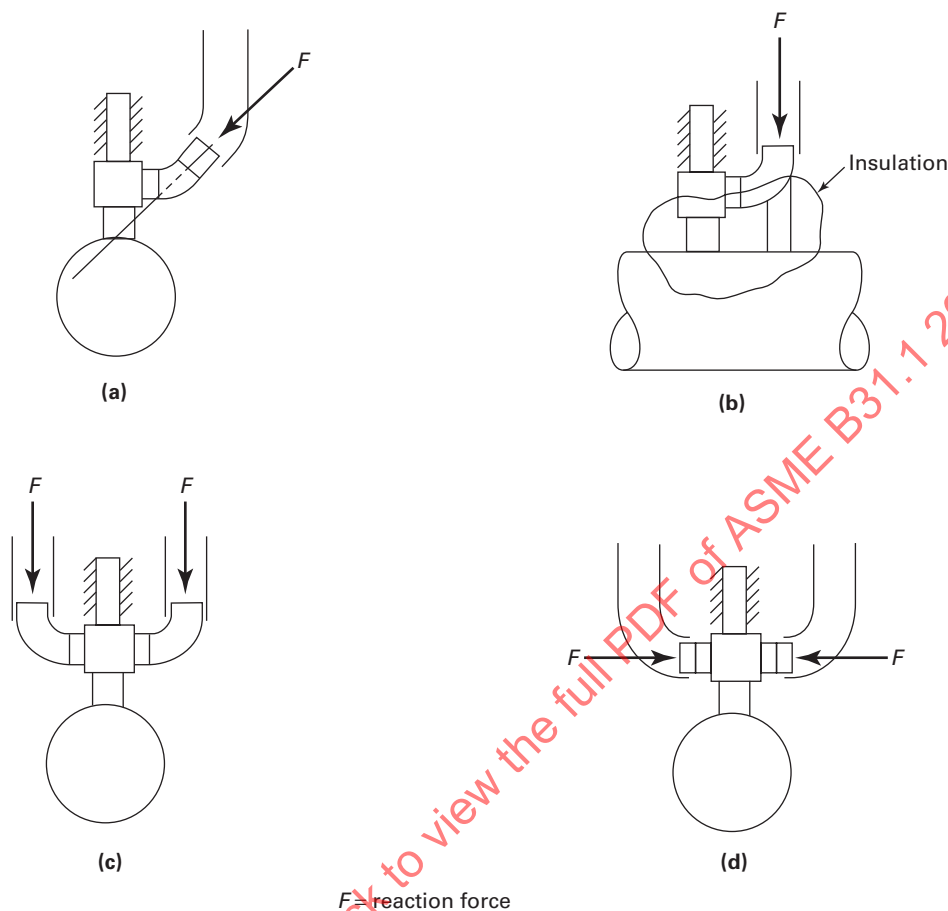

- (C) Calculate reaction force at discharge elbow exit.  
 (D) Calculate bending moments of Points (1) and (2) from reaction force and seismic motion.  
 (E) Determine stress intensification factors at Points (1) and (2).  
 (F) Calculate predicted stresses at Points (1) and (2) and compare with allowable stress.  
 (G) Calculate maximum operating pressure for vent pipe.  
 (H) Check for blowback.  
 (I) Calculate forces and moments on vent pipe.

#### II-7.1.1 Pressure and Velocity at Discharge Elbow Exit (Para. II-2.2.1)

$$P_1 = \frac{W}{A_1} \frac{(b-1)}{b} \sqrt{\frac{2(h_o - a)J}{g_c(2b-1)}}$$

$$V_1 = \sqrt{\frac{2g_c J(h_o - a)}{(2b-1)}}$$

where

$$A_1 = 50.03 \text{ in.}^2$$

$$a = 823 \text{ Btu/lbm for } 15 \leq P_1 \leq 1,000 \text{ psia and } h_o \leq 1,600 \text{ Btu/lbm}$$

$$b = 4.33 \text{ for } 15 \leq P_1 \leq 1,000 \text{ psia and } h_o \leq 1,600 \text{ Btu/lbm}$$

$$g_c = 32.2 \text{ lbm-ft/lbf-sec}^2$$

$$h_o = \text{stagnation enthalpy for steam at 925 psia, } 1,000^\circ\text{F}$$

$$= 1,507.3 \text{ Btu/lbm}$$

$$J = 778 \text{ ft-lbf/Btu}$$

$$P_1 = 118 \text{ psia}$$

$$V_1 = 2,116 \text{ ft/sec}$$


$$W = \text{flow rate}$$

$$= 116.38 \text{ lbm/sec}$$

#### II-7.1.2 Discharge Elbow Maximum Operating Pressure. For 8 in. Class 150 ASME weld neck flange,

$$\frac{L}{D} = \frac{4 \text{ in.}}{7.981 \text{ in.}} = 0.5$$

Fig. II-7-1 Sample Problem Figure 1

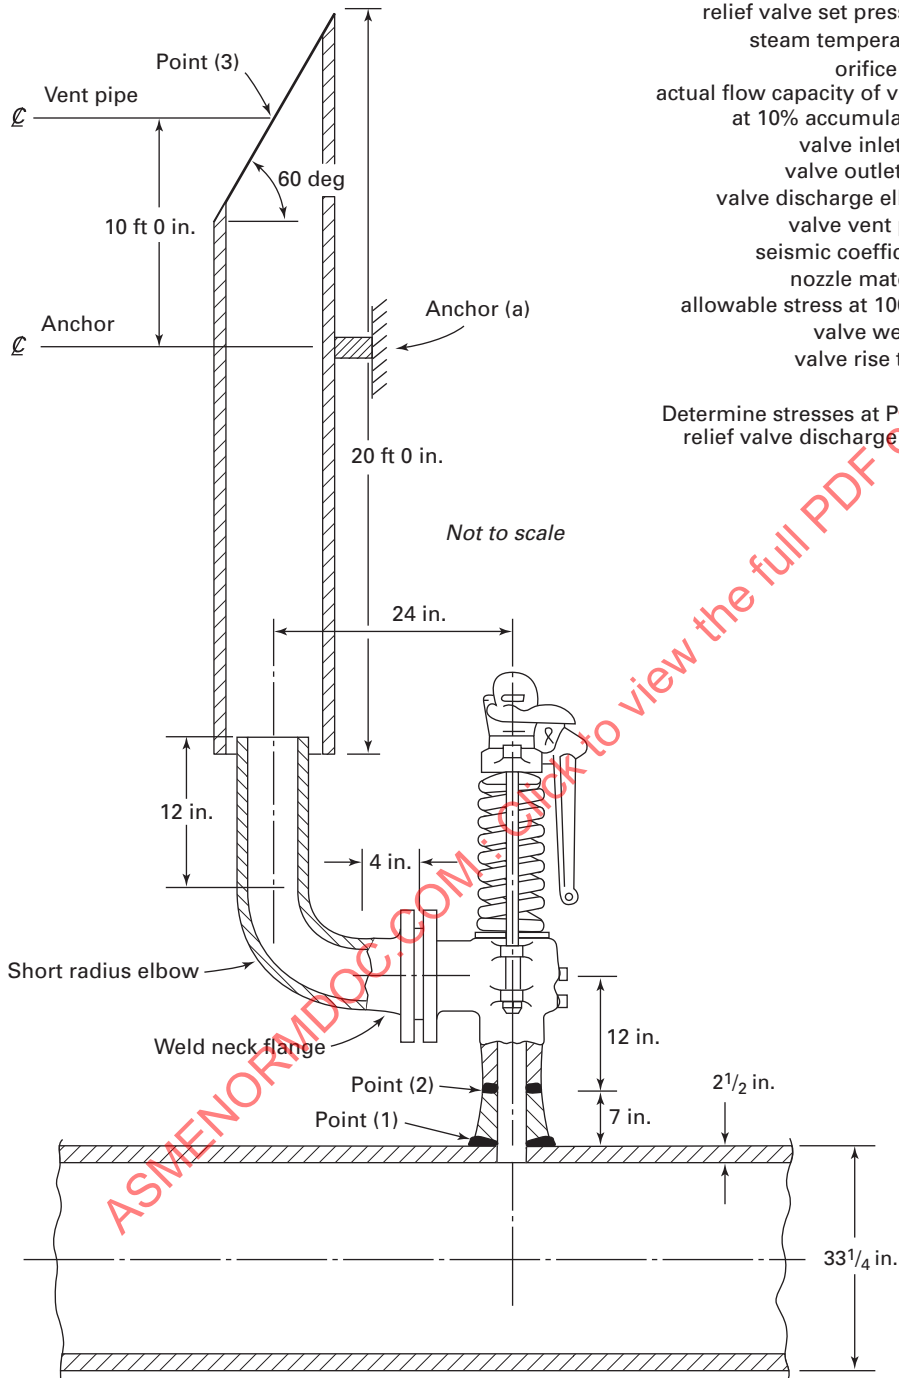

relief valve set pressure = 910 psig

steam temperature = 1,000°F

orifice size = 11.05 in.<sup>2</sup> (Q orifice)

actual flow capacity of valve

at 10% accumulation = 418,950 lbm/hr

valve inlet I.D. = 6 in.

valve outlet I.D. = 8 in.

valve discharge elbow = 8 in. SCH 40

valve vent pipe = 12 in. SCH 30

seismic coefficient = 1.5g

nozzle material = ASTM A335 P22 2<sup>1</sup>/<sub>4</sub>Cr-1Mo

allowable stress at 1000°F = 7,800 psi

valve weight = 800 lb

valve rise time = 0.040 sec

Determine stresses at Points (1) and (2) due to seismic and relief valve discharge loads only.


**Fig. II-7-2 Sample Problem Figure 2**

$$i = 1.5 \left( \frac{R_m}{T_r} \right)^{2/3} \left( \frac{r'_m}{R_m} \right)^{1/2} \left( \frac{T'_b}{T_r} \right) \left( \frac{r'_m}{r_p} \right)$$

$R_m$ ,  $T_r$ ,  $r'_m$ ,  $T'_b$ , and  $r_p$  are shown in sketch below:

$$i_{(1)} = 1.5 \left( \frac{15.375}{2.5} \right)^{2/3} \left( \frac{4.25}{15.375} \right)^{1/2} \left( \frac{2.5}{2.5} \right) \left( \frac{4.25}{5.5} \right)$$

$$i_{(1)} = 2.05$$

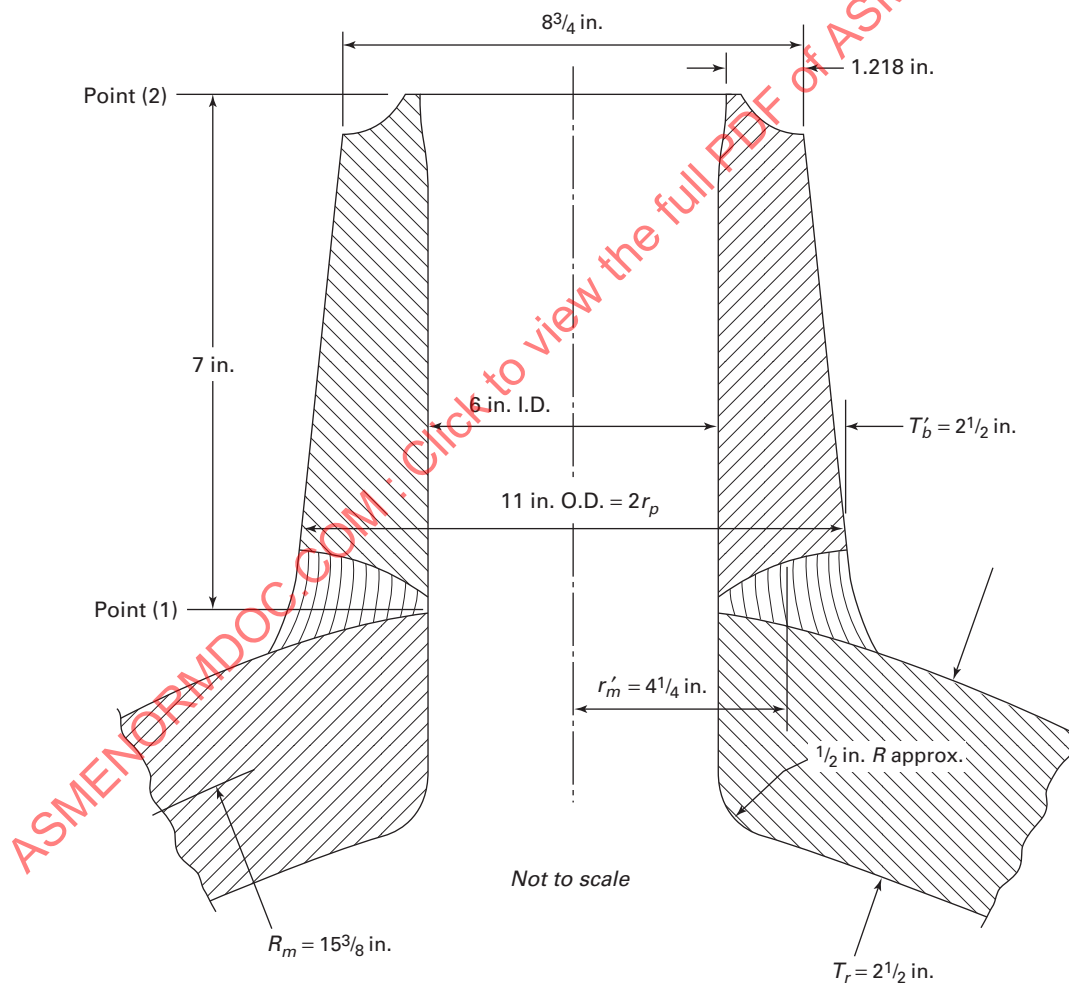

For 8 in. SCH 40 short radius elbow,

$$\frac{L}{D} = 30$$

For 12 in. of 8 in. SCH 40 pipe,

$$\frac{L}{D} = \frac{12 \text{ in.}}{7.981 \text{ in.}} = 1.5$$

$$\Sigma \left( \frac{L}{D} \right) = \left( \frac{L_{\max}}{D} \right) = 0.5 + 30 + 1.5 = 32.0$$

$$f = 0.013$$

$$k = 1.3$$

$$f \left( \frac{L_{\max}}{D} \right) = 0.416$$

From Chart II-1,  $P/P^* = 1.647$ .

$$P_{1a} = P_1 (P/P^*) = 194 \text{ psia}$$

### II-7.1.3 Reaction Force at Discharge Elbow Exit.

Reaction force,

$$F_1 = \frac{WV_1}{g_c} + (P_1 - P_a) A_1$$

where

$$W = 116.38 \text{ lbm/sec}$$

$$V_1 = 2,116 \text{ ft/sec}$$

$$g_c = 32.2 \text{ lbm-ft/lbf-sec}^2$$

$$P_1 = 118 \text{ psia}$$

$$P_a = 15 \text{ psia}$$

$$A_1 = 50.03 \text{ in.}^2$$

$$(P_1 - P_a) = 118 - 15 = 103 \text{ psig}$$

$$WV_1/g_c = 7,648 \text{ lbf}$$

$$(P_1 - P_a) A_1 = 5,153 \text{ lbf}$$

$$F_1 = 12,801 \text{ lbf}$$

### II-7.1.4 Bending Moments at Points (1) and (2)

(A) Bending Moment at Points (1) and (2) Due to Reaction at Point (1)

$$M_{1(1)} = M_{1(2)} = F_1 \times L \times DLF$$

$$L = \text{moment arm} = 24 \text{ in.}$$

$$DLF = \text{dynamic load factor}$$

To determine  $DLF$ , first determine the safety valve installation period  $T$ :

$$T = 0.1846 \sqrt{\frac{Wh^3}{EI}}$$

where

$$E = \text{Young's modulus of inlet pipe at design temperature} = 23 \times 10^6 \text{ psi}$$

$$h = \text{distance from run pipe to centerline of outlet piping} = 19 \text{ in.}$$

$$I = \text{moment of inertia of inlet pipe} = \frac{\pi}{64} (D_o^4 - D_i^4)$$

Use average O.D. and I.D. to determine  $I$ .  $D_o = 9.875 \text{ in. avg.}; D_i = 6 \text{ in. avg.}$

$$= 403.2 \text{ in.}^4$$

$$T = 0.00449 \text{ sec}$$

$$W = \text{weight of valve} = 800 \text{ lb}$$

For a valve rise time of 0.040 sec  $= t_o$ , the ratio  $t_o/T$  is 8.9. From Fig. II-3-2,  $DLF = 1.11$ .

Using  $F_1 = 12,801 \text{ lbf}$ ,  $L = 24 \text{ in.}$ , and  $DLF = 1.11$ ,

$$M_{1(1)} = M_{1(2)} = 341,018 \text{ in.-lb}$$

(B) Bending Moments at Points (1) and (2) Due to Seismic Loading  
Seismic force,

$$F_s = \text{mass} \times \text{acceleration}$$

$$= \left[ \frac{800 \text{ lbm}}{32.2 \text{ lbm-ft/lbf-sec}^2} \right]$$

$$\times 1.5(32.2 \text{ ft/sec}^2)$$

$$= 1,200 \text{ lbf}$$

Moment arm for Point (1) = 19 in.

$$M_{S(1)} = 1,200 \text{ lbf} (19 \text{ in.}) = 22,800 \text{ in.-lb}$$

Moment arm for Point (2) = 12 in.

$$M_{S(2)} = 1,200 \text{ lbf} (12 \text{ in.}) = 14,400 \text{ in.-lb}$$

(C) Combined Bending Moments at Points (1) and (2)

$$M_{(1)} = M_{1(1)} + M_{S(1)} = 363,819 \text{ in.-lb}$$

$$M_{(2)} = M_{1(2)} + M_{S(2)} = 355,419 \text{ in.-lb}$$

### II-7.1.5 Stress Intensification Factors at Points (1) and (2)

(A) At Point (1), Branch Connection

$$i_{(1)} = 2.05$$

(B) Stress Intensification Factors at Point (2), Butt Weld

$$i_{(2)} = 1.0$$

**II-7.1.6 Predicted Stresses at Points (1) and (2)**

(A) Predicted Stresses at Point (1), Branch Connection

$$\text{Predicted stress} = \frac{PD_o}{4t_n}$$

$$\frac{D_o}{t_n} \text{ for run pipe} = \frac{33.25 \text{ in.}}{2.5 \text{ in.}} = 13.3$$

$$\frac{D_o}{t_n} \text{ for branch pipe} = \frac{11 \text{ in.}}{2.5 \text{ in.}} = 4.4$$

Use larger value with  $P = 910$  psig.

$$\text{Pressure stress}_{(1)} = 3,030 \text{ psi}$$

$$\text{Flexure stress}_{(1)} = \frac{0.75i M_{(1)}}{Z_{(1)}}$$

$$Z_{(1)} = \pi r_b^2 t_s$$

$$t_s = \text{lesser of } t_r \text{ or } (i) t_b$$

$$t_R = 2.5 \text{ in.}; (i) t_b = (2.05) 2.5 \text{ in.}$$

$$t_s = 2.5 \text{ in.}$$

$$r_b = 4.25 \text{ in.}$$

$$Z_{(1)} = 142 \text{ in.}^3$$

$$i_{(1)} = 2.05; M_{(1)} = 363,819 \text{ in.-lb}$$

$$\text{Flexure stress}_{(1)} = 3,939 \text{ psi}$$

$$\begin{aligned} \text{Combined stress}_{(1)} &= \text{pressure stress}_{(1)} \\ &\quad + \text{flexure stress}_{(1)} \\ &= 6,969 \text{ psi} \end{aligned}$$

(B) Predicted Stresses at Point (2), Butt Weld

$$\text{Pressure stress} = \frac{PD_o}{4t_n}$$

$$P = 910 \text{ psig}$$

$$D_o = 8.75 \text{ in.}$$

$$t_n = 1.218 \text{ in.}$$

$$\text{Pressure stress}_{(2)} = 1,635 \text{ psi}$$

$$\text{Flexure stress}_{(2)} = \frac{0.75 i M_{(2)}}{Z_{(2)}}$$

$$Z_{(2)} = \frac{\pi}{32} \frac{D_o^4 - D_i^4}{D_o}$$

$$D_o = 8.75 \text{ in.}$$

$$D_i = 6 \text{ in.}$$

$$Z_{(2)} = 51.1 \text{ in.}^3$$

$$i_{(2)} = 1.0$$

$$M_{(2)} = 355,419 \text{ in.-lb}$$

$$\text{Flexure stress}_{(2)} = 6,955 \text{ psi}$$

(Note that 0.75*i* is set equal to 1.0 whenever 0.75*i* is less than 1.0, as in this case.)

$$\begin{aligned} \text{Combined stress}_{(2)} &= \text{pressure stress}_{(2)} \\ &\quad + \text{flexure stress}_{(2)} \\ &= 8,590 \text{ psi} \end{aligned}$$

(C) Comparison of Predicted Stress With Allowable Stress. Allowable stress of nozzle material at 1,000°F is

$$S_h = 7,800 \text{ psi}$$

$$k = 1.2$$

$$kS_h = 9,360 \text{ psi}$$

$$\text{Combined stress}_{(1)} = 6,969 \text{ psi}$$

$$\text{Combined stress}_{(2)} = 8,590 \text{ psi}$$

**II-7.1.7 Calculate the Maximum Operating Pressure for Vent Pipe**

$$P_3 = P_1 \left( \frac{A_1}{A_3} \right) = 118 \text{ psia} \left( \frac{50.03 \text{ in.}^2}{114.80 \text{ in.}^2} \right)$$

$$= 51.4 \text{ psia}$$

$$L/D \text{ for 20 ft 0 in. of 12 in. SCH 30 pipe} = 19.85.$$

$$\Sigma(L/D) = \left( \frac{L_{\max}}{D} \right) = 19.85$$

$$f = 0.013$$

$$k = 1.3$$

$$f \left( \frac{L_{\max}}{D} \right) = 0.258$$

From Chart II-1,  $P/P^* = 1.506$ .

$$P_2 = P_3 (P/P^*) = 77.4 \text{ psia}$$

**II-7.1.8 Check for Blowback From Vent Pipe.** Calculate the velocity  $V_2$  that exists at the inlet to the vent pipe (para. II-2.2.1.4).

$$f \left( \frac{L_{\max}}{D} \right) = 0.258 \text{ from Step (7)}$$

$$V_3 = V_1 = 2,116 \text{ ft/sec}$$

From Chart II-1,  $V/V^* = 0.7120$ .

$$V_2 = V_3 (V/V^*) = 1,507 \text{ ft/sec}$$

Check the inequality from para. II-2.3.1.2.

$$\frac{W(V_1 - V_2)}{g_c} > (P_2 - P_a) A_2 - (P_1 - P_a) A_1$$

$$\frac{116.38(2,116 - 1,507)}{32.2} > (77.4 - 14.7)(114.8) - (118 - 14.7)(50.03)$$

$$2,201 > 2,030$$

The inequality has been satisfied but the designer may require a design margin that would make 14 in. SCH 30 more acceptable. If a larger vent pipe is chosen, then the vent pipe analysis would have to be repeated for the 14 in. SCH 30 pipe.

#### II-7.1.9 Calculate Forces and Moments on Vent Pipe Anchor

$$F_2 = \frac{WV_2}{g_c} + (P_2 - P_a) A_2$$

$$= \frac{(116.38)(1,507)}{32.2}$$

$$+ (77.4 - 14.7)(114.8)$$

$$= 5,447 + 7,198.0 = 12,645 \text{ lbf}$$

$$F_3 = \frac{(116.38)(2,116)}{32.2}$$

$$+ (51.4 - 14.7)(114.8)$$

$$= 7,648 + 4,213 = 11,861 \text{ lbf}$$


Assume a 30 deg jet deflection angle for vent pipe outlet. Vertical component of  $F_3$

$$F_{3V} = F_3 \cos 30 \text{ deg} = 10,272 \text{ lbf}$$

Horizontal component of  $F_3$

$$F_{3H} = F_3 \sin 30 \text{ deg} = 5,931 \text{ lbf}$$

Fig. II-7-3 Sample Problem Figure 3

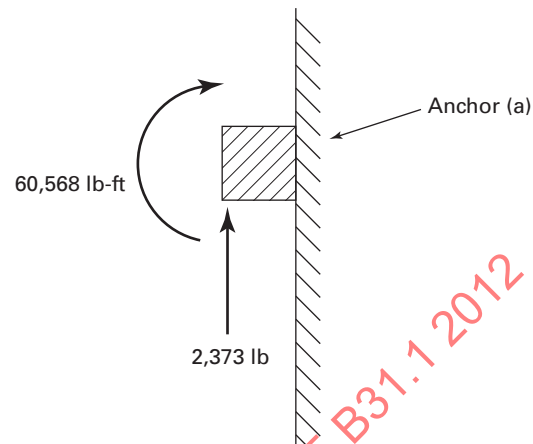

Net imbalance on the vent pipe in the vertical direction is

$$F_2 - F_{3V} = 2,373 \text{ lbf}$$

Moment on vent pipe anchor

$$\Sigma M = (F_2 - F_{3V}) \frac{D_o}{2}$$

$$+ F_{3H} \times [\text{distance from (a) to Point (3)}]$$

$$= (2,373) \left( \frac{1.06}{2} \right) + (5,931)(10.0)$$

$$= 60,568 \text{ ft-lb}$$

The vent pipe anchor would then be designed for the loads shown in Fig. II-7-3 for safety valve operation.

**II-7.1.10 Conclusion.** Branch connection stresses at Points (1) and (2) due to seismic and relief valve discharge are within  $1.2 S_H$ . Blowback will not occur with the 12 in. standard weight vent pipe. The vent pipe anchor loads have been identified.

# NONMANDATORY APPENDIX III

## RULES FOR NONMETALLIC PIPING AND PIPING LINED WITH NONMETALS

### FOREWORD

ASME B31.1 contains rules governing the design, fabrication, materials, erection, and examination of power piping systems. Experience in the application of nonmetallic materials for piping systems has shown that a number of considerations exist for the use of these materials that are not addressed in the current body of the Code. To address these, the requirements and recommendations for the use of nonmetallic piping (except in paras. 105.3, 108.4, 116, and 118) have been separately assembled in this Appendix.

### III-1 SCOPE AND DEFINITION

#### III-1.1 General

**III-1.1.1** This Appendix provides minimum requirements for the design, materials, fabrication, erection, testing, examination, and inspection of nonmetallic piping and metallic piping lined with nonmetals within the jurisdiction of the ASME B31.1 Power Piping Code. All references to the Code or to Code paragraphs in this Appendix are to the Section B31.1 Power Piping Code. In this Appendix, nonmetallic piping shall be limited to plastic and elastomer based piping materials, with or without fabric or fibrous material added for pressure reinforcement. Metallic piping lined with nonmetals shall be limited to factory-made plastic-lined ferrous metal pipe, fittings, and flanges produced to one of the product standards for plastic-lined piping materials listed in Table III-4.1.1.

**III-1.1.2** Standards and specifications incorporated in this Appendix are listed in Table III-4.1.1. The effective date of these documents shall correspond to the date of this Appendix.

**III-1.1.3** The provisions in Chapters I through VI and in Mandatory Appendices A through F are requirements of this Appendix only when specifically referenced herein.

#### III-1.2 Scope

**III-1.2.1** All applicable requirements of para. 100.1 and the limitations of para. 105.3 shall be met in addition to those in this Appendix.

**III-1.2.2** Use of this Appendix is limited to

- (A) water service.
- (B) nonflammable and nontoxic liquid, dry material, and slurry systems.
- (C) reinforced thermosetting resin pipe in buried flammable and combustible liquid service systems [refer to para. 122.7.3(F)].
- (D) polyethylene pipe in buried flammable and combustible liquid and gas service. Refer to paras. 122.7.3(F) and 122.8.1(G).
- (E) metallic piping lined with nonmetals. If used in accordance with para. 122.9 for conveying corrosive liquids and gases, the design of the lined piping system shall meet the requirements of para. 104.7.

(C) reinforced thermosetting resin pipe in buried flammable and combustible liquid service systems [refer to para. 122.7.3(F)].

(D) polyethylene pipe in buried flammable and combustible liquid and gas service. Refer to paras. 122.7.3(F) and 122.8.1(G).

(E) metallic piping lined with nonmetals. If used in accordance with para. 122.9 for conveying corrosive liquids and gases, the design of the lined piping system shall meet the requirements of para. 104.7.

**III-1.2.3** Nonmetallic piping systems shall not be installed in a confined space where toxic gases could be produced and accumulate, either from combustion of the piping materials or from exposure to flame or elevated temperatures from fire.

#### III-1.3 Definitions and Abbreviations

**III-1.3.1** Terms and definitions relating to plastic and other nonmetallic piping materials shall be in accordance with ASTM D883. The following terms and definitions are in addition to those provided in the ASTM standard.

*adhesive*: a material designed to join two other component materials together by surface attachment (bonding).

*adhesive joint*: a bonded joint made using an adhesive on the surfaces to be joined.

*bonder*: one who performs a manual or semiautomatic bonding operation.

*bonding operator*: one who operates a machine or automatic bonding equipment.

*bonding procedure*: the detailed methods and practices involved in the production of a bonded joint.

*Bonding Procedure Specification (BPS)*: the document that lists the parameters to be used in the construction of bonded joints in accordance with the requirements of this Code.

*butt-and-wrapped joint*: a joint made by applying plies of reinforcement saturated with resin to the surfaces to be joined.

*chopped roving*: a collection of noncontinuous glass strands gathered without mechanical twist. Each strand is made up of glass filaments bonded together with a finish or size for application by chopper gun.

*chopped strand mat*: a collection of randomly oriented glass fiber strands, chopped or swirled together with a binder in the form of a blanket.

*continuous roving*: a collection of continuous glass strands wound into a cylindrical package without mechanical twist.

*curing agent*: a reactive material that when combined with a resin material reacts or polymerizes (crosslinks) with the resin; also referred to as a hardener.

*diluent*: a reactive modifying material, usually liquid, that reduces the concentration of a resin material to facilitate handling characteristics and improve wetting.

*electrofusion*: a heat fusion joining process where the heat source is an integral part of the fitting, such that when electric current is applied, heat is produced that melts and joins the plastics.

*fire retardant resin*: a specially compounded material combined with a resin material designed to reduce or eliminate the tendency to burn.

*flexibilizer*: a modifying liquid material added to a resinous mixture designed to allow the finished component the ability to be flexed or less rigid and more prone to bending.

*grout*: a heavily filled paste material used to fill crevices and transitions between piping components.

*heat fusion joint*: a joint made by heating the surfaces to be joined and pressing them together so they fuse and become essentially one piece.

*hot gas welded joint*: a joint made by simultaneously heating a filler material and the surfaces to be joined with a stream of hot air or hot inert gas until the materials soften, after which the surfaces to be joined are pressed together and welded with the molten filler material.

*liner*: a coating or layer of material constructed as, applied to, or inserted within the inside surface of a piping component intended to protect the structure from chemical attack, to inhibit erosion, or to prevent leakage under strain.

*seal weld*: the addition of material external to a joint by welding or bonding for the purpose of enhancing leak tightness.

*solvent cement joint*: a joint using a solvent cement to soften the surfaces to be joined, after which the joining surfaces are pressed together and become essentially one piece as the solvent evaporates.

*stiffness factor*: the measurement of a pipe's ability to resist deflection as determined in accordance with ASTM D2412.

*thixotropic agent*: a material added to resin to impart high static shear strength (viscosity) and low dynamic shear strength.

*ultraviolet absorber*: a material that when combined in a resin mixture will selectively absorb ultraviolet radiation.

*woven roving*: a heavy glass fiber fabric reinforcing material made by the weaving of glass fiber roving.

**III-1.3.2** Abbreviations used in this Appendix denote materials and terms as follows:

| Abbreviation      | Term                              |
|-------------------|-----------------------------------|
| ABS <sup>1</sup>  | Acrylonitrile-butadiene-styrene   |
| AP                | Polyacetal                        |
| CP                | Chlorinated polyether             |
| CPVC <sup>1</sup> | Chlorinated poly (vinyl chloride) |
| DS                | Design stress                     |
| FEP <sup>1</sup>  | Perfluoro (ethylene propylene)    |
| HDB               | Hydrostatic design basis          |
| HDS               | Hydrostatic design stress         |
| PA <sup>1</sup>   | Polyamide (nylon)                 |
| PB                | Polybutylene                      |
| PE <sup>1</sup>   | Polyethylene                      |
| PFA               | Poly (perfluoroalkoxy)            |
| POP               | Poly (phenylene oxide)            |
| PP <sup>1</sup>   | Polypropylene                     |
| PPS               | Polyphenylene                     |
| PR                | Pressure rated                    |
| PTFE <sup>1</sup> | Polytetrafluoroethylene           |
| PVC <sup>1</sup>  | Poly (vinyl chloride)             |
| PVDC              | Poly (vinylidene chloride)        |
| PVDF              | Poly(vinylidene fluoride)         |
| RTR               | Reinforced thermosetting resin    |
| SDR               | Standard dimensional ratio        |

## III-2 DESIGN

### III-2.1 Conditions and Criteria

#### III-2.1.1 General

(A) The Design Conditions of para. 101 shall apply for the design of nonmetallic piping systems.

(B) The design of nonmetallic piping systems must ensure the adequacy of material and its manufacture, considering at least the following:

(B.1) tensile, compressive, flexural, shear strength, and modulus of elasticity at design temperature (long-term and short-term)

(B.2) creep characteristics for the service conditions

(B.3) design stress and its basis

(B.4) coefficient of thermal expansion

(B.5) ductility and plasticity

(B.6) impact and thermal shock properties

(B.7) temperature limits for the service

(B.8) transition temperatures: melting and vaporization

(B.9) toxicity of the material or of the gases produced by its combustion or exposure to elevated temperatures

(B.10) porosity and permeability

(B.11) test methods

<sup>1</sup> Abbreviations in accordance with ASTM D1600.

- (B.12) methods of making joints and their efficiency
- (B.13) deterioration in the service environment
- (B.14) the effects on unprotected piping from external heat sources (particularly solar radiation)

### III-2.1.2 Pressure-Temperature Ratings for Components

(A) Components having specific pressure-temperature ratings have been established in the standards listed in Table III-4.1.1. Other components may be used in accordance with para. III-2.1.2(B).

(A.1) Except as qualified in para. III-2.1.3, the ratings of Tables III-4.2.1, III-4.2.2, and III-4.2.3 are the limiting values for allowable stresses at temperature in this Appendix.

(A.2) The application of pressures exceeding the pressure-temperature ratings of valves is not permitted. Valves shall be selected for operation within the limits defined in para. III-2.1.2(C).

(B) *Components Not Having Specific Ratings*

(B.1) Pipe and other piping components for which allowable stresses have been developed in accordance with para. III-2.1.3, but that do not have specific pressure-temperature ratings, shall be rated by the rules for pressure design in para. III-2.2 within the range of temperatures for which stresses are listed in Tables III-4.2.1, III-4.2.2, and III-4.2.3.

(B.2) Custom-molded pipe and other piping components that do not have allowable stresses or pressure-temperature ratings shall be qualified for pressure design as required in para. III-2.2.9.

(B.3) When components other than described above, such as pipe or fittings not assigned pressure-temperature ratings in an ASME or American National Standard, are used, the manufacturer's recommended pressure-temperature rating shall not be exceeded.

(C) *Allowances for Pressure and Temperature Variations*

(C.1) *Nonmetallic Piping.* Allowances for variations of pressure, temperature, or both, above design conditions are not permitted. The most severe conditions of coincident pressure and temperature shall be used to determine the design conditions.

(C.2) *Metallic Piping Lined With Nonmetals.* Allowances for pressure and temperature variations provided in para. 102.2.4 are permitted only if the suitability of the lining material for the increased conditions is established through prior successful experience or tests under comparable conditions.

(D) *Considerations for Local Conditions.* Where two services that operate at different pressure-temperature conditions are connected, the valve segregating the two services shall be rated for the most severe service conditions. Other requirements of para. 102.2.5 must be considered where applicable.

### III-2.1.3 Allowable Stresses and Other Stress Limits

(A) *General.* Tables III-4.2.1, III-4.2.2, and III-4.2.3 list recommended maximum allowable stresses in the form of hydrostatic design stresses (HDS), allowable design stresses (DS), and the hydrostatic design basis (HDB), which may be used in design calculations except where modified by other provisions of this Appendix. The use of hydrostatic design stresses for calculations other than pressure design has not been established. The basis for determining allowable stresses and pressures is outlined in para. III-2.1.3(B). The allowable stresses are grouped by materials and listed for stated temperatures. Where sufficient data have been provided, straight-line interpolation between temperatures is permissible. The materials listed are available from one or more manufacturers and may be obtained with maximum allowable stresses varying from those listed in Tables III-4.2.1, III-4.2.2, and III-4.2.3. These materials and values are acceptable for use where they have been established in accordance with (B) below and para. III-2.2.9.

(B) *Basis for Allowable Stresses for Internal Pressure*

(B.1) *Thermoplastics.* A method of determining hydrostatic design stress (HDS) and pressure rating (PR) is described in ASTM D2837. Hydrostatic design stresses are provided in Table III-4.2.1 for those materials and temperatures for which sufficient data have been compiled to substantiate a determination of stress. Data on these materials at other temperatures, and on other materials, are being developed. Pending publication of additional data, the limitations in para. III-2.1.2(B) shall be observed.

(B.2) *Reinforced Thermosetting Resin (Laminated).* For laminated piping components, the design stresses (DS) are listed in Table III-4.2.2. These typically are based on one-tenth of the minimum tensile strengths specified in Table 1 of ASTM C582.

(B.3) *Reinforced Thermosetting Resin (Filament Wound and Centrifugally Cast).* For filament wound and centrifugally cast piping components, hydrostatic design basis (HDB) values are listed in Table III-4.2.3. These values may be obtained by procedures in ASTM D2992. HDS may be obtained by multiplying the HDB by a service (design) factor<sup>2</sup> selected for the application, in accordance with procedures described in ASTM D2992, within the following limits:

(B.3.1) When using the cyclic HDB from Table III-4.2.3, the service (design) factor shall not exceed 1.0.

(B.3.2) When using the static HDB from Table III-4.2.3, the service (design) factor shall not exceed 0.5.

<sup>2</sup> The service (design) factor should be selected by the designer after evaluating fully the service conditions and the engineering properties of the specific material under consideration. Aside from the limits in paras. III-2.1.3(B.3.1) and (B.3.2), it is not the intent of the Code to specify service (design) factors.

### III-2.1.4 Limits of Calculated Stresses Due to Sustained Loads

(A) *Internal Pressure Stresses.* The limits for stress due to internal pressure are provided in para. III-2.2.2.

(B) *External Pressure Stresses.* Stresses due to uniform external pressures shall be considered safe when the wall thickness of the component, and means of stiffening, have been established in accordance with para. III-2.2.9.

(C) *External Loading Stresses.* Design of reinforced thermosetting resin (RTR) and thermoplastic piping under external loading shall be based on the results of the parallel plate loading test in ASTM D2412. The allowable deflection for RTR and thermoplastic pipe shall be 5% of the pipe diameter. Where other nonmetallic piping is intended for use under conditions of external loading, it shall be subject to a crushing or three-edge bearing test, in accordance with ASTM C14 or C301, and the allowable load shall be 25% of the minimum value obtained.

### III-2.1.5 Limits of Calculated Stresses Due to Occasional Loads

(A) *Operation.* The total stress produced by pressure, live and dead loads, and by occasional loads, such as wind or earthquake, shall not exceed the considerations and recommendations in para. III-2.5. Wind and earthquake forces need not be considered as acting concurrently.

(B) *Test.* Stresses due to test conditions are not subject to the limitations in (A) above. It is not necessary to consider other occasional loads, such as wind and earthquake, as occurring concurrently with test loads.

### III-2.1.6 Allowances

(A) *Erosion, Corrosion, Threading, and Grooving.* In determining the minimum required thickness of a piping component, allowances shall be included for erosion and for thread depth or groove depth.

(B) *Mechanical Strength.* When necessary, pipe wall thicknesses shall be increased to prevent overstress, damage, collapse, or buckling due to superimposed loads from supports, ice formation, backfill, or other causes. Where increasing thickness will cause excessive local stress, or is otherwise impractical, the required strength may be obtained through the use of additional supports, braces, or other means without an increased wall thickness. Particular consideration should be given to the mechanical strength of a small branch connected to large piping or to equipment.

## III-2.2 Pressure Design of Piping Components

**III-2.2.1 Criteria for Pressure Design.** The design of piping components shall consider the effects of pressure and temperature in accordance with para. III-2.1.2, and provide for allowances in accordance with para. III-2.1.6. In addition, the design shall be checked for adequacy

of mechanical strength under other applicable loadings as required in paras. III-2.1.4 and III-2.1.5.

(A) The required minimum wall thickness of straight sections of pipe,  $t_m$ , shall be determined in accordance with eq. (1).

$$t_m = t + c \quad (1)$$

where

$c$  = the sum of the mechanical allowances (thread or groove depth), plus erosion and/or corrosion allowance, and the manufacturer's minus tolerance for product wall thickness, in. For threaded components, the nominal thread depth shall apply. For machined surfaces or grooves where a tolerance is not specified, the tolerance shall be assumed to be 0.02 in., in addition to the specified depth of the thread or groove.

$t$  = pressure design thickness, in., as calculated in para. III-2.2.2 for internal pressure, or in accordance with para. III-2.2.3 for external pressure

$t_m$  = minimum required thickness, in.

### III-2.2.2 Straight Pipe Under Internal Pressure

(A) The internal pressure design thickness,  $t$ , shall not be less than that calculated by the following equations.

(A.1) *Thermoplastic Pipe*

$$t = \frac{D}{2S_a/P + 1} \quad (2)$$

(A.2) *Reinforced Thermosetting Resin (Laminated)*

$$t = \frac{D}{2S_b/P + 1} \quad (3)$$

(A.3) *Reinforced Thermosetting Resin (Filament Wound and Centrifugally Cast)*

$$t = \frac{D}{2S_c F/P + 1} \quad (4)$$

where

$D$  = outside diameter of pipe, in.

$F$  = service design factor in accordance with para. III-2.1.3(B.3)

$P$  = internal design gage pressure, psi

$S_a$  = hydrostatic design stress from Table III-4.2.1

$S_b$  = design stress from Table III-4.2.2

$S_c$  = hydrostatic design basis from Table III-4.2.3

(A.4) *Metallic Pipe Lined With Nonmetals.* Pressure limitations shall be those established by the manufacturer, considering both pressure and temperature limitations of the metal housings and sealing ability of the liner at flanged joints. In addition, the metallic pipe shall meet the requirements of the mandatory sections of B31 including the pressure design requirements of ASME B31.1 Chapter II.