

NFPA 1962

Care, Use, and Service Testing of Fire Hose Including Couplings and Nozzles

1993 Edition



NOTICE

All questions or other communications relating to this document should be sent only to NFPA headquarters, addressed to the attention of the Committee responsible for the document.

For information on the procedures for requesting Technical Committees to issue Formal Interpretations, proposing Tentative Interim Amendments, proposing amendments for Committee consideration, and appeals on matters relating to the content of the document, write to the Secretary, Standards Council, National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

A statement, written or oral, that is not processed in accordance with Section 16 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Users of this document should consult applicable federal, state and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action that is not in compliance with applicable laws, and this document may not be construed as doing so.

Policy Adopted by NFPA Board of Directors on December 3, 1982

The Board of Directors reaffirms that the National Fire Protection Association recognizes that the toxicity of the products of combustion is an important factor in the loss of life from fire. NFPA has dealt with that subject in its technical committee documents for many years.

There is a concern that the growing use of synthetic materials may produce more or additional toxic products of combustion in a fire environment. The Board has, therefore, asked all NFPA technical committees to review the documents for which they are responsible to be sure that the documents respond to this current concern. To assist the committees in meeting this request, the Board has appointed an advisory committee to provide specific guidance to the technical committees on questions relating to assessing the hazards of the products of combustion.

Licensing Provision—This document is copyrighted by the National Fire Protection Association (NFPA).

1. Adoption by Reference—Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders, or similar instruments. Any deletions, additions, and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. The term "adoption by reference" means the citing of title and publishing information only.

2. Adoption by Transcription—A. Public authorities with lawmaking or rule-making powers only upon written notice to the NFPA (Attention: Secretary, Standards Council), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders, or similar instruments having the force of law, provided that: (1) due notice of NFPA's copyright is contained in each law and in each copy thereof; and (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction's lawmaking or rule-making process. B. Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rule-making powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Secretary, Standards Council), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately, provided that due notice of NFPA's copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rule-making powers may apply for and may receive a special royalty where the public interest will be served thereby.

3. Scope of License Grant—The terms and conditions set forth above do not extend to the index to this document.

(For further explanation, see the Policy Concerning the Adoption, Printing, and Publication of NFPA Documents, which is available upon request from the NFPA.)

Statement on NFPA Procedures

This material has been developed under the published procedures of the National Fire Protection Association, which are designed to assure the appointment of technically competent Committees having balanced representation. While these procedures assure the highest degree of care, neither the National Fire Protection Association, its members, nor those participating in its activities accept any liability resulting from compliance or noncompliance with the provisions given herein, for any restrictions imposed on materials or processes, or for the completeness of the text.

NFPA has no power or authority to police or enforce compliance with the contents of this document, and any certification of products stating compliance with requirements of this document is made at the peril of the certifier.

NFPA 1962

Care, Use, and Service Testing of Fire Hose Including Couplings and Nozzles

1993 Edition

Reference: Table 1-4.1, 2-5.1

The Committee on Fire Hose notes the following errors in the 1993 edition of NFPA 1962, *Standard for the Care, Use, and Service Testing of Fire Hose Including Couplings and Nozzles*:

1. In Table 1-4.1, the conversion for 1 ft should be 305 mm.
2. In 2-5.1, the word "no" should appear after the word "exhibit."

Issue Date: May 12, 1993

Copyright © 1993 NFPA, All Rights Reserved

NFPA 1962
Standard for the
Care, Use, and Service Testing of
Fire Hose Including Couplings and Nozzles
1993 Edition

This edition of NFPA 1962, *Standard for the Care, Use, and Service Testing of Fire Hose Including Couplings and Nozzles*, was prepared by the Technical Committee on Fire Hose and acted on by the National Fire Protection Association, Inc. at its Fall Meeting held November 16-18, 1992, in Dallas, TX. It was issued by the Standards Council on January 15, 1993, with an effective date of February 12, 1993, and supersedes all previous editions.

The 1993 edition of this document has been approved by the American National Standards Institute.

Origin and Development of NFPA 1962

NFPA originally developed a Recommended Practice for the care, maintenance, and use of fire hose in 1936 through its Committee on Field Practices. This document was designated NFPA 198 and was revised extensively through the years. In 1954, the Fire Hose Committee assumed the responsibility for the document.

In 1979, NFPA 1962 was issued as a new standard. The standard was completely rewritten but still contained portions of NFPA 198. The requirements were carefully developed to ensure a reasonable level of reliability for fire hose that is in service.

This edition of the document has been editorially revised, adding explanation where appropriate to make it more understandable. Requirements were added for service testing hose before it is placed in service to ensure there is no damage during shipment or while in storage. The standard was revised where necessary to recognize that 6 in. supply hose can only be used to 135 psig working pressure and 150 psig service pressure. The term "rack and reel hose" was changed to "occupant-use hose" to be consistent with NFPA 1961. The increased use of hose testing machines was recognized in the test procedure section. The test requirements for booster and suction hose were revised by incorporating the information in the standard rather than referring to a different standard.

Technical Committee on Fire Hose

John W. Stacey, *Chairman*
Bellevue Fire Dept., NE
Rep. Int'l Assn. of Fire Chiefs

William H. Barnes, Akron Brass Co., OH
Patrick E. Begley, Andersen Fire Equipment Co., Inc., NE
Rep. Nat'l Assn. of Fire Equipment Distributors Inc.
Frank T. Blackburn, PWSS Co. Ltd., CA
Robert Ely (Ret.), San Diego, CA
Ronald George, Red Head Brass Inc., OH
Rep. Int'l Society of Fire Service Instructors
James M. Hebert, LSU Firemen Training Program, LA
Paul R. Hill, US Forest Service, CA
Gregory Jakubowski, Merck, Sharp & Dohme, PA
Philip W. Johnson, Factory Mutual Research Corp., MA
Allen Leach, Jaffrey Fire Protection Co., NH

Larry Linton, Washington Township Volunteer Fire Dept., IN
William E. Patterson, Snap-tite Hose, Inc., PA
Rep. Fire Equipment Mfrs. Assn., Inc.
William J. Patterson, Federal Emergency Management Agency, CA
David J. Pritchard, Angus Fire, NC
Sherman Stark, Nat'l Fire Hose Corp., CA
Rep. Rubber Mfrs. Assn.
L. M. Walker, Underwriters Laboratories Inc., IL
Halbert C. Weill, Jr., Duke Power Co., NC
Rep. Electric Light Power Group/Edison Electric Inst.

Alternates

Thomas J. Brown, Jr., Factory Mutual Research Corp., MA
(Alt. to P. W. Johnson)
Mark A. Conron, Niedner Ltd. Coaticook, Quebec
(Alt. to W. E. Patterson)

Mark Saner, Akron Brass/Western Fire, OH
(Alt. to W. H. Barnes)
L. G. Sheffer, Underwriters Laboratories Inc., IL
(Alt. to L. M. Walker)

Carl E. Peterson, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in the membership may have occurred.

NOTE: Membership on a Committee shall not in and of itself constitute an endorsement of the Association or any document developed by the Committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on the size and design of fire hose connections, and the performance, maintenance, and selection of all types of fire hose, couplings, nozzles, and accessory equipment.

Contents

Chapter 1 Administration	1962- 4	Chapter 4 Nozzles, Couplings, and Gaskets . .	1962- 8
1-1 Scope	1962- 4	4-1 Nozzles	1962- 8
1-2 Purpose	1962- 4	4-2 Couplings	1962- 8
1-3 Definitions	1962- 4	4-3 Gaskets	1962- 9
1-4 Units of Measurement	1962- 5		
Chapter 2 Care and Use of Fire Hose	1962- 5	Chapter 5 Service Testing	1962- 9
2-1 Attack Hose, Supply Hose, and Forestry Hose	1962- 5	5-1 Service Test Pressure	1962- 9
2-2 Relay-Supply Hose	1962- 6	5-2 Service Test Procedure	1962- 9
2-3 Occupant-Use Hose	1962- 7	5-3 Unlined Hose	1962-10
2-4 Booster and Suction Hose	1962- 7	5-4 Booster and Hard Suction Hose	1962-10
2-5 Inspecting	1962- 7		
2-6 Cleaning and Drying	1962- 7	Chapter 6 Referenced Publications	1962-11
2-7 Storage	1962- 7	Appendix A	1962-11
Chapter 3 Hose Records	1962- 7	Appendix B Referenced Publications	1962-16
3-1 Attack Hose, Supply Hose, and Occupant-Use Hose	1962- 7	Index	1962-16
3-2 Forestry Hose	1962- 8		

NFPA 1962
Standard for the
Care, Use, and Service Testing of
Fire Hose Including Couplings and Nozzles
1993 Edition

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates explanatory material on that paragraph in Appendix A.

Information on referenced publications can be found in Chapter 6 and Appendix B.

Chapter 1 Administration

1-1 Scope. This standard shall apply to the care of all types of fire hose, coupling assemblies, and nozzles while in service, in use, and after use; including record keeping, inspecting, and service testing.

1-2 Purpose.

1-2.1 The purpose of this standard is to provide a reasonable level of safety for users of fire hose and a reasonable degree of assurance that the hose, coupling assemblies, and nozzles will perform as designed.

1-2.2 Unless otherwise noted, it is intended that the provisions of this standard be applied to equipment or installations that were existing or approved for construction or installation prior to the effective date of the standard.

1-3 Definitions.

Approved. Acceptable to the "authority having jurisdiction."

NOTE: The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization concerned with product evaluations that is in a position to determine compliance with appropriate standards for the current production of listed items.

Attack Hose. Hose designed to be used by trained fire fighters and fire brigade members to combat fires beyond the incipient stage. The hose is designed to convey water to handline nozzles, distributor nozzles, master stream appliances, portable hydrants, manifolds, standpipe and sprinkler systems, and pumps used by fire departments.

Authority Having Jurisdiction. The "authority having jurisdiction" is the organization, office, or individual responsible for "approving" equipment, an installation, or a procedure.

NOTE: The phrase "authority having jurisdiction" is used in NFPA documents in a broad manner since jurisdictions and "approval" agencies vary as do their responsibilities. Where public safety is primary, the "authority having jurisdiction" may be a federal, state, local, or other regional department or individual such as a fire chief, fire marshal, chief of a fire prevention bureau, labor department, health department, building official, electrical inspector, or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the "authority having jurisdiction." In many circumstances the property owner or his designated agent assumes the role of the "authority having jurisdiction"; at government installations, the commanding officer or departmental official may be the "authority having jurisdiction."

Booster Hose. A hose having a rubber tube, a braided or spiraled reinforcement, and an outer protective cover. The hose is manufactured in sizes up to 1½ in. (38 mm) and is intended for use on fire apparatus.

Braided Reinforcement. A hose reinforcement consisting of one or more layers of interlaced spiraled strands of yarn or wire, with a layer of rubber between each braid.

Coating. A protective material that impregnates or saturates the yarn of the jacket so the outside of the jacket is relatively smooth.

Covered Hose. A hose with a jacket covered and lined with a continuous synthetic rubber or plastic. The cover is usually thicker than a coating.

Fire Hose. A flexible conduit constructed with one or more reinforcements (jackets), with or without a coating or covering, but with an approved nonpermeable lining; or with an inner reinforcement between a protective cover and an approved nonpermeable lining.

Fold. A transverse bend (fold) occurring where the hose is lengthwise doubled over on itself, as on a pin rack.

Forestry Hose. A hose designed to meet specialized requirements for fighting wildland fires.

Hard Suction Hose. A hose used for drafting water from static supplies (lakes, rivers, wells, etc.). It may also be used for supplying pumps on fire apparatus from hydrants if designed for that purpose. The hose contains a semirigid or rigid reinforcement designed to prevent collapse of the hose under vacuum.

In Service. Hose ready for use and kept in hose houses, on racks or reels, or on fire apparatus, but not including hose in storage where it is not readily available to be put into service at an incident.

In Storage. Hose that is not readily available for use because it is not at the scene of an incident and not loaded on a vehicle that can transport it to the scene.

In Use. Hose being used during fire suppression or training.

Labeled. Equipment or materials to which has been attached a label, symbol, or other identifying mark of an organization acceptable to the "authority having jurisdiction" and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

Large-Diameter Hose. A hose of 3½-in. (90-mm) size or larger. Supply hose is designed to be used at operating pressures not exceeding 185 psig (1275 kPag). Attack hose is designed for use at operating pressures up to at least 275 psig (1896 kPag).

Listed. Equipment or materials included in a list published by an organization acceptable to the "authority having jurisdiction" and concerned with product evaluation, that maintains periodic inspection of production of listed equipment or materials, and whose listing states either that the equipment or material meets appropriate standards or has been tested and found suitable for use in a specified manner.

NOTE: The means for identifying listed equipment may vary for each organization concerned with product evaluation, some of which do not recognize equipment as listed unless it is also labeled. The "authority having jurisdiction" should utilize the system employed by the listing organization to identify a listed product.

May. This term is used to state permissive use or an alternative method to a specified requirement.

Multiple Jacket. A construction consisting of a combination of two separately woven jackets (double jacket), or two or more jackets interwoven.

Occupant-Use Hose. Fire hose designed to be used by the building's occupants to fight incipient fires prior to the arrival of trained fire fighters or fire brigade members.

Relay-Supply Hose. A single-jacket fire hose of 3-in. (90-mm) and larger diameter used to move large volumes of water at low pressure and manufactured prior to January 1987 to meet the requirements of the 1979 and prior editions of NFPA 1961, *Standard for Fire Hose*.

Service Test. Hydrostatic test conducted by users on all in-service hose to determine suitability for continued service.

Shall. Indicates a mandatory requirement.

Should. Indicates a recommendation or that which is advised but not required.

Single Jacket. A construction consisting of one woven jacket.

Soft Suction Hose. Collapsible hose used to supply pumpers from hydrants.

Spiral Reinforcement. A hose reinforcement consisting of pairs of layers of yarn spiraled with no interlacing between the individual layers. The layers of yarn in each pair are spirally wound in opposite directions. A layer of rubber separates each pair of spiraled layers.

Unlined Hose. A hose consisting of only a woven jacket that is usually of linen yarns and is of such quality that the yarn swells when wet, tending to seal the hose.

Water Hammer.* The surge of pressure caused when a high-velocity flow of water is abruptly shut off. The pressure exerted by the flowing water against the closed system can be seven or more times that of the static pressure.

1-4 Units of Measurement.

1-4.1* Metric units of measurement in this standard are in accordance with the modernized metric system known as the International System of Units (SI). The liter unit, which is not part of but is recognized by SI, is commonly used in international fire protection. The SI units used in this standard are listed in Table 1-4.1 with their conversion factors.

1-4.2 In this standard, U.S. values for measurements are followed by an equivalent in SI units. The U.S. value shall be regarded as the requirement because the SI equivalent value may be approximate. However, as all 2½-in. hose shall have an internal waterway of 2⅞ in., as specified in NFPA 1961, *Standard for Fire Hose*, the SI unit value for 2⅞ in. (65 mm) is required.

Table 1-4.1

Quantity	U.S. Unit (Symbol)	SI Unit (Symbol)	Conversion Factor
Length	inch (in.)	millimeter (mm)	1 in. = 25.4 mm
	foot (ft)	meter (m)	1 ft = 0.305 mm
Volume	gallon (gal)	liter (L)	1 gal = 3.785 L
Flow Rate	gallon per minute (gpm)	liter per minute (L/min)	1 gpm = 3.785 L/min
	pounds per sq inch (psi)	kilopascal (kPa)	1 psig = 6.895 kPag

Chapter 2 Care and Use of Fire Hose

2-1 Attack Hose, Supply Hose, and Forestry Hose.

2-1.1* Hose shall be inspected and service-tested as specified in Chapter 5 within 90 days before being placed in service for the first time and at least annually thereafter.

2-1.2* Hose carried on fire apparatus shall be loaded in such a way that air can circulate under the hose load to eliminate or reduce the growth of mildew in the hose jackets and rust and corrosion in the hose compartment. Only clean, dry hose shall be placed into service. Wet hose accelerates mildew growth and rusting and shall be thoroughly dried before being placed in service.

2-1.3* Hose shall be removed from the apparatus and reloaded so that the folds occur at different positions with sufficient frequency to prevent damage and permanent folds setting in the rubber lining.

2-1.4* Large-diameter hose used to supply a pumper from a hydrant shall be repacked in a different position after each use to avoid folds and strains occurring at the same location.

2-1.5 Large-diameter hose used to supply a pumper from a hydrant shall be protected from chafing with chafing blocks or similar protection where it comes in contact with pavement or curbing. When connecting a pumper to a hydrant, the hose shall be bent slightly to avoid kinks when the water is turned on.

2-1.6 Large-Diameter Supply Hose.

2-1.6.1 Large-diameter hose marked "SUPPLY HOSE" shall not be used at operating pressures exceeding 185 psig (1275 kPag) when supplying fire department pumpers from hydrants; when relaying water from pumper to pumper; and when directly supplying attack lines, master stream appliances, portable hydrants, manifolds, and standpipe and sprinkler systems.

Exception: 6-in. (152-mm) supply hose shall not be used at operating pressures exceeding 135 psig (930 kPag).

2-1.6.2* A pressure and volume relief device with adequate capabilities and a maximum setting, not to exceed the service test pressure of the hose being used, shall be used on the discharge side of the pump when large-diameter supply hose is being used to supply attack lines, manifolds, and standpipe and sprinkler systems. Rapid closing or opening valves shall not be used with large-diameter supply hose.

2-1.6.3 Where large-diameter hose marked "SUPPLY HOSE" is used in relay between fire department pumpers, the suction of each receiving pumper shall be equipped with a relief valve. The maximum pressure setting of the relief valve(s) shall be not more than 10 psi (69 kPa) over the static pressure of the water source to which it is connected or not more than 10 psi (69 kPa) over the discharge pressure of a supply pumper in a relay. In no event shall it exceed the working pressure of the hose used with the system.

2-1.7* Hose, while in use, shall be positioned to minimize mechanical damage and heat exposure; nozzles and valves shall be opened and closed slowly to prevent pressure surges and water hammer that may burst the hose and in turn cause injury to people or damage to the pump. Care shall be taken to prevent the hose from chafing.

2-1.8 When hose is in use during subfreezing weather, care shall be taken to prevent water from freezing inside the hose. To help prevent freezing once the water is turned on, some water shall be left running through the hose until the line is no longer needed. When the line is no longer needed, it shall be uncoupled and drained before the water freezes.

2-1.9* Hose that has been frozen during use shall be thawed and service-tested as specified in Chapter 5 before being put back in service or in storage.

2-1.10* After each use and before being placed in storage or back in service, the hose shall be drained, cleaned, dried, and inspected as specified in Sections 2-5 and 2-6.

2-2* Relay-Supply Hose. This section shall apply only to relay-supply hose manufactured to the requirements of the 1979 and prior editions of NFPA 1961, *Standard for Fire Hose*.

2-2.1 In-service hose shall be inspected and service-tested as specified in Chapter 5 at least annually.

2-2.2 Hose carried on fire apparatus shall be loaded in such a way that air can circulate under the hose load to eliminate or reduce the growth of mildew in the hose jackets and rust and corrosion in the hose compartment. Only clean, dry hose shall be placed into service. Wet hose accelerates mildew growth and rusting and shall be thoroughly dried before being placed in service.

2-2.3 Hose shall be removed from the apparatus and reloaded so that the folds occur at different positions with sufficient frequency to prevent damage and permanent folds setting in the rubber lining.

2-2.4 Relay-supply hose used to supply a pumper from a hydrant shall be repacked in a different position after each use to avoid folds and strains occurring at the same location.

2-2.5 Relay-supply hose used to supply a pumper from a hydrant shall be protected from chafing with chafing blocks or similar protection where it comes in contact with pavement or curbing. When connecting a pumper to a hydrant, the hose shall be bent slightly to avoid kinks when the water is turned on.

2-2.6 Relay-supply hose shall not be used at operating pressures exceeding 185 psig (1275 kPag) when supplying fire department pumpers from hydrants; when relaying water from pumper to pumper; and when directly supplying attack lines, master stream appliances, portable hydrants, manifolds, and standpipe and sprinkler systems.

Exception: 6-in. (152-mm) relay-supply hose shall not be used at operating pressures exceeding 135 psig (930 kPag).

2-2.7* Fire departments shall establish operational procedures for relay-supply operations. Special precautions shall be used when relaying water from a pump at a water source to a pump near the fire ground or to other pumps in a relay in order to control pressure surges and water hammer. The pump receiving the relay shall be provided with a relay-relief valve on the inlet (suction) to which the relay-supply hose is attached. The maximum pressure setting of the relief valve(s) shall be not more than 10 psi (69 kPa) over the static pressure of the water source to which it is connected, and in no event shall it exceed the working pressure of the hose used within the system.

2-2.8 Care shall be taken to avoid dragging the hose. If it must be dragged, it shall be dragged flat.

2-2.9* Vehicles shall not be driven over relay-supply lines unless the hose is bridged.

2-2.10 When hose is in use during subfreezing weather, care shall be taken to prevent water from freezing inside the hose. To help prevent freezing once the water is turned on, some water shall be left running through the hose until the line is no longer needed. When the line is no longer needed, it shall be uncoupled and drained before the water freezes.

2-2.11 Hose that has been frozen during use shall be thawed and service-tested as specified in Chapter 5 before being put back in service or in storage.

2-2.12 After use and before being placed in storage or back in service, the hose shall be drained, cleaned, dried, and inspected as specified in Sections 2-5 and 2-6.

2-3* Occupant-Use Hose.

2-3.1 Occupant-use hose shall be service-tested as specified in Chapter 5 within the 90 days prior to being put in service.

2-3.2 In-service hose designed for occupant use only shall be removed and service-tested as specified in Chapter 5 at intervals not exceeding 5 years after installation and every 3 years thereafter.

2-3.3 In-service hose shall be unracked, unreeled, or unrolled and physically inspected as specified in Section 2-5 at least annually. Hose shall be reracked, rereeled, or rerolled so that any folds do not occur at the same position on the hose.

2-3.4* Hose stored on racks or reels shall be protected from the weather and any local environmental condition that may be harmful to the hose. Hose shall be protected from mechanical damage and exposure to heat. Enclosures for occupant-use hose shall be constructed and the hose stored in accordance with NFPA 24, *Standard for the Installation of Private Fire Service Mains and Their Appurtenances*.

2-3.5 In areas where rodents may pose a problem, the hose shall be visually inspected more frequently for rodent damage.

2-3.6 After each use and before being placed back in service, the hose shall be inspected as specified in Section 2-5, service-tested as specified in Chapter 5, and cleaned and dried as specified in Section 2-6.

2-4 Booster and Suction Hose.

2-4.1 The hose shall be service-tested as specified in Section 5-4 at least annually.

2-4.2* Hose shall be stored out of direct sunlight and as recommended by the manufacturer. The hose shall not be stored kinked and, if stored on a reel, care shall be taken to avoid twisting the hose when rolling it onto the reel.

2-4.3 Hose that has the reinforcement exposed shall be removed from service and repaired or condemned. The defective section shall be permitted to be cut out and the length recoupled and service-tested as specified in Section 5-4.

2-4.4 Foreign objects of any kind, including items of equipment, shall not be carried inside the hose.

2-5 Inspecting.

2-5.1 Physical inspection shall determine that the hose, couplings, and any nozzle have not been vandalized, are free of debris, and exhibit evidence of mildew, rot, or damage by chemicals, burns, cuts, abrasion, and vermin.

2-5.2 If the hose fails the physical inspection, it shall be removed from service, repaired as necessary, and service-tested as specified in Chapter 5 or condemned.

2-5.3 The couplings shall be inspected as specified in 4-2.1.

2-5.4 Where nozzles are required on occupant-use hose, they shall be inspected as specified in 4-1.1, 4-1.2, and 4-1.3.

2-6 Cleaning and Drying.

2-6.1* After each use, all hose shall be cleaned. If the dirt cannot be thoroughly brushed from it or if it has come in contact with harmful materials, the hose shall be washed.

2-6.2 If, during use, the hose has been exposed to hazardous materials, it shall be decontaminated by the method approved for the contaminate.

2-6.3* All hose shall be drained and thoroughly dried before being placed in service or in storage. Covered hose may be wiped dry. Hose shall not be dried on hot pavements or under intense sunlight.

2-7 Storage.

2-7.1* Hose in storage shall be kept out of direct sunlight and in a well-ventilated location. Hose shall be stored only after it has been properly inspected, service-tested, if required, cleaned, dried, and rolled.

2-7.2 Hose that is out of service for repair shall be properly tagged as specified in Chapter 3 and kept separated from any hose that is in storage and ready for service.

Chapter 3 Hose Records

3-1 Attack Hose, Supply Hose, and Occupant-Use Hose.

3-1.1* Accurate hose records shall be established and maintained.

3-1.2* Each length of hose shall be assigned an identification number for use in recording its history throughout its service life. The identification number shall be stenciled on the jacket or cover using an ink or paint that is not harmful to the hose. The identification number may be stamped on the bowl or swivel of the female coupling in a manner that prevents damage to the coupling.

3-1.3* Records of hose used by fire departments shall be kept as part of the department's or individual company's complete equipment inventory.

3-1.4 Records for hose on racks or reels or in enclosures shall be kept at the hose location or at a control location on the premises where the hose is located.

3-1.5* The following information shall be included for each length of hose:

- (a) Assigned identification number.
- (b) Manufacturer and part number.
- (c) Vendor.
- (d) Size (internal diameter of waterway).
- (e) Length.
- (f) Type of hose.
- (g) Construction.
- (h) Date received and date put in service.
- (i) The date of each service test and the service test pressure.
- (j) Repairs and new length if shortened.
- (k) Actual damage.
- (l) Exposure to possible damage.
- (m) Reason removed from service.
- (n) Reason condemned.
- (o) Indication that the hose has been removed from service or condemned within the warranty period because of an in-warranty failure.

3-1.6* Out-of-service hose shall be properly tagged, with the reason for removal from service noted on the tag. This tag may also include information required for inclusion on the permanent hose record.

3-1.7 Personnel responsible for the repair and maintenance of fire hose shall ensure that a report of the work performed to repair each length is recorded on the permanent hose record.

3-2 Forestry Hose.

3-2.1* The authority having jurisdiction shall determine the records necessary to achieve an effective hose management program.

Chapter 4 Nozzles, Couplings, and Gaskets

4-1 Nozzles.

4-1.1 Nozzle valves attached to in-service hose shall be kept in the closed position.

4-1.2* All nozzles shall be inspected at least annually and after each use. The nozzle inspection shall include verification of the following:

- (a) Clear of obstructions in waterway.
- (b) No damage to tip.
- (c) Full operation of adjustments such as pattern selection, etc.

(d) Proper operation of shutoff valve, if so equipped.

(e) No missing parts.

(f) Thread gasket in good condition in accordance with 4-3.1.

4-1.3 If the nozzle fails the inspection for any reason, it shall be removed from service and repaired or replaced.

4-1.4 If, during use, there is an obstruction that cannot be removed by flushing the nozzle, the nozzle shall be taken from the hose line and the obstruction removed through the connection end as soon as is practicable, since any further attempt to force the obstruction out through the tip may damage the nozzle.

4-1.5 Care shall be taken to avoid dents or nicks in nozzle tips, as these can seriously affect the reach of the stream. To prevent mechanical damage, nozzles shall be handled with care. They shall not be dropped or thrown.

4-1.6 Nozzle control valves shall be opened and closed slowly to eliminate unnecessary strain on the hose and couplings and reduce pressure surges.

4-1.7* After each use, all nozzles shall be thoroughly washed and inspected in accordance with 4-1.2 before being placed back in service.

4-2 Couplings.

4-2.1* Couplings shall be kept in serviceable condition. After each use, and during each hose service test, they shall be visually inspected for the following:

- (a) Damaged threads.
- (b) Corrosion.
- (c) Slippage on the hose.
- (d) Out-of-round.
- (e) Swivel not rotating freely.
- (f) Missing lugs.
- (g) Loose external collar.
- (h) Internal gasket in accordance with Section 4-3.
- (i) Other defects that impair operation.

Defective couplings shall be removed from service and repaired or replaced. The internal gasket shall be inspected as specified in 4-2.8. A lubricant specified by the coupling manufacturer shall be permitted to be used on coupling swivels and threads.

4-2.2* Care shall be taken not to drop the couplings on pavement or other hard surfaces that may cause damage to the swivel section or exposed threads.

4-2.3 Care shall be taken to prevent vehicles from driving over couplings.

4-2.4 Special care shall be taken where couplings of dissimilar metals are connected, as corrosion can occur due to this difference and moisture tends to accelerate this corrosion. Where couplings of dissimilar metals are left connected, they shall be disconnected and inspected at least

quarterly. If corrosion exists, the couplings shall be cleaned and an anticorrosive lubricant specified by the coupling manufacturer shall be applied to the threads. Anticorrosive lubricant shall be applied at the time of each service test.

4-2.5* When attaching new or used couplings, care shall be taken to have the hose fit properly in the bowl of the coupling. The outside diameter of the hose shall fit snugly in the internal diameter of the bowl of the coupling. The expansion ring shall be of the proper size and length for the coupling used. A new tail gasket shall be used.

4-2.6* When couplings are attached or reattached to hose, the hose shall be tested its service test pressure in accordance with Chapter 5.

Warning: Retesting repaired or recoupled fire hose can be extremely dangerous. Extreme care shall be taken to prevent exposure of anyone to the hose during the test.

4-2.7 The date and nature of the repair or recoupling and the identity of the person performing the repair shall be recorded for each length of hose as specified in 3-1.5.

4-2.8 The socket head cap screws on shank-type couplings shall be checked at least annually to ensure they are torqued to the manufacturer's specified tolerance.

4-3 Gaskets.

4-3.1* The thread gasket in couplings and nozzles shall be inspected for presence, tight fit, and lack of deterioration. If defective, it shall be replaced with a new gasket.

4-3.2* Gaskets shall not protrude into the waterway.

Chapter 5 Service Testing

Warning: Service testing of hose is undertaken to confirm its suitability for continued use. Because there is a potential for catastrophic failure during these tests, it is vital that adequate safety precautions be taken.

5-1 Service Test Pressure.

5-1.1 Hose Manufactured Prior to July 1987.

5-1.1.1 The service test pressure for hose manufactured prior to July 1987 to meet the requirements of the 1979 and previous editions of NFPA 1961, *Standard for Fire Hose*, shall be determined by the acceptance or proof test pressure stenciled on each length of hose, which reads "Tested to - - - PSI," and then determining the corresponding service test pressure from Table 5-1.1 for that type of hose.

5-1.1.2 The acceptance or proof test pressure that is stenciled on hose manufactured prior to July 1987 shall not be used for the service test pressure.

5-1.2 Hose Manufactured July 1987 and After.

5-1.2.1 The service test pressure for hose manufactured in July 1987 and after to meet the requirements of the 1987 or subsequent editions of NFPA 1961, *Standard for*

Table 5-1.1. Service Test Pressures for Hose Manufactured Prior to July 1987

Trade Size in. (mm)	Jackets	New Hose Rated Acceptance Test Pressure psig (kPag)	Service Test Pressure psig (kPag)
Lined Industrial, Standpipe, and Fire Department			
1½ (38) thru 2½ (65)*	Single	300 (2070)	150 (1030)
1½ (38) thru 4½ (114)	Single	400 (2760)	250 (1720)
1½ (38) thru 2½ (65)	Single	500 (3450)	250 (1720)
1½ (38) thru 4 (100)	Multiple	400 (2760)	250 (1720)
1½ (38) thru 4 (100)	Multiple	600 (4140)	250 (1720)
Unlined Standpipe			
1½ (38) and 2½ (65)	Single		150 (1030)
Lined Forestry			
1 (25) and 1½ (38)	Single	450 (3100)	250 (1720)
Unlined Forestry			
1 (25) and 1½ (38)	Single	450 (3100)	250 (1720)
Relay Supply			
3½ (90) thru 5 (125)	Single	400 (2760)	200 (1380)
6 (150)	Single	300 (2070)	150 (1030)
Pumper Supply (Soft Suction)			
4 (100) thru 6 (150)	Multiple	400 (2760)	200 (1380)

* 1½ (38) thru 2½ (65) single-jacket hose with a new hose rated acceptance test pressure of 300 psig (2070 kPag) shall not be maintained on fire apparatus for fire fighting purposes.

Fire Hose, is stenciled on each length of hose and reads "Service Test to - - - PSI per NFPA 1962."

5-1.2.2 New proof pressure tests for hoses shall only be conducted at the point of manufacture or at a facility properly equipped to perform these tests. Tests in the field shall not subject the hose to its proof test pressure.

5-1.3* After determining the correct service test pressure for each length of hose to be tested, the service test shall be conducted as specified in Section 5-2.

5-2 Service Test Procedure.

5-2.1 Each length of hose to be service-tested shall be inspected as specified in Section 2-5. Any length of hose that fails the inspection shall be removed from the service test area and repaired as necessary or condemned.

5-2.2* A hose testing machine, a stationary pump, or a pump on a fire department apparatus shall be used. Where the pressure supply source is not specifically designed for testing hose, a hose test gate valve designed to withstand the test pressures shall be used between the pump and the hose to be tested. The hose test gate valve shall be a fire department gate valve with a ¼-in. (6.4-mm) opening drilled through the gate that permits the pressure to be raised to the test pressure after the hose has been filled, the air completely removed, and the hose test gate valve closed. The gauge used to read the test pressure shall have been calibrated within 30 days prior to the testing.

5-2.3 All 3½-in. (89-mm) and larger hose shall be service-tested while lying flat. A short length of smaller diameter hose with the same or higher proof pressure shall be used to connect the pressure source to the hose being tested.

5-2.4* Each length of hose to be tested simultaneously shall be of the same service test pressure and, collectively, shall be considered the hose test layout. The total length of any hose line in the hose test layout to be service-tested shall not exceed 300 ft (91 m). The hose test layout shall be straight, without kinks or twists.

Exception: Hose that has been repaired or recoupled shall be tested one length at a time.

5-2.5 The test layout shall be connected to the hose test gate valve of the pump. The hose test gate valve shall be used to prevent the reaction of discharging a large volume of water in the event of a hose bursting during the test. If a fire department pumper is used, the hose test gate valve shall not be attached to any discharge outlet at or adjacent to the pump operator's position. The hose test gate valve end of the hose line shall be secured with a belt tie-in or rope hose tool at a point 10 in. – 15 in. (250 mm – 400 mm) from the coupling. Shutoff nozzles or test caps shall be attached to the far end of the line.

5-2.6* With the hose test gate valve open and the nozzle or test cap valve open, the pressure shall be gradually raised to 45 psig \pm 5 psig (310 kPag \pm 35 kPag). After the hose test layout is full of water, all air in each hose line shall be exhausted by raising the discharge end of each hose line above the highest point in the system. The nozzle or test cap valve shall be closed slowly, then the hose test gate valve shall be closed.

Warning: Care shall be taken to remove all air from the hose before the nozzle or test cap is closed and the pressure raised. The development of test pressures introduces a serious accident potential if air remains in the system.

5-2.7* The shutoff device or the hose directly in back of the shutoff device shall be secured to avoid possible whipping or other uncontrolled reaction in the event of a hose burst.

5-2.8 After filling to 45 psig \pm 5 psig (310 kPag \pm 35 kPag), the hose shall be checked for leakage at the coupling and tightened with a spanner wrench where necessary. Each hose shall then be marked at the end or back of each coupling to determine, after the hose has been drained, if the coupling has slipped during the test.

5-2.9 All personnel other than those persons required to perform the remainder of the procedure shall clear the area.

5-2.10 The pressure shall be raised slowly at a rate not greater than 1000 psi (6900 kPa) per minute to the service test pressure, and held for 5 minutes.

5-2.11 While the test layout is at the service test pressure, the hose shall be inspected for leaks. If the inspecting personnel walk the test layout to inspect for leaks, they shall be at least 15 ft (4.5 m) to the left side of the nearest hose line in the test layout. The left side of the hose line shall be defined as that side that is to the left when facing the free end from the pressure source. Personnel shall never stand

in front of the free end of the hose, on the right side of the hose, or closer than 15 ft (4.5 m) on the left side of the hose, or straddle a hose in the test layout during the test.

5-2.12 If, during the test, a section of hose is leaking or a section bursts, the service test shall be terminated, and that length of hose shall have failed the test. The test layout shall be drained, and the defective hose removed from the test layout. The service test shall be restarted in accordance with Section 5-2.

5-2.13 After 5 minutes at the service test pressure, the pump shall be shut down, the hose test gate valve opened, the pressure allowed to equalize with the source, the pump discharge gates closed, and each nozzle or test cap valve opened to drain the test layout.

5-2.14* The marks placed on the hose at the back of the couplings shall be observed for coupling slippage. If the coupling has slipped, the hose shall have failed the test.

5-2.15 Hose records specified in Chapter 3 shall be updated to indicate the results of the service test for each length of hose tested.

5-2.16* All hose failing the physical examination, bursting, leaking, or having couplings that fail because of slippage or leakage shall be tagged as required in 3-1.6, removed from service, and repaired or discarded.

5-2.17 After testing, all hose shall be thoroughly cleaned, drained, and dried as specified in Section 2-6 before being placed in service or storage.

5-3 Unlined Hose.

5-3.1 All service testing of unlined hose shall be performed in accordance with procedures specified in 5-1.1 and Section 5-2.

Exception: Unlined linen hose shall have a 10-minute wet-soak at 50 psig (345 kPag) to condition the linen yarn prior to applying the service test pressure.

5-3.2 If the service test pressure cannot be obtained, the hose shall be removed from service and condemned.

5-3.3* Linen hose shall be thoroughly dried immediately after testing to avoid mildew growth.

5-4 Booster and Hard Suction Hose.

5-4.1* Booster hose shall be tested annually in accordance with Section 5-2 to 110 percent of its maximum working pressure. If a maximum working pressure cannot be determined for the hose, it shall be tested to 110 percent of the normal highest working pressure as used in the system.

5-4.2* Hard suction hose shall be dry-vacuum tested annually as follows:

(a) The hose shall be attached to a suction source.

(b) The free end shall be sealed with a transparent disk and connected to an accurate vacuum measuring instrument.

(c) A 22-in. (74.5-kPa) mercury vacuum shall be developed. While holding the vacuum for 10 minutes, the lining of the hose shall be inspected through the transparent disk. There shall be no collapsing of the lining into the waterway.

5-4.3* If hard suction hose is used under positive pressure, it shall also be service-tested to a water pressure of 165 psig (1138 kPag) using the procedures outlined in Section 5-2.

Chapter 6 Referenced Publications

6-1 The following documents or portions thereof are referenced within this standard and shall be considered part of the requirements of this document. The edition indicated for each reference is the current edition as of the date of the NFPA issuance of this document.

6-1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 24, *Standard for the Installation of Fire Service Mains and Their Appurtenances*, 1992 edition

NFPA 1961, *Standard for Fire Hose*, 1992 edition

Appendix A

This Appendix is not a part of the requirements of this NFPA document, but is included for information purposes only.

A-1-3 The formula for water hammer is:

$$\Delta p = c \times d \times \Delta v$$

where:

Δp = change in pressure (lbs/ft)

c = velocity of pressure wave traveling back toward the water sources (ft/sec)

d = mass density of water (1.9 slugs/cu ft)

Δv = change in water velocity (ft/sec)

NOTE: For 2½-in. (65-mm) double-jacket rubber-lined hose c = approximately 800 ft/sec to 1000 ft/sec. (See *Fire Fighting Hydraulics* by R. G. Purington.)

A-1-4.1 See ASTM E380, *Standard for Metric Practice*, for additional information.

A-2-1.1 Attack grade hose can be used in applications designed for occupant-use hose. It is not the intent of this standard to require the testing of attack grade hose used in an occupant-use hose application any more frequently than is required by Section 2-3. If attack grade hose is installed on racks or reels or in hose houses and is designed to be used by a fire department or fire brigade, it is the intent of this standard that the hose be tested in conformance with Section 2-1.

A-2-1.2 If at all possible, the apparatus should be loaded with previously tested and dried hose and returned to service.

The use of 100 percent polyester hose has increased very rapidly. However, this hose should be thoroughly drained and dried before reloading on the apparatus. Damp or wet polyester hose loaded on the apparatus hose bed will still form mildew. Although this will not affect the hose itself, it does cause undue rusting of the apparatus body and increases the potential of dry rot in the wood flooring under the hose.

The use of a protective hose bed cover is recommended to protect the hose load from weather damage and other physical damage. Where covers are provided, care must be taken to permit free circulation of air under the cover to reduce mildew growth. Covers should be made from flame-resistant materials and secured to the apparatus in a manner that prevents them from blowing off while the apparatus is in motion.

Where the humidity is 70 percent or greater or where hose is for municipal use, jackets with cotton yarns should be treated with water repellents and against mildew.

A-2-1.3 It has been discovered that when 100 percent polyester hose is loaded on the apparatus in the conventional manner (horseshoe U-load, accordion, or skid loads), excessive edge wear is noted on this type of hose. As a result of this edge wear, hose manufacturers recommend that where 100 percent polyester hose is used, it should be loaded on the apparatus in the flat load manner.

The best fire department and forestry practice is to remove the hose from the apparatus at least once a month. Water should be run through the hose once quarterly and the hose thoroughly dried before being replaced on the apparatus.

The user should contact the manufacturer of the hose for advice on how often the hose should be removed from the hose bed and repacked.

A-2-1.4 Failures in short lengths of large-diameter pumper supply hose, also called soft suction hose, generally are caused when this hose is folded while carried on the apparatus and either tied down or placed in a small compartment. Where hose is constantly folded at the same points, the folds place considerable stress on the warp threads. If space limitations prevent varying folding positions, the hose should be carried in a roll on a step or running board. Many fire departments keep one end of the hose preconnected to the suction side of the pump, which decreases the time for hydrant hookup.

A-2-1.6.2 Pressure and volume relief devices should be provided to allow sufficient flow to the atmosphere to effectively prevent reduce the pressure in large-diameter hose from exceeding the desired setting. Relief valves normally installed on fire department pumpers to control discharge pressures are not adequate to perform this function.

A-2-1.7 When hoisting attack hose, damage can be avoided and the task made easier by use of hose rollers. Synthetic hose is more susceptible than cotton hose to

damage from hot embers and radiant heat. Where it is necessary for vehicles to cross attack hose lines, hose bridges should be used. More damage to the hose is likely to occur on uncharged hose than on charged hose. To control water hammer when opening a water supply controlled by a quick-acting valve, such as a ball valve, crack the valve and allow water to fill the system before opening the valve completely.

A-2-1.9 During freezing weather, it is common practice to place the nozzle out of a window and, by "cracking" the valve, keep water moving through the hose while overhaul is in process. Avoid sharply bending hose in or on which ice has formed, as frozen hose can easily be damaged by a sharp bend. Use care in removing hose from ice after a fire. Steam is useful in removing ice from hose.

A-2-1.10 At structural fires, fire hose is exposed not only to heat from fires but to burning embers and broken glass, nails, and other sharp objects.

A-2-2 General recommendations for care and use of large-diameter relay-supply hose:

(a) Hose should be loaded flat in the hose bed and layered across the bed. All couplings should be loaded so as to pull off the load without flipping over.

(b) Before reloading into apparatus bed, remove all grit and foreign materials from hose. For hose of the type described in 2-1.4, drying after washing is not a requirement; however, hose should be rinsed off and dried with a clean rag or towel and then reloaded. Wet and dirty hose should not be reloaded for in-service use until thoroughly cleaned and dried.

(c) Couplings should be lubricated occasionally with a liquid silicone or light silicone base lubricant or a dry graphite powder.

A-2-2.7 The automatic pressure governor or the discharge relief valve on the pumper does not provide protection to the suction side of the pump. The lower the setting of the relay relief valve, the greater the protection to the hose. A manual air bleeder valve (petcock) should be provided on the relay relief valve to control the buildup of air pressure.

When shutting down the relay operation, always disengage the pump nearest the fire first and allow the water to run free, then shut down the relay from the water source. This will prevent the pumper nearest the fire from pumping dry.

A-2-2.9 Large-diameter relay-supply hose should not be run over by vehicles. If hose must be crossed, hose bridges should be used and vehicles should have sufficient clearance to cross without contacting the hose.

A-2-3 Class II Standpipe System. Note size of standpipe and 1½-in. (38-mm) hose for building occupant use in Figure A-2-3.

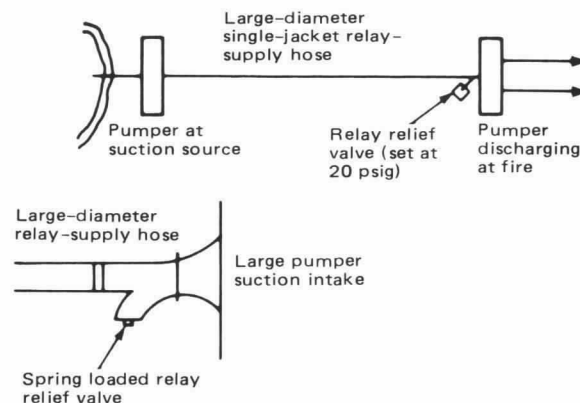


Figure A-2-2.7 Schematic showing relay relief valve.



Figure A-2-3 (Courtesy of National Aeronautics and Space Administration)

A-2-3.4 When the humidity is 70 percent or greater, jackets with cotton yarns should be treated with water repellents and against mildew growth.

Typical Hose Houses

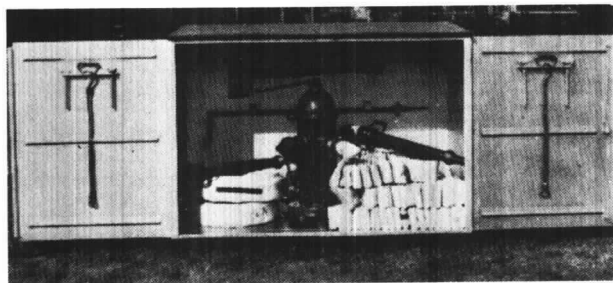


Figure A-2-3.4(a) Hose house of compact dimensions for installation over a yard hydrant. Construction may be steel or aluminum.

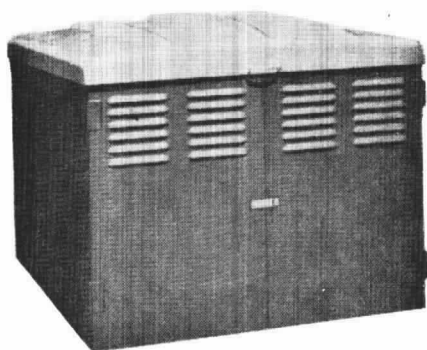


Figure A-2-3.4(b) Steel house of compact dimensions for installation over a yard hydrant. House is shown closed. Top lifts up, and doors on front side open for complete accessibility.

A-2-4.2 To maximize life of hose, it should be stored in a ventilated area at temperatures between 32°F and 100°F (0°C and 38°C).

A-2-6.1 For washing, use a scrub brush and mild soap or detergent and water. A mechanical washer can be used where hose is used frequently or the number of hose lengths to be washed is great. Avoid constant washing of cotton jacket hose treated for mildew resistance, as this will remove the treatment. There are several commercial hose washers available, although many fire departments have constructed their own.

A-2-6.3 There are a number of ways to dry hose. Tower drying has proved successful. However, care should be taken to properly ventilate and control the temperature of the tower so the hose will not be damaged by excessive heat. It is poor practice to suspend hose from couplings.

The design of hose towers should meet all applicable building, electrical, and safety codes and requirements. Fire fighters should be made aware of the hazards associated with hose-drying towers, the protective equipment they should wear while working in a hose tower, and the correct method for raising and hanging wet fire hose, as well as retrieving dry hose.

Commercial hose dryers that force warm air through a cabinet in which hose is loosely coiled on wire racks are also available. While this process dries the outside jacket, it may not allow for thorough draining of the inside of the hose.

Inclined hose racks are often used, as most existing stations can accommodate such racks. The racks should be located where the sun or excessive heat will not damage the hose. The rack has the advantage of allowing the hose to drain internally while providing a drying area from which fire fighters easily can load and unload hose.

A-2-7.1 Commercial storage racks are available, but many users have built their own to fit their particular needs.

A-3-1.1 Records are essential and necessary data to determine hose performance and ensure safe use in fire fighting. Cost-effectiveness can also be determined. This recorded information should be used for effective hose management.

A-3-1.2 Where hose repairs are frequent, however, couplings and hose lengths may become intermingled so that either stenciling the hose or changing the couplings should be employed. In stamping couplings, the proper procedure is to insert a special steel plug with round edges into the end of the expansion ring. One sharp blow from a steel numbering die will then clearly stamp the coupling. Coupling bowls may be damaged by improper stamping. Aluminum couplings should be stamped before they are hard-coated. Some fire departments color-code couplings as well as various tools to identify the company to which the equipment is assigned. This enables each company to readily identify and pick up its hose and equipment at a fire. Where mutual aid operations are frequent, each length of hose should be appropriately stenciled or marked with the identification of the fire department owning same. A water-based latex paint is not harmful to the hose. Paints with a petroleum solvent base may cause the bond between the liner and jacket to fail.

A-3-1.3 Because the safe use of hose requires continuous, accurate, up-to-date records, records should be maintained and kept at the company level in addition to being part of a central file. Conditions, repairs, changes, problems, etc., should be recorded immediately for each length of hose. See Figure A-3-1.3 on next page.

A-3-1.5 Other information recorded might include: coupling threads, manufacturer of coupling and part number, length of guarantee, label number, and cost.

A-3-1.6 See Figure A-3-1.6.

A-3-2.1 Forestry hose is often moved from one location to another in large quantities. Many times forestry fire apparatus leaves the scene of a fire with a different complement of hose than that at arrival. Because of the relocation of hose following fire activity, maintaining individual records of each length of hose may be impractical. As a minimum, records on stored hose should be kept at stations and fire warehouses to ensure proper inventory rotation.

HOSE REPAIR TAG

[illegible][illegible]

A-4-1.2 It should never be necessary to hammer a shutoff valve to make it operate.




A-4-1.7 Nozzles should be washed in a solution of soap and warm water. The nozzle should be submerged and the adjustable controls operated until there is free movement. The nozzle should then be rinsed in water. The nozzle should be lubricated in accordance with the manufacturer's instructions. Cracked rubber-covered handles on nozzles can be the source of accidents and should be replaced.

A-4-2.1 In most cases, a machine shop with the proper facilities can repair damaged threads. One way to detect any slippage of the coupling on the hose is to inspect the area where the expansion ring is located for any appreciable gap between the expansion ring and the coupling waterway. Ordinarily, the swivels can be freed satisfactorily by immersion in warm, soapy water.


A-4-2.2 On some couplings such abuse can cause the hose bowl and swivel to go “out-of-round,” and, as a result, the swivel will not turn.

A-4-2.5 Usually a misfit between the internal bowl diameter and the outside diameter of the hose of more than $\pm 1/32$ in. (± 0.79 mm) will require special techniques and should be avoided.

HOSE REPAIR TAG

<u>ID NUMBER</u> 	<u>COMPANY NUMBER</u>
<u>PICKED UP BY:</u> 	<u>DATE PICKED UP</u>
<u>DELIVERED BY:</u> 	<u>DATE DELIVERED</u>

REPAIRS MADE:

REPAIRED BY: 		DATE REPAIRED
SERVICE TESTED	PSI	DATE TESTED

☐ HOSE IS NOT REPAIRABLE.
ID NO. OF REPLACEMENT HOSE

**NOTE: THIS TAG MUST BE FILLED OUT
AND RETURNED WITH HOSE.
ENTER REPAIRS ON HOSE
RECORD CARD.**

Figure A-3-1.6 An example of a hose repair tag. (Courtesy of Memphis Fire Department)

The tail gasket is the gasket placed in the coupling at the end of the hose to prevent leakage and to keep the fabric of the hose jacket dry. It is important when ordering couplings and tail gaskets for recoupling hose with expansion ring couplings that the appropriate tail gasket be provided. The coupling manufacturer needs to know the outside diameter of the hose and the wall thickness of the hose to provide the proper coupling and gasket. Also, the length of the expansion ring must be consistent with the length of the coupling bowl. (See Figure A-4-2.5.)

The three-piece collars and compression-type hose couplings attached with a shank and external binding method may not be interchangeable from manufacturer to manufacturer and among different hose constructions. The user should make certain that the binding is designed for the hose and shank with which it is being used. Check with the coupling or hose manufacturer for proper assembly instructions and bolt torque settings where necessary.

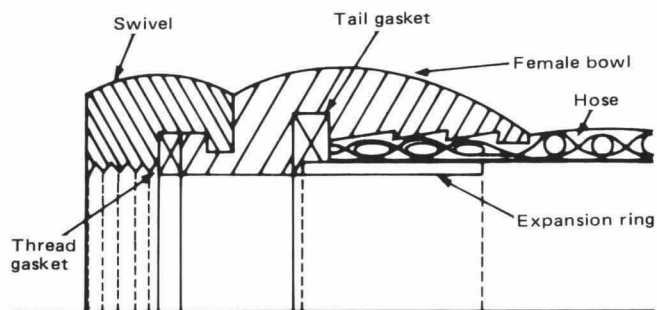


Figure A-4-2.5 Female coupling assembly.

A-4-2.6 A degree of skill and experience is required to properly attach couplings to hose. It is necessary to have good equipment and a mechanic skilled and experienced in attaching couplings. If not, this work should be done by the hose manufacturer.

A-4-3.1 A high-quality synthetic gasket, i.e., Buna N., with antioxidants or neoprene should be used, as natural rubber gaskets may deteriorate with age and will harden and break away from the gasket seat.

A thread gasket with a smaller diameter than that of the recess can cause a leaky connection when pressure is applied. See NFPA 1963, *Standard for Screw Threads and Gaskets for Fire Hose Connections*.

A-4-3.2 If the gasket protrudes at the nozzle connection, it can cause a ragged stream, reducing the effective reach of the nozzle, and, at a coupling, it can cause increased friction loss.

A-5-1.3 Hose meeting the requirements of NFPA 1961, *Standard for Fire Hose*, 1987 or subsequent editions, and hose meeting the requirements of NFPA 1961, *Standard for Fire Hose*, 1979 and prior editions, will probably have different service test pressures.

A-5-2.2 If the hose bursts during the test, the hose test gate valve will not permit a volume surge from the pump. The closed-hose test gate valve will allow just enough water to enter the hose during the test to compensate for dilation and not allow a volume surge from the pump if a hose bursts.

A-5-2.4 The surface on which the hose is laid out should be as smooth as possible. Rough surfaces will accelerate abrasion and hinder proper movement of the hose line.

Hose is tested in lengths not exceeding 300 ft (91 m) to allow the hose to untwist and be straightened out. As the pressure rises, the shorter length will allow the hose to assume a natural elongation, creating less warp in the hose.

It is also important that all the air in the hose be removed. If any point in the hose layout is elevated, air will be trapped at that point. Excessive lengths make it difficult to exhaust all the air. The ideal hose test area is one with a slight upward incline from the pressure source to the

capped end. This allows the air to flow to the capped end and be bled off. There should be no humps or valleys in the hose between the ends, as these will trap air.

A-5-2.6 Air under pressure becomes greatly compressed, and the hose can whip violently if the pressure is suddenly released by a hose burst; also, a blown-off coupling propelled by the compressed air will act like a high-velocity missile.

A-5-2.7 Hose can be expected to stretch when the pressure is increased to the test pressure. Allowance should be made for this stretch when the hose is secured.

A-5-2.14 Rate of increase specified in 5-2.10 should not exceed 250 psig (1720 kPag) in 15 seconds, or 500 psig (3450 kPag) in 30 seconds.

A-5-2.16 Damaged fire hose should not be patched unless such repair is recommended by the manufacturer of the hose and it is performed by properly trained and equipped personnel.

A-5-3.3 To dry linen hose, the following should be considered:

1. Hose should remain at least 24 hours in a hose drier, loosely coiled.
2. Regardless of drying method, the hose should be limp and flexible and retain no degree of stiffness beyond its original rigidity.
3. Do not be misled by the fact that hose is dry on the outside.

A-5-4.1 If booster hose is manufactured in accordance with ANSI/UL 92, *Fire Extinguisher and Booster Hose*, the maximum working pressure will be shown on the cover of the hose.

A-5-4.2 The suction hose vacuum test may be run in conjunction with the annual pumper suction test.

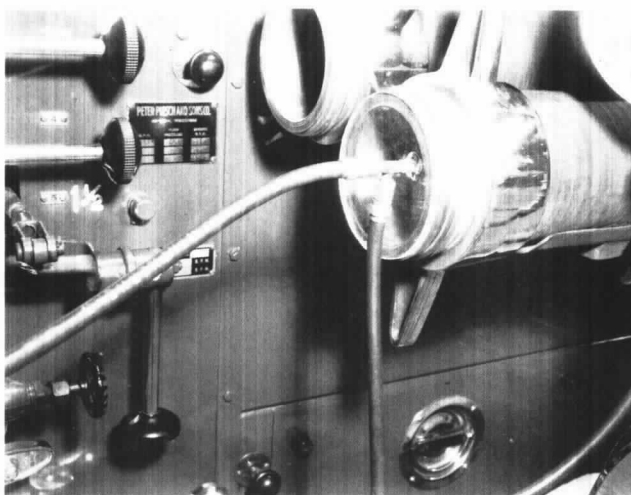


Figure A-5-4.2 Plastic test disk for pumper suction hose. One line runs to the pumper vacuum and the other to a test gauge. A clear plastic disk at the other end used with a light makes it possible to observe if the internal lining is drawn into the waterway. (Courtesy of San Diego Fire Department)

A-5-4.3 Suction hose manufactured in accordance with the 1992 edition of NFPA 1961, *Standard for Fire Hose*, will be marked "FOR VACUUM USE ONLY" if it is designed for use under vacuum only. If the suction hose is designed for use under positive pressure, it will be marked "SERVICE TEST TO (the service test pressure) AND 22 IN. HG. VACUUM PER NFPA 1962."

PVC suction hose is not designed for use under positive pressure. If unmarked suction hose is to be used under positive pressure, the user should check with the manufacturer to be sure the hose is designed for such applications.

Appendix B Referenced Publications

B-1 The following documents or portions thereof are referenced within this standard for informational purposes only and thus are not considered part of the requirements of this document. The edition indicated for each reference is the current edition as of the date of the NFPA issuance of this document.

B-1.1 NFPA Publication. National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 1963, *Standard for Screw Threads and Gaskets for Fire Hose Connections*, 1985 edition

B-1.2 Other Publications.

ASTM E380-91, *Standard for Metric Practice*, American Society for Testing and Materials, 1916 Race Street, Philadelphia, PA 19103.

Purington, R. G., *Fire Fighting Hydraulics*, 1974, 1st edition, pp. 371-373, McGraw-Hill Book Co., New York, NY.

ANSI/UL 92-88, *Fire Extinguisher and Booster Hose*, Underwriters Laboratories, Inc., 333 Pfingsten Rd., Northbrook, IL 60062.

Index

©1993 National Fire Protection Association, All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document which it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of the National Fire Protection Association, Inc.

-A-

Attack hose
 Care and use of 2-1, A-2-1
 Definition 1-3
 Records of 3-1, A-3-1

-B-

Booster hose 2-4, A-2-4.2
 Definition 1-3
 Service testing 5-4, A-5-4
Braided reinforcement
 Definition 1-3

-C-

Cleaning of hose 2-6, A-2-6.1
Coating
 Definition 1-3
Couplings 4-2, A-4-2
Covered hose
 Definition 1-3

-D-

Drying of hose 2-6, A-2-6.3, A-2-7.1

-F-

Fire hose see also specific types such as Attack hose
 Definition 1-3
 Out-of-service 3-1.6, A-3-1.6
Fold
 Definition 1-3

Forestry hose

Care and use of 2-1, A-2-1
 Definition 1-3
 Records for 3-2, A-3-2.1
Frequency of service testing 2-1.1, 2-2.1, 2-3.1, 2-3.2, 2-4.1

-G-

Gaskets 4-3, A-4-3

-H-

Hard suction hose see Suction hose, hard
Hose see Fire hose; specific types of hose

-I-

Identification numbers 3-1.2, A-3-1.2
In-service hose 2-1.1, A-2-1.1
 Definition 1-3
In-storage hose
 Definition 1-3
In-use hose
 Definition 1-3
Inspection of hose 2-5

-L-

Large-diameter hose
 Definition 1-3
Large-diameter supply hose ... 2-1.4 thru 2-1.6, A-2-1.4, A-2-1.6.2
Linen hose 5-3.3, A-5-3.3

- M-**
Maintenance Chap. 2
Measurement, units of 1-4, A-1-4.1
Multiple-jacket construction
 Definition 1-3
- N-**
Nozzles 4-1, A-4-1
- O-**
Occupant-use hose 2-3, A-2-3
 Definition 1-3
 Records of 3-1, A-3-1
Out-of-service hose 3-1.6, A-3-1.6
- P-**
Pressure, service test 5-1, A-5-1.3
Purpose of standard 1-2
- R-**
Record keeping Chap. 3, A-3
 Service tests 5-2.15
Relay-supply hose 2-2, A-2-2
 Definition 1-3
- S-**
Scope of standard 1-1
Service testing Chap. 5, A-5
 Definition 1-3
 Frequency of 2-1.1, 2-2.1, 2-3.1, 2-3.2, 2-4.1
 Pressure 5-1, A-5-1.3
 Procedure 5-2, A-5-2
Single-jacket construction
 Definition 1-3
Spiral reinforcement
 Definition 1-3
Standpipe hose A-2-3
Storage of hose 2-7, A-2-7.1
Suction hose 2-4, A-2-4.2
 Hard
 Definition 1-3
 Service testing 5-4, A-5-4.3
 Soft
 Definition 1-3
Supply hose 2-1, A-2-1
 Care and use of 2-1, A-2-1
 Records for 3-1, A-3-1
- T-**
Tests see Service testing
- U-**
Units of measurement see Measurement, units of
Unlined hose
 Definition 1-3
 Service testing 5-3, A-5-3.3
- V-**
Valves
 Hose test gate 5-2.2, A-5-2.2
 Relay relief A-2-2.7
- W-**
Washing of hose 2-6, A-2-6
Water hammer
 Definition 1-3, A-1-3

FORM FOR PROPOSALS ON NFPA TECHNICAL COMMITTEE DOCUMENTS

Mail to: Secretary, Standards Council

National Fire Protection Association, 1 Batterymarch Park, Quincy, Massachusetts 02269-9101

Fax No. 617-770-3500

Note: All proposals must be received by 5:00 p.m. EST/EDST on the published proposal-closing date.

If you need further information on the standards-making process, please contact the Standards Administration Department at 617-984-7249.

Date 9/18/93 Name John B. Smith Tel. No. 617-555-1212

Company _____

Street Address 9 Seattle St., Seattle, WA 02255

Please Indicate Organization Represented (if any) Fire Marshals Assn. of North America

1. a) NFPA Document Title National Fire Alarm Code NFPA No. & Year NFPA 72, 1993 ed.

b) Section/Paragraph 1-5.8.1 (Exception No.1)

2. Proposal recommends: (Check one) ☐ new text
☐ revised text
☒ deleted text

FOR OFFICE USE ONLY

Log # _____

Date Rec'd _____

3. Proposal (include proposed new or revised wording, or identification of wording to be deleted):

Delete exception.

4. Statement of Problem and Substantiation for Proposal: (Note: State the problem that will be resolved by your recommendation; give the specific reason for your proposal including copies of tests, research papers, fire experience, etc. If more than 200 words, it may be abstracted for publication.)

A properly installed and maintained system should be free of ground faults. The occurrence of one or more ground faults should be required to cause a "trouble" signal because it indicates a condition that could contribute to future malfunction of the system. Ground fault protection has been widely available on these systems for years and its cost is negligible. Requiring it on all systems will promote better installations, maintenance and reliability.

5. ☒ This Proposal is original material. (Note: Original material is considered to be the submitter's own idea based on or as a result of his/her own experience, thought, or research and, to the best of his/her knowledge, is not copied from another source.)

☐ This Proposal is not original material; its source (if known) is as follows: _____

Note 1: Type or print legibly in black ink.

Note 2: If supplementary material (photographs, diagrams, reports, etc.) is included, you may be required to submit sufficient copies for all members and alternates of the technical committee.

I hereby grant NFPA the non-exclusive, royalty-free rights, including non-exclusive, royalty-free rights in copyright, in this proposal and I understand that I acquire no rights in any publication of NFPA in which this proposal in this or another similar or analogous form is used.

John B. Smith
Signature (Required)

PLEASE USE SEPARATE FORM FOR EACH PROPOSAL