

NFPA 24

Installation of Private Fire Service Mains and Their Appurtenances 1987 Edition



NOTICE

All questions or other communications relating to this document should be sent only to NFPA Headquarters, addressed to the attention of the Committee responsible for the document.

For information on the procedures for requesting Technical Committees to issue Formal Interpretations, proposing Tentative Interim Amendments, proposing amendments for Committee consideration, and appeals on matters relating to the content of the document, write to the Secretary, Standards Council, National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

A statement, written or oral, that is not processed in accordance with Section 16 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Users of this document should consult applicable Federal, State and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action which is not in compliance with applicable laws and this document may not be construed as doing so.

Policy Adopted by NFPA Board of Directors on December 3, 1982

The Board of Directors reaffirms that the National Fire Protection Association recognizes that the toxicity of the products of combustion is an important factor in the loss of life from fire. NFPA has dealt with that subject in its technical committee documents for many years.

There is a concern that the growing use of synthetic materials may produce more or additional toxic products of combustion in a fire environment. The Board has, therefore, asked all NFPA technical committees to review the documents for which they are responsible to be sure that the documents respond to this current concern. To assist the committees in meeting this request, the Board has appointed an advisory committee to provide specific guidance to the technical committees on questions relating to assessing the hazards of the products of combustion.

Licensing Provision — This document is copyrighted by the National Fire Protection Association (NFPA).

1. Adoption by Reference — Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders or similar instruments. Any deletions, additions and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. The term "adoption by reference" means the citing of title and publishing information only.

2. Adoption by Transcription — **A.** Public authorities with lawmaking or rule-making powers only, upon written notice to the NFPA (Attention: Secretary, Standards Council), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders or similar instruments having the force of law, provided that: (1) due notice of NFPA's copyright is contained in each law and in each copy thereof; and, (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction's lawmaking or rulemaking process. **B.** Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rulemaking powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Secretary, Standards Council), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately provided that due notice of NFPA's copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rulemaking powers may apply for and may receive a special royalty when the public interest will be served thereby.

3. Scope of License Grant — The terms and conditions set forth above do not extend to the index to this document.

(For further explanation, see the Policy Concerning the Adoption, Printing and Publication of NFPA Documents which is available upon request from the NFPA.)

Statement on NFPA Procedures

This material has been developed under the published procedures of the National Fire Protection Association, which are designed to assure the appointment of technically competent Committees having balanced representation. While these procedures assure the highest degree of care, neither the National Fire Protection Association, its members, nor those participating in its activities accepts any liability resulting from compliance or noncompliance with the provisions given herein, for any restrictions imposed on materials or processes, or for the completeness of the text.

NFPA has no power or authority to police or enforce compliance with the contents of this document and any certification of products stating compliance with requirements of this document is made at the peril of the certifier.

**CHARLES S. MORGAN LIBRARY
NATIONAL FIRE PROTECTION ASSOCIATION
1 BATTERYMARCH PARK
QUINCY, MA 02269-9101**

24-1

© 1987 NFPA, All Rights Reserved

NFPA 24

**Standard for the Installation of
Private Fire Service Mains
and Their Appurtenances**

1987 Edition

This edition of NFPA 24, *Standard for the Installation of Private Fire Service Mains and Their Appurtenances*, was prepared by the Technical Committee on Private Water Supply Piping Systems, released by the Correlating Committee on Water Extinguishing Systems, and acted on by the National Fire Protection Association, Inc. at its Annual Meeting held May 18-21, 1987 in Cincinnati, Ohio. It was issued by the Standards Council on June 10, 1987, with an effective date of June 30, 1987, and supersedes all previous editions.

The 1987 edition of this standard has been approved by the American National Standards Institute.

Changes other than editorial are indicated by a vertical rule in the margin of the pages on which they appear. These lines are included as an aid to the user in identifying changes from the previous edition.

Origin and Development of NFPA 24

In 1903, the NFPA Committee on Hose and Hydrants first presented *Specifications for Mill Yard Hose Houses*, taken substantially from a standard published by the Eastern Factory Insurance Association. This text was revised and adopted in 1904. The NFPA Committee on Field Practice amended the Specifications in 1926, published as NFPA 25.

In 1925 the Committee on Field Practice prepared a *Standard on Outside Protection, Private Underground Piping Systems Supplying Water for Fire Extinguishment*, which was adopted by NFPA. It was largely taken from the 1920 edition of the NFPA *Automatic Sprinkler Standard*, Section M on Underground Pipes and Fittings. In September 1931, a revision was made with the resulting Standard designated as NFPA 24. In the 1981 edition the title was changed from *Standard for Outside Protection* to *Standard for the Installation of Private Fire Service Mains and Their Appurtenances*.

In 1953, on recommendation of the Committee on Standpipes and Outside Protection, the two standards (NFPA 24 and NFPA 25) were completely revised and adopted as NFPA 24. Amendments were made leading to separate editions in 1955, 1959, 1962, 1963, 1965, 1966, 1968, 1969, 1970, 1973, 1977, 1981, 1983, and 1987.

Committee on Water Extinguishing Systems Correlating Committee

Paul D. Smith, Chairman
Gage-Babcock & Assoc., Inc.

John K. Bouchard, Secretary
National Fire Protection Assn.
(Nonvoting)

Wayne E. Ault, Rolf Jensen & Assoc., Inc.
Thomas J. Brown, Jr., Factory Mutual Research Corp.
Casimir J. Drygas, Jr., M&M Protection Consultants

Robert H. Merz, Moorestown, NJ
James W. Nolan, James W. Nolan Co.
Chester W. Schirmer, Schirmer Engineering Corp.
J. Samuel Slicer, W. Chatham, MA

Technical Committee on Private Water Supply Piping Systems

J. Samuel Slicer, Chairman
W. Chatham, MA

Kerry M. Bell, Underwriters Laboratories Inc.
Frank E. Cann, Jr., Grinnell Fire Protection Systems Co., Inc.
Kenneth J. Carl, Baldwin, NY
Manuel J. DeLerno, S-P-D Industries, Inc.
Rep. Illinois Fire Prevention Assn.
Marshall A. Klein, Marshall A. Klein & Assoc., Inc.
Richard Martineau, Mid Hudson Automatic Sprinkler Corp.
Rep. NFSA
Robert H. Merz, Moorestown, NJ
David S. Mowrer, Professional Loss Control, Inc.

Heinz E. Otte, Waterous Co.
Rep. Mfrs. Standardization Society
David O. Rogers, Alexander & Alexander, Inc.
Peter K. Schontag, Pacific Gas & Electric Co.
Rep. EEI
J. William Sheppard, General Motors Corp.
Rep. NFPA Industrial Fire Protection Section
Troy F. Stroud, Ductile Iron Pipe Research Assn.
James G. Whitelaw, Febco Sales, Inc.
William E. Wilcox, Factory Mutual Research Corp.
Fred S. Winters, Wausau Insurance Companies
Rep. Alliance of American Insurers

Alternates

Lee J. Dosedlo, Underwriters Laboratories Inc.
(Alternate to K. M. Bell)
Russell P. Fleming, Nat'l. Fire Sprinkler Assn.
(Alternate to R. Martineau)
Richard A. Hennie, Union Camp Corp.
(Alternate to J. W. Sheppard)

Richard D. Jacobson, Factory Mutual Research Corp.
(Alternate to W. E. Wilcox)
Michael L. Johnson, Sprinklerfitters Local Union 669
(Alternate to Sprinklerfitters Union Rep.)
Peter R. Yurkonis, Rolf Jensen & Assoc. Inc.
(Alternate to R. J. & Assoc. Rep.)

This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in the membership may have occurred.

NOTE: Membership on a Committee shall not in and of itself constitute an endorsement of the Association or any document developed by the Committee on which the member serves.

Contents

Chapter 1 General Information	24- 5
1-1 Scope	24- 5
1-2 Purpose	24- 5
1-3 Definitions	24- 5
1-4 Plans	24- 5
1-5 Installation Work	24- 6
1-6 Units	24- 6
Chapter 2 Water Supplies	24- 6
2-1 Nature of Supply	24- 6
2-2 Public Water Systems	24- 6
2-3 Pumps	24- 6
2-4 Tanks	24- 6
2-5 Penstocks or Flumes, Rivers or Lakes	24- 6
2-6 Fire Department Connections	24- 6
Chapter 3 Valves	24- 7
3-1 Types of Valves	24- 7
3-2 Valves Controlling Water Supplies	24- 7
3-3 Post Indicator Valves	24- 7
3-4 Valves in Pits	24- 8
3-5 Sectional Valves	24- 8
3-6 Identifying and Securing	24- 8
Chapter 4 Hydrants	24- 8
4-1 General	24- 8
4-2 Number and Location	24- 8
4-3 Installation and Maintenance	24- 8
Chapter 5 Hose Houses and Equipment	24- 9
5-1 General	24- 9
5-2 Location	24- 9
5-3 Construction	24- 9
5-4 Size and Arrangement	24- 9
5-5 Marking	24- 9
5-6 Equipment—General	24- 9
5-7 Domestic Service Use Prohibited	24- 9
Chapter 6 Master Streams	24- 9
6-1 General	24- 9
6-2 Application	24- 9
6-3 Special Consideration	24- 9
Chapter 7 Pipe and Fittings	24- 9
7-1 Selection of Pipe	24- 9
7-2 Coating and Lining of Pipe	24-10
7-3 Joints	24-10
7-4 Fittings	24-10
7-5 Sizes of Pipe	24-10
Chapter 8 Rules for Laying Pipe	24-10
8-1 Depth of Cover	24-10
8-2 Protection Against Freezing	24-10
8-3 Protection Against Damage	24-10
8-4 Care in Laying	24-10
8-5 Pipe Joint Assembly	24-11

8-6 Anchoring Fire Mains	24-11
8-7 Backfilling	24-12
8-8 Flushing	24-12
8-9 Testing Underground System	24-12
Chapter 9 Referenced Publications	24-13
Appendix A	24-14
Appendix B Referenced Publications	24-25
Index	24-26

NFPA 24

Standard for the Installation of Private Fire Service Mains and Their Appurtenances

1987 Edition

NOTICE: An asterisk (*) following the number or letter designating a subdivision indicates explanatory material on that subdivision in Appendix A.

Information on referenced publications can be found in Chapter 9 and Appendix C.

Chapter 1 General Information

1-1 Scope. This standard establishes the minimum requirements for installation of private fire service mains and their appurtenances supplying automatic sprinkler systems, open sprinkler systems, water spray fixed systems, foam systems, private hydrants, monitor nozzles or standpipe systems with references to water supplies, private hydrants, and hose houses. This standard also applies to "combined service mains" used to carry water for both fire service and other use. The authority having jurisdiction shall always be consulted before installation or remodeling of private fire service mains.

1-2 Purpose. The purpose of this standard is to provide a reasonable degree of protection for life and property from fire through installation requirements for private fire service main systems based upon sound engineering principles, test data, and field experience. Nothing in this standard is intended to restrict new technologies or alternate arrangements, providing the level of safety prescribed by the standard is not lowered.

1-3 Definitions.

Approved. Means "acceptable to the authority having jurisdiction."

NOTE: The National Fire Protection Association does not approve, inspect or certify any installations, procedures, equipment, or materials nor does it approve or evaluate testing laboratories. In determining the acceptability of installations or procedures, equipment or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization concerned with product evaluations which is in a position to determine compliance with appropriate standards for the current production of listed items.

Authority Having Jurisdiction. The "authority having jurisdiction" is the organization, office or individual responsible for "approving" equipment, an installation or a procedure.

NOTE: The phrase "authority having jurisdiction" is used in NFPA documents in a broad manner since jurisdictions and "approval" agencies vary as do their responsibilities. Where public

safety is primary, the "authority having jurisdiction" may be a federal, state, local or other regional department or individual such as a fire chief, fire marshal, chief of a fire prevention bureau, labor department, health department, building official, electrical inspector, or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the "authority having jurisdiction." In many circumstances the property owner or his designated agent assumes the role of the "authority having jurisdiction"; at government installations, the commanding officer or departmental official may be the "authority having jurisdiction."

Listed. Equipment or materials included in a list published by an organization acceptable to the "authority having jurisdiction" and concerned with product evaluation, that maintains periodic inspection of production of listed equipment or materials and whose listing states either that the equipment or material meets appropriate standards or has been tested and found suitable for use in a specified manner.

NOTE: The means for identifying listed equipment may vary for each organization concerned with product evaluation, some of which do not recognize equipment as listed unless it is also labeled. The "authority having jurisdiction" should utilize the system employed by the listing organization to identify a listed product.

Private Fire Service Main.* Private fire service main, as used in this standard, is that pipe and its appurtenances on private property between a source of water and the base of the riser (flange or flange and spigot piece or base tee) for automatic sprinkler systems, open sprinkler systems, water spray fixed systems, standpipe systems, inlets to foam making systems, or the base elbow of private hydrants or monitor nozzles. When connected to a public water system, the private service main begins at a point designated by the public water utility, usually at a manually operated valve near the property line. When connected to fire pumps, the main begins at the fire protection system side of the pump discharge valve. When connected to a gravity or pressure tank, the main begins at the inlet side of the tank's check valve.

Shall. Indicates a mandatory requirement.

Should. Indicates a recommendation or that which is advised but not required.

Standard. A document containing only mandatory provisions using the word "shall" to indicate requirements. Explanatory material may be included only in the form of "fine print" notes, in footnotes, or in an appendix.

1-4* Plans.

1-4.1 A layout plan shall be approved by the authority having jurisdiction in every case where new private fire service main is contemplated.

1-4.2 The plan shall be drawn to scale and shall include all essential details such as:

- (a) Size and location of all water supplies.
- (b) Size and location of all piping, indicating, where possible, the class and type and depth of existing pipe, the class and type of new pipe to be installed and the depth to which it is to be buried.

(c) Size, type, and location of valves. Indicate if located in pit or if operation is by post indicator or key wrench through a curb box. Indicate the size, type, and location of meters, regulators, and check valves.

(d) Size and location of hydrants, showing size and number of outlets and if outlets are to be equipped with independent gate valves. Indicate if hose houses and equipment are to be provided and by whom.

(e) Sprinkler and standpipe risers and monitor nozzles to be supplied by the system.

(f) Location of fire department connections, if part of private fire service main system, including detail of connections.

1-5 Installation Work. Installation work shall be done by fully experienced and responsible persons.

1-6 Units. Metric units of measurement in this standard are in accordance with the modernized metric system known as the International System of Units (SI). Two units (liter and bar), outside of but recognized by SI, are commonly used in international fire protection. These units are listed in Table 1-6 with conversion factors.

Table 1-6

Name of Unit	Unit Symbol	Conversion Factor
liter	L	1 gal = 3.785 L
liter per minute per square meter	(L/min)/m ²	1 gpm/ft ² = (40.746 L/min)/m ²
cubic decimeter	dm ³	1 gal = 3.785 dm ³
Pascal	Pa	1 psi = 6894.757 Pa
bar	bar	1 psi = 0.0689 bar
bar	bar	1 bar = 10 ⁵ Pa

For additional conversions and information, see ASTM E380-1979, *Standard for Metric Practice*.

1-6.1 If a value for measurement as given in this standard is followed by an equivalent value in other units, the first stated is to be regarded as the requirement. A given equivalent value may be approximate.

1-6.2 The conversion procedure for the SI units has been to multiply the quantity by the conversion factor and then round the result to the appropriate number of significant digits.

Chapter 2 Water Supplies

2-1 Nature of Supply. The choice of water supplies shall be made in cooperation with the authority having jurisdiction.

2-2 Public Water Systems. (Applicable also to private supply systems.)

2-2.1 One or more connections from a reliable public water system of good pressure and adequate capacity fur-

nishes a satisfactory supply. A high static water pressure shall not, however, be the criterion by which the efficiency of the supply is determined.

2-2.2 Adequacy of water supply shall be determined by flow tests or other reliable means. Where flow tests are made, the flow in gallons per minute (L/min) together with the static and residual pressures shall be indicated on the plan.

2-2.3* Public mains shall be of ample size, in no case smaller than 6 in.

2-2.4 No pressure regulating valve shall be used in water supply except by special permission of the authority having jurisdiction. Where meters are used they shall be of an approved type.

2-2.5* Where connections are made from public waterworks systems, it may be necessary to guard against possible contamination of the public supply. The requirements of the public health authority having jurisdiction shall be determined and followed.

2-2.6 Connections larger than 2 in. to public water systems shall be controlled by post indicator valves of a standard type and located not less than 40 ft (12.2 m) from the buildings protected.

Exception: If this cannot be done, the post indicator valves shall be placed where they will be readily accessible in case of fire and not liable to injury. (See Section 3-3 for details.) Where post indicator valves cannot readily be used, as in a city block, underground valves shall conform to these provisions and their locations and direction of turning to open shall be clearly marked.

2-3* Pumps. A fire pump installation consisting of pump, driver, and suction supply, when of adequate capacity and reliability and properly located, makes a good supply. An automatically controlled fire pump taking water from a water main of adequate capacity or taking draft under a head from a reliable storage of adequate capacity, may, under certain conditions, be accepted by the authority having jurisdiction as a single supply.

2-4* Tanks. When gravity, pressure, or suction tanks are to be used, the authority having jurisdiction shall be consulted.

2-5 Penstocks or Flumes, Rivers or Lakes. Water supply connections from penstocks, flumes, rivers, lakes, or reservoirs shall be arranged to avoid mud and sediment, and shall be provided with approved double removable screens or approved strainers installed in an approved manner.

2-6* Fire Department Connections.

2-6.1 A connection through which the public fire department can pump water into the sprinkler, standpipe, or other system furnishing water for fire extinguishment makes a desirable auxiliary supply. For this purpose, one or more fire department connections shall be provided.

Exception: Omission of fire department connections may be allowed by the authority having jurisdiction.

2-6.2 Fire department connections shall be properly supported.

2-6.3 There shall be no shutoff valve in the fire department connection.

2-6.4 An approved straightway check valve shall be installed in each fire department connection, located as near as practicable to the point where it joins the system.

2-6.5 The pipe between the check valve and the outside hose coupling shall be equipped with an approved automatic drip, arranged to discharge to a proper place.

2-6.6 Hose connections shall be of an approved type.

2-6.7 The fire department connection(s) shall have the NH internal threaded swivel fitting(s) having the NH standard thread, at least one of which shall be the 2.5-7.5 NH standard thread, as specified in NFPA 1963, *Standard for Screw Threads and Gaskets for Fire Hose Connections*.

Exception: Where local fire department connections do not conform to NFPA 1963, Standard for Screw Threads and Gaskets for Fire Hose Connections, the authority having jurisdiction shall designate the connection to be used.

2-6.8 Hose connections shall be equipped with standard caps, properly secured and arranged for easy removal by fire departments.

2-6.9 Hose connections shall be on the street side of buildings and shall be located and arranged so that hose lines can be readily and conveniently attached to the inlets without interference from any nearby objects including buildings, fences, posts, or other fire department connections.

2-6.10 Signs.

2-6.10.1 Hose connections shall be designated by a sign having raised letters at least 1 in. (25.4 mm) in size cast on a plate or fitting, reading for service designated: i.e., "AUTO SPKR." or "OPEN SPKR." or "STANDPIPE," etc.

2-6.10.2 If a hose connection does not serve all of the system an appropriate and durable sign shall be attached.

Chapter 3 Valves

3-1 Types of Valves.

3-1.1 All control valves shall be listed indicating type unless a nonindicating valve, such as an underground gate valve with approved roadway box complete with T-wrench, is acceptable to the authority having jurisdiction.

Such valves shall not close in less than 5 seconds when

operated at maximum possible speed from the fully open position. This is to avoid damage to piping by water hammer.

The following may not incorporate indicating devices as part of the valve, but the valve assembly described shall qualify as an indicating valve.

(a) An underground gate valve of listed type equipped with a listed indicator post.

(b) A listed water control valve assembly which has a reliable position indication connected to a remote supervisory station.

3-1.2 Check valves shall be listed.

3-2 Valves Controlling Water Supplies.

3-2.1 At least one control valve shall be installed in each source of water supply except fire department connections.

3-2.2 Where there is more than one source of water supply, a check valve shall be installed in each connection, except that, where cushion tanks are used with automatic fire pumps, no check valve is required in the cushion tank connection.

3-2.3* A control valve shall be installed on each side of each check valve, except that, in the discharge pipe from a pressure tank or a gravity tank of less than 15,000 gal (56.78 m³) capacity, no control valve need be installed on the tank side of the check valve.

3-2.4* Where a gravity tank is located on a tower in the yard, the control valve on the tank side of the check valve shall be an outside screw and yoke or listed indicating valve; the other shall be either an outside screw and yoke, listed indicating or a listed valve having a post type indicator. Where a gravity tank is located on a building, both control valves shall be outside screw and yoke or listed indicating valves; and all fittings inside the building, except the drain tee and heater connections, shall be under the control of a listed valve.

3-2.5* When a pump is located in a combustible pump house or exposed to danger from fire or falling walls, or when a tank discharges into a private fire service main fed by another supply, either the check valve in the connection shall be located in a pit or the control valve shall be of the post indicator type located a safe distance outside buildings.

3-2.6 All control valves shall be located where readily accessible and free from obstructions.

3-3 Post Indicator Valves.

3-3.1* Every connection from the private fire service main to a building shall be provided with a listed indicating valve so located as to control all sources of water supply except fire department connections when arranged as specified in Section 2-6.

Exception: Omission of the post indicator may be allowed by the authority having jurisdiction in accordance with the provisions of 3-1.1 and 3-4.1.

3-3.2 Post indicator valves shall be located not less than 40 ft (12.2 m) from buildings.

Exception: When post indicator valves cannot be placed at this distance, they may be located closer, or wall post indicator valves used provided they are set in locations by blank walls where the possibility of injury by falling walls is small and from which people are not likely to be driven by smoke or heat. Usually, in crowded plant yards, they can be placed beside low buildings, near brick stair towers, or at angles formed by substantial brick walls which are not likely to fall.

3-3.3 Post indicator valves shall be set so that the top of the post will be 36 in. (0.9 m) above the final grade.

3-3.4 Post indicator valves shall be properly protected against mechanical damage where needed.

3-4 Valves in Pits.

3-4.1 Where it is impracticable to provide a post indicator valve, valves may be placed in pits through permission of the authority having jurisdiction.

3-4.2* When used, valve pits shall be of adequate size and readily accessible for inspection, operation, testing, maintenance, and removal of equipment contained therein. They shall be constructed and arranged to properly protect the installed equipment from movement of earth, freezing, and accumulation of water. Poured-in-place or precast concrete, with or without reinforcement, or brick (all depending upon soil conditions and size of pit) are appropriate materials for construction of valve pits. Other approved materials may be used. Where the water table is low and the soil is porous, crushed stone or gravel may be used for the floor of the pit. See Figures A-2-6(b) and A-2-6(c) for suggested arrangements.

Valve pits located at or near the base of the riser of an elevated tank shall be designed in accordance with Chapter 9 of NFPA 22, *Standard for Water Tanks for Private Fire Protection*.

3-4.3 The location of the valve shall be clearly marked and the cover of the pit shall be kept free of obstructions.

3-5 Sectional Valves.

3-5.1 Large private fire service main systems shall have sectional controlling valves at appropriate points, in order to permit sectionalizing the system in the event of a break, or for the making of repairs or extensions.

3-5.2 A valve shall be provided on each bank where a main crosses water, and outside the building foundation(s) where the main or section of main runs under a building (see 8-3.1).

3-6 Identifying and Securing. Identification signs shall be provided at each valve to indicate its function and what it controls. To assure that valves are kept open, see Chapter 6 of NFPA 26, *Recommended Practice for the Supervision of Valves Controlling Water Supplies for Fire Protection*.

Chapter 4 Hydrants

4-1* General.

4-1.1 Hydrants shall be of an approved type and shall have not less than a 6-in. connection with the mains. A valve shall be installed in the hydrant connection. The number, size, and arrangement of outlets, the size of main valve opening, and the size of barrel shall be suitable for the protection to be provided and shall be approved by the authority having jurisdiction. Independent gate valves on 2½-in. outlets may be used. (See Chapter 5.)

4-1.2 Hydrant outlet threads shall have the NH standard external threads for the size outlet(s) supplied as specified in NFPA 1963, *Standard for Screw Threads and Gaskets for Fire Hose Connections*.

Exception: Where local fire department connections do not conform to NFPA 1963, Standard for Screw Threads and Gaskets for Fire Hose Connections, the authority having jurisdiction shall designate the connection to be used.

4-2 Number and Location.

4-2.1 Hydrants shall be provided in sufficient number and be located in a manner that will enable the fire flow needed to be delivered through hose lines about any important structure. The fire flow needed and the hydrant locations shall be determined by the authority having jurisdiction, but in no case shall hose lengths be greater than 500 ft (152.5 m). Public hydrants are recognized as meeting all or part of the above requirements.

NOTE: Fire department pumpers will normally be required to augment the pressure available from public hydrants.

4-2.2* For average conditions, hydrants shall be placed at least 40 ft (12.2 m) from the buildings protected.

Exception: When hydrants cannot be placed at this distance, they may be located closer, or wall hydrants used (see Figure A-4-2.2) provided they are set in locations by blank walls where the possibility of injury by falling walls is small and from which people are not likely to be driven by smoke or heat. Usually, in crowded plant yards, they can be placed beside low buildings, near brick stair towers or at angles formed by substantial brick walls which are not likely to fall.

4-2.3 Hydrants shall not be placed near retaining walls where there is danger of frost through the walls.

4-3 Installation and Maintenance.

4-3.1 Hydrants shall be set on flat stones or concrete slabs and, if necessary, shall be provided with sufficient small stones (or equivalent) placed about the drain to ensure quick drainage.

4-3.2 Where soil is of such a nature that the hydrants will not drain properly with the arrangement specified in 4-3.1, or ground water stands at levels above that of the drain, the hydrant drain shall be plugged at the time of installation. If drain is plugged, hydrants in service in cold climates shall be pumped out after usage. Such

hydrants shall be marked to indicate the need for pumping out after usage.

4-3.3* The center of a hose outlet shall be not less than 12 in. (305 mm) above final grade, or when located in a hose house, 12 in. (305 mm) above the floor.

4-3.4 Hydrants shall be fastened to piping by standard clamps or be properly anchored.

4-3.5 Hydrants shall be protected if subject to mechanical damage. The means of protection shall be arranged in a manner which will not interfere with the connection to or operation of hydrants.

4-3.6* To assure proper functioning, wet barrel hydrants shall be tested at least annually, and dry barrel hydrants tested semiannually in the early spring and fall, in accordance with the requirements of the authority having jurisdiction.

Chapter 5 Hose Houses and Equipment

5-1 General.

5-1.1* An adequate supply of hose and equipment shall be provided when hydrants are intended for use by plant personnel or a fire brigade. The quantity and type of hose and equipment will depend upon the number and location of hydrants relative to the protected property, the extent of the hazard, and the fire fighting capabilities of the potential users. The authority having jurisdiction shall be consulted.

5-1.2* Hose shall conform to NFPA 1961, *Standard for Fire Hose*.

5-1.3* Hose shall be stored so it is readily accessible and is protected from the weather. This may be done by storing hose in hose houses or by locating hose reels or hose carriers in weatherproof enclosures.

5-1.4 Hose Couplings. Hose coupling threads shall conform to the NH standard threads, as specified in NFPA 1963, *Standard for Screw Threads and Gaskets for Fire Hose Connections*.

Exception: Where local fire department connections do not conform to NFPA 1963, Standard for Screw Threads and Gaskets for Fire Hose Connections, the authority having jurisdiction shall designate the connections to be used.

5-2 Location.

5-2.1 When hose houses are used, they shall either be located over the hydrant or immediately nearby. Hydrants within hose houses shall be as close to the front of the house as possible and still allow sufficient room in back of the doors for the hose gates and the attached hose.

5-2.2 When hose reels or hose carriers are used, they shall be located so that the hose may be brought quickly into use at a hydrant.

5-3 Construction. Hose houses shall be of substantial construction on adequate foundations. The construction shall be such as to protect the hose from weather and vermin and designed so that hose lines can be quickly brought into use. Clearance shall be provided for proper operation of the hydrant wrench. Proper ventilation shall be provided. The exterior shall be painted or otherwise suitably protected against deterioration.

5-4* Size and Arrangement. Hose houses shall be of a size and arrangement to provide shelves or racks for the hose and equipment. For equipment details of hose houses, see Section 5-6 and 5-1.4.

5-5 Marking. Hose houses shall be plainly identified.

5-6 Equipment—General.

5-6.1* When hose houses are used in addition to the hose, each shall be equipped with:

2-Approved adjustable-spray solid-stream nozzles equipped with shutoffs for each size of hose provided

1-Hydrant wrench (in addition to wrench on hydrant)

4-Coupling spanners for each size hose provided

2-Hose coupling gaskets for each size hose.

5-6.1.1 Where two sizes of hose and nozzles are provided, reducers or gated wyes shall be included in the hose house equipment.

5-7 Domestic Service Use Prohibited. The use of hydrants and hose for purposes other than fire-related services shall be prohibited.

Chapter 6 Master Streams

6-1* General. Master streams are delivered by monitor nozzles, hydrant-mounted monitor nozzles, or portable deluge sets capable of delivering more than 250 gpm (946 L/min).

6-2 Application. Master streams shall be provided as protection for large amounts of combustible materials located in yards, average amounts of combustible materials in inaccessible locations or occupancies presenting special hazards as required by the authority having jurisdiction.

6-3 Special Consideration. The location of this apparatus, the size of piping supplying it, the arrangement of control valves, and the necessary water supplies all demand special considerations in each individual case, and the authority having jurisdiction shall be consulted.

Chapter 7* Pipe and Fittings

7-1 Selection of Pipe.

7-1.1* Piping. Piping shall be listed for fire protection service and comply with AWWA standards, where applicable.

7-1.2* The type and class of pipe for a particular installation shall be determined through consideration of its fire resistance, the maximum working pressure, the laying conditions under which the pipe is to be installed, soil conditions, corrosion, and susceptibility of pipe to other external loads, including earth loads installation beneath buildings and traffic or vehicle loads.

7-1.3 Pipe used in private fire service shall be designed to withstand a working pressure of not less than 150 psi (10.3 bars).

7-2* Coating and Lining of Pipe. All ferrous metal pipe shall be lined, and steel pipe shall be coated and wrapped with joints field-coated and wrapped after assembly. Galvanizing does not meet the requirements of this section.

7-3* Joints. Joints shall be of an approved type.

7-4* Fittings. Fittings shall be of an approved type with joints and pressure class ratings compatible with the pipe used. Steel pipe fittings shall be coated, wrapped, and lined.

7-5 Sizes of Pipe.

7-5.1* No pipe smaller than 6 in. in diameter shall be installed as a private service main.

Exception: For mains that do not supply hydrants, sizes smaller than 6 in. may be used subject to the following restrictions:

1. *The main supplies only automatic sprinkler systems, open sprinkler systems, water spray fixed systems, foam systems, or Class II standpipe systems.*
2. *Hydraulic calculations show that the main will supply the total demand at the appropriate pressure.*
3. *Main size shall be at least as large as the riser.*

7-5.2 The size of the private fire service mains supplying fire protection systems shall be approved by the authority having jurisdiction, with due consideration being given to the construction and occupancy of the plant, to the fire flow and pressure of water required, and to the adequacy of the supply.

7-5.3* For purposes of estimating friction loss, see A-7-5.3.

Chapter 8* Rules for Laying Pipe

8-1 Depth of Cover.

8-1.1* The depth of cover over water pipes shall be determined by the maximum depth of frost penetration in the locality where the pipe is laid. The top of the pipe shall be buried not less than 1 ft (0.3 m) below the frost line for the locality. In those locations where frost is not a factor, the depth of cover shall be not less than 2½ ft (0.8 m) to prevent mechanical injury. Pipe under driveways shall be buried a minimum of 3 ft (0.9 m) and under railroad tracks a minimum of 4 ft (1.2 m). (See A-8-1.1.)

8-1.2 Depth of covering shall be measured from top of pipe to finished grade, and due consideration shall always be given to future or final grade and nature of soil.

8-2 Protection Against Freezing.

8-2.1 Where it is impracticable to bury pipe, it may be laid aboveground, provided the pipe is protected against freezing and mechanical injury, to the satisfaction of the authority having jurisdiction.

8-2.2 Pipes shall not be placed over water raceways or near embankment walls without special attention being given to protection against frost.

8-2.3 Where pipe is laid in water raceways or shallow streams, care shall be taken that there will be sufficient depth of running water between the pipe and the frost line during all seasons of frost; a safer method is to bury the pipe one foot or more under the bed of the waterway. Care shall also be taken to keep the pipe back from the banks a sufficient distance to avoid any danger of freezing through the side of the bank above the water line. Pipe shall be buried below frost line where entering the water.

8-3 Protection Against Damage.

8-3.1 Pipe shall not be run under buildings.

Exception: When absolutely necessary to run pipe under buildings, special precautions shall be taken which include arching the foundation walls over the pipe, running pipe in covered trenches, and providing valves to isolate sections of pipe under buildings. (See 3-5.2.)

8-3.2 Where a riser is close to building foundations, underground fittings of proper design and type shall be used to avoid pipe joints being located in or under the foundations.

8-3.3 Mains running under railroads carrying heavy trucking, under large piles of heavy commodities, or in areas subjecting the main to heavy shock and vibrations shall be subjected to an evaluation of the specific loading conditions and suitably protected, if necessary. (See 7-1.2.)

8-3.4* When it is necessary to join metal pipe with pipe of dissimilar metal, the joint shall be insulated, by an approved method, against the passage of an electric current.

8-3.5 In no case shall the pipe be used for grounding of electrical services.

8-4 Care in Laying.

8-4.1 Pipes, valves, hydrants, and fittings shall be inspected for damage when received and shall be inspected prior to installation. Bolted joints shall be checked for proper torquing of bolts. Pipe, valves, hydrants, and fittings shall be clean inside. When work is stopped, open ends shall be plugged to prevent stones and foreign materials from entering.

8-4.2 All pipe, fittings, valves, and hydrants shall be carefully lowered into the trench with suitable equip-

ment. They shall be carefully examined for cracks or other defects while suspended above the trench immediately before installation. Plain ends shall be inspected with special attention as these ends are the most susceptible to damage. Under no circumstances shall water main materials be dropped or dumped. Pipe shall not be rolled or skidded against other pipe materials.

8-4.3 Pipes shall bear throughout their full length and shall not be supported by the bell ends only or by blocks.

Exception: If ground is soft, or of a quicksand nature, special provisions shall be made for supporting pipe. For ordinary conditions of soft ground, longitudinal wooden stringers with cross ties will give good results.

8-4.4 Valves and fittings used with nonmetallic pipe shall be properly supported and anchored in accordance with the manufacturer's specifications.

8-5 Pipe Joint Assembly.

8-5.1 Joints shall be assembled by persons familiar with the particular materials being used and in accordance with the manufacturer's instructions and specifications.

8-5.2 All bolted joint accessories shall be cleaned and thoroughly coated with asphalt or other corrosion-retarding material after installation.

8-6 Anchoring Fire Mains.

8-6.1 Except for the case of welded joints and approved special restrained joints, such as provided by approved mechanical joint retainer glands or locked mechanical and push-on joints, the usual joints for underground pipe and fittings are expected to be held in place by the soil in which the pipe is buried. Gasketed push-on and mechanical joints without special locking devices have limited ability to resist separation due to movement of the pipe. All tees, plugs, caps, bends, and hydrant branches on pipe installed underground shall be restrained against movement.

8-6.2* Methods of Anchoring Fire Mains.

8-6.2.1 Pipe clamps and tie-rods, thrust blocks, locked mechanical or push-on joints, mechanical joints utilizing set screw retainer glands, or other approved methods or devices shall be used. The type of pipe, soil conditions, and available space determine the method.

8-6.2.2 Sizing the Clamps, Rods, Bolts, and Washers.

(a) Clamps shall be ½ by 2 in. (12.7 by 50.8 mm) for pipe 4 to 6 in.; ⅝ by 2½ in. (15.9 by 63.5 mm) for pipe 8 and 10 in.; ⅞ by 3 in. (15.9 by 76.2 mm) for pipe 12 in. Bolt holes shall be ⅛ in. (1.6 mm) diameter larger than bolts.

(b) Minimum rod size shall be ⅝ in. (15.9 mm) diameter. Table 8-6.2.2(b) gives numbers of various diameter rods required for a given pipe size. When using bolting rods, the diameter of mechanical joint bolts limits the size of rods to ¾ in. (19.1 mm).

When using clamps, rods shall be used in pairs, two to a clamp.

Exception: Assemblies in which an anchor is made by means of two clamps canted on the barrel of the pipe may use one rod per clamp if approved for the specific installation by the authority having jurisdiction.

When using combinations of rods greater in number than two, the rods shall be symmetrically spaced.

Table 8-6.2.2(b)
Rod Number — Diameter Combinations

Pipe Size inches	Number of Rods			
	⅝ in. (15.9 mm)	¾ in. (19.1 mm)	⅞ in. (22.2 mm)	1 in. (25.4 mm)
4	2	—	—	—
6	2	—	—	—
8	3	2	—	—
10	4	3	2	—
12	6	4	3	2
14	8	5	4	3
16	10	7	5	4

Table has been derived using pressure of 225 psi (15.5 bars) and design stress of 25,000 psi (172.4 MPa).

(c) Clamp bolts shall be ⅝ in. (15.9 mm) diameter for pipe 4, 6, and 8 in.; ¾ in. (19.1 mm) diameter for pipe 10 in. and ⅞ in. (22.2 mm) diameter for pipe 12 in.

(d) Washers may be cast-iron or steel, round or square. Dimensions for cast-iron washers shall be ⅝ by 3 in. (15.9 by 76.2 mm) for pipe 4, 6, 8, and 10 in. and ¾ by 3½ in. (19.1 by 88.9 mm) for pipe 12 in. Dimensions for steel washers shall be ½ by 3 in. (12.7 by 76.2 mm) for pipe 4, 6, 8, and 10 in. and ½ by 3½ in. (12.7 by 88.9 mm) for 12 in. Holes shall be ⅝ in. (3.2 mm) diameter larger than rods.

8-6.2.3 Sizes of Anchor Straps for Tees. Straps shall be ⅝ in. (15.9 mm) thick and 2½ in. (63.5 mm) wide for pipe 4, 6, 8, and 10 in.; ⅞ in. (15.9 mm) thick and 3 in. (76.2 mm) wide for pipe 12 in. Rod holes shall be ⅛ in. (1.6 mm) diameter larger than rods. Dimensions in inches (mm) for straps are suitable either for mechanical or push-on joint tee fittings.

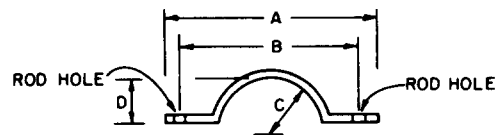


Figure 8-6.2.3 Anchor Straps for Tees.

Table 8-6.2.3 Anchor Straps for Tees

Pipe Size	A		B		C		D	
	In.	mm	In.	mm	In.	mm	In.	mm
4	12½	318	10⅞	257	2½	64	1¾	44
6	14½	368	12⅞	308	3⅞	90	2⅞	71
8	16¾	425	14⅞	365	4⅞	118	3⅞	99
10	19⅞	484	16⅞	424	5¾	146	5	127
12	22⅞	567	19⅞	487	6¾	171	5⅞	149

8-6.2.4 Sizes of Plug Strap for Bell End of Pipe. Strap shall be ¾ in. (19.1 mm) thick, 2½ in. (63.5 mm) wide. Strap length is the same as dimension A for tee

straps given in Figure 8-6.2.3; distance between centers of rod holes is the same as dimension *B* for tee straps.

8-6.2.5* Material used for clamps, rods, rod couplings or turnbuckles, bolts, washers, anchor straps, and plug straps shall be of material having physical and chemical characteristics such that its deterioration under stress can be predicted with reliability.

8-6.2.6 After installation, rods, nuts, bolts, washers, clamps, and other restraining devices except thrust blocks shall be cleaned and thoroughly coated with a bituminous or other acceptable corrosion-retarding material.

8-6.2.7 Thrust blocks are satisfactory where soil is suitable. Table 8-6.2.7 gives bearing areas against undisturbed vertical wall of a trench in soil equivalent to sand and gravel cemented with clay. For other soils, the values in the table shall be multiplied by an appropriate factor. (See Table A-8-6.2.8.)

8-6.2.8* Thrust blocks or other suitable means of thrust restraint shall be provided at each change in the direction of a pipeline and at all tees, plugs, caps, and bends. The thrust blocks shall be of concrete of a mix not leaner than one part cement, two and one-half parts sand, and five parts stone. Backing shall be placed between undisturbed earth and the fitting to be anchored and shall be of such bearing area as to assure adequate resistance to the thrust to be encountered. In general, backing shall be so placed that the joints will be accessible for inspection and repair. Thrust blocks are not suitable for vertical pipe.

Table 8-6.2.7
Area of Bearing Face of Concrete Thrust Blocks

Pipe Size In.	1/4 Bend Sq Ft	m ²	1/2 Bend Sq Ft	m ²	Tees, Plugs, Caps and Hydrants Sq Ft	m ²
4	2	0.19	2	0.19	2	0.19
6	5	0.46	3	0.28	4	0.37
8	8	0.74	5	0.46	6	0.56
10	13	1.21	7	0.65	9	0.84
12	18	1.67	10	0.93	13	1.21
14	25	2.32	14	1.30	18	1.67
16	32	2.97	18	1.67	23	2.14

Areas in table have been derived using a water pressure of 225 pounds per square inch (15.5 bars) and a soil resistance of 2000 pounds per square foot (1.0 bars).

8-6.2.9 On steep grades, mains shall be properly anchored to prevent slipping. The pipe shall be anchored at the bottom of a hill and at any turns (lateral or vertical). The anchoring shall be done either to natural rock or by means of suitable piers built on the downhill side of the bell. Bell ends shall be installed facing uphill. Straight runs on hills shall be anchored as determined by the design engineer.

8-7 Backfilling.

8-7.1 Backfill shall be well tamped in layers under and around pipes (and puddled where possible) to prevent settlement or lateral movement, and shall contain no ashes, cinders, refuse, organic matter, or other corrosive materials.

8-7.2 Rocks shall not be placed in trenches. Frozen earth shall not be used for backfilling.

8-7.3 In trenches cut through rock, tamped backfill shall be used for at least 6 in. (152 mm) under and around the pipe and for at least 2 ft (0.6 m) above the pipe.

8-8 Flushing.

8-8.1 Underground mains and lead-in connections to system risers shall be flushed thoroughly before connection is made to sprinkler, standpipe, or other fire protection system piping in order to remove foreign materials which may have entered the pipe during the course of the installation.

8-8.2 Flushing of Piping. Underground mains and lead-in connections to system risers shall be flushed thoroughly before connection is made to system piping in order to remove foreign materials which may have entered the underground main during the course of the installation or which may have been present in existing piping. The minimum rate of flow shall be not less than the water demand rate of the system, which is determined by the system design, or not less than that necessary to provide a velocity of 10 ft per second (3 m/s), whichever is greater. For all systems, the flushing operations shall be continued for a sufficient time to ensure thorough cleaning. When planning the flushing operations, consideration shall be given to disposal of the water issuing from the test outlets.

Exception: When the flow rate as listed in Table 8-8.2 cannot be verified or met, supply piping shall be flushed at the maximum flow rate available to the system under fire conditions.

Table 8-8.2
Flow Required to Produce a Velocity
of 10 Ft per Second (3 m/s) in Pipes

Pipe Size	Flow Rate	
(In.)	(gpm)	(L/min)
4	390	1476
6	880	3331
8	1560	5905
10	2440	9235
12	3520	13323

8-9 Testing Underground System.

8-9.1* Before asking final approval of an installation by the authority having jurisdiction, the installing company shall furnish a Contractor's Material and Test Certificate countersigned by the property owner or representative. For a typical Contractor's Material and Test Certificate for Underground Piping, see Figure A-8-9.1.

8-9.2* The trench shall be backfilled between joints before testing to prevent movement of pipe. (See A-8-9.2.)

8-9.3 Hydrostatic Test Requirements.

8-9.3.1* All new private fire service mains shall be tested hydrostatically at not less than 200 psi (13.8 bars)

pressure for two hours, or at 50 psi (3.4 bars) in excess of the maximum static pressure when the maximum static pressure is in excess of 150 psi (10.3 bars). (See A-8-9.3.1.)

8-9.3.2* The amount of leakage in piping shall be measured at the specified test pressure by pumping from a calibrated container. For new pipe, the amount of leakage at the joints shall not exceed two quarts per hour (1.89 L/h) per 100 gaskets or joints irrespective of pipe diameter.

8-9.3.3 The amount of allowable leakage specified in 8-9.3.2 may be increased by one fluid ounce per inch valve diameter per hour (30 ml/25 mm/h) for each metal seated valve isolating the test section. If dry barrel hydrants are tested with the main valve open, so the hydrants are under pressure, an additional five ounces per minute (150 ml/min) leakage is permitted for each hydrant.

8-9.3.4 Tests shall be made by the contractor in the presence of the authority having jurisdiction or the representative of the owner. The certificate shown in Figure A-8-9.1 is to be completed.

8-9.4 Operating Test.

8-9.4.1 Each hydrant shall be fully opened and closed under system water pressure and dry barrel hydrants checked for proper drainage. Where fire pumps are available, this shall be done with the pumps running.

8-9.4.2 All control valves shall be fully closed and opened under system water pressure to ensure proper operation.

Chapter 9 Referenced Publications

9-1 The following documents or portions thereof are referenced within this document and shall be considered part of the requirements of this document. The edition indicated for each reference shall be the current edition as of the date of the NFPA issuance of this document. These references shall be listed separately to facilitate updating to the latest edition by the user.

9-1.1 NFPA Publications. National Fire Protection Association, Batterymarch Park, Quincy, MA 02269.

NFPA 22-1987, *Standard for Water Tanks for Private Fire Protection*

NFPA 26-1983, *Recommended Practice for the Supervision of Valves Controlling Water Supplies for Fire Protection*

NFPA 1961-1987, *Standard for Fire Hose*

NFPA 1963-1985, *Standard for Screw Threads and Gaskets for Fire Hose Connections*

9-1.2 AWWA Publications. American Water Works Association, Inc., 666 West Quincy Avenue, Denver, CO 80235.

AWWA C104-85, *AWWA Standard for Cement Mortar Lining for Cast-Iron Pipe and Fittings for Water*

AWWA C105-82, *AWWA Standard for Polyethylene Encasement for Ductile Iron Piping for Water and Other Liquids*

AWWA C110-82, *AWWA Standard for Gray Iron and Ductile Iron Fittings, 2-in. through 48-in., for Water and Other Liquids*

AWWA C111-85, *AWWA Standard for Rubber Gasket Joints for Cast-Iron and Ductile Iron Pressure Pipe and Fittings*

AWWA C115-83, *AWWA Standard for Flanged Cast-Iron and Ductile Iron Pipe with Threaded Flanges*

AWWA C150-82, *AWWA Standard for the Thickness Design of Ductile Iron Pipe*

AWWA C151-81, *AWWA Standard for Ductile Iron Pipe Centrifugally Cast in Metal Molds or Sand-Lined Molds, for Water or Other Liquids*

AWWA C200-80, *AWWA Standard for Steel Water Pipe 6 in. and larger*

AWWA C203-78, *AWWA Standard for Coal-Tar Enamel Protective Coatings for Steel Water Pipelines*

AWWA C205-80, *AWWA Standard for Cement-Mortar Protective Lining and Coating for Steel Water Pipe*

AWWA C206-82, *AWWA Standard for Field Welding of Steel Water Pipe Joints*

AWWA C207-78, *AWWA Standard for Steel Pipe Flanges*

AWWA C208-83, *AWWA Standard for Dimensions for Steel Water Pipe Fittings*

AWWA C300-82, *AWWA Standard for Reinforced Concrete Pressure Pipe, Steel-Cylinder Type*

AWWA C301-79, *AWWA Standard for Prestressed Concrete Pressure Pipe, Steel-Cylinder Type*

AWWA C302-74, *AWWA Standard for Reinforced Concrete Pressure Pipe, Non-Cylinder Type*

AWWA C303-78, *AWWA Standard for Reinforced Concrete Water Pipe, Steel-Cylinder Type, Pretensioned*

AWWA C400-80, *AWWA Standard for Asbestos-Cement Pressure Pipe*

AWWA C602-76, *AWWA Standard for Cement-Mortar Lining of Water Pipe Lines in Place*

AWWA C900-81, *AWWA Standard for Polyvinyl Chloride (PVC) Pressure Pipe*

9-1.3 ANSI Publication. American National Standards Institute, 1430 Broadway, New York, NY 10018.

ANSI B16.1-75, *American National Standard for Cast-Iron Pipe Flanges and Flanged Fittings for 25, 125, 250 and 800 lb.*

Appendix A

This Appendix is not a part of the requirements of this NFPA document, but is included for information purposes only.

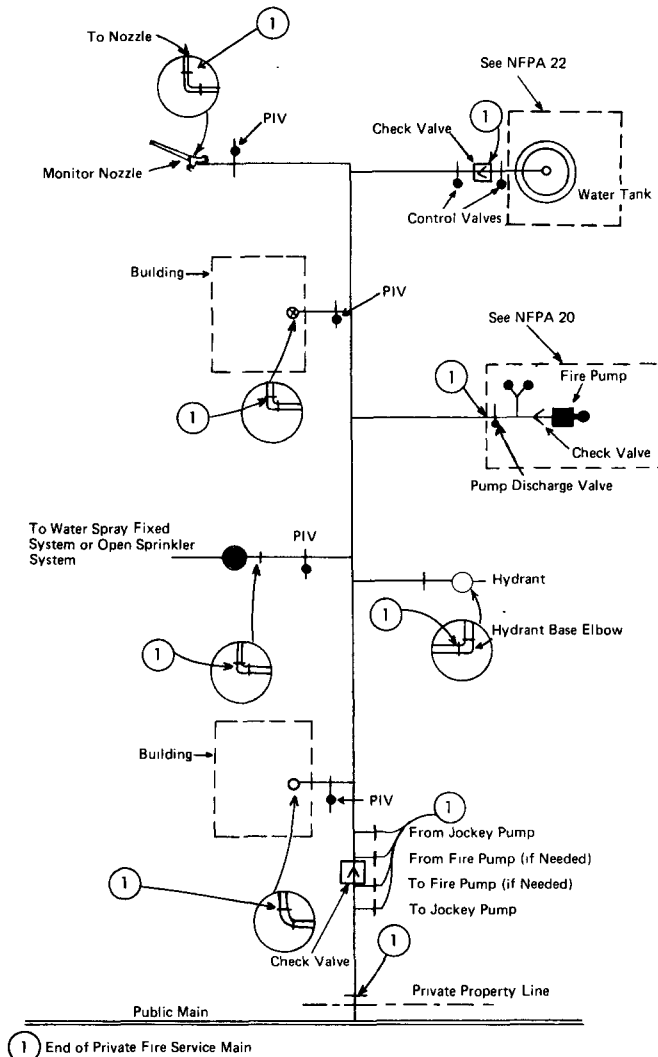


Figure A-1-3 Typical Private Fire Service Main.

NOTE: The piping shown is specific as to the end of the private fire service main and schematic only for illustrative purposes beyond. Details of valves and their location requirements are covered in the specific standard involved.

A-1-4 Piping should be laid so that the system can be extended with a minimum of expense. Possible future plant expansion should also be considered and the piping laid so that it will not be covered by buildings. One or more framed plans of the complete system (kept corrected and up to date) should be conspicuously posted for ready reference.

A-2-2.3 Dead-end mains should be avoided, if possible, by arranging for mains supplied from both directions. When private fire service mains are connected to dead-end public mains, each situation should be examined to

determine if it is practical to request the water utility to loop the mains in order to obtain a more reliable supply.

A-2-2.5 Where connections are made from public waterworks systems, such systems should be guarded against possible contamination as follows (see *AWWA Manual 14*):

(a) For private fire service mains with direct connections from public waterworks mains only or with booster pumps installed in the connections from the street mains; no tanks or reservoirs; no physical connection from other water supplies; no antifreeze or other additives of any kind; and with all drains discharging to atmosphere, dry well, or other safe outlets, no backflow protection is recommended at the service connection.

(b) For private fire service mains with direct connection from the public water supply main plus one or more of the following: elevated storage tanks; fire pumps taking suction from aboveground covered reservoirs or tanks (all storage facilities are filled or connected to public water only, the water in the tanks to be maintained in a potable condition), an approved double check valve assembly is recommended.

(c) For private fire service mains directly supplied from public mains with an auxiliary water supply such as a pond or river on or available to the premises and dedicated to fire department use; or for systems supplied from public mains and interconnected with auxiliary supplies, such as: pumps taking suction from reservoirs exposed to contamination or rivers and ponds; driven wells, mills, or other industrial water systems; or for systems or portions of systems where antifreeze or other solutions are used, an approved reduced-pressure-zone-type backflow preventer is recommended.

A-2-3 See sections dealing with sprinkler equipment supervisory and water flow alarm services in NFPA 71, *Standard for the Installation, Maintenance, and Use of Signaling Systems for Central Station Service*; NFPA 72A, *Standard for the Installation, Maintenance, and Use of Local Protective Signaling Systems for Guard's Tour, Fire Alarm, and Supervisory Service*; NFPA 72B, *Standard for the Installation, Maintenance, and Use of Auxiliary Protective Signaling Systems for Fire Alarm Service*; NFPA 72C, *Standard for the Installation, Maintenance, and Use of Remote Station Protective Signaling*



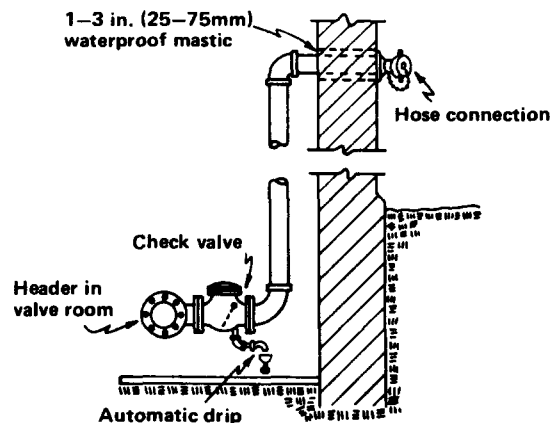


Figure A-2-6(a) Fire Department Connection.

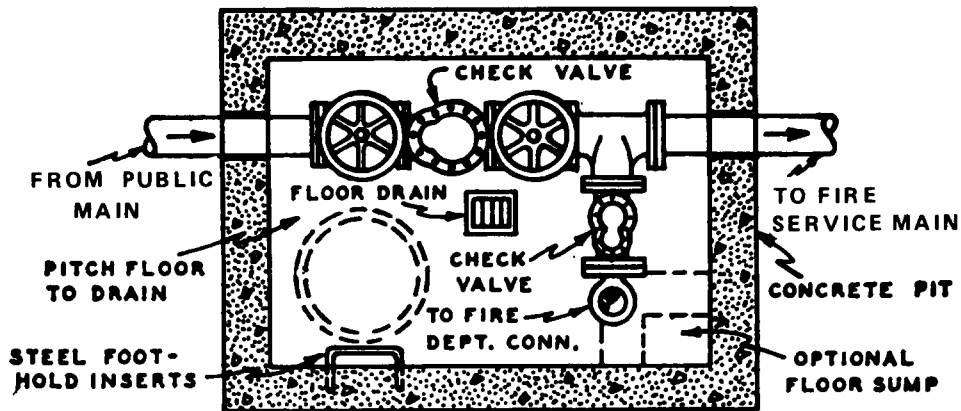

PLAN
NO SCALE

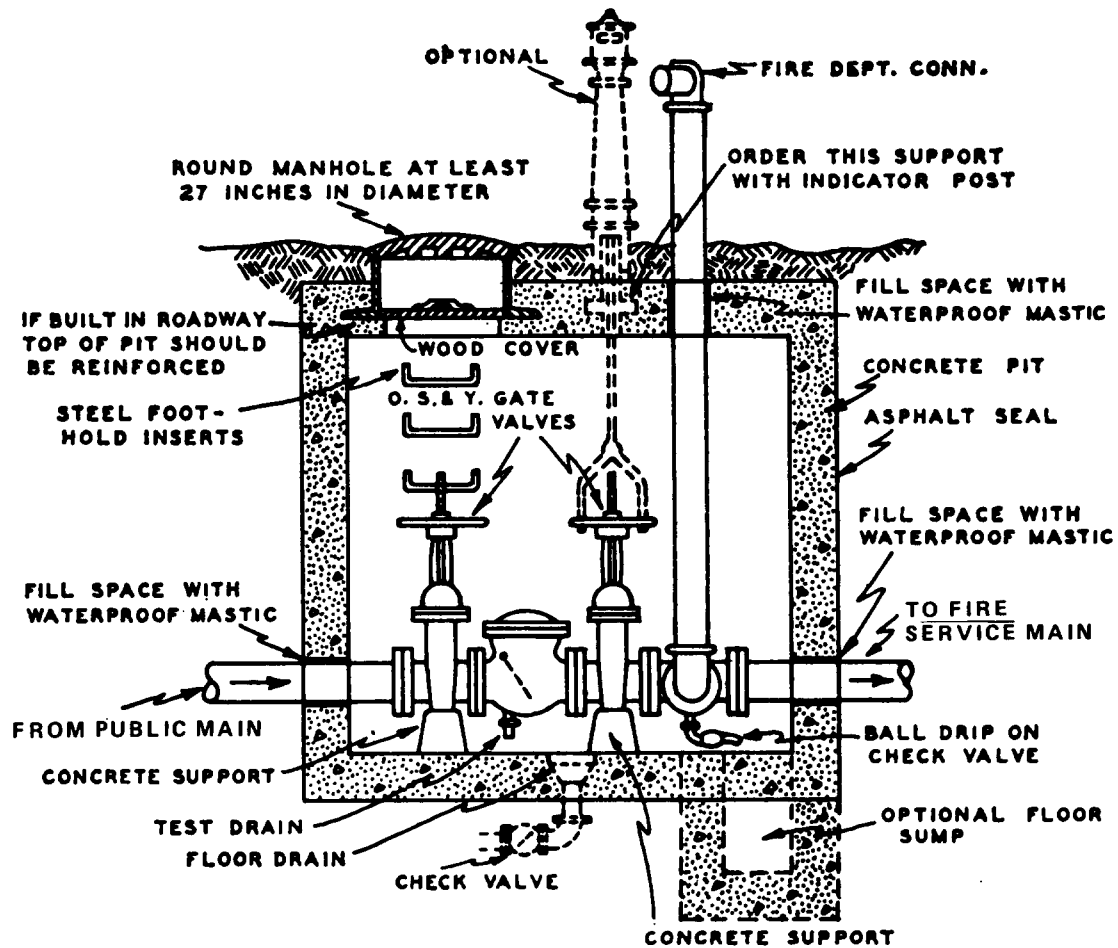

SECTION
NO SCALE

Figure A-2-6(b) Typical City Water Pit — Single Check Valve Arrangement.

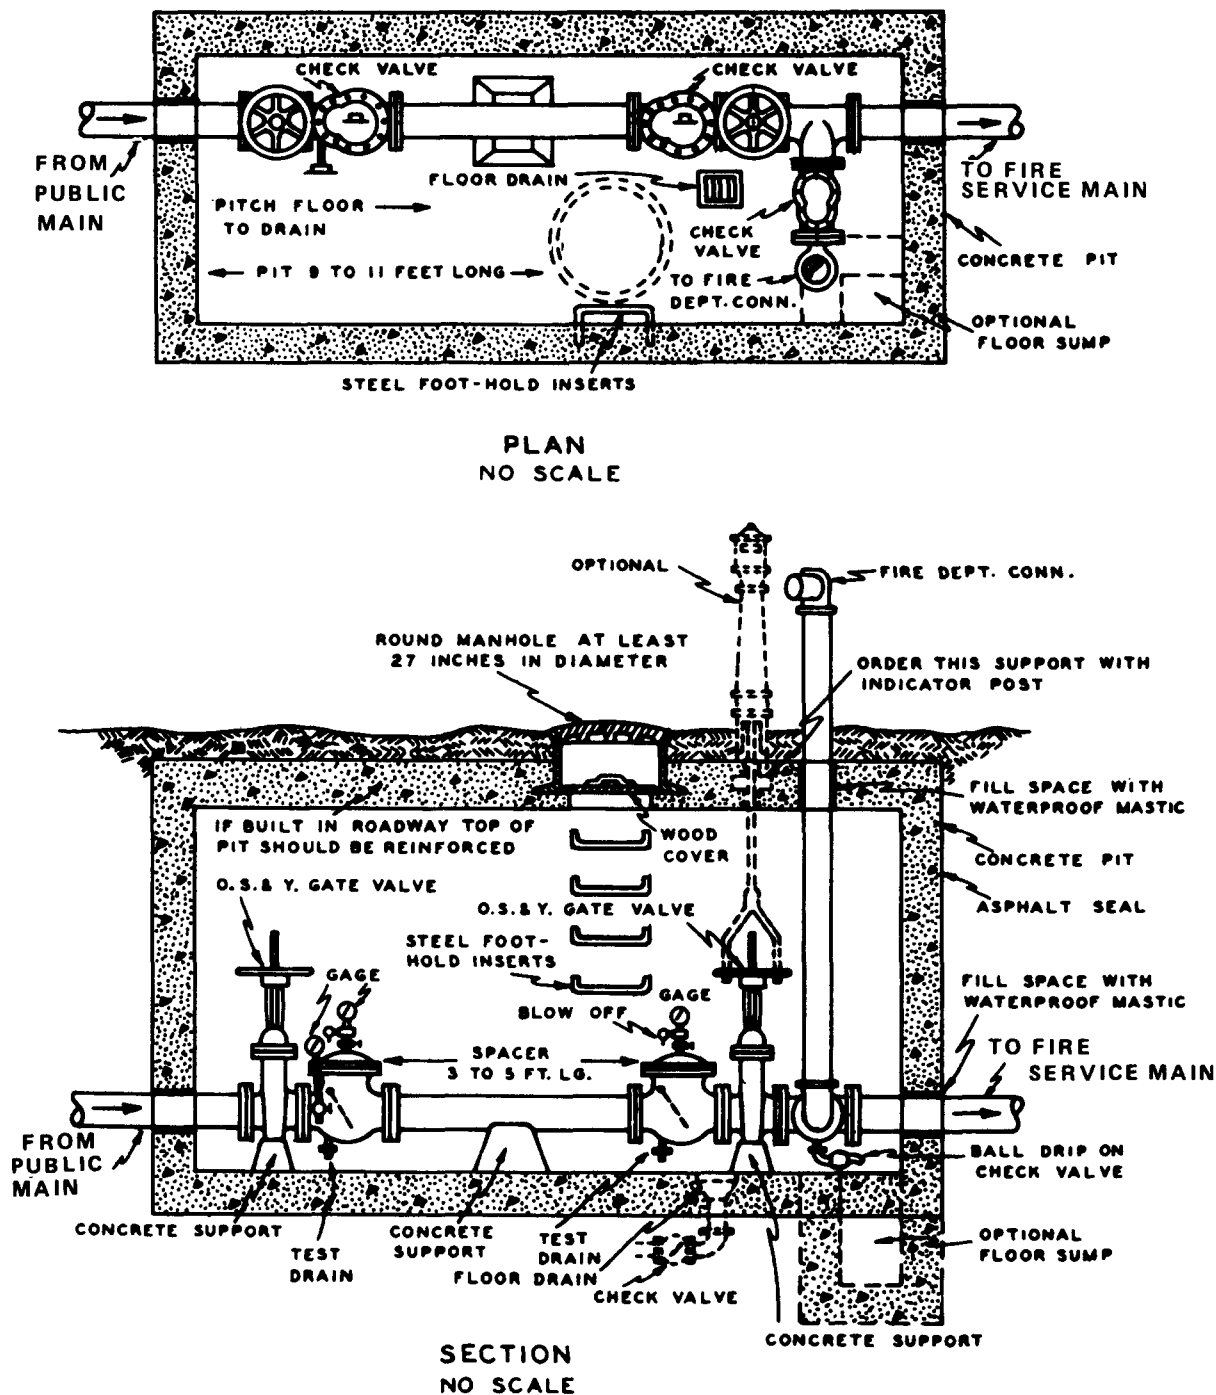


Figure A-2-6(c) Typical City Water Pit — Double Check Valve Arrangement.

Systems; and NFPA 72D, *Standard for the Installation, Maintenance, and Use of Proprietary Protective Signaling Systems*. See separately published NFPA 13, *Standard for the Installation of Sprinkler Systems*, and NFPA 20, *Standard for the Installation of Centrifugal Fire Pumps*.

A-2-4 See NFPA 22, *Standard for Water Tanks for*

Private Fire Protection, when gravity, pressure, or suction tanks are to be used.

A-2-6 Typical fire department connections are shown in Figures A-2-6(a), A-2-6(b), and A-2-6(c). See NFPA 13E, *Recommendations for Fire Department Operations in Properties Protected by Sprinkler and Standpipe Systems*.

A-3-2.3, A-3-2.4 For additional information on controlling valves, see NFPA 22, *Standard for Water Tanks for Private Fire Protection*.

A-3-2.5 Check valves on tank or pump connections, when located underground, may be placed inside of buildings and at a safe distance from the tank riser or pump, except in cases where the building is entirely of one fire area, when it is ordinarily considered satisfactory to locate the check valve overhead in the lowest level.

A-3-3.1 Outside control valves are suggested in the following order of preference:

- (a) Listed indicating valves at each connection into the building at least 40 ft (12.2 m) from buildings if space permits.
- (b) Control valves installed in a cut-off stair tower or valve room accessible from outside.
- (c) Valves located in risers with indicating posts arranged for outside operation.
- (d) Key operated valves in each connection into the building.

A-3-4.2 A valve wrench with a long handle should be provided at a convenient location on the premises.


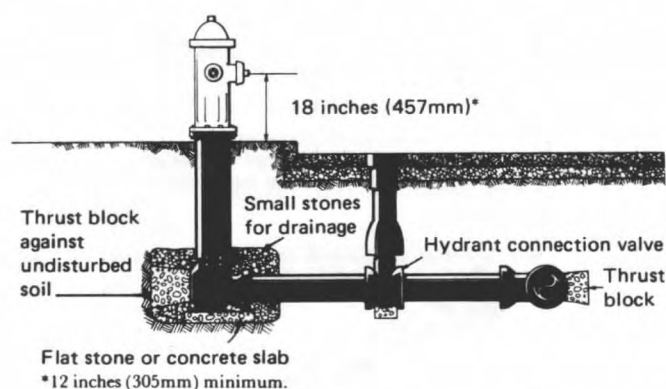


Figure A-4-1 Typical Hydrant Connection.
(See 4-3.3.)

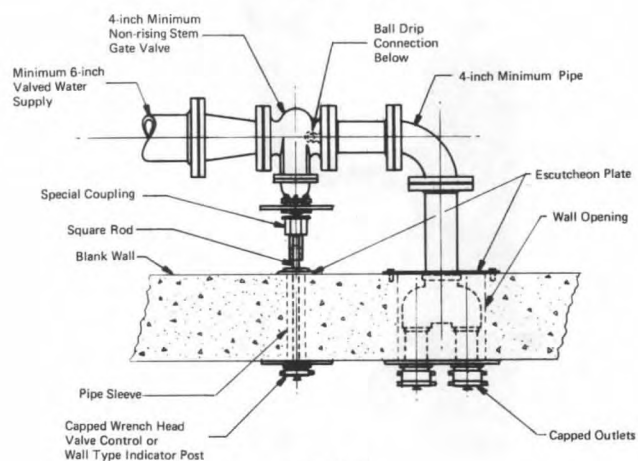

PLAN

Figure A-4-2.2 Typical Wall Fire Hydrant Installation.

A-4-2.2 With use of wall hydrants, the authority having jurisdiction should be consulted regarding the necessary water supply and arrangement of control valves at the point of supply in each individual case.

A-4-3.3 In setting hydrants, due regard should be given to final grade line.

A-4-3.6 See AWWA Manual 17, *Installation, Operation and Maintenance of Fire Hydrants*.

A-5-1.1 All hose should not be removed from a hose house for testing at the same time because the time lost in returning it in case of fire might allow the fire to spread beyond control. See NFPA 1962, *Standard for the Care, Use, and Maintenance of Fire Hose Including Connections and Nozzles*.

A-5-1.2 Where hose may be subjected to acids, acid fumes, or other corrosive materials, as in chemical plants, the purchase of approved rubber-covered, rubber-lined hose is advised. For plant yards containing rough surfaces that will cause heavy wear or where working pressures are above 150 psi (10.3 bars), double-jacketed hose should be considered.

A-5-1.3 When hose houses are located over hydrants, it is good practice to have two or three lengths of hose connected together and attached to the hydrant ready for use.

A-5-4 Typical hose houses are shown in Figures A-5-4(a) through A-5-4(c).

A-5-6.1 Desirable optional equipment to be included in hose house equipment is as follows:

- 1-Fire axe with brackets
- 1-Crow bar with brackets
- 2-Hose and ladder straps
- 2-Electrical battery hand lights.

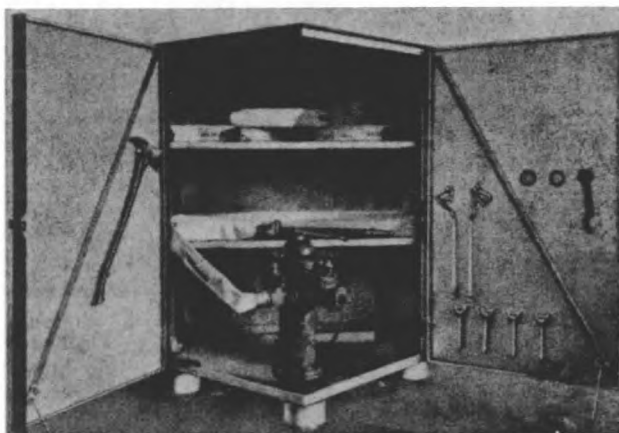


Figure A-5-4(a) House of five-sided design for installation over a private hydrant.



Figure A-5-4(b) Steel house of compact dimensions for installation over a private hydrant. House is shown closed. Top lifts up and doors on front side open for complete accessibility.

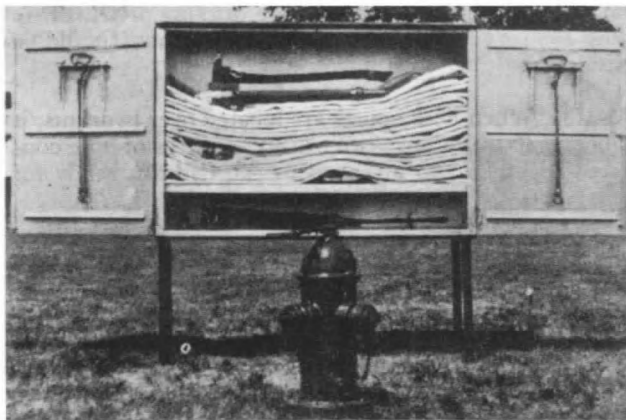


Figure A-5-4(c) This type of hose house can be installed on legs as illustrated or installed on a wall near, but not directly over, a private hydrant.

A-6-1 Typical Monitor Nozzles.

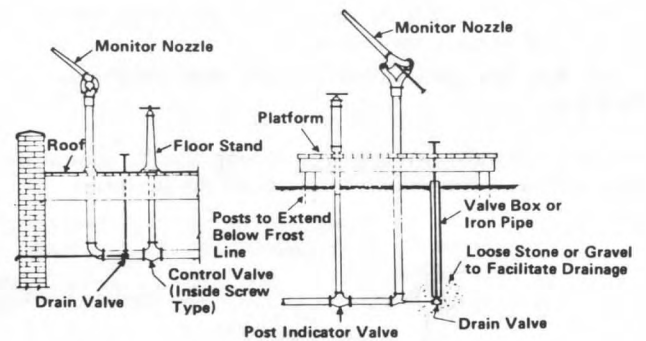
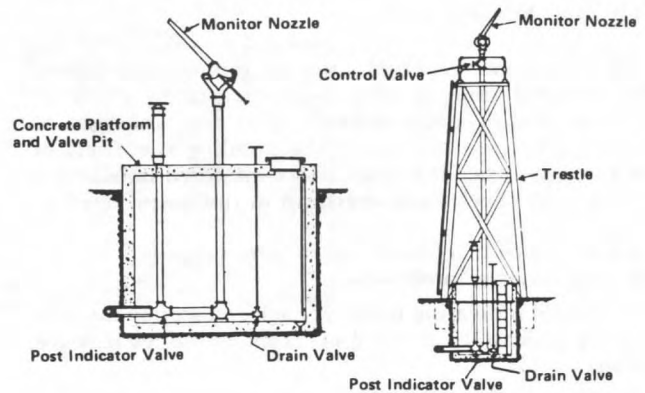


Figure A-6-1(a) Standard Monitor Nozzles. Gear control nozzles are also satisfactory.



Figure A-6-1(b) Typical hydrant-mounted monitor nozzle.

A-7 This standard makes reference to codes and standards published by other organizations. The addresses are as follows:

ACPA

American Concrete Pipe Association
8320 Old Courthouse Road
Vienna, Virginia 20005

ANSI

American National Standards Institute
1430 Broadway
New York, New York 10018

ASSE

American Society of Sanitary Engineering
P.O. Box 9712
Bay Village, Ohio 44140

ASTM

American Society for Testing and Materials
1916 Race Street
Philadelphia, Pennsylvania 19103

AWS

American Welding Society
550 N. W. LeJeune Road
P. O. Box 351040
Miami, Florida 33125

AWWA

American Water Works Association, Inc.
6666 West Quincy Avenue
Denver, Colorado 80235

CSA

Canadian Standards Association
178 Rexdale Boulevard
Rexdale, Ontario, Canada M9W 1R3

DIPRA

Ductile Iron Pipe Research Association
245 Riverchase Parkway, East
Suite O
Birmingham, AL 35244

A-7-1.1

(a) Testing laboratories list or label cast-iron and ductile iron pipe (cement-lined and unlined, coated and uncoated), asbestos-cement pipe and couplings, steel pipe, copper pipe, fiberglass filament-wound epoxy pipe and couplings, polyethylene pipe, and polyvinyl chloride (PVC) pipe and couplings. Underwriters Laboratories Inc. lists under reexamination service reinforced concrete pipe (cylinder pipe, nonprestressed and prestressed).

(b) *Pipe Standards.* The various types of pipe are usually manufactured to one of the following standards:

AWWA Standard for Asbestos-Cement Pressure Pipe, AWWA C400-80.

ASTM Specifications for Asbestos-Cement Pressure Pipe, ASTM C-296-81.

American National Standard for Ductile Iron Pipe Centrifugally Cast in Metal Molds or Sand-Lined Molds, for Water or Other Liquids, AWWA C151-81.

AWWA Standard for Polyvinyl Chloride (PVC) Pressure Pipe, AWWA C900-81.

AWWA Standard for Reinforced Concrete Pressure Pipe, Steel-Cylinder Type, AWWA C300-82.

AWWA Standard for Prestressed Concrete Pressure Pipe, Steel-Cylinder Type, AWWA C301-79.

AWWA Standard for Reinforced Concrete Pressure Pipe, Non-Cylinder Type, AWWA C302-74.

AWWA Standard for Reinforced Concrete Water Pipe, Steel-Cylinder Type, Pretensioned, AWWA C303-78.

AWWA Standard for Steel Water Pipe 6 In. and Larger, AWWA C200-80.

A-7-1.2 Pipe Design Manuals. The following pipe design manuals may be used as guides:

Standard Practice for the Selection of Asbestos-Cement Water Pipe, AWWA C401-83.

Concrete Pipe Handbook, American Concrete Pipe Association.

AWWA Standard for the Thickness Design of Ductile Iron Pipe, AWWA C150-82.

Steel Pipe Design and Installation, AWWA M11.

A-7-2 Coating and Lining Standards. The following apply to the application of coating and linings:

AWWA Standard for Cement Mortar Lining for Cast-Iron Pipe and Fittings for Water, AWWA C104-85.

AWWA Standard for Polyethylene Encasement for Ductile Iron Piping for Water and Other Liquids, AWWA C105-82.

AWWA Standard for Coal-Tar Enamel Protective Coatings for Steel Water Pipelines, AWWA C203-78.

AWWA Standard for Cement-Mortar Protective Lining and Coating for Steel Water Pipe, AWWA C205-80.

AWWA Standard for Cement-Mortar Lining of Water Pipe Lines in Place, AWWA C602-76.

A-7-3 Joint Standards. The following apply to joints used with the various types of pipe:

American National Standard for Rubber Gasket Joints for Cast-Iron and Ductile Iron Pressure Pipe and Fittings, AWWA C111-85.

AWWA Standard for Field Welding of Steel Water Pipe Joints, AWWA C206-82.

AWWA Standard for Steel Pipe Flanges, AWWA C207-78.

American National Standard for Cast-Iron Pipe Flanges and Flanged Fittings for 25, 125, 250 and 800 lb., ANSI B16.1-75.

AWWA Standard for Flanged Cast-Iron and Ductile Iron Pipe with Threaded Flanges, AWWA C115-83.

A-7-4 Fittings Standards. Fittings generally used are cast iron with joints to specifications of the manufacturer of the particular type of pipe. See *Joint Standards* listed following A-7-3. Steel fittings also have some applications. There are the following standards on fittings:

AWWA Standard for Gray Iron and Ductile Iron Fittings, 2-in. through 48-in., for Water and Other Liquids, AWWA C110-82.

AWWA Standard for Dimensions for Steel Water Pipe Fittings, AWWA C208-83.

American National Standard for Cast-Iron Pipe Flanges and Flanged Fittings for 25, 125, 250 and 800 lb, ANSI B16.1-75.

A-7-5.1 Loop systems for yard piping are recommended for increased reliability and improved hydraulics. Loop systems should be sectionalized by placing valves at branches and at strategic locations to minimize the extent of impairments.

A-7-5.3 Pipe friction losses should be determined on the basis of Hazen and Williams formula.

$$P = \frac{4.52 Q^{1.85}}{C^{1.85} d^{4.87}}$$

P = Pressure in psi

Q = Flow in gpm

C = Hazen and Williams Coefficient

d = Actual pipe diameter, in inches

Table A-7-5.3

Pipe or Tube	Hazen-Williams "C" Value ¹
Unlined Cast or Ductile Iron	100
Asbestos Cement, Cement-Lined Cast or Ductile Iron, and Cement-Lined Steel	140
Fiberglass Filament Wound Epoxy, Polyethylene and Polyvinyl Chloride (PVC)	150

¹These values may be reduced by the authority having jurisdiction to be consistent with design procedures.

A-8 Installation Standards. The following apply to the installation of pipe and fittings:

AWWA Standard for the Installation of Asbestos-Cement Water Pipe, AWWA C603-78.

AWWA Standard for the Installation of Ductile-Iron Water Mains and Their Appurtenances, AWWA C600-82.

Concrete Pipe Handbook, American Concrete Pipe Association.

Steel Pipe Design and Installation, AWWA M11, Steel Pipe Manual.

A Guide for the Installation of Gray Cast-Iron Water Mains, Ductile Iron Pipe Research Association.

A Guide for the Installation of Ductile Iron Pipe, Ductile Iron Pipe Research Association.

Thrust Restraint Design for Ductile Iron Pipe, DIPRA, 245 Riverchase Parkway, East, Suite O, Birmingham, AL 35244.

Handbook of PVC Pipe, Uni-Bell Plastic Pipe Association, 2655 Ville Creek Drive, Dallas, TX 75234.

A-8-1.1 As there is normally no circulation of water in private fire mains; they require greater depth of covering than do public mains. Greater depth is required in a loose gravelly soil (or in rock) than in compact, clayey soil. Recommended depth of cover above the top of underground yard mains is shown in Figure A-8-1.1.

A-8-3.4 Gray cast iron is not considered galvanically dissimilar to ductile iron. Rubber gasket joints

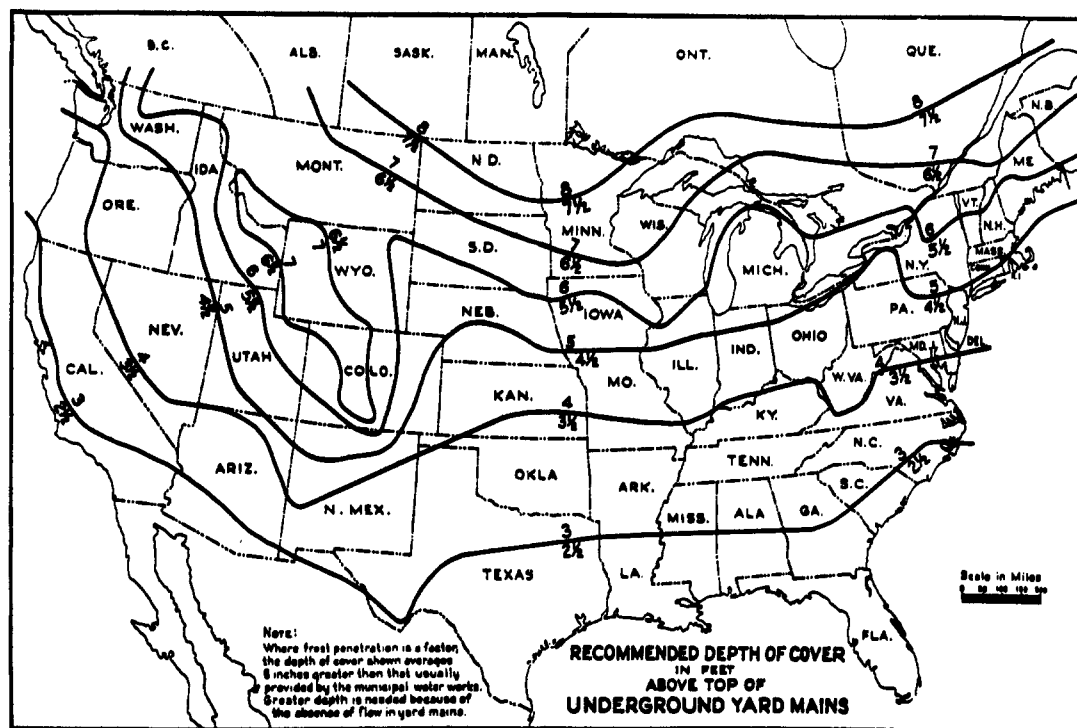


Figure A-8-1.1.

(unrestrained push-on or mechanical joints) are not considered connected electrically. Metal thickness should not be considered a protection against corrosive environments. In the case of cast-iron or ductile iron pipe for soil evaluation and external protection systems, see 9-1.2, AWWA C150-82.

A-8-6.2 It is a fundamental design principle of fluid mechanics that dynamic and static pressures, acting at change in size or direction of a pipe, produce unbalanced thrust forces at bends, tees, wyes, deadends, reducers, off-sets, etc.

This procedure includes consideration of lateral soil pressure and pipe/soil friction, variables which can be reliably determined using present-day soils engineering knowledge.

Refer to A-7-1.1 for a list of references for use in calculating and determining joint restraint systems.

Thrust Blocking

Concrete thrust blocks are the most common method of restraint now in use, providing stable soil conditions prevail and space requirements permit placement. Successful blocking is dependent upon factors such as location, availability and placement of concrete, and possible disturbance through future excavation. Concrete blocks are readily utilized in combination with tie rods, structural anchoring, thrust collars, and restrained joints.

Thrust blocks are generally categorized into two groups: gravity and bearing blocks.

Gravity Blocks [Figure A-8-6.2(a)]: Important factors considered in design are:

- Horizontal and vertical thrust components
- Allowable bearing value of soil
- Combined weight of pipe, water, and soil prism
- Density of block material
- Block dimensions and volume.

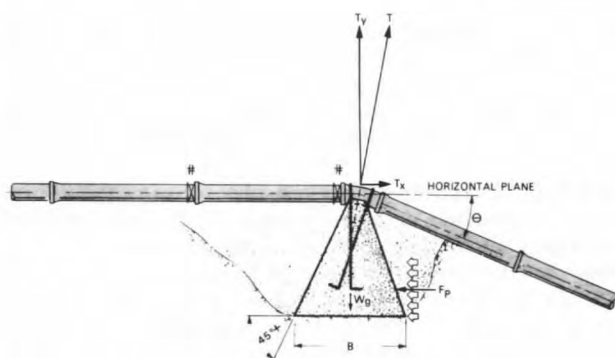


Figure A-8-6.2(a) Gravity Thrust Block.

Restrained joints may be used when $T_x > F_p$.

A thrust force analysis is conducted similar to Figure A-8-6.2(b).

Physical characteristics of the block are determined from the following formulas:

$$V_G = \frac{PA \sin \Theta}{W_m} \text{ (neglecting } W_\gamma)$$

$$V_G = \frac{T_\gamma - W_\gamma}{W_m} \text{ (including } W_\gamma) \text{ where } W_\gamma = \frac{1}{2} W_c L$$

Where V_G = Volume of thrust block (ft³)
 P = Design pressure (psi)
 A = Cross sectional area of pipe (inch²) = $36 \pi D'^2$
 W_m = Density of thrust block material (lbs/ft³)
 T = Resultant thrust force (lbs)
 γ = Backfill soil density (lbs/ft³)
 L = Minimum required restrained pipe length (ft)

Earth cover (W_e), is neglected when determining (W_c), if unstable conditions are anticipated. The horizontal thrust component (T_x) is counteracted by soil pressure on the vertical face of the block (F_p) or by joint restraint.

Allowable soil bearing pressure determines the minimum size of the block base.

Table A-8-6.2
Thrust at Fittings at 100 PSI Water Pressure for
Ductile Iron and PVC Pipe

Nom. Pipe Dia. In.	Total Pounds				
	Dead End	90° Bend	45° Bend	22½° Bend	11¼° Bend
4	1,810	2,559	1,385	706	355
6	3,739	5,288	2,862	1,459	733
8	6,433	9,097	4,923	2,510	1,261
10	9,677	13,685	7,406	3,776	1,897
12	13,685	19,353	10,474	5,340	2,683
14	18,385	26,001	14,072	7,174	3,604
16	23,779	33,628	18,199	9,278	4,661
18	29,865	42,235	22,858	11,653	5,855
20	36,644	51,822	28,046	14,298	7,183
24	52,279	73,934	40,013	20,398	10,249
30	80,425	113,738	61,554	31,380	15,766
36	115,209	162,931	88,177	44,952	22,585
42	155,528	219,950	119,036	60,684	30,489
48	202,683	286,637	155,127	79,083	39,733
54	256,072	362,140	195,989	99,914	50,199

NOTE: To determine thrust at pressure other than 100 psi, multiply the thrust obtained in the table by the ratio of the pressure to 100.

For example, the thrust on a 12 inch, 90° bend at 125 psi is

$$19,353 \times \frac{125}{100} = 24,191 \text{ pounds.}$$

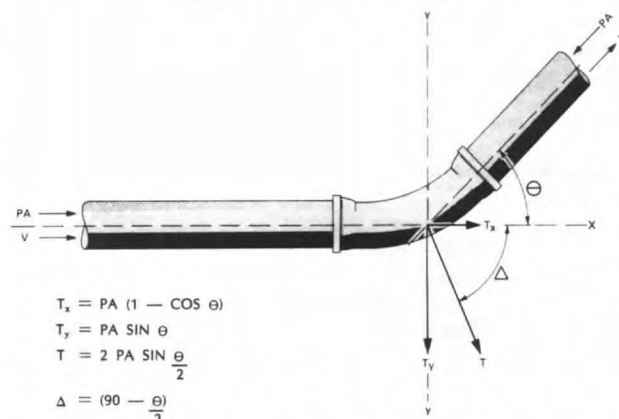


Figure A-8-6.2(b) Thrust Forces Acting on a Bend.

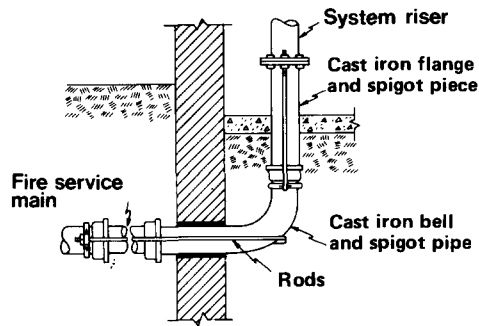


Figure A-8-6.2(c) Typical Connection to a Fire Protection System Riser.

This shows a common arrangement illustrating an acceptable anchoring method.

A-8-6.2.5 Examples of materials and the standards covering these materials are:

- (a) *Clamps.* Steel (see Note).
- (b) *Rods.* Steel (see Note).
- (c) *Bolts.* Steel (ASTM A307-80).
- (d) *Washers.* Steel (see Note 1). Cast Iron (Class A cast iron as defined by ASTM A126-79).
- (e) *Anchor Straps and Plug Straps.* Steel (See Note).
- (f) *Rod Couplings or Turnbuckles.* Malleable iron (ASTM A197-79).

NOTE: Steel of modified range merchant quality as defined in U.S. Federal Standard No. 66C, *Standard for Steel Chemical Composition and Harden Ability*, April 18, 1967, change notice No. 2, April 16, 1970, as promulgated by the U.S. Federal Government General Services Administration.


The above-listed materials do not preclude the use of other materials which will also satisfy the requirements of this section.

A-8-6.2.8 Illustrations of the use of thrust blocks: Figure A-8-6.2.8 top, at one-quarter bend; Figure A-8-6.2.8 bottom, at tee and plug. Publications of pipe and fitting manufacturers show methods for installing thrust blocks at other fittings. In each case, the trench is cut to provide a bearing surface on undisturbed soil, and concrete is poured to fit snugly against as much of the fitting as possible without interfering with access to fitting joints. In some cases, anchor rods may be used to hold the fitting against the blocks.

Table A-8-6.2.8

Suggested factors to be used in determining size of thrust blocks are:

Soft Clay	4
Sand	2
Sand and Gravel	1.33
Shale	0.4

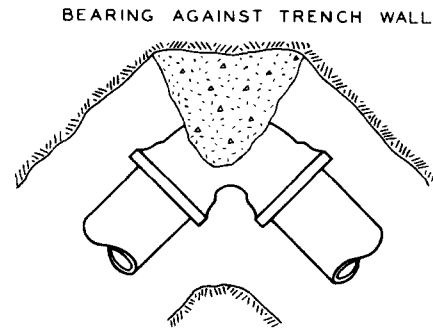

BEARINGS AGAINST TRENCH WALLS

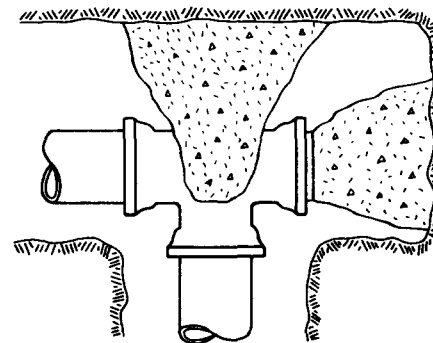


Figure A-8-6.2.8 Typical Thrust Blocks.

A-8-9.2

(a) Hydrostatic tests should be made before the joints are covered in order that any leaks may be readily detected. Thrust blocks should be sufficiently hardened before hydrostatic testing is begun. If the joints are covered with backfill prior to testing, the contractor remains responsible for locating and correcting any leakage in excess of that permitted in 8-9.3.2 and 8-9.3.3.

(b) The pipeline should be prepared 24 hrs prior to testing by filling it with water, in a manner to remove all air. The test pressure should be applied to stabilize the system. This should minimize losses due to entrapped air, changes in water temperature, distention of components under pressure, movement of gaskets, and absorption of air by the water and water by the pipe wall.

A-8-9.3.1 A recommended test procedure is as follows: The water pressure is to be increased in 50 psi (3.4 bars) increments until the test pressure described in 8-9.3.1 is attained. After each increase in pressure, observations are to be made of the stability of the joints. These observations are to include such items as protrusion or extrusion of the gasket, leakage, or other factors likely to affect the continued use of a pipe in service. During the test, the pressure is not to be increased by the next increment until the joint has become stable. This applies particularly to movement of the gasket. After the pressure has been increased to the required maximum value and held for one hour, the pressure is to be decreased to 0 psi while observations are made for leakage. The pressure is again to be slowly increased to the value specified in 8-9.3.1 and held for one more hour while observations are made for leakage and the leakage measurement is made.

Figure A-8-9.1 Typical Contractor's Material and Test Certificate for Underground Piping

CONTRACTOR'S MATERIAL & TEST CERTIFICATE FOR UNDERGROUND PIPING

PROCEDURE

Upon completion of work, inspection and tests shall be made by the contractor's representative and witnessed by an owner's representative. All defects shall be corrected and system left in service before contractor's personnel finally leave the job.

A certificate shall be filled out and signed by both representatives. Copies shall be prepared for approving authorities, owners and contractor. It is understood the owner's representative's signature in no way prejudices any claim against contractor for faulty material, poor workmanship, or failure to comply with approving authority's requirements or local ordinances.

PROPERTY NAME		DATE
PROPERTY ADDRESS		
PLANS	ACCEPTED BY APPROVING AUTHORITY(S) NAMES	
	ADDRESS	
	INSTALLATION CONFORMS TO ACCEPTED PLANS <input type="checkbox"/> YES <input type="checkbox"/> NO	
	EQUIPMENT USED IS APPROVED <input type="checkbox"/> YES <input type="checkbox"/> NO IF NO, STATE DEVIATIONS	
INSTRUCTIONS	HAS PERSON IN CHARGE OF FIRE EQUIPMENT BEEN INSTRUCTED AS TO LOCATION OF CONTROL VALVES AND CARE AND MAINTENANCE OF THIS NEW EQUIPMENT <input type="checkbox"/> YES <input type="checkbox"/> NO IF NO, EXPLAIN	
	HAVE COPIES OF APPROPRIATE INSTRUCTIONS AND CARE AND MAINTENANCE CHARTS BEEN LEFT ON PREMISES <input type="checkbox"/> YES <input type="checkbox"/> NO IF NO, EXPLAIN	
LOCATION	SUPPLIES BLDGS.	
UNDERGROUND PIPES AND JOINTS	PIPE TYPES AND CLASS	TYPE JOINT
	PIPE CONFORMS TO _____ STANDARD <input type="checkbox"/> YES <input type="checkbox"/> NO	
	FITTINGS CONFORM TO _____ STANDARD <input type="checkbox"/> YES <input type="checkbox"/> NO IF NO, EXPLAIN	
	JOINTS NEEDING ANCHORAGE CLAMPED, STRAPPED, OR BLOCKED IN <input type="checkbox"/> YES <input type="checkbox"/> NO	
	ACCORDANCE WITH _____ STANDARD IF NO, EXPLAIN	
TEST DESCRIPTION	<p>FLUSHING. Flow the required rate until water is clear as indicated by no collection of foreign material in burlap bags at outlets such as hydrants and blow-offs. Flush at flows not less than 400 GPM (1514 L/min) for 4-inch pipe, 600 GPM (2271 L/min) for 5-inch pipe, 750 GPM (2839 L/min) for 6-inch pipe, 1000 GPM (3785 L/min) for 8-inch pipe, 1500 GPM (5678 L/min) for 10-inch pipe and 2000 GPM (7570 L/min) for 12-inch pipe. When supply cannot produce stipulated flow rates, obtain maximum available.</p> <p>HYDROSTATIC. Hydrostatic tests shall be made at not less than 200 psi (13.8 bars) for two hours or 50 psi (3.4 bars) above static pressure in excess of 150 psi (10.3 bars) for two hours.</p> <p>LEAKAGE. New pipe laid with rubber gasketed joints shall, if the workmanship is satisfactory, have little or no leakage at the joints. The amount of leakage at the joints shall not exceed 2 qts. per hr. (1.89 L/h) per 100 joints irrespective of pipe diameter. The leakage shall be distributed over all joints. If such leakage occurs at a few joints the installation shall be considered unsatisfactory and necessary repairs made. The amount of allowable leakage specified above may be increased by 1 fl oz per in. valve diameter per hour (30 mL/25 mm/h) for each metal seated valve isolating the test section. If dry barrel hydrants are tested with the main valve open, so the hydrants are under pressure, an additional 5 oz per minute (150 mL/min) leakage is permitted for each hydrant.</p>	
FLUSHING TESTS	NEW UNDERGROUND PIPING FLUSHED ACCORDING TO _____ STANDARD <input type="checkbox"/> YES <input type="checkbox"/> NO BY (COMPANY) IF NO, EXPLAIN	
	HOW FLUSHING FLOW WAS OBTAINED <input type="checkbox"/> PUBLIC WATER <input type="checkbox"/> TANK OR RESERVOIR <input type="checkbox"/> FIRE PUMP	THROUGH WHAT TYPE OPENING <input type="checkbox"/> HYDRANT BUTT. <input type="checkbox"/> OPEN PIPE
	LEAD-INS FLUSHED ACCORDING TO _____ STANDARD <input type="checkbox"/> YES <input type="checkbox"/> NO BY (COMPANY) IF NO, EXPLAIN	
	HOW FLUSHING FLOW WAS OBTAINED <input type="checkbox"/> PUBLIC WATER <input type="checkbox"/> TANK OR RESERVOIR <input type="checkbox"/> FIRE PUMP	THROUGH WHAT TYPE OPENING <input type="checkbox"/> Y CONN. TO FLANGE & SPIGOT <input type="checkbox"/> OPEN PIPE

HYDROSTATIC TEST	ALL NEW UNDERGROUND PIPING HYDROSTATICALLY TESTED AT _____ PSI FOR _____ HOURS		JOINTS COVERED <input type="checkbox"/> YES <input type="checkbox"/> NO	
LEAKAGE TEST	TOTAL AMOUNT OF LEAKAGE MEASURED _____ GALS. _____ HOURS			
	ALLOWABLE LEAKAGE _____ GALS. _____ HOURS			
HYDRANTS	NUMBER INSTALLED	TYPE AND MAKE		ALL OPERATE SATISFACTORILY <input type="checkbox"/> YES <input type="checkbox"/> NO
				<input type="checkbox"/> YES <input type="checkbox"/> NO
CONTROL VALVES	WATER CONTROL VALVES LEFT WIDE OPEN IF NO, STATE REASON <input type="checkbox"/> YES <input type="checkbox"/> NO			
	HOSE THREADS OF FIRE DEPARTMENT CONNECTIONS AND HYDRANTS INTERCHANGEABLE WITH THOSE OF FIRE DEPARTMENT ANSWERING ALARM <input type="checkbox"/> YES <input type="checkbox"/> NO			
REMARKS	DATE LEFT IN SERVICE			
SIGNATURES	NAME OF INSTALLING CONTRACTOR			
	TESTS WITNESSED BY			
	FOR PROPERTY OWNER (SIGNED)	TITLE	DATE	
	FOR INSTALLING CONTRACTOR (SIGNED)	TITLE	DATE	

ADDITIONAL EXPLANATION AND NOTES

A-8-9.3.2 New pipe laid with rubber gasketed joints should, if the workmanship is satisfactory, have no leakage at the joints. Unsatisfactory amounts of leakage usually result from twisted, pinched, or cut gaskets. However, some leakage might result from small amounts of grit or small imperfections in the surfaces of the pipe joints.

Appendix B Referenced Publications

This Appendix is not a part of the requirements of this NFPA document, but is included for information purposes only.

B-1 The following documents or portions thereof are referenced within this document for informational purposes only and thus are not considered part of the requirements of this document. The edition indicated for each reference should be the current edition as of the date of the NFPA issuance of this document. These references should be listed separately to facilitate updating to the latest edition by the user.

B-1.1 NFPA Publications. National Fire Protection Association, Batterymarch Park, Quincy, MA 02269.

NFPA 11-1983, *Standard for Low Expansion Foam and Combined Agent Systems*

NFPA 13-1987, *Standard for the Installation of Sprinkler Systems*

NFPA 13E-1984, *Recommendations for Fire Department Operations in Properties Protected by Sprinkler and Standpipe Systems*

NFPA 14-1986, *Standard for the Installation of Standpipe and Hose Systems*

NFPA 15-1985, *Standard for Water Spray Fixed Systems for Fire Protection*

NFPA 16-1986, *Standard on Deluge Foam-Water Sprinkler and Foam-Water Spray Systems*

NFPA 20-1987, *Standard for the Installation of Centrifugal Fire Pumps*

NFPA 22-1987, *Standard for Water Tanks for Private Fire Protection*

NFPA 26-1983, *Recommended Practice for the Supervision of Valves Controlling Water Supplies for Fire Protection*

NFPA 71-1987, *Standard for the Installation, Maintenance, and Use of Signaling Systems for Central Station Service*

NFPA 72A-1987, *Standard for the Installation, Maintenance, and Use of Local Protective Signaling Systems for Guard's Tour, Fire Alarm, and Supervisory Service*

NFPA 72B-1986, *Standard for the Installation, Maintenance, and Use of Auxiliary Protective Signaling Systems for Fire Alarm Service*

NFPA 72C-1986, *Standard for the Installation, Maintenance, and Use of Remote Station Protective Signaling Systems*

NFPA 72D-1986, *Standard for the Installation, Maintenance, and Use of Proprietary Protective Signaling Systems*

NFPA 1961-1987, *Standard for Fire Hose*

NFPA 1962-1979, *Standard for the Care, Use, and Maintenance of Fire Hose Including Connections and Nozzles*

NFPA 1963-1985, *Standard for Screw Threads and Gaskets for Fire Hose Connections*

B-1.2 AWWA Publication. American Water Works Association Inc., 666 West Quincy Avenue, Denver, CO 80235.

AWWA Manual 17, *Installation, Operation and Maintenance of Fire Hydrants*