

# NFPA 252

## Fire Tests of

## Door Assemblies

## 1984



National Fire Protection Association    Batterymarch Park, Quincy, MA 02269

## NOTICE

All questions or other communications relating to this document should be sent only to NFPA Headquarters, addressed to the attention of the Committee responsible for the document.

For information on obtaining Formal Interpretations of the document, proposing Tentative Interim Amendments, proposing amendments for Committee consideration, and appeals on matters relating to the content of the document, write to the Secretary, Standards Council, National Fire Protection Association, Batterymarch Park, Quincy, MA 02269.

A statement, written or oral, that is not processed in accordance with Section 16 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Users of this document should consult applicable Federal, State and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action which is not in compliance with applicable laws and this document may not be construed as doing so.

### Policy Adopted by NFPA Board of Directors on December 3, 1982

The Board of Directors reaffirms that the National Fire Protection Association recognizes that the toxicity of the products of combustion is an important factor in the loss of life from fire. NFPA has dealt with that subject in its technical committee documents for many years.

There is a concern that the growing use of synthetic materials may produce more or additional toxic products of combustion in a fire environment. The Board has, therefore, asked all NFPA technical committees to review the documents for which they are responsible to be sure that the documents respond to this current concern. To assist the committees in meeting this request, the Board has appointed an advisory committee to provide specific guidance to the technical committees on questions relating to assessing the hazards of the products of combustion.

---

**Licensing Provision** — This document is copyrighted by the National Fire Protection Association (NFPA).

**1. Adoption by Reference** — Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders or similar instruments. Any deletions, additions and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Vice President and Chief Engineer) in writing of such use. The term "adoption by reference" means the citing of title and publishing information only.

**2. Adoption by Transcription** — **A.** Public authorities with lawmaking or rule-making powers only, upon written notice to the NFPA (Attention: Vice President and Chief Engineer), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders or similar instruments having the force of law, provided that: (1) due notice of NFPA's copyright is contained in each law and in each copy thereof; and, (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction's lawmaking or rulemaking process. **B.** Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rulemaking powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Vice President and Chief Engineer), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately provided that due notice of NFPA's copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rulemaking powers may apply for and may receive a special royalty when the public interest will be served thereby.

All other rights, including the right to vend, are retained by NFPA.

(For further explanation, see the Policy Concerning the Adoption, Printing and Publication of NFPA Documents which is available upon request from the NFPA.)

---

### Statement on NFPA Procedures

This material has been developed under the published procedures of the National Fire Protection Association, which are designed to assure the appointment of technically competent Committees having balanced representation. While these procedures assure the highest degree of care, neither the National Fire Protection Association, its members, nor those participating in its activities accepts any liability resulting from compliance or noncompliance with the provisions given herein, for any restrictions imposed on materials or processes, or for the completeness of the text.

NFPA has no power or authority to police or enforce compliance with the contents of this document and any certification of products stating compliance with requirements of this document is made at the peril of the certifier.

© 1984 NFPA, All Rights Reserved

## **Standard Methods of Fire Tests of Door Assemblies**

**NFPA 252-1984**

### **1984 Edition of NFPA 252**

This edition of NFPA 252, *Standard Methods of Fire Tests of Door Assemblies*, was prepared by the Technical Committee on Fire Tests, and acted on by the National Fire Protection Association, Inc. at its Fall Meeting held November 14-17, 1983, in Orlando, Florida. It was issued by the Standards Council on December 8, 1983, with an effective date of December 28, 1983, and supersedes all previous editions.

Changes other than editorial are indicated by a vertical rule in the margin of the pages on which they appear. These lines are included as an aid to the user in identifying changes from the previous edition.

### **Origin and Development of NFPA 252**

The Standard for Fire Tests of Door Assemblies was adopted as a tentative standard by the ASTM in 1940 and was formally adopted in 1941. In 1942 this standard was adopted by the NFPA and approved by the American Standards Association. It was reaffirmed by the Committee on Fire Tests of Building Construction and Materials and adopted in 1950. In 1953 a new NFPA Committee on Fire Tests was formed by action of the Board of Directors and recommendations for revision of the standard made from that Committee were adopted in 1958, 1969, 1972, 1976, 1979 and 1984.

The test procedure covered by this standard was developed by Underwriters Laboratories Inc.

## Technical Committee on Fire Tests

**Herman Spaeth, Chairman**

Insurance Services Office

**John A. Blair, Secretary**

E I Dupont De Nemours & Co.

Rep. Society of Plastics Industry

**M. S. Abrams**, Portland Cement Assn.

**Jesse J. Beitel**, Southwest Research Inst.

**Irwin A. Benjamin**, Benjamin/Clarke Assoc., Inc.

**David Brackett**, Gypsum Assn.

**B. J. Callahan**, Factory Mutual Research Corp.

**William J. Christian**, Underwriters Laboratories Inc.

**Wells Denyes**, Eastman Chemical Products Inc.

Rep. Man-Made Fiber Producers Assn.

**Gerard R. Dufresne**, US Testing Co., Inc.

(Vote Limited to Textile Materials)

**Buell B. Dutton**, Building and Zoning Consultants

**Richard G. Gewain**, American Iron & Steel Inst.

**Peter Higginson**, Underwriters Labs of Canada

**Alfred J. Hogan**, Cypress Gardens, FL

Rep. Fire Marshals Assn. of N. America

**Joan Koonce**, Cone Mills Corp.

Rep. American Textile Mfrs. Inst., Inc.

(Vote Limited to Textile Materials)

**Gerald E. Lingenfelter**, American Insurance Assn.

**George E. Meyer**, Warnock Hersey Intl., Inc.

**James A. Milke**, College Park, MD

**E. E. Miller**, Industrial Risk Insurers

**Shirley C. Reznikoff**, Arizona State University

**John Ed Ryan**, Nat'l Forest Products Assn.

**K. Sumi**, Nat'l Research Council of Canada

**Richard P. Thornberry**, The Code Consortium

**Lewis W. Vaughan**, Canadian Sheet Steel Bldg. Inst.

**James H. Winger**, NBS Center for Fire Research

### Alternates

**J. S. Barritt**, Industrial Risk Insurers

(Alternate to E. E. Miller)

**J. P. Carroll**, Society of Plastics Industry

(Alternate to J. A. Blair)

**John L. Crooks**, Insurance Services Office

(Alternate to H. Spaeth)

**Sanford Davis**, Center for Fire Research

(Alternate to J. Winger)

**Philip J. DiNenno**, Benjamin/Clarke Assoc., Inc.

(Alternate to I. A. Benjamin)

**Mark M. DiPierro**, American Insurance Assn.

(Alternate to G. E. Lingenfelter)

**Robert W. Glowinski**, Nat'l Forest Products Assn.

(Alternate to J. E. Ryan)

**Norman S. Pearce**, Underwriters Labs of Canada

(Alternate to P. Higginson)

### Nonvoting

**A. J. Bartosic**, Rohm & Haas Co.

*This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in the membership may have occurred.*

NOTE: Membership on a Committee shall not in and of itself constitute an endorsement of the Association or any document developed by the Committee on which the member serves.

## Contents

<b>Chapter 1 General</b> .....	252-4
1-1 Purpose .....	252-4
1-2 Scope .....	252-4
1-3 Significance .....	252-4
<b>Chapter 2 Control of Fire Tests</b> .....	252-4
2-1 Time-Temperature Curve .....	252-4
2-2 Furnace Temperatures .....	252-5
2-3 Unexposed Surface Temperatures .....	252-5
<b>Chapter 3 Test Assemblies</b> .....	252-6
3-1 Construction and Size .....	252-6
3-2 Mounting .....	252-6
3-3 Clearances .....	252-6
<b>Chapter 4 Conduct of Tests</b> .....	252-6
4-1 Test Assembly .....	252-6
4-2 Fire Endurance Test .....	252-7
4-3 Hose Stream Test .....	252-7
<b>Chapter 5 Report</b> .....	252-7
5-1 Results .....	252-7
<b>Chapter 6 Conditions of Acceptance</b> .....	252-7
6-1 General .....	252-7
6-2 Swinging Doors .....	252-8
6-3 Sliding Doors .....	252-8
<b>Appendix A Commentary</b> .....	252-9

## Standard Methods of Fire Tests of Door Assemblies

NFPA 252-1984

### Chapter 1 General

**1-1 Purpose.** This standard outlines methods of fire test for door assemblies.

#### 1-2 Scope.

**1-2.1** These methods of fire test are applicable to door assemblies of various materials and types of construction, for use in wall openings to retard the passage of fire.

**1-2.2** Tests made in conformity with these test methods will register performance during the test exposure; but such tests shall not be construed as determining suitability for use after exposure to fire.

**1-2.3** It is the intent that tests made in conformity with these test methods will develop data to enable regulatory bodies to determine the suitability of door assemblies for use in locations where fire resistance of a specified duration is required.

#### 1-3 Significance.

**1-3.1** These methods are intended to evaluate the ability of a door assembly to remain in an opening during a predetermined test exposure.

**1-3.2** The tests expose a specimen to a standard fire exposure controlled to achieve specified temperatures throughout a specified time period, followed by the application of a specified standard fire hose stream. The exposure, however, may not be representative of all fire conditions, which may vary with changes in the amount, nature, and distribution of fire loading, ventilation, compartment size and configuration, and heat sink characteristics of the compartment. It does, however, provide a relative measure of fire performance of door assemblies under these specified fire exposure conditions.

**1-3.3** Any variation from the construction or conditions that are tested may substantially change the performance characteristics of the assembly.

**1-3.4** The methods do not provide the following:

**1-3.4.1** Full information as to performance of all door assemblies in walls constructed of materials other than those tested.

**1-3.4.2** Evaluation of the degree by which the door assembly contributes to the fire hazard by generation of smoke, toxic gases, or other products of combustion.

**1-3.4.3** A limit on the number of openings allowed in

glazed areas or of the number and size of lateral openings between the door and frame.


**1-3.4.4** Measurement of the degree of control or limitation of the passage of smoke or products of combustion through the door assembly.

**1-3.4.5** A temperature limit on the unexposed side of the door assembly.

### Chapter 2 Control of Fire Tests

#### 2-1 Time-Temperature Curve.

**2-1.1** The fire exposure of door assemblies shall be controlled to conform to the applicable portion of the standard time-temperature curve shown in Figure 2-1.1. The points on the curve that determine its character are:

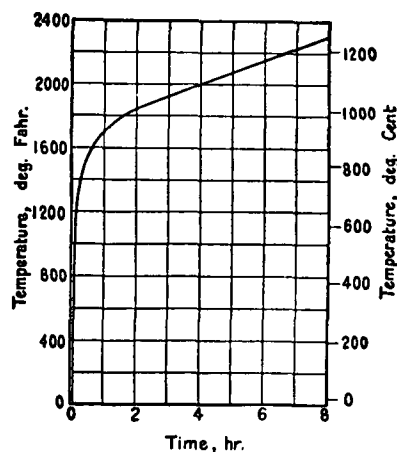

1000° F ( 538° C) . . . at 5 minutes  
 1300° F ( 704° C) . . . at 10 minutes  
 1550° F ( 843° C) . . . at 30 minutes  
 1638° F ( 892° C) . . . at 45 minutes  
 1700° F ( 927° C) . . . at 1 hour  
 1792° F ( 978° C) . . . at 1½ hours  
 1925° F (1052° C) . . . at 3 hours

Figure 2-1.1.

**2-1.2** For a closer definition of the time-temperature curve, see Figure 2-1.2.

Time hr. min.	Temperature, deg. Fahr.	Area Above 68 F. Base		Temperature deg. Cent.	Area Above 20 C. Base	
		deg. Fahr.- min.	deg. Fahr.-hr.		deg. Cent.- min.	deg. Cent.-hr.
0:00	68	00	0	20	00	0
0:05	1 000	2 330	39	538	1 290	22
0:10	1 300	7 740	129	704	4 300	72
0:15	1 399	14 150	236	760	7 860	131
0:20	1 462	20 970	350	795	11 650	194
0:25	1 510	28 050	468	821	15 590	260
0:30	1 550	35 360	539	843	19 650	328
0:35	1 584	42 860	714	862	23 810	397
0:40	1 613	50 510	842	878	28 060	468
0:45	1 638	58 300	971	892	32 390	540
0:50	1 661	66 200	1 103	905	36 780	613
0:55	1 681	74 220	1 237	916	41 230	687
1:00	1 700	82 330	1 372	927	45 740	762
1:05	1 718	90 540	1 509	937	50 300	838
1:10	1 735	98 830	1 647	946	54 910	915
1:15	1 750	107 200	1 787	955	59 560	998
1:20	1 765	115 650	1 928	963	64 250	1 071
1:25	1 779	124 180	2 070	971	68 990	1 150
1:30	1 792	132 760	2 213	978	73 760	1 229
1:35	1 804	141 420	2 357	985	78 560	1 309
1:40	1 815	150 120	2 502	991	83 400	1 390
1:45	1 826	158 890	2 648	996	88 280	1 471
1:50	1 835	167 700	2 795	1 001	93 170	1 553
1:55	1 843	176 550	2 942	1 006	98 080	1 635
2:00	1 850	185 440	3 091	1 010	103 020	1 717
2:10	1 862	203 330	3 389	1 017	112 960	1 882
2:20	1 875	221 330	3 689	1 024	122 960	2 049
2:30	1 888	239 470	3 991	1 031	133 040	2 217
2:40	1 900	257 720	4 295	1 038	143 180	2 386
2:50	1 912	276 110	4 602	1 045	153 390	2 556
3:00	1 925	294 610	4 910	1 052	163 670	2 728
3:10	1 938	313 250	5 221	1 059	174 030	2 900
3:20	1 950	332 000	5 533	1 066	184 450	3 074
3:30	1 962	350 890	5 848	1 072	194 940	3 249
3:40	1 975	369 890	6 165	1 079	205 500	3 425
3:50	1 988	389 030	6 484	1 086	216 130	3 602
4:00	2 000	408 280	6 805	1 093	226 820	3 780
4:10	2 012	427 670	7 128	1 100	237 590	3 960
4:20	2 025	447 180	7 453	1 107	248 430	4 140
4:30	2 038	466 810	7 780	1 114	259 340	4 322
4:40	2 050	486 560	8 110	1 121	270 310	4 505
4:50	2 062	506 450	8 441	1 128	281 360	4 689
5:00	2 075	526 460	8 774	1 135	292 470	4 874
5:10	2 088	546 580	9 110	1 142	303 660	5 061
5:20	2 100	566 840	9 447	1 149	314 910	5 248
5:30	2 112	587 220	9 787	1 156	326 240	5 437
5:40	2 125	607 730	10 129	1 163	337 630	5 627
5:50	2 138	628 360	10 473	1 170	349 090	5 818
6:00	2 150	649 120	10 819	1 177	360 620	6 010
6:10	2 162	670 000	11 167	1 184	372 230	6 204
6:20	2 175	691 010	11 517	1 191	383 900	6 398
6:30	2 188	712 140	11 869	1 198	395 640	6 594
6:40	2 200	733 400	12 223	1 204	407 450	6 791
6:50	2 212	754 780	12 580	1 211	419 330	6 989
7:00	2 225	776 290	12 938	1 218	431 270	7 188
7:10	2 238	797 920	13 299	1 225	443 290	7 388
7:20	2 250	819 680	13 661	1 232	455 380	7 590
7:30	2 262	841 560	14 026	1 239	467 540	7 792
7:40	2 275	863 570	14 393	1 246	479 760	7 996
7:50	2 288	885 700	14 762	1 253	492 060	8 201
8:00	2 300	907 960	15 133	1 260	504 420	8 407

Figure 2-1.2. Standard Time-Temperature Curve for Control of Fire Tests.

## 2-2 Furnace Temperatures.

2-2.1 The temperatures of the test exposure shall be deemed to be the average temperature obtained from the readings of not less than nine thermocouples symmetrically disposed and distributed to show the temperature near all parts of the test assembly. The thermocouples shall be protected by sealed porcelain tubes having  $\frac{3}{4}$  in. (19 mm) outside diameter and  $\frac{1}{8}$  in. (3 mm) wall thickness, or, as an alternate, in the case of base metal thermocouples, protected by  $\frac{1}{2}$  in. (13 mm) wrought steel or wrought iron pipe of standard weight. The junction of the thermocouples shall be 6 in. (152 mm) from the exposed face of the test assembly or from the masonry in which the assembly is installed, during the entire test exposure.

2-2.2 The temperatures shall be read at intervals not exceeding 5 minutes during the first 2 hours, and there-

after the intervals may be increased to not more than 10 minutes.

2-2.3 The accuracy of the furnace control shall be such that the area under the time-temperature curve, obtained by averaging the results from the thermocouple readings, is within 10 percent of the corresponding area under the standard time-temperature curve for fire tests of 1 hour or less duration, within 7.5 percent for those over 1 hour and not more than 2 hours, and within 5 percent for tests exceeding 2 hours in duration.

## 2-3 Unexposed Surface Temperatures.

2-3.1 Unexposed surface temperatures shall be recorded and shall be determined in the following manner:

*Exception: Single-layer metal doors need not comply with this section.*

**2-3.1.1** Unexposed surface temperatures shall be taken at not less than three points with at least one thermocouple in each 16-sq ft (1.5-m<sup>2</sup>) area of the door. Thermocouples shall not be located over reinforcements extending through the door, over vision panels, or nearer than 12 in. (305 mm) from the edge of the door.

**2-3.1.2** Unexposed surface temperatures shall be measured with thermocouples placed under flexible, oven-dry, felted asbestos pads  $6 \pm \frac{1}{8}$  in. sq ( $152 \pm 3$  mm sq),  $0.40 \pm 0.05$  in. ( $10 \pm 1$  mm) in thickness, and weighing not less than 1.0 nor more than 1.4 lb/ft<sup>2</sup> (5 kg nor more than 6.8 kg/m<sup>2</sup>). The pads shall be held firmly against the surface of the door and shall fit closely about the thermocouples. The thermocouple leads shall be positioned under the pad for a distance of not less than  $3\frac{1}{2}$  in. (89 mm) with the hot junction under the center of the pad. The thermocouple leads under the pads shall be not heavier than No. 18 AWG (0.82 mm<sup>2</sup>) and shall be electrically insulated with heat-resistant and moisture-resistant coatings.

**2-3.1.3** Unexposed surface temperatures shall be read at intervals not exceeding 5 minutes for the first 30 minutes of the test.

## Chapter 3 Test Assemblies

### 3-1 Construction and Size.

**3-1.1** The construction and size of the test door assembly, consisting of single doors, doors in pairs, special-purpose doors (such as Dutch doors, double-egress doors, etc.), or multisection doors, shall be representative of that for which classification or rating is desired.

**3-1.2** A floor structure shall be provided as part of the opening to be protected, except where such floor interferes with the operation of the door. The floor segment shall be of noncombustible material and shall project into the furnace approximately twice the thickness of the test door, or to the limit of the frame, whichever is greater.

### 3-2 Mounting.

**3-2.1** Swinging doors shall be mounted so as to open into the furnace chamber.

**3-2.2** Sliding and rolling doors, except horizontal slide-type elevator doors, shall be mounted on the exposed side of the opening in the wall closing the furnace chamber.

**3-2.3** Horizontal slide-type elevator doors shall be mounted on the unexposed side of the opening in the wall closing the furnace chamber.

**3-2.4** Access-type doors and chute-type doors and frame assemblies shall be mounted so as to have one assembly open into the furnace chamber and another assembly open away from the furnace chamber.

**3-2.5** Dumbwaiter and service-counter doors and frame assemblies shall be mounted on the exposed side of the opening in the wall.

**3-2.6** Door frames shall be evaluated when mounted so as to have the doors open either away from or into the furnace chamber, at the discretion of the testing authority, to obtain representative information on the performance of the construction under test.

**3-2.7** Surface-mounted hardware (fire-exit devices) for use on fire doors shall be evaluated by being installed in one door assembly swinging into the furnace chamber and another door assembly swinging away from the furnace chamber.

**3-2.8** The mountings of all doors shall be such that they fit snugly within the frame, against the wall surfaces, or in guides, but such mounting shall not prevent free and easy operation of the test door.

### 3-3 Clearances.

**3-3.1** Clearances for swinging doors shall be as follows: With a minus  $\frac{1}{16}$ -in. (1.6-mm) tolerance —  $\frac{1}{8}$  in. (3 mm) along the top,  $\frac{1}{8}$  in. (3 mm) along the hinge and latch jambs,  $\frac{1}{8}$  in. (3 mm) along the meeting edge of doors in pairs, and  $\frac{3}{8}$  in. (10 mm) at the bottom edge of a single swinging door, and  $\frac{1}{4}$  in. (6 mm) at the bottom of a pair of doors.

**3-3.2** Clearances for horizontal sliding doors not mounted within guides shall be as follows: With a minus  $\frac{1}{8}$ -in. (3-mm) tolerance —  $\frac{1}{2}$  in. (12.7 mm) between door and wall surfaces,  $\frac{3}{8}$  in. (10 mm) between door and floor structure, and  $\frac{1}{4}$  in. (6 mm) between the meeting edges of center-parting doors. A maximum lap of 4 in. (102 mm) of the door over the wall opening at sides and top shall be provided.

**3-3.3** Clearances for vertical sliding doors moving within guides shall be as follows: With a minus  $\frac{1}{8}$ -in. (3-mm) tolerance —  $\frac{1}{2}$  in. (12.7 mm) between the door and wall surfaces along top and/or bottom door edges with guides mounted directly to the wall surface and  $\frac{3}{8}$  in. (10 mm) between meeting edges of bi-parting doors or  $\frac{3}{16}$  in. (5 mm) between door and floor structure or sill.

**3-3.4** Clearances for horizontal slide-type elevator doors shall be as follows: With a minus  $\frac{1}{8}$ -in. (3-mm) tolerance —  $\frac{3}{8}$  in. (10 mm) between the door and wall surface,  $\frac{3}{8}$  in. (10 mm) between multisection door panels, and  $\frac{3}{8}$  in. (10 mm) from the bottom of a panel to the sill. Multisection door panels shall overlap  $\frac{3}{4}$  in. (19 mm). Door panels shall lap the wall opening  $\frac{3}{4}$  in. (19 mm) at sides and top.

## Chapter 4 Conduct of Tests

### 4-1 Test Assembly.

**4-1.1** The wall or partition in which the door assembly is tested shall be adequate to retain the assembly through-



out the fire and hose stream test; it shall be constructed of masonry or other materials representative of wall or partition construction.

4-1.2 Door frame wall anchors, when used, shall be suitable for the wall or partition construction.

#### 4-2 Fire Endurance Test.

4-2.1 Maintain the pressure in the furnace chamber as nearly equal to the atmospheric pressure as possible.

4-2.2 Continue the test until the exposure period of the desired classification or rating is reached unless the conditions of acceptance set forth in Chapter 5 are exceeded in a shorter period.

#### 4-3 Hose Stream Test.

4-3.1 Immediately following the fire endurance test, subject the test assembly to the impact, erosion and cooling effects of a hose stream directed first at the middle and then at all parts of the exposed surface, making changes in direction slowly.

4-3.2 Deliver the hose stream through a 2½-in. (64-mm) hose discharging through a National Standard Playpipe of corresponding size equipped with 1 ¼-in. (29-mm) discharge tip of the standard-taper smooth-bore pattern without shoulder at the orifice. The water pressure at the base of the nozzle and for the duration of application in seconds per sq ft of exposed area shall be as prescribed in Table 4-3.2.

4-3.3 The tip of the nozzle shall be located 20 ft (6 m) from and on a line normal to the center of the test door. If impossible to be so located, the nozzle may be on a line deviating not to exceed 30° from the line normal to the center of the test door. When so located the distance from the center shall be less than 20 ft (6 m) by an amount equal to 1 ft (0.3 m) for each 10° of deviation from the normal.

Table 4-3.2 Water Pressure at Base of Nozzle and Duration of Application.

Desired Rating	Water Pressure at Base of Nozzle lb per sq in.	Duration of Application Seconds per sq ft or Exposed Area
3 hour	54 (310 kPa)	3.0 (32 seconds/m <sup>2</sup> )
1½ hour and over, if less than 3 hour	30 (207 kPa)	1.5 (16 seconds/m <sup>2</sup> )
1 hour and over, if less than 1½ hour	30 (207 kPa)	0.9 (10 seconds/m <sup>2</sup> )
Less than 1 hour	30 (207 kPa)	0.6 (6 seconds/m <sup>2</sup> )

NOTE: The exposed area may be calculated using the outside dimensions of the test specimen, including a frame, hangers, tracks, or other parts of the assembly if provided, but normally not including the wall into which the specimen is mounted. Where multiple test specimens are mounted in the same wall, the rectangular or square wall area encompassing all of the specimens will have to be considered as the exposed area since the hose stream must traverse this area during its application.

## Chapter 5 Report

### 5-1 Results.

5-1.1 Results shall be reported in accordance with the performance in the tests prescribed in these test methods. The report shall show:

5-1.1.1 The performance under the desired exposure period chosen from the following: 20 minutes, 30 minutes, ¾ hour, 1 hour, 1½ hours, or 3 hours.

5-1.1.2 The temperature measurements of the furnace.

5-1.1.3 The temperature measurements of the unexposed side.

5-1.1.4 All observations having a bearing on the performance of the test assembly.

5-1.1.5 Flaming, if any, on the unexposed surface of the door leaf.

5-1.1.6 The amount of movement of any portion of the edges of the door adjacent to the door frame from the original position (see Chapter 6).

5-1.1.7 The materials and the construction of the door, frame and wall or partition and the details of the installation, hardware, door frame and wall anchors, hangers, guides, trim, finish and clearance or lap shall be recorded or appropriately referenced to ensure positive identification or duplication in all respects.

5-1.1.8 Pressure measurements made in the furnace and location of such measurements relative to the elevation of the top of the door.

## Chapter 6 Conditions of Acceptance

### 6-1 General.

6-1.1 A door assembly shall be considered as meeting the requirements for acceptable performance when it remains in the opening during the fire endurance test and hose stream test within the following limitations:

6-1.1.1 The test assembly shall have withstood the fire endurance test and the hose stream test without developing openings anywhere through the assembly.<sup>1</sup>

*Exception No. 1: Dislodging of small portions of glass light during the hose stream.*

*Exception No. 2: Permissible separation between meeting edges of pairs of doors as stated in 6-2.4, 6-3.4 and 6-3.10.*

<sup>1</sup> Openings, for purposes of this provision, are defined as through-holes in the assembly that can be seen from the unexposed side when looking perpendicular to the plane of the assembly at the location of the suspected opening.

*Exception No. 3: Permissible openings between the bottom edges of doors and sills as stated in 3-3.1 through 3-3.4 and in 6-3.3.*

**6-1.1.2** No flaming shall occur on the unexposed surface of a door assembly during the first 30 minutes of the classification period.

**6-1.1.3** After 30 minutes, some intermittent light flames [approximately 6 in. (152 mm) long], for periods not exceeding 5-minute intervals, may occur along the edges of doors.

**6-1.1.4** Light flaming may occur during the last 15 minutes of the classification period on the unexposed surface area of the door, provided it is contained within a distance of 1½ in. (38 mm) from a vertical door edge and within 3 in. (76 mm) from the top edge of the door and within 3 in. (76 mm) from the top edge of the frame of a vision panel.

**6-1.1.5** When hardware is to be evaluated for use on fire doors, it shall hold the door closed in accordance with the conditions of acceptance for an exposure period of 3 hours and, in addition, the latch bolt shall remain projected and shall be intact after the test. The hardware need not be operable after test.

## **6-2 Swinging Doors.**

**6-2.1** The movement of swinging doors shall not result in any portion of the edges adjacent to the door frame moving from the original position in a direction perpendicular to the plane of the door more than the thickness of the door during the first half of the classification period, nor more than 1½ times the door thickness during the entire classification period or as a result of the hose stream test.

**6-2.2** The movement of swinging doors mounted in pairs shall not result in any portion of the meeting edges moving more than the thickness of the door away from the adjacent door edge in a direction perpendicular to the plane of the doors during the entire classification period or as a result of the hose stream test.

**6-2.3** An assembly consisting of a pair of swinging doors incorporating an astragal shall not separate in a direction parallel to the plane of the doors more than ¾ in. (19 mm) nor a distance equal to the throw of the latch bolt at the latch location.

**6-2.4** An assembly consisting of a pair of swinging doors, without an overlapping astragal, for a fire and hose stream exposure of 1½ hours or less, shall not separate along the meeting edges more than ¾ in. (10 mm), including the initial clearance between doors.

**6-2.5** An assembly consisting of a single swinging door shall not separate more than ½ in. (13 mm) at the latch location.

**6-2.6** Door frames to be evaluated with doors shall remain securely fastened to the wall on all sides and shall not permit through-openings between frame and doors or between frame and adjacent wall.

## **6-3 Sliding Doors.**

**6-3.1** Doors mounted on the face of the wall shall not move from the wall sufficiently to develop a separation of more than 2½ in. (73 mm) during the entire classification period or as a result of the hose stream test.

**6-3.2** Doors mounted in guides shall not release from the guides, and the guides shall not loosen from fastenings.

**6-3.3** The bottom bar of rolling steel doors shall not separate from the floor structure more than ¾ in. (19 mm) during the entire classification period or as a result of the hose stream test.

**6-3.4** The meeting edge of center-parting horizontal sliding doors and bi-parting vertical sliding doors shall not separate more than the door thickness in a direction perpendicular to the plane of the doors.

**6-3.5** The meeting edges of center-parting horizontal sliding doors and bi-parting vertical sliding doors without an overlapping astragal, for a fire and hose stream exposure of 1½ hours or less, shall not separate in a direction parallel to the plane of the doors more than ¾ in. (10 mm) along the meeting edges, including the initial clearance between doors.

**6-3.6** The meeting edges of center-parting horizontal sliding doors incorporating an astragal shall not separate in a direction parallel to the plane of the doors more than ¾ in. (19 mm) nor a distance equal to the throw of the latch bolt along the meeting edges.

**6-3.7** The bottom edge of service-counter doors or single-slide dumbwaiter doors shall not separate from the sill more than ¾ in. (10 mm).

**6-3.8** A resilient astragal, if provided, shall not deteriorate sufficiently to result in through openings during the fire endurance test, but small portions may be dislodged during the hose stream test.

**6-3.9** The lap edges of horizontal slide-type elevator doors, including the lap edges of multisection doors, shall not move from the wall or adjacent panel surfaces sufficiently to develop a separation of more than 2½ in. (73 mm) during the entire classification period or immediately following the hose stream test.

**6-3.10** The meeting edges of center-parting horizontal slide-type elevator door assemblies, for a fire and hose stream exposure of 1½ hours or less, shall not move apart more than 1¼ in. (32 mm) as measured in any horizontal plane during the entire classification period or immediately following the hose stream test.

## Appendix A Commentary

*This Appendix is not a part of the requirements of this NFPA document... but is included for information purposes only.*

**A-1 Introduction.** This commentary has been prepared to provide the user of NFPA 252 with background information on the development of the standard and its application in fire protection of buildings. It also provides guidance in the planning and performance of fire tests and in the reporting of results. No attempt has been made to incorporate all of the available information on fire testing in this commentary. The serious student of fire testing is strongly urged to peruse the referenced documents for a better appreciation of the history of fire-resistant design and the intricate problems associated with testing and with interpretation of test results.

### A-2 Application.

**A-2.1** Compartmentation of buildings by fire-resistive walls has been recognized for many years as an efficient method of restricting fires to the area of origin (1, 2, 5, 6, 7, 8, 16)<sup>1</sup> or limiting their spread. The functional use of buildings, however, demands a reasonable amount of communication between compartments necessitating openings in these fire-resistive walls. Fire door assemblies are utilized to protect these openings and maintain the integrity of the fire barrier (11). Openings in walls have been classified by fire protection standards (8, 9, 15) and building codes in accordance with the location and purpose of the wall in which the opening occurs, and these standards and codes specify the fire rating of the assembly required to protect the openings.

**A-2.2** These fire protection standards and building codes permit labeled wire glass panels and other penetrations, such as labeled ventilation louvers, in some rated doors. The reader is referred to the model building codes, NFPA 80, *Fire Doors and Windows*, and the specific fire door manufacturer's label service for information on the types and sizes of these openings.

**A-2.3** Fire doors must also be properly installed to maintain their fire rating. Again, NFPA 80, *Fire Doors and Windows*, and the specific fire door manufacturer's label service should be consulted for details on the installation of fire door assemblies and for limitations on the application of specific labeled fire doors.

**A-3 Historical Aspects.** The first effort to test fire doors is reported in a series of tests conducted in Germany in 1893 (3, 4, 10). The British Fire Prevention Committee began testing in 1899 and produced a Standard Table of Fire Resisting Elements including Fire Resisting Doors (1). Underwriters Laboratories Inc. was involved in testing and listing fire doors shortly after 1900 using their own standards. ASTM adopted Method E-152 on fire door assembly tests in 1941.

<sup>1</sup> The numbers in parentheses refer to the list of references at the end of this Appendix.

### A-4 Scope and Significance.

**A-4.1** NFPA 252 is intended to provide methods for measuring the relative performance of fire door assemblies when exposed to predetermined standard fire conditions. The standard provides for testing of several classifications, types, and methods of door operation including swinging, sliding, rolling, and sectional doors (8). Since the effectiveness of the opening protection is dependent upon the entire assembly, proper attention must be paid to the installation as a unit. Accordingly, fire door assemblies are required to be tested as an assembly of all necessary elements and equipment, including the door frame and hardware.

**A-4.2** Fire protection ratings are assigned to indicate that the assembly has continued to perform as required for periods of 3, 1½, 1, ¾, ½ or ⅓ hour. Labels on assemblies also carry the letter designations of A, B, C, D, or E. These letter designations are not a part of the NFPA 252 standard classification system but are used to designate the class of opening for which the door is designed as determined by other standards (8, 9).

**A-4.3** The ⅓-hour or 20-minute fire-rated door is relatively new. Concern about the uniform adequacy of the 1¾-in. (44.5-mm) solid bonded wood core construction and the difficulty of determining equivalency of other types of doors led to a voluntary consensus to test such doors for 20 minutes in the NFPA 252 furnace using the same acceptance criteria as specified for door assemblies traditionally tested for a longer period of time except that the hose stream test is required by the test method but may not be required by regulatory codes.

**A-4.4** It is usual for a fire door to have a fire protection rating lower than the wall in which it is installed, for example, a 1½-hour fire door in a wall having a fire-resistance rating of 2 hours. This is justified in part by the fact that under normal conditions of use the potential fire exposure in the vicinity of a door opening is lessened since there will be a clear space on both sides of the opening for traffic purposes. Wall assemblies are put together on site and their uniformity is not as likely as a complete factory produced door assembly (e.g., undesigned penetrations tend to "creep" into wall assemblies). For this reason, any "factor of safety" that may be tacitly called for in a wall assembly requirement should exceed that of a door assembly. If the opening is not used, combustibles may be piled against the door, and the assumed enclosure protection will not be maintained. In these instances, the openings should be made equal to the rating of the wall or precautions taken to prevent storage of combustibles against the doors (2, 8).

### A-5 Limitations.

**A-5.1** Methods intend that the door be tested until the conditions of acceptance are met for the desired exposure period unless the conditions of acceptance are exceeded in a shorter period. It is not intended that a fire door subjected to a building fire will be satisfactory for reuse after the fire.

**A-5.2** The variations in material performance preclude any prediction of an assembly's performance in walls

other than those types used in the test. The standard also makes no provisions for measuring the generation of smoke and gases or other products of combustion from the unexposed side of the door. Temperature measurements on the unexposed side, when recorded, are stopped after 30 minutes.

#### A-6 Furnace.

**A-6.1** The methods provide details on the operating characteristics and temperature-measurement requirements of the test furnace. The walls of the furnace should be typically of furnace refractory materials and should be sufficiently rugged to maintain the overall integrity of the furnace during the fire-exposure period.

**A-6.2** The thermocouples in the furnace are located 6 in. (152 mm) from the face of the door or the wall in which the door is installed. Otherwise no furnace depth is specified. A depth of 8 to 18 in. (203 to 457 mm) has been considered desirable by most laboratories. The reader is urged to consult reference documents for a more comprehensive review of furnace design and performance (12, 13).

#### A-7 Temperature — Time Curve.

**A-7.1** A specific temperature — time relationship for the test fire is defined in the standard and in Figure 2-1.2. The actual recorded temperature — time condition obtained in the furnace is required to be within specified percentages of those of the standard curve. The number and type of temperature-measuring devices are outlined in the standard. Specific standard practices for location and use of these temperature-measuring devices are also outlined in the standard.

**A-7.2** The standard temperature — time ( $T - t$ ) curve used in NFPA 252 is considered to represent a severe building fire (5). The curve was adopted in 1918 as a result of several conferences by eleven technical organizations, including testing laboratories, insurance underwriters, fire protection associations, and technical societies (14, 15, 16). It should be recognized that the  $T - t$  relationship of these test methods represents only one real fire situation (14, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27).

**A-8 Furnace Control.** The standard contains specific instruction for measuring temperatures in the furnace and for selection of the required thermocouples. Thermocouples of the design specified are sufficiently rugged to retain accuracy throughout anticipated test periods. However, their massive construction results in a significant time delay in response to temperature change and results in temperatures exceeding the indicated temperatures during the early stages of the test period when the temperature rises rapidly. The iron or porcelain tubes surrounding the junction and leads of the thermocouple provide a shield against degradation of the junction and increase the thermal inertia. It is customary for laboratories to replace furnace thermocouples after three or four accumulated hours of use.

#### A-9 Unexposed Surface Temperature.

**A-9.1** Conditions of acceptance for fire-resistive walls specify that the temperature increase on the unexposed side of the wall not exceed an average of 250°F (121°C) above ambient, and that there be no passage of flames or gases hot enough to ignite combustibles. It is obvious that the necessity of maintaining some clearances for efficient operation of the door and the possibility of warping preclude completely any attempt to restrict escape of gases and minor flames on the periphery of doors.

**A-9.2** The standard describes a standard procedure for measuring the unexposed surface temperatures. However, unexposed surface temperatures are not a condition of acceptance for NFPA 252. Building regulations do restrict temperature transmission for some wall-opening protectives (8, 9). For instance, it is usual for codes to limit the temperature rise on the unexposed side of fire doors protecting exit stairways to 450°F (232°C) during the first 30 minutes of test. This criterion assumes that a higher temperature would provide enough radiant heat to discourage if not prevent occupants from passing by the door during an emergency. It is present practice for testing laboratories to provide labels on fire doors indicating that the maximum transmitted temperature on the unexposed side is 250°F, 450°F, or 650°F (121°C, 232°C, or 343°C) above ambient. If not indicated on the label, the temperature rise during the first 30 minutes may or may not be in excess of 650°F (343°C). Temperature rise on the unexposed side of glass panels and louvers is not measured.

**A-9.3** Information on the properties of pads used to cover the thermocouples on the unexposed surfaces may be found in Appendix A2 of ASTM Standard E-119.

#### A-10 Test Assemblies.

**A-10.1** NFPA 252 provides a relative measure of performance for door assemblies. In order to establish confidence that the tested doors will perform in a building as expected, the tested assembly and its installation in the test frame must be representative of actual use conditions. Therefore, NFPA 80, *Fire Doors and Windows* (8), or such other standards or specifications should be consulted before testing an assembly.

**A-10.2** The standard provides additional minimum requirements including direction of door swing, location in relation to the exposed side of the wall, and specific clearance between the door and its frame or wall, or both. Regardless of other specifications, these instructions must be followed in order to make a comparative judgment on test results.

**A-11 Conduct of Tests.** The test frame or wall in which a door assembly is installed should be rugged enough to endure the exposed fire during the time period, without affecting the door assembly. Traditionally, this wall has been of masonry construction. Today, fire doors are installed in other than masonry walls and have been tested in walls framed with metal and wood studs covered with a number of materials.

## A-12 Furnace Pressures.

**A-12.1** A fire in a building compartment will create both negative and positive pressures on door assemblies depending upon atmospheric conditions, height above ground, wind conditions, and ventilation of the compartment at the beginning and during the fire.

**A-12.2** NFPA 252 specifies that the pressure in the furnace be maintained as nearly equal to atmospheric pressure as possible. Experience has shown this practice to be acceptable. The pressure in the furnace is required to be reported but the method of measuring it is optional with the laboratory.

**A-13 Hose Stream Test.** Immediately following a fire test, the test frame is removed from the furnace and the door assembly is subjected to the impact, erosion, and cooling effects of a stream of water from a 2½-in. (63.5-mm) hose discharging through a standard playpipe equipped with a 1¼-in. (28.5-mm) tip under specified pressures. The application of water produces stresses in the assembly and provides a measure of its structural capability. Weights were once used to provide a measure of the ability of the assembly to withstand impact. The hose stream is considered to be an improvement in uniformity and accuracy over the weights.

**A-14 Conditions of Acceptance.** The standard provides a specific set of conditions by which the performance of the door is measured, the most important being that it remain in place during both the fire test and the hose stream test. Instructions for conducting the hose stream test are detailed in the standard.

## A-15 References.

- (1) Bird and Docking, *Fire in Buildings*, D. Van Nostrand Co., Inc., New York, 1949.
- (2) Ferguson, R. S., "Principles of Fire Protection," National Bldg. Code of Canada Technical Paper No. 272, Div. of Bldg. Research, National Research Council of Canada, Ottawa, March 1970.
- (3) Shoub, Harry, "Early History of Fire Endurance Testing in the United States," Symposium on Fire Test Methods, ASTM STP 301, Am. Soc. Testing Mats., 1961.
- (4) Konicek, L., and Lie, T. T., "Temperature Tables for Ventilation Controlled Fires," Bldg. Research Note No. 94, National Research Council of Canada, September, 1974.
- (5) Gordon, C., "Considerations of Life Safety and Bldg. Use," DBR Paper No. 699, Division of Building Research, National Research Council of Canada, Ottawa, January, 1977.
- (6) Gross, D., "Field Burnout Tests of Apartment Dwelling Units," Bldg. Science Series 10, U.S. Dept. of Commerce, National Bureau of Standards, Sept. 29, 1967.
- (7) Law, Margaret, "Radiation from Fires in a Compartment," Fire Research Technical Paper No. 20, Her Majesty's Stationery Office, London 1968.
- (8) NFPA 80, "*Fire Doors and Windows*," National Fire Protection Assn.
- (9) Model Building Codes: *Basic Building Code* - Building Officials & Code Administrators International Inc., *Uniform Building Code* - International Conference of Building Officials Inc., *Standard Building Code* - Southern Building Code Congress International.
- (10) Babrauskas, Vytenis, and Williamson, Robert Brady, "Historical Basis of Fire Resistance Testing, Part I and Part II," *Fire Technology*, Vol. 14, No. 3 and No. 4, 1978, pp. 184-194, 304-316.
- (11) Shoub, H., and Gross, D., "Doors as Barriers to Fire and Smoke," Building Science Series 3, National Bureau of Standards, March 25, 1966.
- (12) Seigel, L. G., "Effects of Furnace Design on Fire Endurance Test Results," Fire Test Performance, ASTM STP 463, Am. Soc. Testing Mats., 1970, pp. 56-67.
- (13) Harmathy, T. Z., "Design of Fire Test Furnaces," *Fire Technology*, Vol. 5, No. 2, May 1969, pp. 146-150.
- (14) Seigel, L. G., "The Severity of Fires in Steel-Framed Buildings," Symposium No. 2, Her Majesty's Stationery Office, 1968, London. Proceedings of the Symposium held at the Fire Research Station, Boreham Woods, Herts (England), January 1967.
- (15) *Fire Protection Handbook*, Revised Fourteenth Edition, National Fire Protection Assn., Boston, 1978.
- (16) Harmathy, T. Z., "Designer's Option: Fire Resistance or Ventilation," Technical Paper No. 436, Division of Building Research, National Research Council of Canada, Ottawa, NRCC 14746.
- (17) Odeen, Kai, "Theoretical Study of Fire Characteristics in Enclosed Spaces," Bulletin No. 10., Royal Institute of Technology, Division of Bldg. Construction, Stockholm, 1963.
- (18) Shorter, G. W., "Fire Protection Engineer and Modern Building Design," NFPA *Fire Technology*, Vol. 4, No. 3, August 1968, pp. 206-213.
- (19) Wall Street Journal, Dec. 8, 1970, "Danger-Flammable," by-line Richard Stone.
- (20) Ryan, J. E., "Assessment of Fire Hazards in Buildings," Ignition, Heat Release, and Noncombustibility of Materials, ASTM STP 502, Am. Soc. Testing Mats., 1972.
- (21) Harmathy, T. Z., "Design Approach to Fire Safety in Buildings," *Progressive Architecture*, April 1974, pp. 82-87, NRCC 14076.
- (22) Harmathy, T. Z., "A New Look at Compartment Fires Part I and Part II," *Fire Technology*, Vol. 8, No. 3 and No. 4, 1972, pp. 196-217, 326-351.
- (23) Robertson, A. F., and Gross, Daniel, "Fire Load, Fire Severity, and Fire Endurance," Fire Test Performances ASTM, STP 464, Am. Soc. Testing Mats., 1970.
- (24) Ingberg, et al., "Combustible Contents in Buildings," National Bureau of Standards BMS 149, July 1957.
- (25) Heselden, A. J. M., "Parameters Determining the Severity of Fire," Symposium No. 2, Her Majesty's Stationery Office, 1968, London. Proceedings of the Symposium held at the Fire Research Station, Boreham Woods, Herts (England) on January, 1967.