



UL 790

STANDARD FOR SAFETY

Standard Test Methods for Fire Tests of
Roof Coverings

ULNORM.COM : Click to view the full PDF of UL 790 2022

ULNORM.COM : Click to view the full PDF of UL 790 2022

UL Standard for Safety for Standard Test Methods for Fire Tests of Roof Coverings, UL 790

Ninth Edition, Dated February 18, 2022

Summary of Topics

This new edition of ANSI/UL 790 dated February 18, 2022 includes the following changes in requirements:

- ***Listing of Test Methods in Scope; [1.1](#)***
- ***Update of Scope and Roof Deck Clarification; [1.2](#), [1.4](#)***
- ***Class B Burning Brand Test Modifications; [Table 3.1](#), [8.4.2.1](#)***
- ***[Figure 4.1](#) Title Change and Editorial Corrections; [4.2.1](#), [4.2.2](#)***
- ***Roof Coverings Clarification; [4.2.3](#), [4.2.4](#)***
- ***Burning Brand Deck Clarification; [4.2.5](#)***
- ***Spread-of-Flame Test Deck Clarification; [4.3.1](#)***
- ***Clarification to [4.4.1](#)***
- ***Thermocouple Stabilization for Calibration; [5.5](#)***
- ***Intermittent-Flame Test Air Supply; [6.1](#)***
- ***Ignition of Brands Timing; [8.3.1](#)***
- ***Flying-Brand Test Air Current Clarity; [9.3](#)***

The new and revised requirements are substantially in accordance with Proposal(s) on this subject dated October 1, 2021.

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form by any means, electronic, mechanical photocopying, recording, or otherwise without prior permission of UL.

UL provides this Standard "as is" without warranty of any kind, either expressed or implied, including but not limited to, the implied warranties of merchantability or fitness for any purpose.

In no event will UL be liable for any special, incidental, consequential, indirect or similar damages, including loss of profits, lost savings, loss of data, or any other damages arising out of the use of or the inability to use this Standard, even if UL or an authorized UL representative has been advised of the possibility of such damage. In no event shall UL's liability for any damage ever exceed the price paid for this Standard, regardless of the form of the claim.

Users of the electronic versions of UL's Standards for Safety agree to defend, indemnify, and hold UL harmless from and against any loss, expense, liability, damage, claim, or judgment (including reasonable attorney's fees) resulting from any error or deviation introduced while purchaser is storing an electronic Standard on the purchaser's computer system.

No Text on This Page

ULNORM.COM : Click to view the full PDF of UL 790 2022

FEBRUARY 18, 2022



ANSI/UL 790-2022

1

UL 790

Standard for Standard Test Methods for Fire Tests of Roof Coverings

The first through seventh editions were titled Tests for Fire Resistance of Roof Covering Materials.

First Edition – September, 1958
Second Edition – April, 1969
Third Edition – May, 1973
Fourth Edition – December, 1978
Fifth Edition – October, 1983
Sixth Edition – October, 1995
Seventh Edition – September, 1997
Eighth Edition – April, 2004

Ninth Edition

February 18, 2022

This ANSI/UL Standard for Safety consists of the Ninth Edition.

The most recent designation of ANSI/UL 790 as an American National Standard (ANSI) occurred on February 18, 2022. ANSI approval for a standard does not include the Cover Page, Transmittal Pages, and Title Page.

The Department of Defense (DoD) has adopted UL 790 on March 21, 1984. The publication of revised pages or a new edition of this Standard will not invalidate the DoD adoption.

Comments or proposals for revisions on any part of the Standard may be submitted to UL at any time. Proposals should be submitted via a Proposal Request in UL's On-Line Collaborative Standards Development System (CSDS) at <https://csds.ul.com>.

UL's Standards for Safety are copyrighted by UL. Neither a printed nor electronic copy of a Standard should be altered in any way. All of UL's Standards and all copyrights, ownerships, and rights regarding those Standards shall remain the sole and exclusive property of UL.

COPYRIGHT © 2022 UNDERWRITERS LABORATORIES INC.

No Text on This Page

ULNORM.COM : Click to view the full PDF of UL 790 2022

CONTENTS

INTRODUCTION

1	Scope	5
2	Units of Measurement	5

PERFORMANCE

3	General	6
4	Preparation of Samples	6
4.1	General	6
4.2	Intermittent-flame, burning-brand, and flying-brand test decks	6
4.3	Spread-of-flame test decks	13
4.4	Application	16
4.5	Conditioning	17
5	Test Apparatus and Set-Up – Intermittent-Flame, Spread-of-Flame, Burning-Brand, and Flying-Brand Tests	17
6	Intermittent-Flame Test	20
7	Spread-of-Flame Test	20
8	Burning-Brand Test	20
8.1	General	20
8.2	Size and construction of brands	21
8.3	Ignition of brands	22
8.4	Test conditions	22
8.5	Duration of test	23
8.6	Observations	24
9	Flying-Brand Test	24
10	Rain Test	24
11	Weathering Test	25

CONDITIONS OF ACCEPTANCE

12	General	25
13	Report	26

ANNEX A – (Informative) – ADDITIONAL PROCEDURE FOR CALIBRATION OF APPARATUS

A1	General	27
A2	Calibration Deck	27
A3	Calibration Procedure	29

No Text on This Page

ULNORM.COM : Click to view the full PDF of UL 790 2022

INTRODUCTION

1 Scope

1.1 These requirements cover the measurement of the relative fire characteristics of roof coverings exposed to simulated fire sources originating from outside a building on which the coverings are installed. They are applicable to roof coverings intended for installation on either combustible or noncombustible roof decks (see [1.4](#)) when the roof coverings are applied as intended. The following test methods are included:

- a) Intermittent-Flame Exposure test;
- b) Spread of Flame test;
- c) Burning Brand test;
- d) Flying Brand test; and
- e) Rain test.

1.2 Three classes of fire exposure are described.

- a) Class A roof coverings that are expected to be effective against severe fire exposures. Under such exposures, roof coverings of this class afford a high degree of fire protection to the roof deck, do not slip from position, and are not expected to produce flying brand.
- b) Class B roof coverings that are expected to be effective against moderate fire exposures. Under such exposures, roof coverings of this class afford a moderate degree of fire protection to the roof deck, do not slip from position, and are not expected to produce flying brand.
- c) Class C roof coverings that are expected to be effective against light fire exposures. Under such exposures, roof coverings of this class afford a light degree of fire protection to the roof deck, do not slip from position, and are not expected to produce flying brand.

1.3 Tests conducted in accordance with these requirements are intended to demonstrate the performance of roof coverings during the types and periods of fire exposure involved, but are not intended to determine the acceptability of roof coverings for use after exposure to fire. These fire test methods do not provide a basis to compare expected performance under all actual fire conditions but they do provide a basis for comparison of the response of roof coverings when subjected to fire sources that are described herein.

1.4 These test methods address roof coverings used over both combustible and noncombustible decks. A combustible deck is generally constructed using materials that do not comply with the requirements of ASTM E136, such as wood sheathing boards, oriented strand boards (OSB), or plywood. A noncombustible deck is generally constructed entirely of materials that comply with the requirements of ASTM E136, such as metal, concrete, or poured gypsum.

2 Units of Measurement

2.1 Values stated without parentheses are the requirement. Values in parentheses are explanatory or approximate information.

PERFORMANCE

3 General

3.1 Representative samples of a roof covering material, assembled to test decks as described in Section 4, are to be subjected to the applicable tests described in Sections 6 – 11 as specified in Table 3.1.

Table 3.1
Required Tests and Test Assemblies

Material to be tested	Required number of test assemblies ^a					
	Intermittent-flame test, Section 6	Spread-of-flame test, Section 7	Burning-brand test, Section 8	Flying-brand test, Section 9	Rain test, Section 10	Weathering test, Section 11
Other than wood shakes or shingles, for installation on:						
A. Combustible decks:						
1. Class A	2	2	4	NA	NA	NA
2. Class B or C	2	2	2 (4) ^c	NA	NA	NA
B. Noncombustible decks only	NA	2	NA	NA	NA	NA
Wood shakes and shingles ^b :						
A. Class A	3 (2) [5]	3	6 (2) [5]	3 (2) [5]	6	15
B. Class B or C	3 (2) [5]	3	3 (2) [5]	3 (2) [5]	6	15

^a NA – Test is not required.

^b Number in parentheses is number of samples from Rain Test, Section 10, to be tested. Number in brackets is number of samples from Weathering Test, Section 11, to be tested.

^c Number in parentheses is number of samples for Class B burning brand tests to be tested, when conducted on Class A burning brand decks as described in 8.4.2.1, Exception.

4 Preparation of Samples

4.1 General


4.1.1 Representative samples of a roof covering material are to be applied, as described in 4.4, to test decks constructed in accordance with the applicable requirements of 4.2.1 – 4.3.2. The assemblies are to be conditioned in accordance with 4.4 prior to testing.

4.2 Intermittent-flame, burning-brand, and flying-brand test decks

4.2.1 Except as indicated in 4.2.2 – 4.2.5, the test deck for the Intermittent-Flame Test, Section 6, and the Burning-Brand Test, Section 8, is to be 3-1/3 feet (1.0 m) wide by 4-1/3 feet (1.3 m) long and is to be made of kiln-dried No. 1 white pine lumber with not less than 8 nor more than 12 percent moisture content. The lumber is to be free from large or loose knots, sapwood, rot, or pitch pockets, and is to contain no edge knots. Individual deck boards are to be of nominal 1 by 8 inch (19.1 by 184 mm) lumber (dressed on four sides). If used for the Class C burning brand test, see 8.4.3.1 – 8.4.5.1, the width of the deck board is to be such that the brands will be located directly over the spaces between the boards. The deck boards are to be laid across the shorter dimension of the test deck, spaced 1/4 inch (6.4 mm) apart, and securely nailed to two nominal 2 by 4 inch (38 by 89 mm) wood battens located under and flush with the outer edges of the deck. Decks so constructed are to be even and uniform. Figure 4.1 and Figure 4.2 illustrate the construction details of these decks.

Figure 4.1


Class A, B, and C Intermittent-Flame and Class A and B Burning-Brand Pine Board Deck

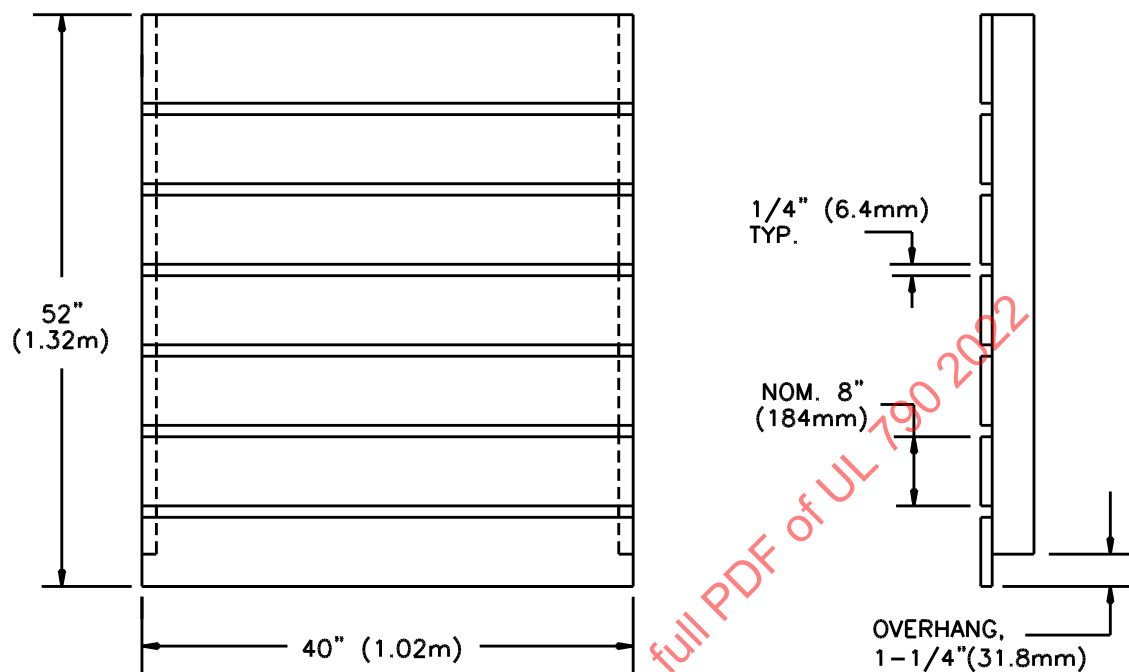

S2449

Figure 4.2


Class C Burning Brand Deck with 3/4 inch Pine Boards

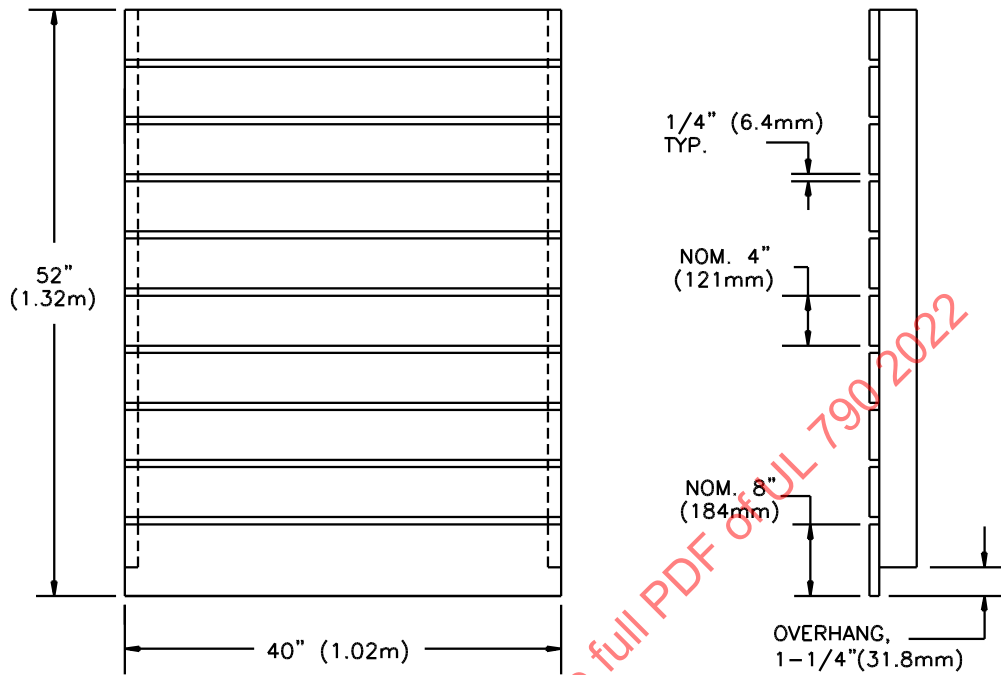

S2450

4.2.2 For the Intermittent-Flame Test, Section 6, Burning-Brand Test, Section 8, Flying-Brand Test, Section 9, and Rain Test, Section 10, on treated wood shingles and shakes, the test decks are to be constructed of nominal 1 by 4 inch (19.1 by 89 mm) lumber (dressed on four sides), spaced 1-1/2 inches (38.1 mm) apart, and securely nailed to two nominal 2 by 4 inch (38 by 89 mm) wood battens. The lumber is to be of the quality specified in 4.2.1. Figure 4.3 illustrates the construction details of this deck.

Figure 4.3

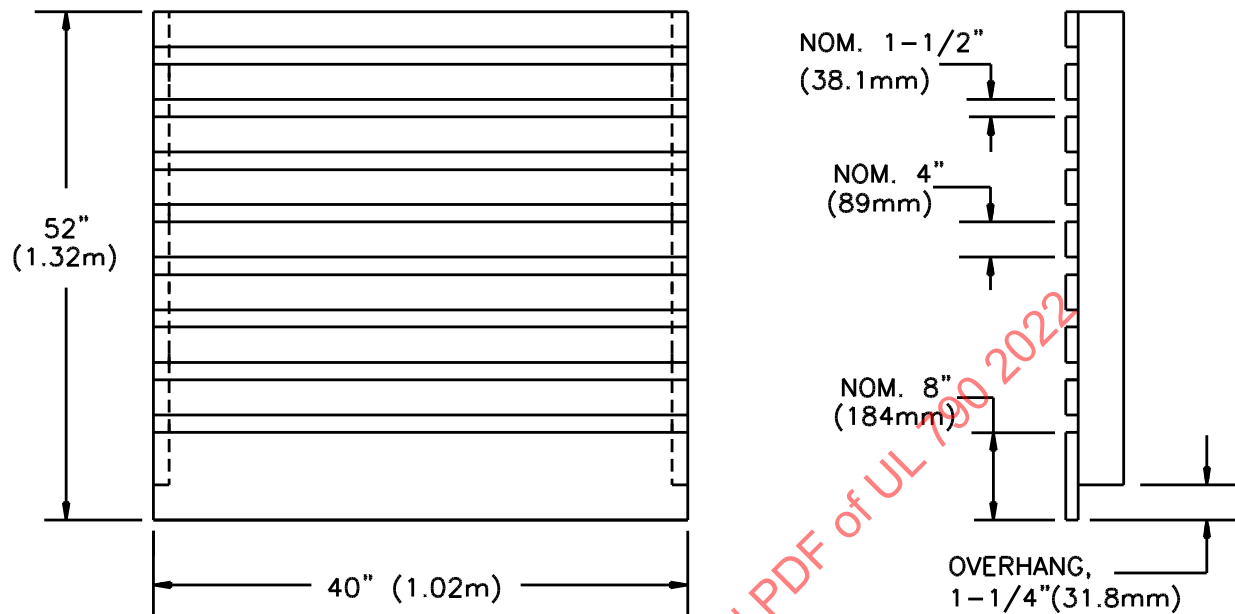
Intermittent-Flame, Burning-Brand and Flying-Brand Deck for Use with Wood Shingles and Shakes

S2451

4.2.3 For roof coverings investigated as applied to other decks, the minimum thickness shall be specified by the test sponsor and noted in the Report. Plywood, if used, shall be exterior type A-C grade, Group 1, with face and back veneers of Douglas fir marked as conforming to Department of Commerce (DOC) PS1 for soft plywood. Oriented Strand Board (OSB), if used shall be marked as conforming to DOC PS2. These plywood decks are to have 1/8 inch (3.2 mm) vertical and horizontal joints, and all vertical joints are to be centered on nominal 2 by 4 inch (38 by 89 mm) wood battens. See [4.2.4](#) and [4.2.5](#). When recommended by the test sponsor the battens shall also be used for horizontal joints and noted in the test report.

4.2.4 A plywood or OSB deck to be used for the Intermittent Flame Test is to have a 1/8 inch (3.2 mm) horizontal joint 8 inches (200 mm) from and parallel to the 3-1/3 foot (1.02 m) long leading edge. In addition, a 1/8 inch (3.2 mm) vertical joint that is centered on the deck and extends from the leading edge of the deck to the horizontal joint is to be provided. [Figure 4.4](#) illustrates the construction details of this deck.


Figure 4.4
Intermittent-Flame Plywood Deck

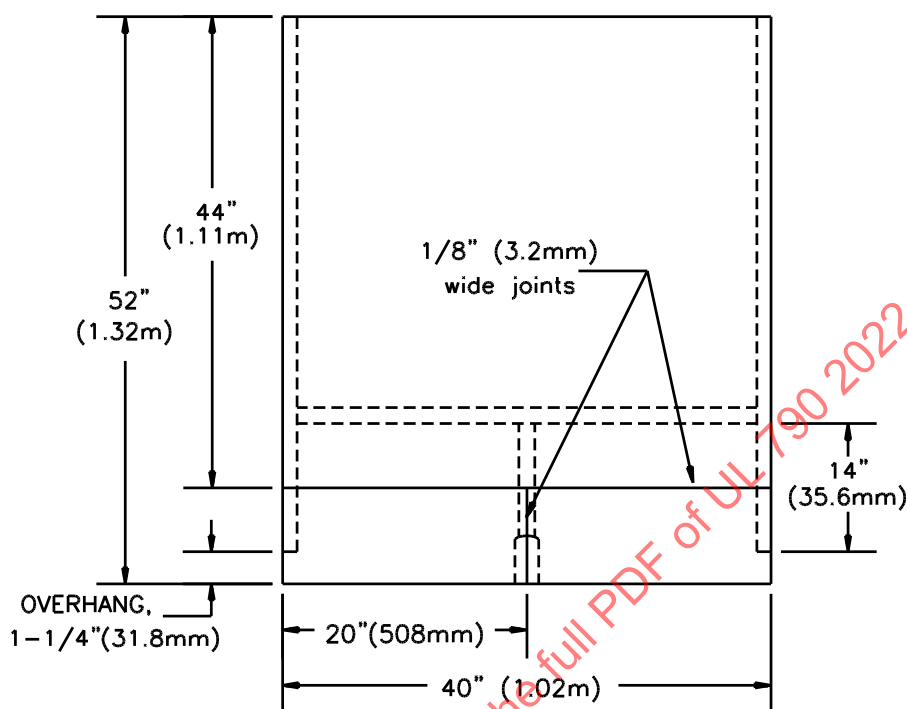

S2445


4.2.5 For a plywood or OSB deck to be used for a Class A or B Burning-Brand Test, a 1/8 inch (3.2 mm) horizontal joint is to be installed 22-1/2 inches (572 mm) from, and parallel to, the leading edge of the deck. A deck to be used for a Class A test is to have a vertical 1/8 inch (3.2 mm) wide joint centered on the deck and extending above the horizontal joint. A deck to be used for a Class B test is to be provided with two 1/8 inch (3.2 mm) vertical joints, extending above the horizontal joint, and each located 10 inches (254 mm) from and parallel to the side edges of the deck. A plywood or OSB deck to be used for a Class C Burning-Brand Test is to have five evenly spaced 1/8 inch (3.2 mm) wide horizontal joints, between each piece of plywood. [Figure 4.5](#) – [Figure 4.7](#) illustrate the construction details of these decks.

Figure 4.5
Class A Burning-Brand Plywood Deck

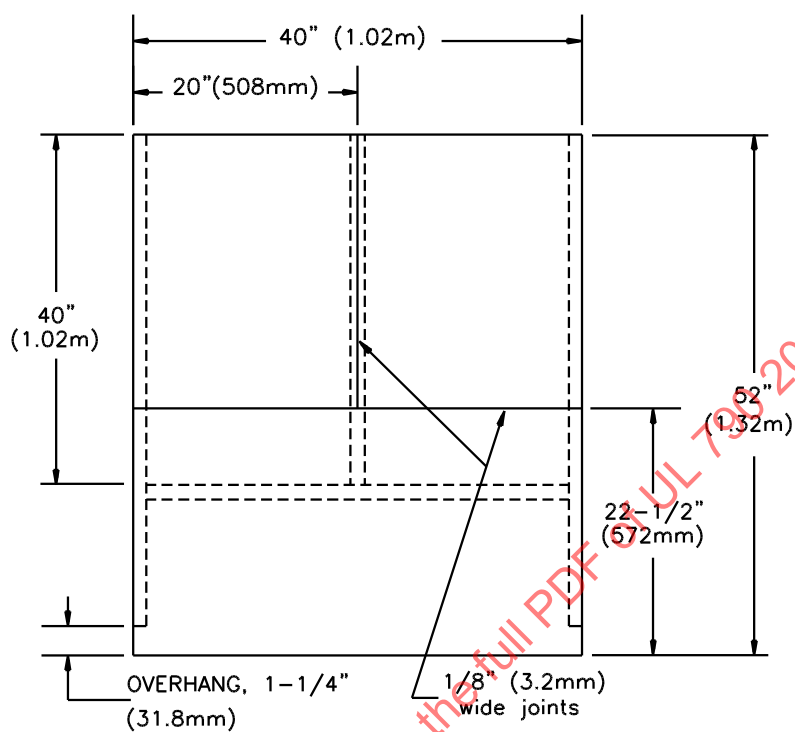


S2446A

Figure 4.6
Class B Burning-Brand Plywood Deck

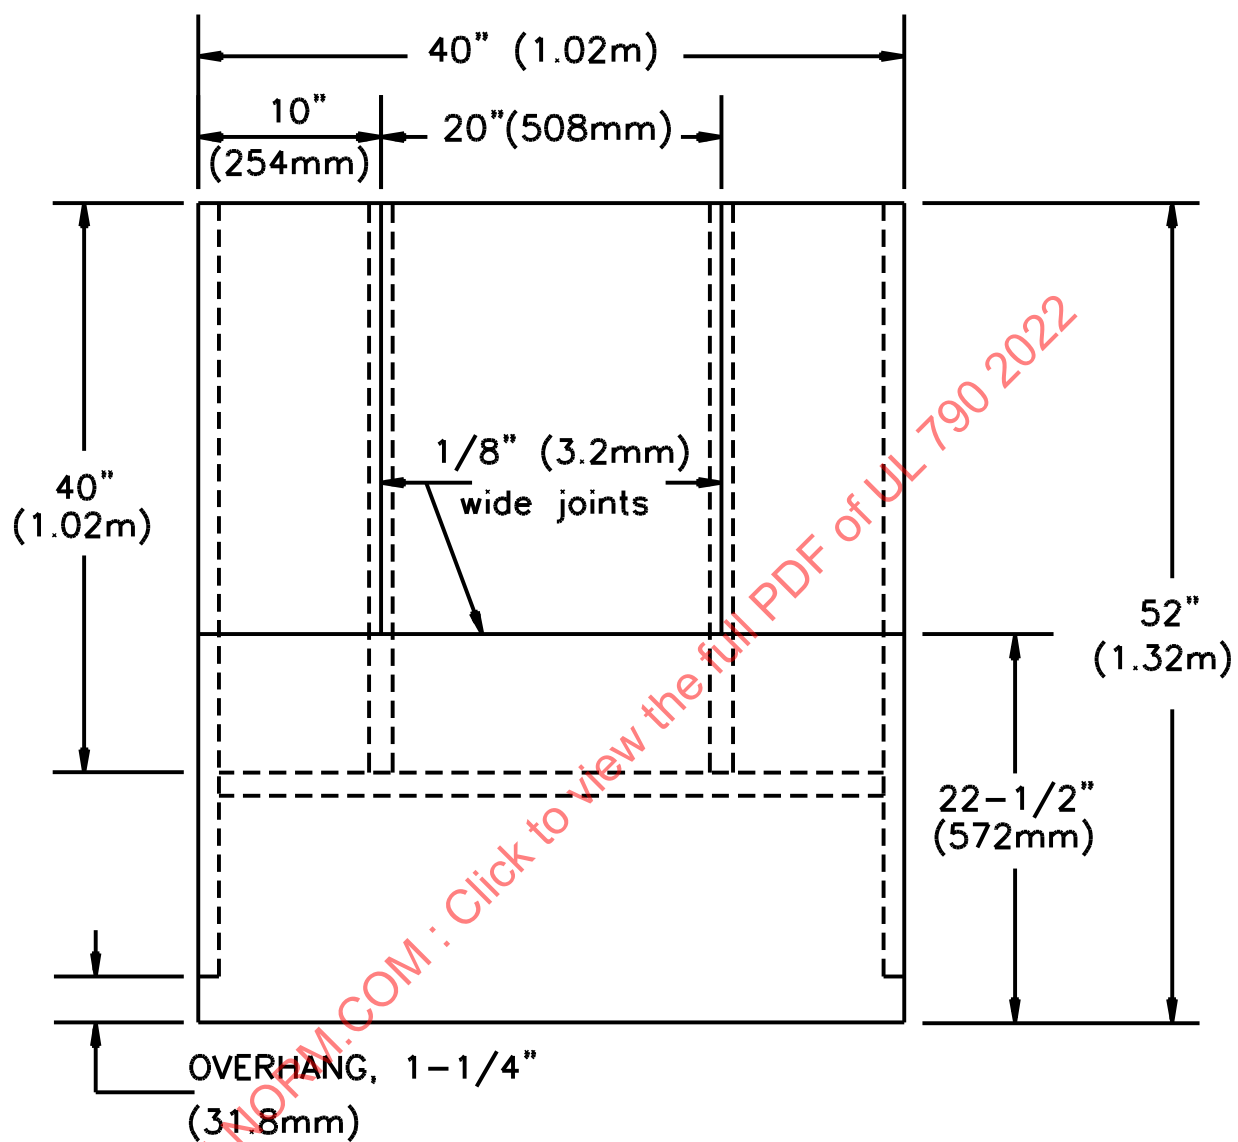

S2447A

Figure 4.7
Class C Burning-Brand Plywood Deck

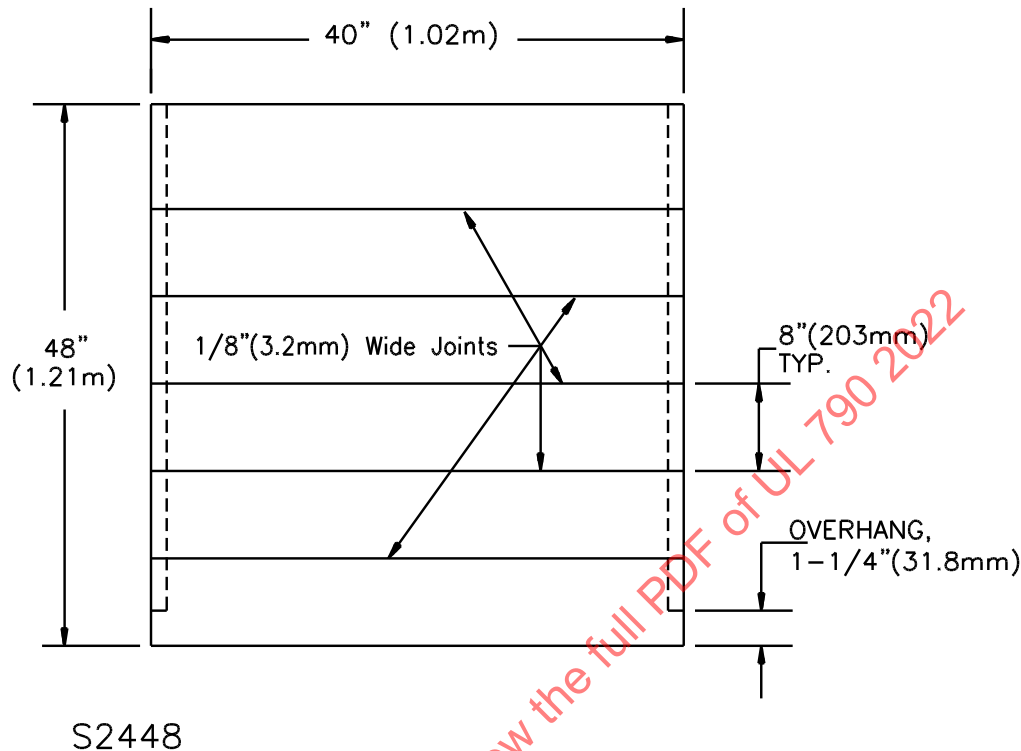

4.3 Spread-of-flame test decks

4.3.1 Unless the material to be tested is intended for use only on noncombustible roof decks, the test deck for the Spread-of-Flame Test, Section 7, for roof coverings other than wood shingles and shakes is to be constructed in accordance with either 4.2.1 or 4.2.3, except that:

- a) The vertical and horizontal joints specified in 4.2.3 need not be provided,
- b) The length of the deck is to be as specified in 4.2.3, and
- c) Standard Sheathing conforming to DOC PS1 32/16, 15/32 inch (11.9 mm) thick or OSB, if used, shall be marked as conforming to DOC PS2, minimum 7/16 inch (11 mm) thick is an acceptable deck for materials or systems where minimal or no involvement of the test deck is expected during the fire tests.

Figure 4.8 and Figure 4.9 illustrate the construction details of these decks. For tests on roof coverings intended for use only on noncombustible decks, a noncombustible deck of the applicable length specified in 4.2.3 is acceptable. The test deck for wood shingles and shakes is to be constructed in accordance with 4.2.2, but the length of the deck is to be as specified in 4.2.3. Figure 4.10 illustrates the construction details of this deck.

Figure 4.8
Spread-of-Flame Pine Board Deck

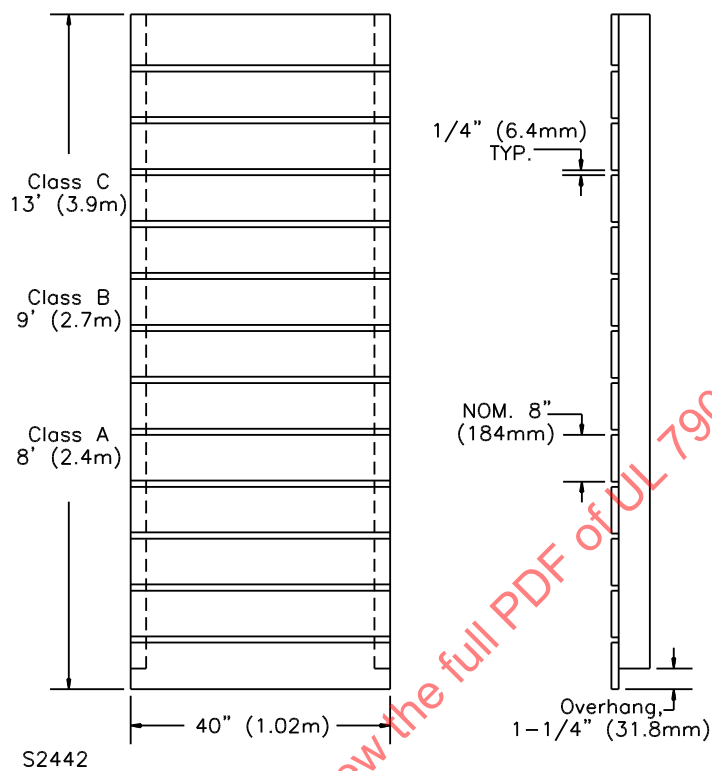


Figure 4.9
Spread-of-Flame Plywood Deck

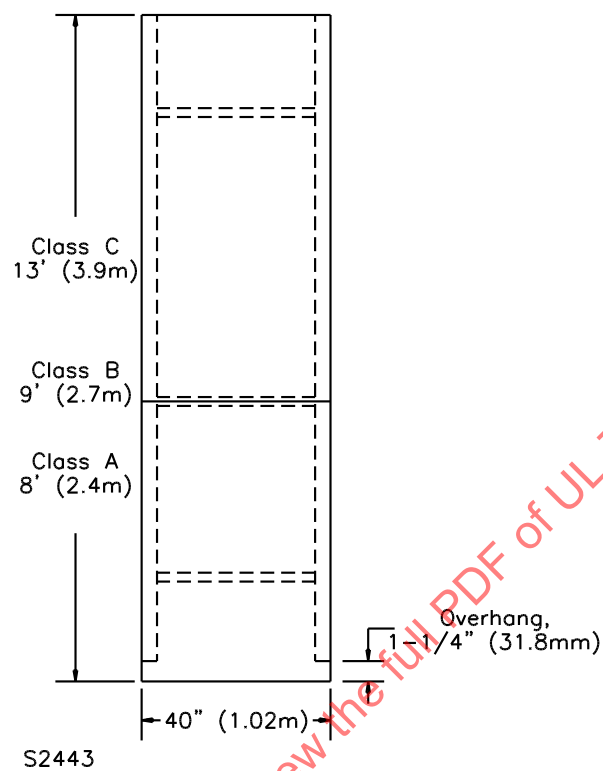
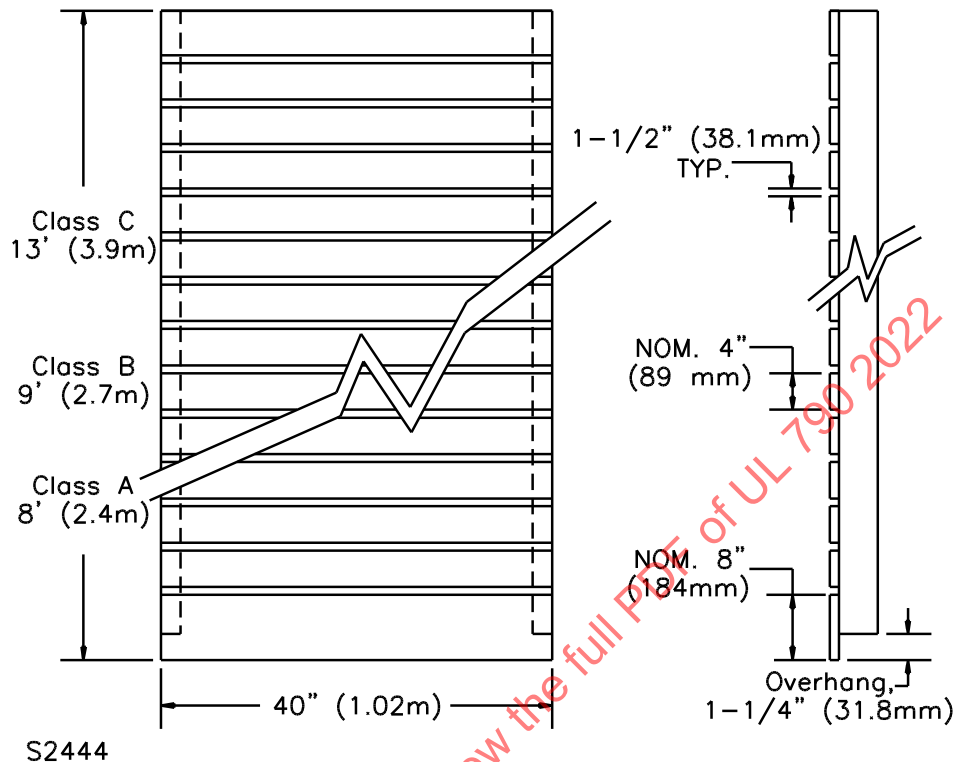


Figure 4.10

Spread-of-Flame Pine Board Deck for Use with Wood Shingles and Shakes

4.3.2 The length of the test deck is to be:

- a) 13 feet (3.9 m) for Class C tests,
- b) 9 feet (2.7 m) for Class B tests, and
- c) 8 feet (2.4 m) for Class A tests.

4.4 Application

4.4.1 The prepared roof covering material to be tested is to be applied, in accordance with the test sponsor's instructions, to the applicable number of test decks as specified in [Table 3.1](#). The material is to extend to, and be flush with, the side and back edges of the deck. At the leading edge, the roof covering material is to be positioned such that there is minimum coverage, or a minimum number of layers, over the horizontal deck joint(s). For mechanically attached and fully adhered single-ply membrane roof covering systems it is not prohibited to pull the membrane taut over all four edges of the assembly to fit snugly against the deck and secure it to the wood supports of the test deck. It is permissible to provide an air-seal along the sides of the representative sample of the roof covering material or system to restrict air flow under the system during the fire test. The use of a 1-inch (25-mm) width metal batten strip or wire fastened on top of and along each lengthwise side edge is not prohibited for mechanically attached single-ply membrane roof covering systems.

4.4.2 Spread of flame decks with insulated roof covering systems which utilize a rigid board insulation component are to be constructed with a joint in the insulation down the centerline of the test deck. When fire test experience with the respective roof covering system has demonstrated that the presence of the joint in the insulation will not affect test results it is not prohibited to conduct the tests without the joint.

4.4.3 Intermittent-flame and burning-brand decks with insulated roof covering systems which utilize a rigid board insulation component shall be constructed with joints in the insulation aligned with the joints of the plywood deck as shown in [Figure 4.4](#) and [Figure 4.5](#) – [Figure 4.7](#), respectively. Test decks constructed with pine boards in accordance with [Figure 4.1](#) or [Figure 4.2](#) shall have at least one horizontal joint in the insulation board aligned directly over a space (joint) between the pine boards at the location most vulnerable (point of minimum coverage over the space) with respect to the application of the intermittent flame or placement of the burning brand(s). When recommended by the test sponsor the respective insulated roof covering system shall be constructed with joints in the insulation staggered with respect to the joints in the plywood or pine board deck.

4.5 Conditioning

4.5.1 The completed test assemblies are to be stored indoors at temperatures not lower than 60 °F (16 °C) nor higher than 90 °F (32 °C) for the period of time necessary to cure the material. Should storage conditions vary from those specified, the decks are to be stored until moisture determinations indicate that the deck lumber has no less than 8 percent nor more than 12 percent moisture content. Test decks are to be stored so that each will be surrounded by freely circulating air.

4.5.2 For a material expected to be hygroscopic in nature, its equilibrium moisture content is to be determined by heating a small sample to constant weight in an oven at 212 °F (100 °C). If its equilibrium moisture content is not between 8 and 12 percent (the moisture content prescribed for deck lumber), the material is to be conditioned in a cell at a temperature not exceeding 140 °F (60 °C) until its moisture content is equal to that prescribed for deck lumber (8 to 12 percent).

4.5.3 If the equilibrium moisture content of the material under the conditions described in [4.5.1](#) is under the range of 8 to 12 percent, the material is acceptable for application to the test deck and subjection to the fire tests at its equilibrium moisture content.

4.5.4 It is permitted for self-sealing shingle test decks to be conditioned at a temperature of 135 to 140 °F (57 to 60 °C) for a continuous period of 16 hours, in accordance with the Standard for Wind-Resistance of Asphalt Shingles (Fan-Induced Method), ASTM D3161/D3161M.

5 Test Apparatus and Set-Up – Intermittent-Flame, Spread-of-Flame, Burning-Brand, and Flying-Brand Tests

5.1 As illustrated in [Figure 5.1](#), the apparatus used for the tests described in Sections [6](#) – [9](#) is to consist of the following:

- a) A test deck to which the roof-covering materials to be tested are applied, mounted on a framework. The incline of the framework is to be adjustable with respect to incline (slope) and with respect to vertical position (if needed for insulated roof coverings).
- b) A construction of noncombustible boards, mounted on the front of the framework to simulate eaves and cornices.
- c) A gas burner (for intermittent-flame, spread-of-flame, and flying brand tests) consisting of a 44-inch (1.12-m) length of nominal 2 inch [2.38 inch (60.3 mm) OD] pipe having a 1/2-inch (12.7 mm) wide, 36-inch (0.91-m) long slot in the side toward the test deck. The burner is to be supplied with gas at both ends through nominal 1-inch [1.32 inch (33.4 mm) OD] pipe to provide uniform gas pressure at the burner assembly.
- d) A blower and air duct for providing the required wind conditions. The air introduced by the blower is to be taken from outside the test room.
- e) Adjustable fins mounted inside the air duct to straighten the air stream and reduce turbulence.

f) A baffle mounted on the back edge of the test deck to prevent backfiring under the deck.

g) Noncombustible boards extending from the sides and bottom of the air duct to the simulated-eaves-and-cornice construction mentioned in (b) (not used during burning brand test).

5.2 The tests are to be conducted in a room vented to relieve the air pressure created by the blower. During these tests, all doors and windows in the room are to be closed, and the room otherwise controlled as necessary to prevent outside wind and weather conditions from affecting the test results. Calibration of the air current described is to be conducted with all vent and exhaust fan settings adjusted to that used during the conduct of the tests. Tests are not to be conducted if the room temperature is less than 50 °F (10 °C) or more than 90 °F (32 °C).


5.3 For these tests, mortar (cementitious mixture, lime, and water) is to be troweled into the joint formed by the leading edge of the roof covering material and the framework of the carriage, to prevent air or the test flame from traveling under the material being tested.

5.4 During the tests, the test decks are to be subjected to an air current that flows uniformly over the top surface of the roof covering material, as determined by a pretest calibration of the equipment using a bare 3-1/3 by 4-1/3 foot (1 by 1.3 m) plywood, gypsum- or cement-board deck. At points midway up the incline of the bare deck, with the deck positioned at an incline of 5 inches (127 mm) to the horizontal foot (0.3 m), the velocity of the air current is to be $12 \pm 1/2$ miles per hour (19 ± 0.8 km/h), as measured^a at the center and at each of two locations measured 3 inches (76 mm) from each edge of the deck, with each measurement being 3-11/16 inches (94 mm) above the surface of the deck. Adjusting the time averaged air current velocity at each location by up to 5 percent from the initial measurements is not prohibited in order to comply with the flame pattern description (see 5.5) so long as the average velocity of all three locations is 12 ± 0.5 mph (5.3 ± 0.2 m/s).

^a Any direct reading instrument with scale graduated in increments of not more than 20 feet per minute (6 m/min) or any timed instrument with scale graduated (for a 1-minute timed reading) in increments of not more than 5 feet per minute (1.5 m/min) is acceptable.

5.5 Calibration of the flame is to be conducted using a bare 3-1/3 by 4-1/3 foot (1 by 1.3 m) cement board deck positioned at an incline of 5 inches (127 mm) to the horizontal foot (0.3 m). The test deck is to be subjected to a luminous gas flame approximately triangular in shape, approximately 3 feet (0.9 m) wide at the leading edge of the deck, and gradually narrowing to a width of approximately 6 inches (152 mm) at the top of the deck. Licks of flame that extend approximately an additional 1 to 2 feet (0.3 to 0.6 m) are not prohibited. The gas supply is to be regulated so that the flame develops a temperature of 1400 ± 50 °F (760 ± 28 °C) for a Class A or B test, and 1300 ± 50 °F (704 ± 28 °C) for a Class C test. The temperature is to be determined by a No. 14 B & S gage (2.1 mm^2) chromel-alumel wire thermocouple located 1 inch (25.4 mm) above the surface and 1/2 inch (12.7 mm) toward the source of flame from the lower edge the deck. Allow the response of the thermocouple to the test flame to stabilize before the 2 minute average flame temperature is measured. Base the 2 minute average on temperatures recorded at 10 second intervals.

Figure 5.1
Apparatus for Fire Tests

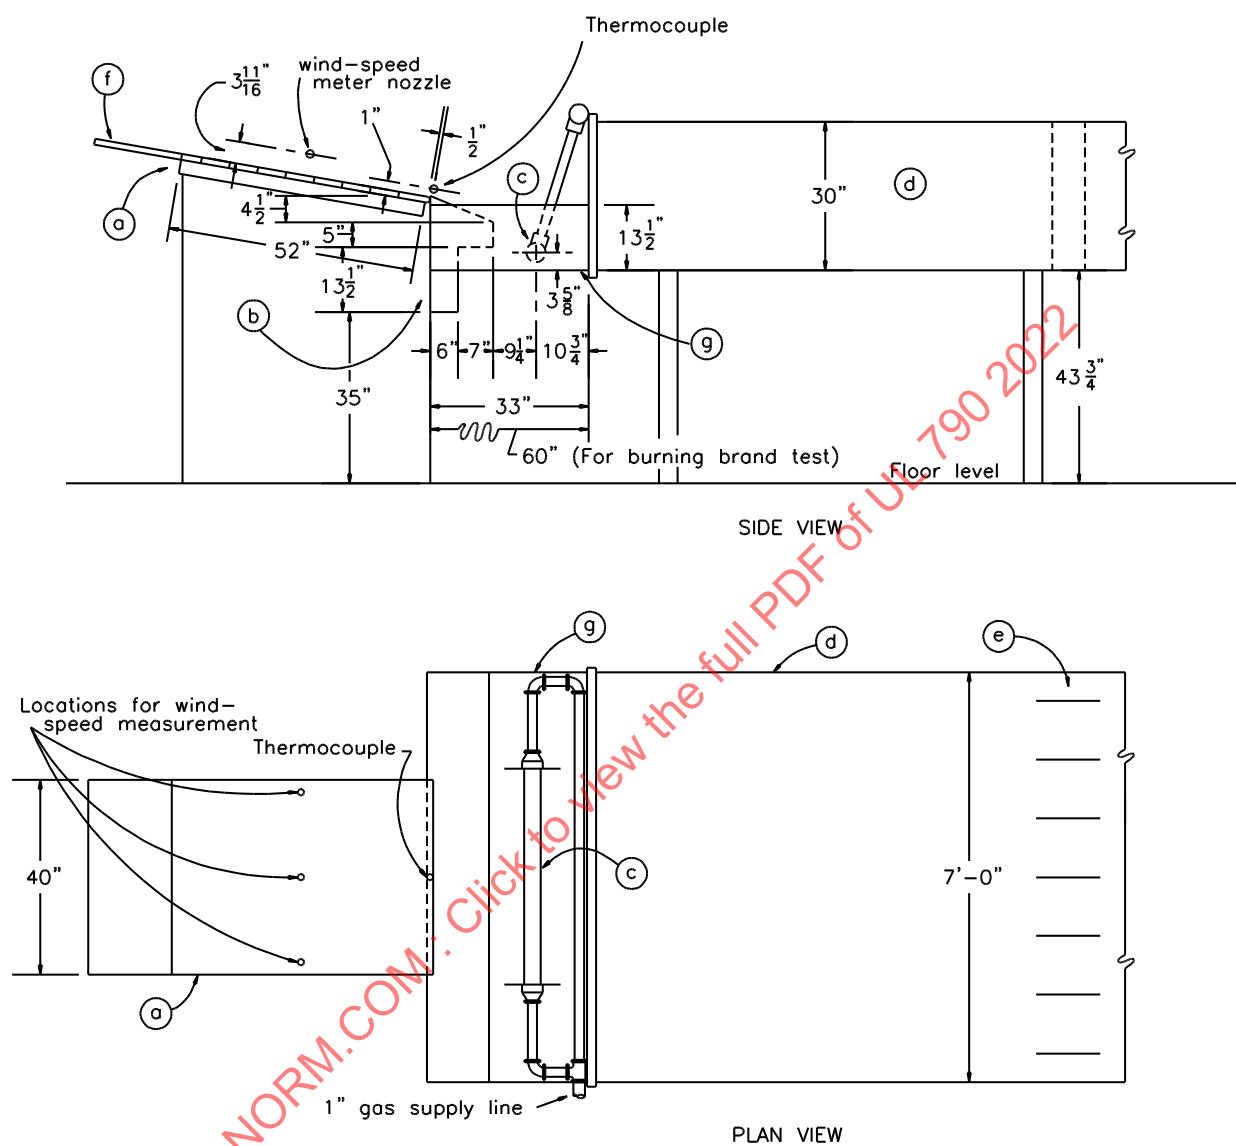

Notes:

1. Letters indicate corresponding items in [5.1](#).

2. Conversion Factors

$$1/16" = 1.6 \text{ mm}$$

$$1" = 25.4 \text{ mm}$$

$$1' = 0.3 \text{ m}$$

5.6 For these tests, the test decks are to be at an incline of 5 inches per horizontal foot (127 mm per 0.3 m); except that roof covering systems intended for low slope (incline) applications are to be tested at the maximum incline recommended by the test sponsor, but not more than 5 inches per horizontal foot.

6 Intermittent-Flame Test

6.1 The required number of assemblies as described in [Table 3.1](#) are to be tested and passed in sequence. The test deck is to be mounted on the framework at the required incline and the calibrated air supply shall be started prior to the brand application and maintained throughout the test to produce the specified air current. The flame is to be intermittently applied, at intervals as specified in [Table 6.1](#).

Table 6.1
Flame Application

Class	Flame on, minutes	Flame off, minutes	Number of test cycles
A	2	2	15
B	2	2	8
C	1	2	3

6.2 Following the last application of flame, air current is to be maintained until all evidence of flame, glow, and smoke has disappeared from the exposed surface of the material being tested or until unacceptable results occur, but in no case is the air current to be maintained for more than 1 hour for a Class A or B test or 1/2 hour for a Class C test.

6.3 During the test, including the on and off periods of flame application and the subsequent period of maintained air flow, the test deck is to be observed for the appearance of sustained flaming on the underside, production of flaming or glowing brands, displacement of portions of the test sample, and exposure or falling away of portions of the roof deck.

7 Spread-of-Flame Test

7.1 The required number of assemblies as described in [Table 3.1](#) are to be tested and passed in sequence. A test deck is to be mounted on the framework. The luminous gas flame described in [5.5](#) for the respective Class is to be applied to the test deck.

7.2 For a Class A or B test, the gas flame is to be applied continuously for 10 minutes or until the spread of flame (flaming of the material being tested) permanently recedes, as determined by prior test experience, from a point of maximum spread, whichever is the shorter duration. For a Class C test, the gas flame is to be applied for 4 minutes and then removed.

7.3 During the application of the test flame, the test sample is to be observed for the distance to which flaming of the material has spread, production of flaming or glowing brands, and displacement of portions of the test sample. The observation is to continue until the flame has permanently receded from a point of maximum spread.


8 Burning-Brand Test

8.1 General

8.1.1 The required number of assemblies as described in [Table 3.1](#) are to be tested and passed in sequence. A test deck is to be mounted as described in [6.1](#), except that the framework is to be 60 inches (1.5 m) from the air duct outlet (see [Figure 5.1](#)), and the gas piping and burner are to be removed so as not to obstruct the air flow.

8.2 Size and construction of brands

8.2.1 The brands to be used in these tests are to be as shown in [Figure 8.1](#) and are to be constructed as specified in [8.2.2](#) – [8.2.4](#). Prior to the test, the brands are to be conditioned in an oven at 105 to 120 °F (40 to 49 °C) for at least 24 hours.

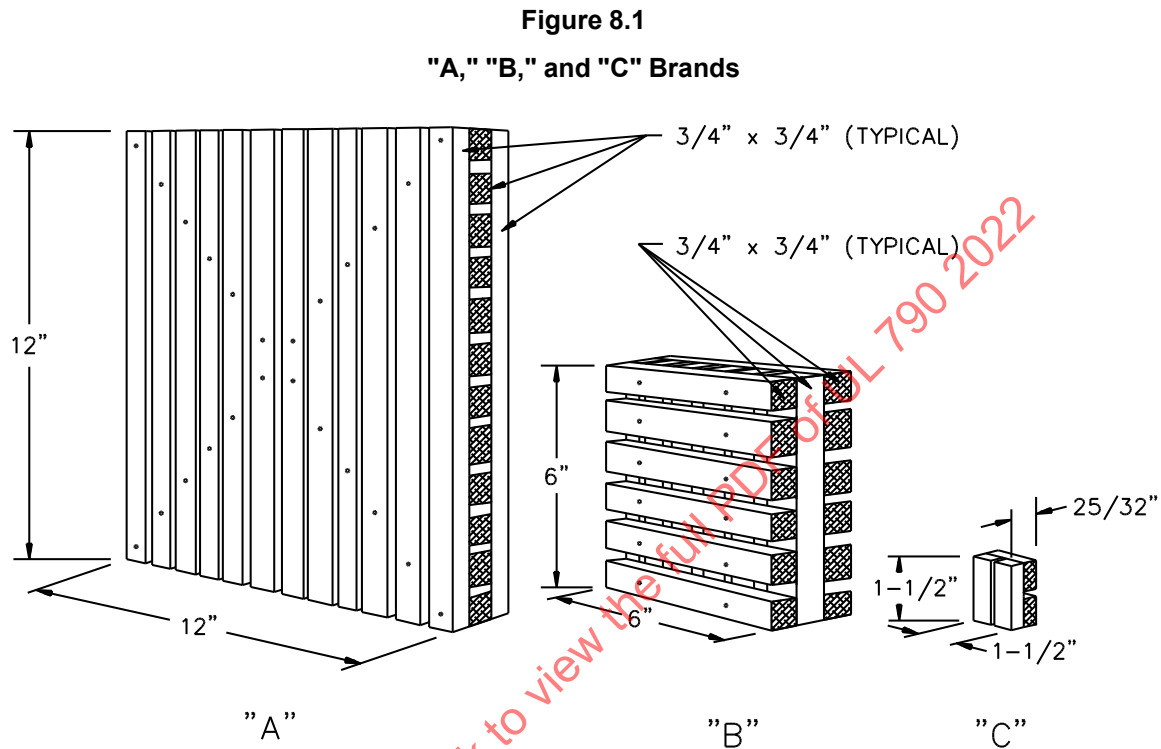

S2496A

8.2.2 The Class A brand is to consist of a grid, 12 inches (300 mm) square and approximately 2-1/4 inches (57 mm) thick, made of kiln-dried Douglas fir lumber that is free from knots and pitch pockets. The brand is to be made of 36 strips of lumber each 3/4 by 3/4 inch (19.1 by 19.1 mm) square by 12 inches (300 mm) long, placed in three layers of 12 strips each, with strips placed 1/4 inch (6.4 mm) apart. These strips are to be placed at right angles to those in adjoining layers and are to be nailed, using 1-1/2 inch (38.1 mm) long, No. 16 gage nails, or stapled, using No. 16 gage steel wire staples having a 7/32 inch (5.6 mm) crown and 1-1/4 inch (31.8 mm) legs, at each end of each strip on one face, and in a diagonal pattern, as shown in [Figure 8.1](#), on the other face. The dry weight of the finished brand is to be 2000 ±150 grams at the time of the test.

8.2.3 The Class B brand is to consist of a grid, 6 inches (150 mm) square and approximately 2-1/4 inches (57 mm) thick, made of kiln-dried Douglas fir lumber that is free from knots and pitch pockets. The brand is to be made of 18 strips of lumber 3/4 by 3/4 inch (19.1 by 19.1 mm) square and 6 inches (150 mm) long, placed in three layers of six strips each, with strips spaced 1/4 inch (6.4 mm) apart. The strips are to be placed at right angles to those in adjoining layers and are to be nailed, using 1-1/2 inch (38.1 mm) long, No. 16 gage nails, or stapled, using No. 16 gage steel wire staples having a 7/32 inch (5.6 mm) crown and 1-1/4 inch (31.8 mm) legs, at each end of each strip on one face, as shown in [Figure 8.1](#), and in a diagonal pattern on the other face. The dry weight of the finished brand is to be 500 ±50 grams at the time of the test.

8.2.4 The Class C brand is to consist of a piece of kiln-dried nonresinous white pine lumber that is free from knots and pitch pockets. The brand is to measure 1-1/2 by 1-1/2 by 25/32 inches (38.1 by 38.1 by 19.8 mm), and a saw kerf 1/8 inch (3.2 mm) wide is to be cut across the center of both the top and bottom faces to a depth of one-half the thickness of the brand, and at right angles to each other. The dry weight of the finished brand is to be 9-1/4 \pm 1-1/4 grams at the time of the test.

8.3 Ignition of brands

8.3.1 Before application to the test deck, the brands are to be ignited so as to burn freely in still air, as described in [8.3.2](#), [8.3.3](#), or [8.3.4](#), as applicable. The flame of the gas burner used to ignite the brands is to essentially envelop the brands during the process of ignition. The temperature of the igniting flame is to be 888 \pm 28 °C (1630 \pm 50 °F), measured 2-5/16 inches (58.7 mm) above the top of the burner. The burner is to be shielded from drafts. The brands shall be applied to the deck within 10 s of the completion of the ignition sequence.

8.3.2 Class A brands are to be exposed to the flame for 5 minutes, during which time they are to be rotated to present each surface to the flame as follows:

- a) Each 12 by 12 inch (305 by 305 mm) face for 30 seconds,
- b) Each 2-1/4 by 12 inch (57.2 by 305 mm) face for 45 seconds,
- c) Each 12 by 12 inch face again for 30 seconds.

8.3.3 Class B brands are to be exposed to the flame for 4 minutes, during which time they are to be rotated to present each surface to the flame as follows:

- a) Each 6 by 6 inch (152 by 152 mm) face for 30 seconds,
- b) Each 2-1/4 by 6 inch (57.2 by 152 mm) face for 30 seconds,
- c) Each 6 by 6 inch face again for 30 seconds.

8.3.4 Class C brands are to be exposed to the flame for 2 minutes, during which time they are to be rotated so as to present each of the 1-1/2 by 1-1/2 inch (38.1 by 38.1 mm) faces to the flame for 1 minute.

8.4 Test conditions

8.4.1 Class A test

8.4.1.1 If the roof covering is applied to a pine board deck, the brand is to be placed such that the upper edge of the brand is located 3 inches (76 mm) above a horizontal joint in the test deck. If the roof covering is applied to plywood or other deck types, the brand is to be placed so that it is centered laterally with respect to the vertical joint in the test deck, and the upper edge of the brand is located 3 inches (76 mm) above the horizontal joint. The brand is to be placed so that the strips in both the upper and lower layers are parallel to the direction of air flow. The brand is to be secured to the deck by a No. 18 B & S gage (0.82 mm²) soft-iron wire.

8.4.2 Class B test

8.4.2.1 A brand is to be placed on the surface of the test deck at each of the two most vulnerable (point of minimum coverage over deck joint) locations with respect to ignition of the deck (see [8.4.2.2](#)). Each brand is to be positioned with its upper edge 1-1/2 inches (38.1 mm) above the selected joint in the deck boards, but in no case closer than 6 inches (152 mm) from each side or 12 inches (305 mm) from the top or bottom edge of the deck. The brands are to be placed so that the strips in both the upper and lower

layers are parallel to the direction of air flow. They are to be secured to the deck by a No. 18 B & S gage (0.82 mm²) soft-iron wire. The second brand is not to be applied until all burning resulting from the first brand has ceased and the effects from the burning of the first brand will not interfere with the potential fire performance of the test deck when exposed to the second brand.

Exception: As an alternate, Class B burning brand tests are permitted to be conducted on Class A burning brand decks as described in [8.4.1](#). A total of four separate brand tests using four separate test decks will be required as indicated in [Table 3.1](#).

8.4.2.2 If the roof covering is applied to a pine board deck, the brands will be in the most vulnerable location when the upper edge of each brand located 3 inches (76.2 mm) above a horizontal joint in the test deck. If the roof cover is applied to a plywood deck, the brands will be in the most vulnerable location when they are placed so that they are centered laterally with respect to a vertical joint in the test deck, and the upper edge of each brand is located 1-1/2 inches (38.1 mm) above the horizontal joint.

8.4.3 Class C test – asphalt shingles

8.4.3.1 Loose or unfastened portions of the shingles that can be bent up to 90 degrees without injury to the fastenings are to be cut away. Twenty ignited brands are then to be placed, at 1 or 2 minute intervals, in the areas of minimum coverage, 1/2 inch (12.7 mm) away from any cut edge of shingles in the course above that course on which the brand is placed. No brand is to be placed closer than 4 inches (102 mm) to the point where the previous brand was located.

8.4.3.2 Brands are to be located not closer than 2 inches (50.8 mm) to the joints between adjacent shingles on the same course. All brands are to be placed so that the center of each brand is directly over the space between the deck boards. Brands are to be held in position throughout the test by a No. 18 B & S gage (0.82 mm²) soft-iron wire stretched across the width of the deck. The saw kerf on the deck side of the brand is to be parallel to the direction of the air flow. The wire is to be placed in the other saw kerf.

8.4.3.3 If the roof covering is applied to plywood decks, the brands are to be placed centrally over the joints in the plywood deck.

8.4.4 Class C test – sheet roofing, built-up, single-ply, spray-applied foam and other roof covering systems

8.4.4.1 Twenty ignited brands are to be placed, at 1 or 2 minute intervals, in the areas of minimum coverage. No brand is to be placed closer than 4 inches (102 mm) to the point where a previous brand was located. All brands are to be placed so that the center of each brand is directly over the space between the deck boards. See [8.4.3.2](#) for securing of brands in place and relative positioning of brand saw kerfs.

8.4.5 Class C test – treated wood shingles and shakes

8.4.5.1 Twenty ignited brands are to be placed on each treated wood shingles deck at 1 or 2 minute intervals. For treated wood shakes, 20 ignited brands are to be distributed at 1 or 2 minute intervals on each pair of decks. Each brand is to be centered over the 1/4 inch (6.4 mm) joint between shakes or shingles so that the top edge of the brand is approximately 1/2 inch (12.7 mm) below the butt of the shake or shingle in the course above. No brand is to be placed closer than 4 inches (102 mm) to the point where a previous brand was located. See [8.4.3.2](#) for securing of brands in place and relative positioning of brand saw kerfs.

8.5 Duration of test

8.5.1 Each individual test, whether Class A, B, or C, is to be continued until the brand is consumed and until all evidence of flame, glow, and smoke has disappeared from both the exposed surface of the